


ELEVATION

- NOTES
1. SEE SDD-114 FOR ADDITIONAL NOTES AND DETAILS.
 2. WHEN V EXCEEDS 4', STEPS SHALL BE INSTALLED.
 3. MAINTAIN 1 1/2" CLEAR SPACING BETWEEN REINFORCING AND SURFACE.
 4. INCREASE IN ALLOWABLE DEPTH SUBJECT TO APPROVAL BY ENGINEER.
 5. SECTION A-A SHOWS 3 SIZES AND SHALL NOT IMPLY THAT AN INTERIOR WALL IS TO BE BUILT FOR THE STRUCTURES WITH DOUBLE OR TRIPLE FRAME AND GRATE.
 6. EXPOSED EDGES OF CONCRETE SHALL BE ROUNDED WITH RADIUS OF 1/2".
 7. DESIGNATE TYPES AS FOLLOWS: SINGLE G-1, DOUBLE G-2 AND TRIPLE G-3.
 8. ONLY END BEARING GRATES SHALL BE USED.
 9. INSTALL INLET MARKER.

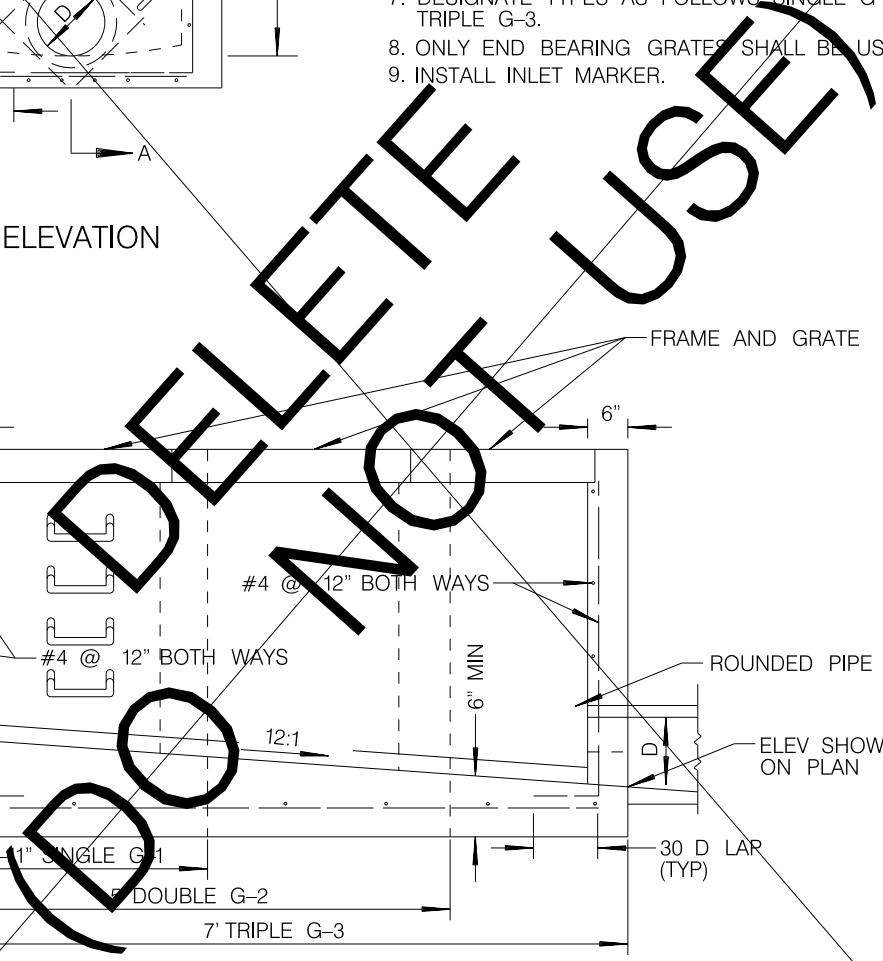

SECTION A-A

LEGEND ON PLANS



REVISION	BY	APPROVED	DATE
ORIGINAL*	KA	J. NAGELVOORT	01/12
UPDATED	AD	J. NAGELVOORT	07/15

CITY OF SAN DIEGO - STANDARD DRAWING

RECOMMENDED BY THE CITY OF SAN DIEGO STANDARDS COMMITTEE
CA Arunga 7/21/15
 COORDINATOR R.C.E. 56523 DATE

CATCH BASIN - TYPE G

DRAWING NUMBER **SDD-120**