


NOTES

1. STRUCTURAL STEEL TUBING USED FOR POST & SLEEVES SHALL BE GALVANIZED 12 GAUGE COLD ROLLED STEEL, OF THE NOMINAL DIMENSIONS SHOWN HEREON AND MEET THE REQUIREMENTS OF ASTM A653.
2. GALVANIZING SHALL BE PER ASTM A653. POSTS & SLEEVES SHALL HAVE 7/16" DIA. HOLES SPACED 1" O.C. 18" & +/- 18" & SHALL HAVE NO MORE VARIATION IN STRAIGHTNESS THAN 1/16" IN 3'. POSTS SHALL BE SQUARE WITHIN +/- 0.014", HAVE TWIST NO GREATER THAN 0.62" IN 3' AND HAVE CORNER RADI OF 5/32" +/- 1/64".
3. THE SIGNS SHALL BE MOUNTED ON POSTS IN ACCORDANCE WITH SECTION 56, "SIGNS" OF THE STATE STANDARD SPECIFICATIONS. ALL FASTENING HARDWARE IS TO BE PROVIDED BY THE CONTRACTOR.
4. MAXIMUM SIGN SIZE 5.2 SQ. FT.
5. TO AVOID CONCRETE INTRUSION IN THE POST HOLES, ALL METAL IN CONTACT WITH CONCRETE SHALL BE WRAPPED IN 10 MIL POLYETHYLENE WRAPPING TAPE WITH EACH WRAP OF TAPE TO OVERLAP THE PREVIOUS WRAP BY 1/3 THE WITH OF THE TAPE (INCLUDING THE BOTTOM).

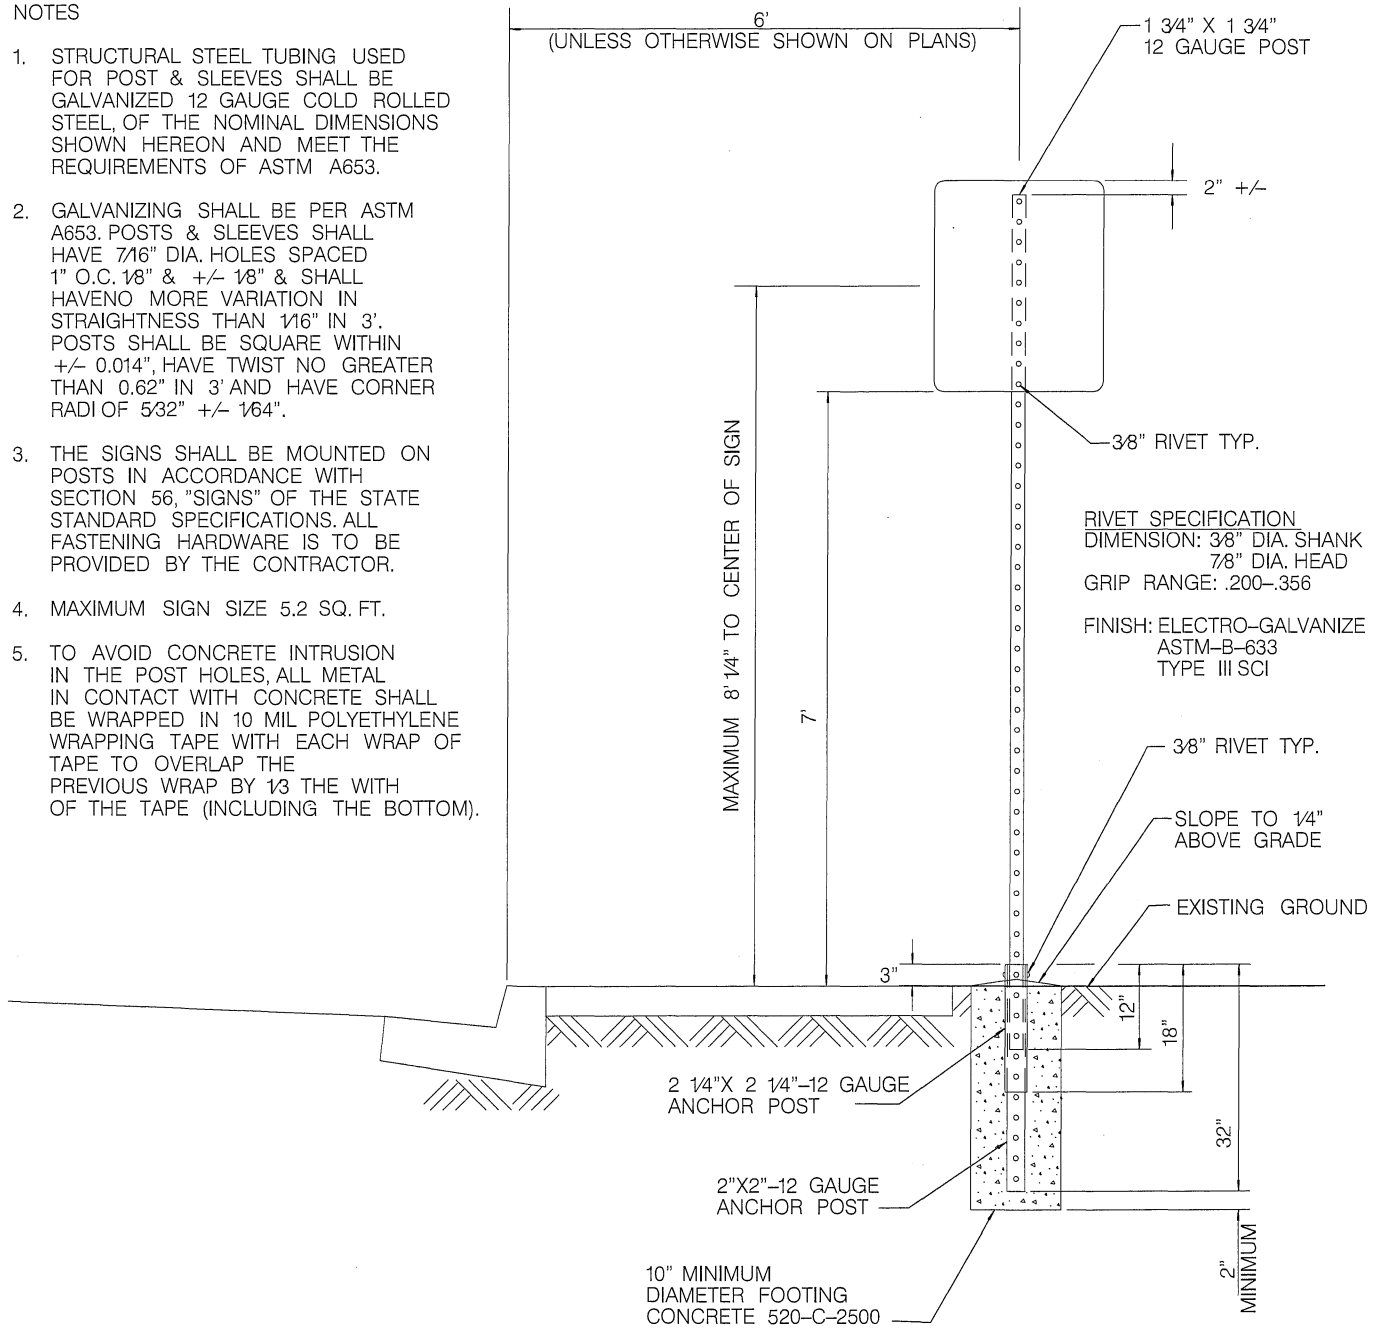

REVISION	BY	APPROVED	DATE
ORIGINAL	BB	J. NAGELVOORT	05/15
UPDATED	MM	J. NAGELVOORT	08/15

CITY OF SAN DIEGO - STANDARD DRAWING

**BREAK-AWAY SIGN POST**

RECOMMENDED BY THE CITY OF SAN DIEGO  
STANDARDS COMMITTEE

*CR Dungea* 8/18/15

COORDINATOR R.C.E. 56523 DATE

DRAWING NUMBER **SDM-104**