




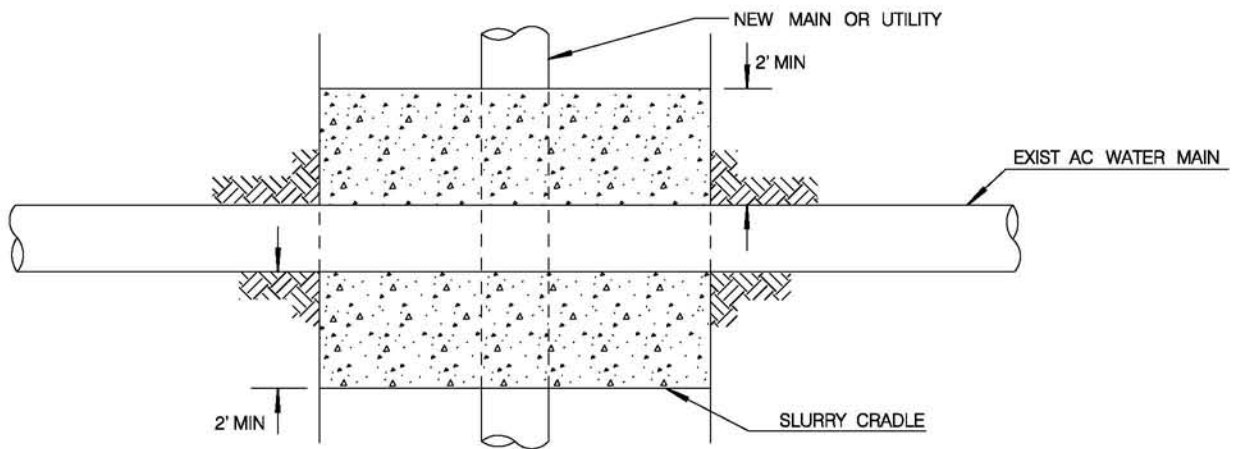

PLAN

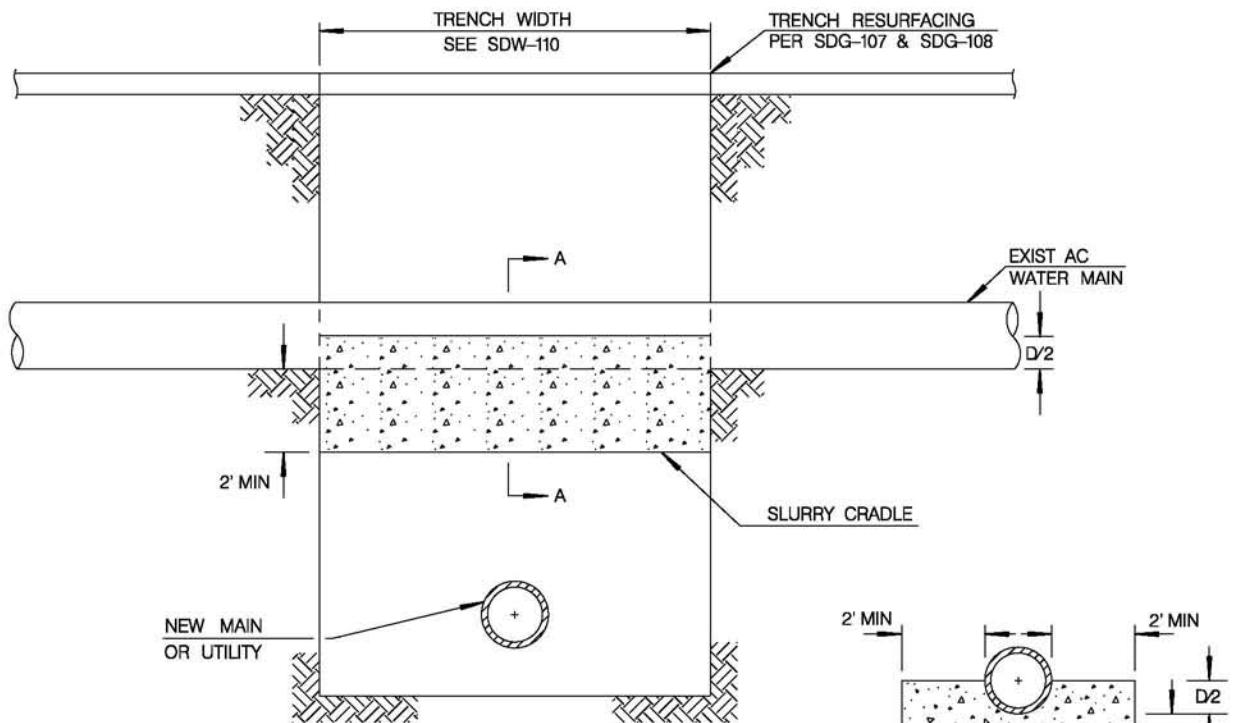

ELEVATION

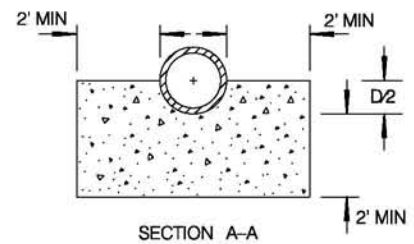

SECTION A-A

NOTES:

- 1) SLURRY SHALL BE CONTROLLED LOW STRENGTH MATERIAL CLSM (100-E-100)
- 2) SLURRY SHALL BE PLACED ON FIRMLY COMPACTED BACKFILL

REVISION	BY	APPROVED	DATE	CITY OF SAN DIEGO – STANDARD DRAWING	RECOMMENDED BY THE CITY OF SAN DIEGO STANDARDS COMMITTEE
ORIGINAL	KA	J. NAGELVOORT	01/12		
				PIPE SUPPORT FOR UNDERCUT AC WATER MAIN	<i>H. Hadli</i> 1/31/2012
					COORDINATOR R.C.E. 65271 DATE
					DRAWING
					NUMBER SDW-162