

February 24, 2023

Mr. David W. Gibson, Executive Officer
California Regional Water Quality Control Board
2375 Northside Drive, Suite 100
San Diego, CA 92108

Subject: 2022 Pretreatment Annual Report for the Point Loma Publicly Owned Treatment Works (POTW) Order No. R9-2017-0007 and subsequent amendments
2022 Pretreatment Annual Report for the South Bay Water Reclamation Plant Order No. R9-2021-0011

Dear Mr. Gibson:

The City of San Diego (City) Wastewater Pretreatment Program Annual Report is hereby submitted in accordance with the requirements of NPDES Permits Nos. CA0107409 and CA0109045. Because flows from industries tributary to the South Bay Water Reclamation Plant (SBWRP) can be diverted to the Point Loma POTW, this report also includes data for industries tributary to the SBWRP and South Bay Ocean Outfall.

The City is committed to protecting public health and the environment through a program of environmental management, which includes source control, wastewater treatment, an improved ocean outfall, and extensive monitoring. One key element of the program is an aggressive pretreatment and pollution prevention program to minimize toxic discharges to the sewerage system. This report includes a summary of pretreatment program activities and accomplishments throughout jurisdictions tributary to the Metropolitan Sewerage System, which includes the Point Loma Wastewater Treatment Plant (PLWTP), the North City Water Reclamation Plant (NCWRP), and the SBWRP.

Should you have any questions concerning the information provided herein, or wish to discuss the report in detail, please contact John Steger, Pretreatment Program Manager, at (858) 654-4103.

Sincerely,



Peter S. Vroom, Ph.D.
Deputy Director, Public Utilities Department

JAS/jn

cc: Lisa Celaya, Executive Assistant Director of Public Utilities, City of San Diego
Joy Newman, Industrial Wastewater Control Program Manager, City of San Diego

POTW PRETREATMENT ANNUAL REPORT

COVER SHEET

NPDES Permit Holder or Sewer Authority Name: City of San Diego

Report Due Date: March 1, 2023

Period Covered by This Report: January 1, 2022 to December 31, 2022

Period Covered by Previous Report: January 1, 2021 to December 31, 2021

Name of Wastewater Treatment Plant: Point Loma Wastewater Treatment Plant

NPDES Permit Number: CA 01107409

Name of Wastewater Treatment Plant: South Bay Water Reclamation Plant

NPDES Permit Number: CA 0109045

Person to contact concerning information contained in this report:

Name: John Steger

Title: Pretreatment Program Manager


Mailing Address: 9192 Topaz Way, MS 901D
San Diego, CA 92123-1119

Telephone No.: (858) 654-4103

I certify under penalty of law that this document and all attachments were prepared under my direction or supervision in accordance with a system designed to assure that qualified personnel properly gather and evaluate the information submitted. Based on my inquiry of the person or persons who manage the system or those persons directly responsible for gathering the information, the information submitted is, to the best of my knowledge and belief, true, accurate, and complete. I am aware that there are significant penalties for submitting false information, including the possibility of fine and imprisonment for knowing violations.

2-24-2023

Date



Peter Vroom, Ph.D.
Deputy Director Public Utilities

POTW PRETREATMENT ANNUAL REPORT

PCS Data Entry Form

PPS1

POTW NAMES: City of San Diego EW Blom Point Loma Metropolitan Wastewater Treatment Plant (PLWTP)

City of San Diego South Bay Water Reclamation Plant and Ocean Outfall (SBWRP)

NPDES Permit #: CA0107409 and CA0109045

**Period Covered
by this Report:** 01/01/2022 (PSSD)
Start Date

12/31/2022 (PSED)
End Date

		PLWTP	SBWRP	TOTAL
Number of Significant Industrial Users (SIU) in Significant Non-Compliance (SNC) with a Pretreatment Compliance Schedule:	(SSNC)	<u>0</u>	<u>0</u>	<u>0</u>
Number of Notices of Violation (NOV) and Administrative Orders Issued Against SIUs:	(FENF)	<u>112</u>	<u>27</u>	<u>139</u>
Number of Civil & Criminal Judicial Actions against SIUs:	(JUDI)	<u>0</u>	<u>0</u>	<u>0</u>
Number of SIUs with Significant Violations Published:	(SVPU)	<u>8</u>	<u>2</u>	<u>10</u>
Number of SIUs from Which Penalties Have Been Collected:	(IUPN)	<u>0</u>	<u>0</u>	<u>0</u>



PRETREATMENT ANNUAL REPORT

**E.W. BLOM POINT LOMA
METROPOLITAN WASTEWATER TREATMENT PLANT
NPDES PERMIT No. CA 0107409**

**SOUTH BAY WATER RECLAMATION PLANT
& OCEAN OUTFALL
NPDES PERMIT No. CA 0109045**

JANUARY 1 – DECEMBER 31, 2022

Environmental Monitoring and Technical Services
Public Utilities Department
2392 Kincaid Road Mail Station 45A
San Diego, CA 92101
Tel (619) 758-2310 • Fax (619) 758-2309



TABLE OF CONTENTS

Chapter 1: Executive Summary	Page
1.1 Introduction	1-1
1.2 Effectiveness	1-1
1.3 Summary	1-3
 Chapter 2: Program Structure	
2.1 Jurisdiction	2-1
2.2 Organization	2-1
2.3 Personnel and Budget	2-4
2.4 Changes and Developments	2-6
2.5 Household Hazardous Waste Program	2-7
2.6 Stormwater Division	2-8
2.7 Stormwater Diversion	2-8
2.8 Pretreatment History	2-9
 Chapter 3: Discharge Permits	
3.1 Introduction	3-1
3.2 Permit Authority	3-1
3.3 Permit Classifications	3-1
3.4 Significant Industrial Users	3-3
3.5 Identification of Industrial Users	3-4
3.6 SIU Permit Requirements	3-4
3.7 Active Permits	3-5
3.8 SIU Permits	3-6
3.9 Changes in Point Loma SIU Inventory	3-6

TABLE OF CONTENTS (Continued)

	Page
3.10 Baseline Monitoring Reports Requested or Received	3-7
3.11 Distribution of Permits and Industrial Flows	3-7
3.12 Inspection and Monitoring Requirements	3-8
3.13 Industrial Waste Sampling and Analytical Services	3-8
3.14 Summary of Routine Sampling and Inspection Statistics	3-8
3.15 Trucked Waste Permits	3-9
 Chapter 4: Enforcement	
4.1 Introduction	4-1
4.2 Annual SIU Compliance Statistics	4-1
4.3 Annual SIU Compliance Status Report	4-2
4.4 Publication of Industries in SNC	4-2
4.5 Non-Compliance Fees/Penalties	4-4
4.6 Enforcement Actions by Type	4-4
4.7 Enforcement Summaries	4-5
4.8 Pollution Prevention Plans	4-9
 Chapter 5: Industrial Pollutant Discharges	
5.1 Introduction	5-1
5.2 Influent and Effluent Metals Trends	5-1
5.3 Point Loma and South Bay Plants Monitoring	5-1
5.4 Point Loma Influent and Effluent Analytical Results	5-8
5.5 South Bay Influent and Effluent Analytical Results	5-30
5.6 Biosolids Beneficial Use and Landfill Disposal Summary	5-58

LIST OF TABLES

Number	Title	Page
2.1-1	Discharge Area / Agency by Area Number	2-1
2.3-1	IWCP Budget	2-4
2.3-2	Regulatory Training Received by Staff	2-4
2.5-1	HHW Services by Member Agencies	2-7
3.6-1	Local Contributory Flow Discharge Limits	3-4
3.7-1	Active Permits Metrowide at Year End	3-5
3.8-1	Significant Industrial Users Permitted Metrowide	3-6
3.9-1	Changes in SIU Inventory	3-6
3.11-1	Distribution of Permits and Industrial Waste Flow by Area	3-7
3.14-1	Summary of Routine Sampling, Certification, and Inspections	3-9
4.2-1	Compliance Status Summary for SIUs	4-2
4.4-1	Notice of SNC with Sewer Discharge Requirements	4-3
4.5-1	Non-Compliance Fees and Penalties Summary	4-4
4.7-1	Enforcement Actions Summary	4-5
5.3-1	Point Loma Wastewater Treatment Plant Influent Heavy Metals	5-6
5.3-2	Point Loma Wastewater Treatment Plant Effluent Heavy Metals	5-6
5.3-3	South Bay Water Reclamation Plant Influent Heavy Metals	5-7
5.3-4	South Bay Water Reclamation Plant Effluent Heavy Metal	5-7
5.6-1	Annual Biosolids Beneficial Use & Landfill Disposal Summary	5-58

LIST OF REPORTS

Report Name	Page
Facilities Discharging to Treatment Plant that became SIUs	3-10
SIU Permits Discharging to Treatment Plant Inactivated	3-12
SIUs Discharging to Treatment Plant with Name Change	3-13
SIUs Discharging to Treatment Plant that became NonSIUs	3-14
SIUs that are discharging under a BMR	3-15
SIU Facilities Federal Category, Process, and Pretreatment Technology	3-16
SIU Facilities: Regulated Parameters by Connection	3-27
Inspections Performed at SIUs	3-56
Active Groundwater Permits	3-60
Trucked Waste Permits Issued	3-61
Trucked Waste Discharge Totals per Month	3-64
Trucked Industrial Discharge Totals per Month by Type	3-65
Active Permits Metrowide at Year End	3-66
Annual SIU Compliance Status Report	4-10
NOVs Issued for SIUs Discharging to Treatment Plant	4-24
NOVs Issued for SIUs Discharging to SBWRP	4-28
NOVs Issued for Non-SIUs Discharging to Treatment Plant	4-29
Sampling at SIUs Discharging to Treatment Plant	4-33
Total Toxic Organics (TTO) Sampling at SIUs Discharging to Treatment Plant	4-65
Analytical Methods Used by the IWCP Lab	4-67

LIST OF REPORTS (continued)

Report Name	Page
Point Loma Influent and Effluent Analytical Results:	
Biochemical Oxygen Demand Concentration	5-8
Total Suspended Solids Concentration	5-9
Systemwide BOD Removals	5-10
Systemwide TSS Removals	5-10
Influent to Plant	5-11
Effluent to Ocean Outfall	5-11
Trace Metals	5-12
Ammonia-Nitrogen, Total Cyanide and Total Residual Chlorine	5-14
Radioactivity	5-15
Chlorinated Pesticide Analysis	5-16
Organophosphorus Pesticides	5-18
Tributyl Tin Analysis	5-20
Phenolic Compounds	5-21
Priority Pollutants Base/Neutrals	5-22
Priority Pollutants Purgeables	5-24
Dioxin and Furan Analysis	5-28

LIST OF REPORTS (continued)

Report Name	Page
South Bay Influent and Effluent Analytical Results:	
Biochemical Oxygen Demand Concentration	5-30
Total Suspended Solids Concentration	5-31
Influent to Plant	5-32
Effluent to Ocean Outfall	5-33
Trace Metals	5-34
Ammonia-Nitrogen and Total Cyanide	5-37
Radioactivity	5-38
Chlorinated Pesticide Analysis	5-39
Organophosphorus Pesticides	5-41
Tributyl Tin Analysis	5-43
Phenolic Compounds	5-44
Priority Pollutants Base/Neutrals	5-45
Priority Pollutants Purgeables	5-47
Dioxin and Furan Analysis	5-49
Anions	5-53
Cations	5-57

LIST OF FIGURES

Number	Title	Page
1.2-1	Industrial Discharge of Heavy Metals	1-2
1.2-2	Influent/Effluent Total Metals and Flows	1-2
1.2-3	Influent/Effluent Industrial Metals vs Total Metals and Flows	1-3
2.1-1	San Diego Metropolitan Sewerage System Tributary Agency Map	2-2
2.2-1	Industrial Wastewater Control Program Organizational Chart	2-3
5.2-1	Point Loma Influent/Effluent Metals	5-2
5.2-2	Cadmium: Point Loma Influent/Effluent History	5-2
5.2-3	Chromium: Point Loma Influent/Effluent History	5-3
5.2-4	Copper: Point Loma Influent/Effluent History	5-3
5.2-5	Lead: Point Loma Influent/Effluent History	5-4
5.2-6	Nickel: Point Loma Influent/Effluent History	5-4
5.2-7	Silver: Point Loma Influent/Effluent History	5-5
5.2-8	Zinc: Point Loma Influent/Effluent History	5-5

ACRONYMS

BMP	Best Management Practice
BMR	Baseline Monitoring Report
BOD	Biochemical Oxygen Demand
CFR	Code of Federal Regulations
CIU	Categorical Industrial User
EMTS	Environmental Monitoring and Technical Services
EPA	Environmental Protection Agency
ESC	Enhanced Source Control
HHW	Household Hazardous Waste
IU	Industrial User
IWCP	Industrial Wastewater Control Program
JRMP	Jurisdictional Runoff Management Plan
MDL	Method Detection Limit
NCWRP	North City Water Reclamation Plant
NOV	Notice of Violation
NPDES	National Pollutant Discharge Elimination System
PCI	Pretreatment Compliance Inspection
PIMS	Pretreatment Information Management System
PLWTP	Point Loma Wastewater Treatment Plant
POTW	Publicly Owned Treatment Works
PS1	Pump Station 1
RWQCB	Regional Water Quality Control Board
SBWRP	South Bay Water Reclamation Plant
SDCSD	San Diego County Sanitation District
SIU	Significant Industrial User
SMR	Self-Monitoring Report
SNC	Significant Non-Compliance
SWRCB	State Water Resources Control Board
TDS	Total Dissolved Solids
TRC	Technical Review Criteria
TSS	Total Suspended Solids
TTO	Total Toxic Organics

CHAPTER 1 – EXECUTIVE SUMMARY

1.1 INTRODUCTION

The City of San Diego (City) is committed to protecting public health and the environment through a program of environmental management which includes pollution prevention, industrial pretreatment, chemically enhanced primary waste treatment, an improved ocean outfall, and extensive monitoring. A key element of this program is an aggressive pretreatment and pollution prevention program to minimize toxic discharges to the sewerage system. The City's federally-approved Industrial Wastewater Control Program (IWCP) consists of: (1) an industrial wastewater discharge permit system to establish industrial discharge limits and requirements; (2) facility inspections and unannounced sampling; (3) effective enforcement procedures to deter violations and bring non-compliant dischargers back into compliance with discharge standards and requirements, and; (4) industrial user guidance and permit conditions designed to encourage pollution prevention and waste minimization.

The IWCP implements an industrial wastewater discharge permit system for the City of San Diego and 11 other Participating Agencies whose sewage is treated by the Point Loma Wastewater Treatment Plant (PLWTP). The South Bay Water Reclamation Plant (SBWRP) is tributary to a subset of this area and because of this the PLWTP and SBWRP pretreatment annual reports have been combined.

1.2 EFFECTIVENESS

- Since 1982, while the average daily wastewater flow into the Metro System has increased by approximately 11%, the total mass of heavy metals entering the Metro collection system at the plants has decreased by 71%.
- Since federal approval and implementation of IWCP in 1982, average metal loadings contributed by industrial sources have decreased by 89%. Whereas in 1982, industrial discharges of metals constituted nearly 27% of all the cadmium, chromium, copper, lead, nickel, and zinc discharged to the collection system, today industrial loadings constitute approximately 5% of the total metals discharged to the system (see Figure 1.2-1, Figure 1.2-2 and Figure 1.2-3).
- San Diego's sludge qualifies as “exceptionally clean” under the criteria set forth in 40 Code of Federal Regulations (CFR) Part 503, attesting to the effectiveness of the City's IWCP and providing maximum options for beneficial reuse of the sludge.

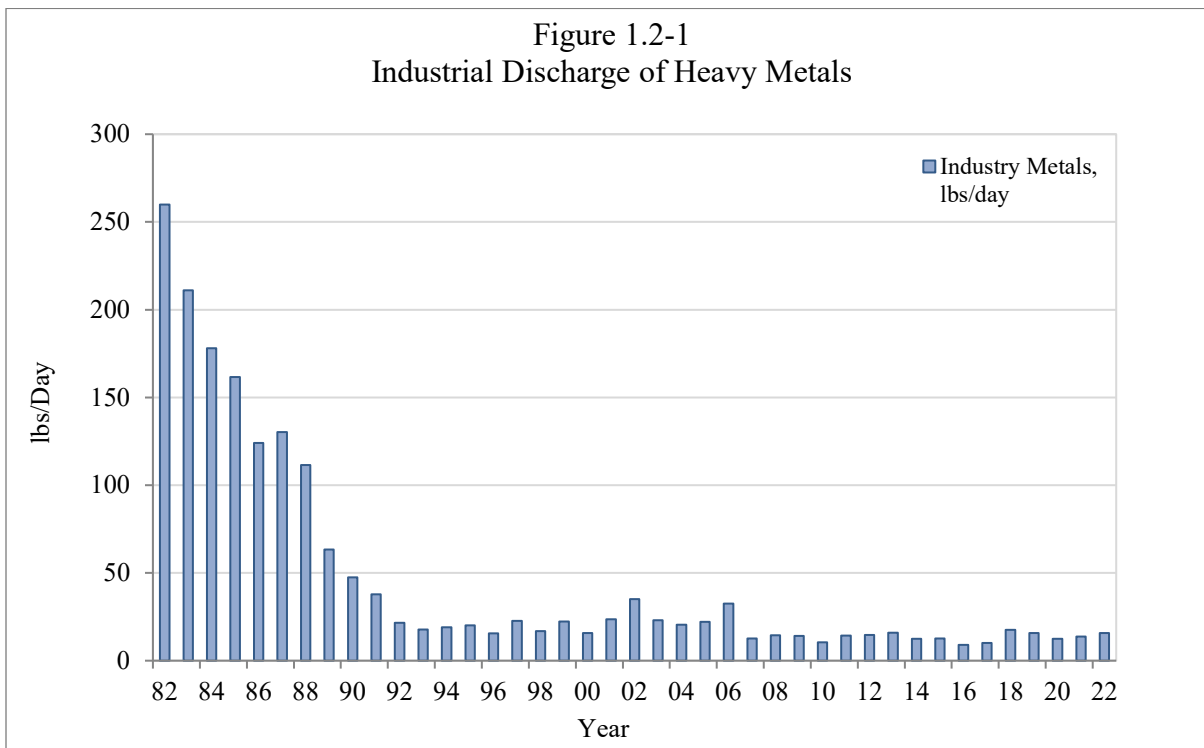


Figure 1.2-1 Average daily industrial discharge of heavy metals (cadmium, chromium, copper, lead, nickel, and zinc) to the PLWTP since IWCP approval in 1982.

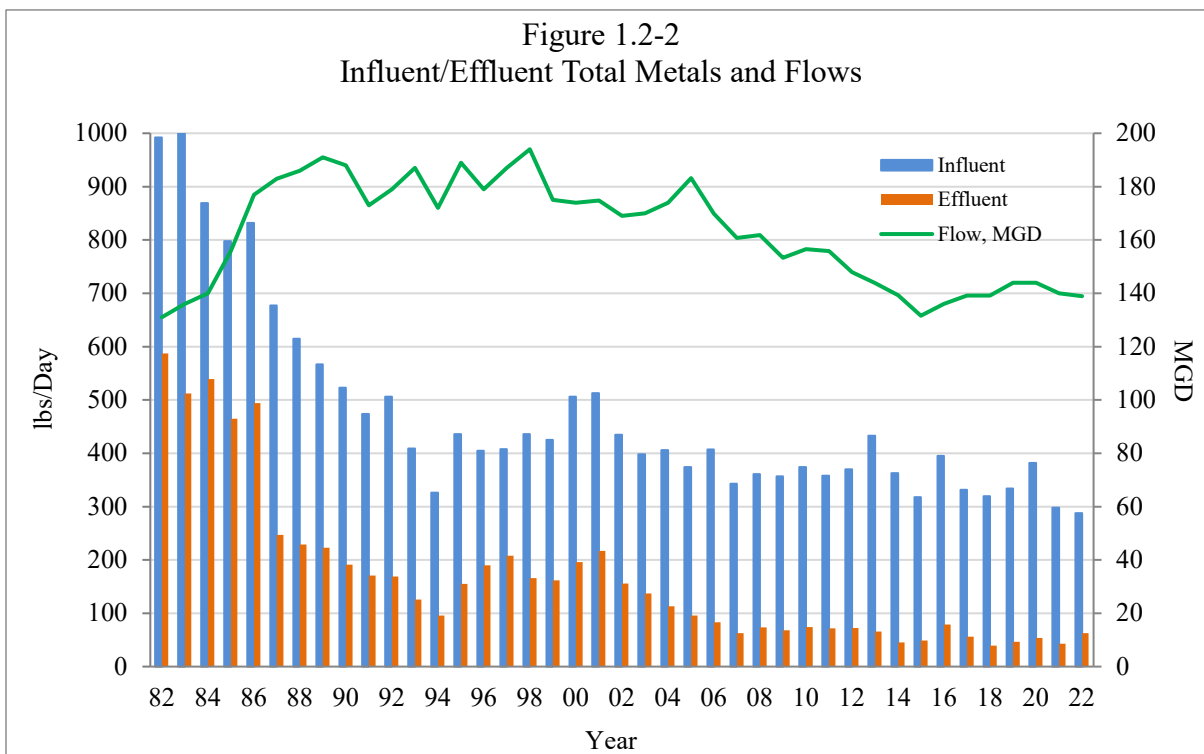


Figure 1.2-2 Long-term trends of PLWTP flows and influent and effluent loadings of potentially toxic heavy metal pollutants are shown above.

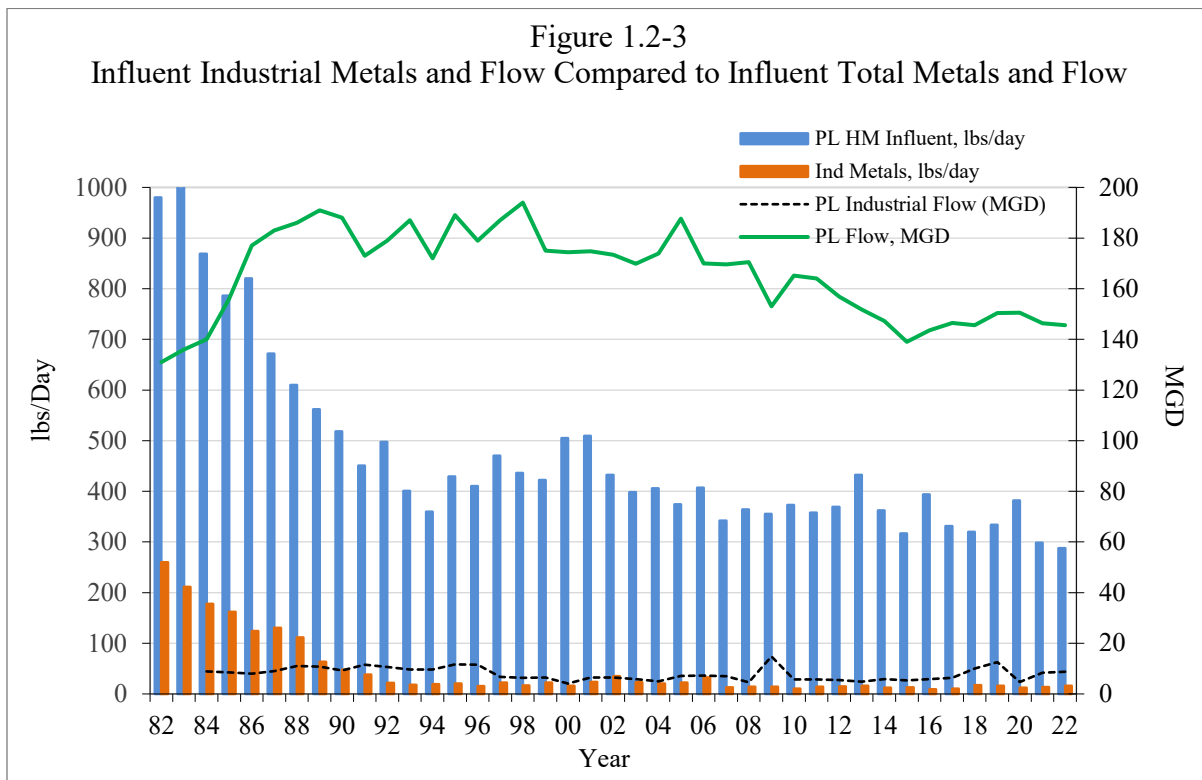


Figure 1.2-3 There were no pass-through or interference incidents attributed to industrial discharges.

Note: The industrial loadings and statistics exclude copper in sanitary discharges from navy ships, which has been determined to originate from seawater corrosion of shipboard copper piping and not from industrial operations. Where there is no federal limit, metals loadings in industrial discharges that are below domestic/commercial background screening level concentrations are also excluded from the industrial loadings.

1.3 SUMMARY

- During the year, IWCP administered 95 Significant Industrial User (SIU) permits, covering 118 outfalls, and monitored at 151 sample points. Ten (10) outfalls at ten (10) SIU facilities were in significant non-compliance (SNC) during the year resulting in a SNC rate of 8% (10 of 118 outfalls). SIUs were in full compliance (no pollutant violations) with discharge standards and requirements at 80% of the outfalls. Included in the system wide counts above, the 13 SIUs discharging to the SBWRP were monitored at 16 sampling locations constituting 14 outfalls. Of the ten (10) outfalls found to be in SNC, two (2) were dischargers to the SBWRP.
- At the end of the year, 74 SIU permits remained active and IWCP administered 1,756 total control mechanisms, including 37 Class 1 Categorical Industrial User (CIU) permits, 611 Class 2 and 3 permits (of which 37 were SIUs), 121 Hauled Waste permits, and 952 Best Management Practice Discharge Authorizations, covering targeted commercial sectors. IWCP also performed annual inspections to confirm continuing non-regulated status at 35 additional facilities (Class 4C and 4Z) with processes subject to federal pretreatment standards that either do not generate regulated wastestreams, or do not discharge regulated wastestreams to sewer.

- 6,000 inspections and site assessments were conducted; 1,415 unannounced sampling visits were performed; and results from 2,266 industry self-monitoring samples and 1,856 best management practices (BMP) self-certifications were received and reviewed to evaluate compliance.
- 261 Notice of Violations (NOVs) were issued to industries for exceeding discharge limits or failing to comply with permit conditions; 139 of these were issued to SIUs. For new formal enforcement actions, no Administrative Penalty Orders and one Compliance Order, were issued. Non-compliance fees in the amount of \$21,659 were invoiced.
- The annual publication list of SIUs in SNC during the calendar year is based on compliance determinations for the entire year.
- The Annual Point Loma Publicly Owned Treatment Works (POTW) Local Limits Re-evaluation submitted July 1, 2022 confirms that the local limits developed in 1996 remain technically justified and sufficient to protect the Point Loma POTW and the environment.

CHAPTER 2 – IWCP STRUCTURE

2.1 JURISDICTION

The IWCP administers the pretreatment program in the City of San Diego (Map areas 01 – 12) and in 11 participating agencies contributing to the San Diego Metropolitan Sewerage System, including five service areas of the San Diego County Sanitation District (SDCSD). Table 2.1-1 lists the areas served; Figure 2.1-1 shows the areas geographically.

Table 2.1-1 DISCHARGE AREA / AGENCY BY AREA NUMBER			
Area	Description	Area	Description
01	¹ SD: Rancho Bernardo	14	City of Coronado
02	SD: Sorrento Valley & Torrey Pines	15	City of Del Mar
03	SD: Miramar, Mira Mesa, Scripps Ranch	16	City of El Cajon
04	SD: Mission Bay, Pacific Beach, La Jolla	17	City of Imperial Beach
05	SD: Clairemont Mesa	18	City of La Mesa
06	SD: Kearny Mesa	19	City of National City
07	SD: Mission Gorge	20	City of Poway
08	SD: Point Loma, Lindberg Field	21	Santee/Padre Dam Municipal Water District
09	SD: North Downtown	22	City of Lemon Grove
10	SD: East San Diego	32	² SDCSD: Alpine Service Area
11	SD: South Downtown	33	² SDCSD: Lakeside Service Area
12	SD: San Ysidro, Otay Mesa	34	² SDCSD: Spring Valley Service Area
13	City of Chula Vista	35	² SDCSD: Winter Gardens Service Area Maintenance District
		36	² SDCSD: East Otay Mesa Service Area

¹ All flows from the Rancho Bernardo area of San Diego are treated by the Hale Avenue Resource Recovery Facility (Treatment Plant 5), which is owned and operated by the City of Escondido. Except for parts of areas 12, 13, and 36, which are in part diverted to the South Bay Water Reclamation Plant, the remaining areas are tributary to the City's Point Loma Wastewater Treatment Plant. Permitted flows in some areas include significant volumes of construction dewatering and groundwater remediation.

² San Diego County Sanitation District: In July 2011, Areas 32 through 36, previously separate sewer districts, were incorporated into the newly formed San Diego County Sanitation District; the former districts are now “service areas”.


2.2 ORGANIZATION


The IWCP is part of the Environmental Monitoring and Technical Services (EMTS) Division of the City of San Diego Public Utilities Department. The IWCP consists of four operational sub-sections: SIU Permits, Enhanced Source Control (ESC) Permits divided into north, central, and south areas, Support Services, and Industrial Wastewater Sampling. Figure 2.2-1 shows the current organizational chart.



Figure 2.1-1

San Diego Metropolitan Sewerage System Tributary Agency Map

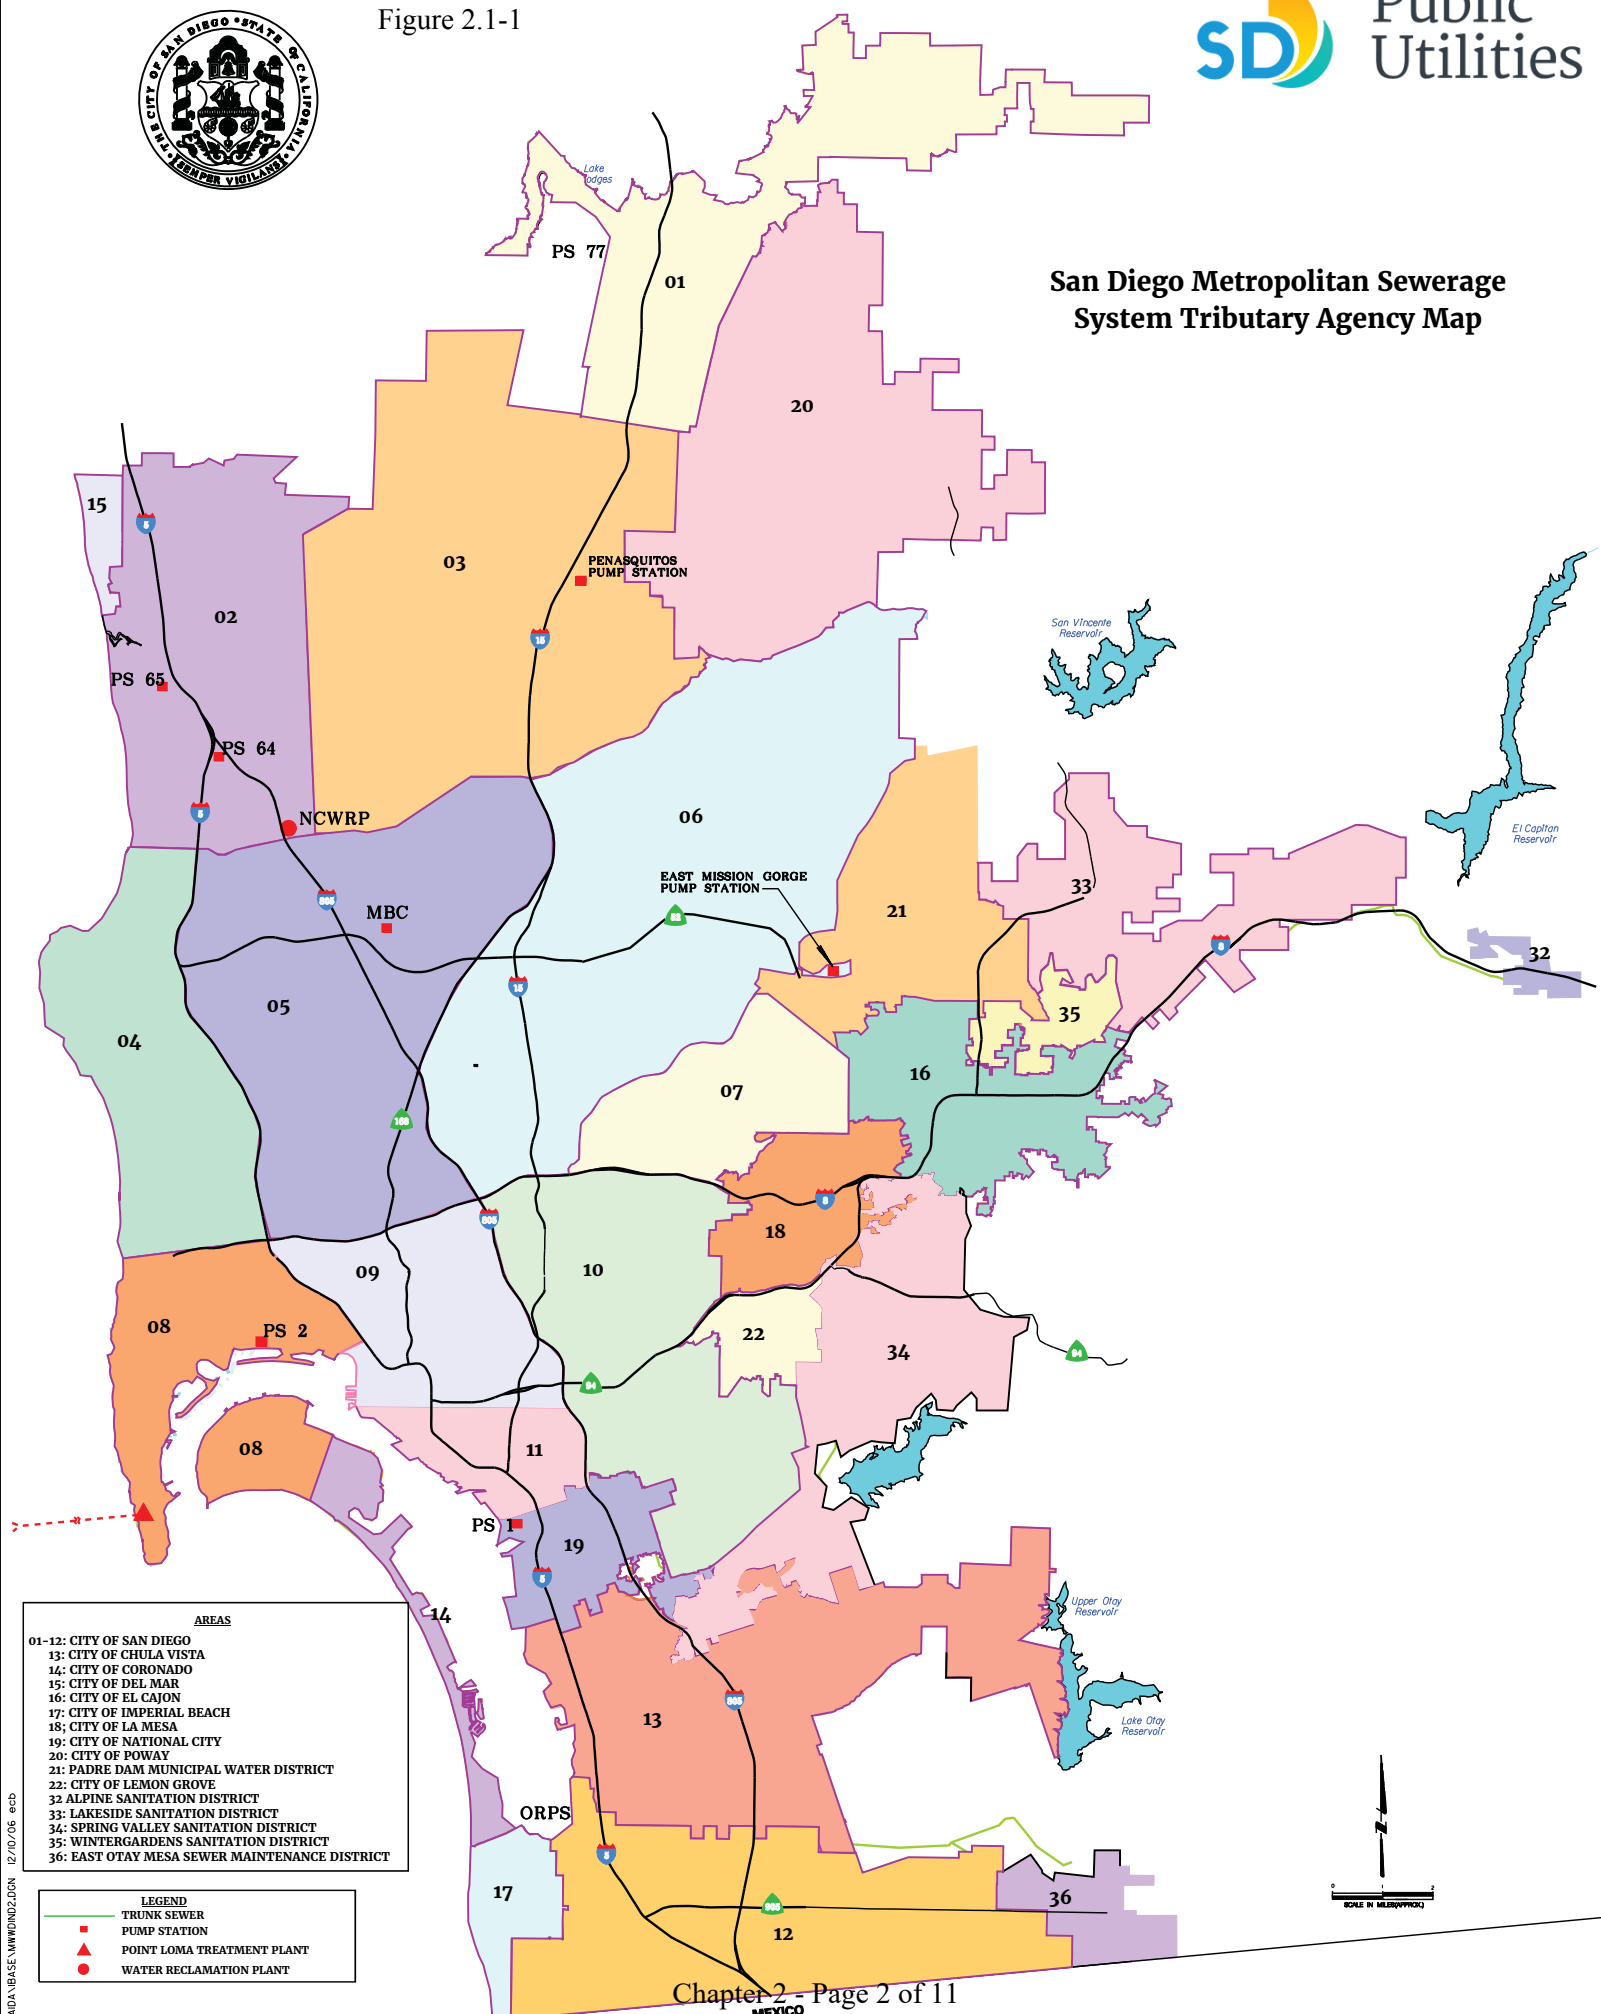

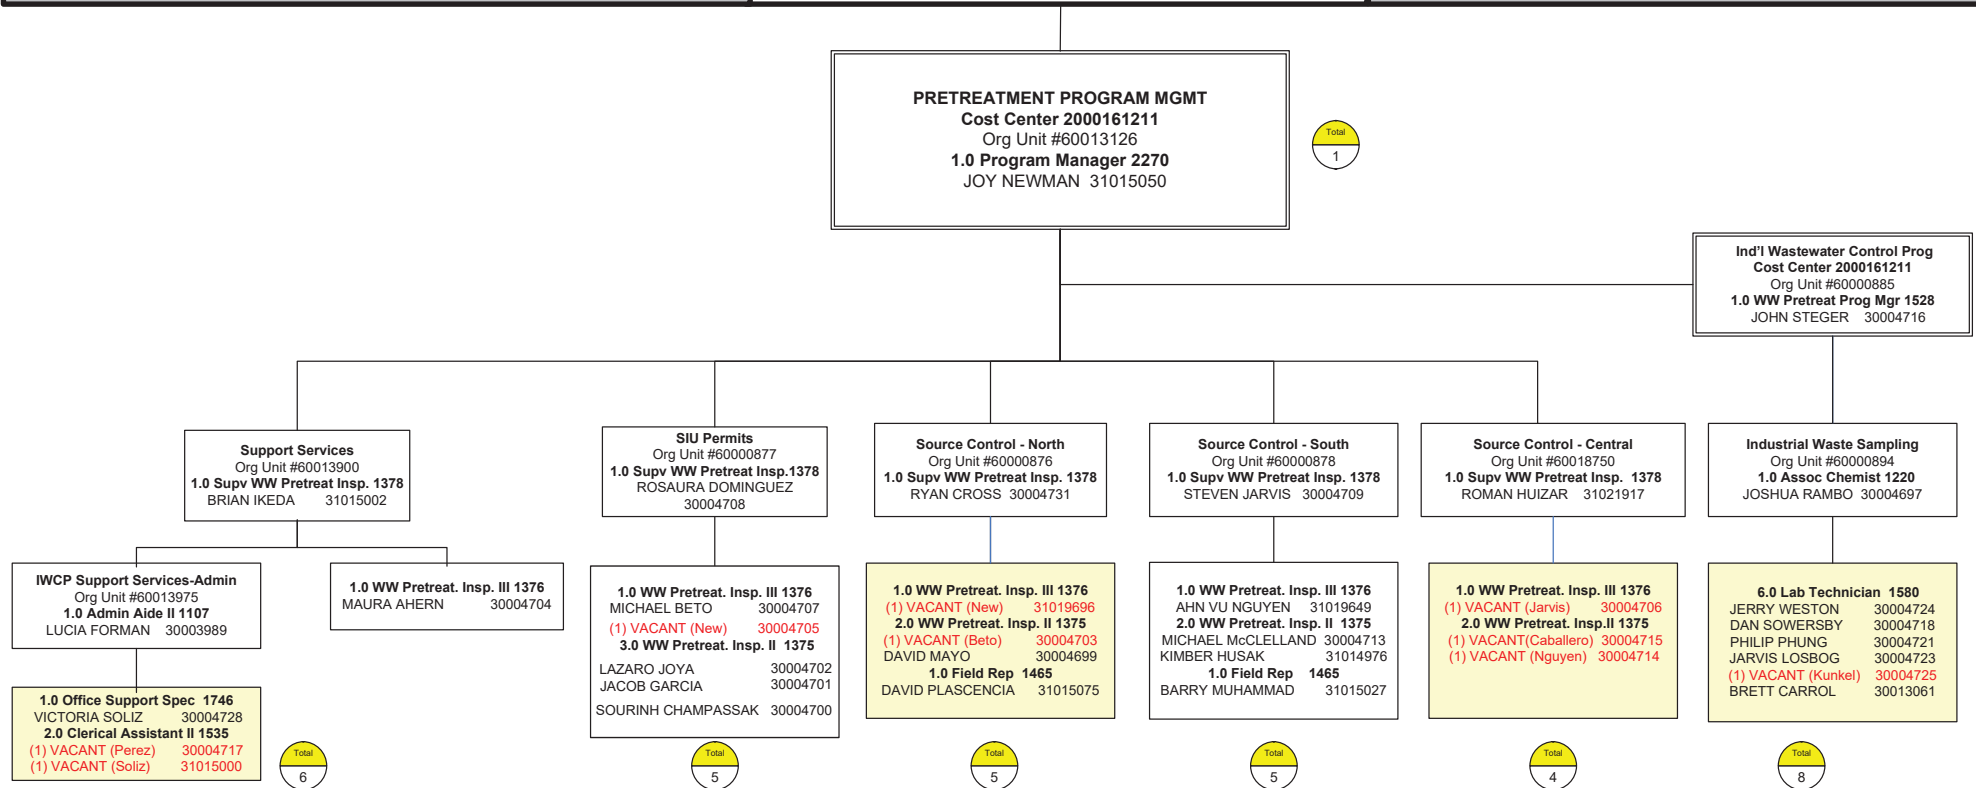

SUMMARY	
Budgeted FTE:	213.00
Vacant FTE:	40.00
Limited (Mgt Intern)	3.00

	City of San Diego Public Utilities Department-Water & Wastewater Environmental Monitoring & Technical Services Division	
	Organization Chart - FY 2023 Total No. of FTE: 213 Limited: 3	
	As of 12/01/2022	

Total
34

2.3 PERSONNEL AND BUDGET

IWCP budgeted positions and monies for fiscal year 2022 are summarized below:

Table 2.3-1 IWCP BUDGET		
# of Positions	Budget	
34	Personnel	\$3,479,843
	Supplies	\$20,535
	Contracts, training, IT services, fleet, other expenses	\$664,790
	Capital Outlay	\$761,150
	Total	\$4,926,318

Table 2.3-2 REGULATORY TRAINING RECEIVED BY STAFF					
Date	Class Title	# attendees	# hr./ person	Total Hours	Type
Various	Cyber Security at Work, Cyber Security Foundations	26	1	26	E-learning
Various	Administrative Regulation (AR) Reviews and Other Acknowledgements: Annual EEO Policy Statement, AR 4.50 Employee Assistance Program Administration, AR 45.10 Employee Transportation Authorization AR Review, AR 45.50 Private Use of City Labor, Equipment, Materials and Supplies Prohibited, A.R. 63.30 - Accounts Receivable-Invoice Processing and Collection, AR 75.12 Vehicle and Industrial Incident Review, Reporting, and Discipline Program, AR 75.50 Driver License Certification, Training, and Verification Requirements, AR 85.10 Records Management Policy, AR 90.62 Information and Communication Technology Acceptable Use Policy Review, AR 95.05 Cell Phone and Other Handheld Communication Device Use Policy Review, AR 95.60 Conflict of Interest and Employee Conduct Policy Review, AR 95.94 Tobacco and Smoke-Free Workplace Policy Review, AR 96.50 EEO Policy, AR 97.00 Substance Abuse Policy, AR 97.10 Threat Management policy review, AR 97.20 Weapon-Free Workplace Policy Review, Information Security Policy AR 90.63, Citywide Injury and Illness Prevention Program, Driver Operator Manual Review, FY22 Procure-to-Pay Deadlines and Processes, Work Comp Medical Care and Work-Related Injury or Illness Policy Review	26	1.13	29.5	E-learning
Various	New Transfer Promoted Employee Acknowledgement	4	0.5	2	E-learning
Various	Appointing Authority Interview Training	3	2	6	E-learning

Table 2.3-2
REGULATORY TRAINING RECEIVED BY STAFF

Date	Class Title	# attendees	# hr./ person	Total Hours	Type
Various	Fall Classic: Includes Fire Safety E-Learning, Hazcom Program Refresher, Hazard Communication Program Refresher (Lab Techs), Hazmat for Supervisors (Supervisors), Environmental Impact, First Responder Awareness Refresher, Stormwater for Inspectors (Inspectors), Lab Safety (Lab Techs), Annual Storm Water Training - IGP, Consent Decree, and JRMP	21	6.3	132.3	E-learning
Various	New Employee Training: New Employee Onboarding – Public Utilities, Public Utility Department New Employee Orientation	1	8.5	8.5	E-learning
Various	Webinars: Bloodborne Pathogens, Ergonomics Office, Temporary Traffic Control - Safety CEU	8	1.875	15	E-learning
Various	Sexual Harassment Prevention Training	6	2.5	15	E-learning
Various	Secrets Successful People Know about Time Management, Financial Disclosure Training, 5S Workplace Productivity, Accident & Minor Injury Training, Accounting Foundations, Advanced Grammar, Americans with Disabilities Act: Civic Access and Reasonable Accommodations, Asserting Yourself an Empowered Choice, Basics of Labor Relations, Becoming a Manager Your Team Loves, Building Resilience, Business Process Improvement, City Civics: History, Structure, and Compliance, Coaching and Developing Employees, Communicating Across Cultures, Communicating with Diplomacy and Tact, Communication Foundations, Conflict Resolution for Beginners, Customer Service Foundations, Customer Service Managing Customer Feedback, Customer Service Serving Customers Through Chat and Text, Dan Ariely on Making Decisions, Dealing with Microaggression as an Employee, Developing Your Emotional Intelligence, Electronic Storage of City Email Record, Employee Accountability, Employee Performance Review Training, Employee Rewards & Recognition, Equal Employee: A Supervisors' Role in Maintaining an Unbiased Workplace, Essentials of Team Collaboration, Ethics Training, Fact Finding Fundamentals, Family, Medical & Other Leave (FMLA, CFRA, PDL, etc.), Financial Record Keeping, First Aid/CPR/AED, Fred Kofman on Managing Conflict, GeoTab Telematics, Getting Things Done, Giving and Receiving Feedback, How to Train Your Brain for Maximum Growth, Inclusive Mindset for Committed Allies, Injury and Illness	26	8.9	232	E-learning

Table 2.3-2 REGULATORY TRAINING RECEIVED BY STAFF					
Date	Class Title	# attendees	# hr./ person	Total Hours	Type
	Prevention Program Review, Interpersonal Communication, Introduction to hazardous Material, Linked in Learning Financial Record Keeping, Microsoft Teams Essential Training, Nacia Website Training, Process Narrative - Post a FI-CA Invoice, Productivity Principles to Make Time for What's Important, Public Records Act Compliance Training Video, RCAC Budgeting for Small Water Systems, Reducing Repetitive Motion Injuries in the Workplace and at Home, Risk Management and Safety: Resources and Tools for Supervisors, San Diego Civic Leadership Summit, SAP ERP Trainings (Reporting, Financials, Procurement), Supporting Employees in Distress: Employee Assistance Program & Policies, Threat Management, Tips for Writing Business Emails, Working with Difficult People, Writing Emails, Writing in Plain English, Zero Waste in the Work Place, Zoom Participation Tutorial				
Various	Ethics and Data Integrity	25	0.5	12.5	E-learning
Total				478.8	

2.4 CHANGES AND DEVELOPMENTS

Facilities with processes subject to federal categorical pretreatment standards that do not discharge from the CIU processes and only have flows below the other permitting thresholds are now issued permits to better establish the requirements and ensure compliance; whereas, previously a conditional permit waiver was issued. Based on the 2021 Local Limit re-evaluation for the South Bay Water Reclamation Plant, total dissolved solids (TDS) limits were added to SIU permits on a case by case basis and overview monitoring for manganese was added to SIU and groundwater permits.

2.5 HOUSEHOLD HAZARDOUS WASTE PROGRAM

The City of San Diego Environmental Services and the Public Utilities Department jointly finance a Household Hazardous Waste (HHW) collection program designed to reduce the introduction of pollutants from non-point sources into sewers, storm drains, and municipal landfills. The City's permanent household hazardous waste collection facility at the Miramar Landfill is open to City of San Diego residents on Saturdays excluding holidays (such as Thanksgiving and Christmas weekends); an appointment and proof of residency is required. The City's program also sponsors seven to eight auto product recycling events per year, coordinates and advertises commercial locations that accept auto products for recycling. Each contributing agency has also implemented a strategy for handling household hazardous wastes originating within its jurisdiction.

Table 2.5-1 HHW SERVICES BY MEMBER AGENCIES		
JURISDICTION	COLLECTION SERVICE	HOTLINE/EDUCATION SERVICE (Yes or No)
Chula Vista	Chula Vista Regional HHW Facility Temporary HHW Collection Events Door-to-Door Collection for Seniors/Disabled Curbside Used Oil and Filter Collection	Yes
Coronado	Coronado HHW Facility Door-to-Door Collection for Seniors/Disabled	Yes
El Cajon	El Cajon HHW Facility Curbside Used Oil and Filter Collection	Yes
Imperial Beach	Chula Vista Regional HHW Facility Door-to-Door Collection for Seniors/Disabled	Yes
La Mesa	La Mesa HHW Facility	Yes
Lemon Grove	La Mesa HHW Facility	Yes
National City	Chula Vista Regional HHW Facility Door-to-Door Collection for Seniors/Disabled	Yes
Poway	Poway HHW Facilities Door to Door Collections for City Residents	Yes
San Diego*	San Diego HHW Facility Auto Product Recycling Events Door-to-Door Collection for Seniors/Disabled	Yes
Santee	El Cajon HHW Facility Curbside Used Oil and Filter Collection	Yes
County of San Diego - Unincorporated Areas**	El Cajon, Ramona, and the Chula Vista Regional HHW facility Temporary HHW Collection Events Door-to-Door Collection for Seniors/Disabled	Yes

* **City of San Diego** includes communities such as La Jolla, Mira Mesa, Normal Heights, North Park, Otay Mesa, Pt. Loma, Rancho Bernardo, Rancho Penasquitos, and San Ysidro.

** Unincorporated Areas include communities such as Alpine, Lakeside, Winter Gardens, and Spring Valley.

2.6 STORMWATER DIVISION

The City's Stormwater Department implements Monitoring and Inspection, Policy and Enforcement, Construction and Development Standards, Watershed Planning, Education and Outreach, and Administration of the Stormwater Planning Division. The inspection groups perform commercial, industrial, and municipal facility inspections to ensure compliance with the minimum best management practices listed in Appendix IX of the Jurisdictional Runoff Management Plan (JRMP) and the San Diego Municipal Code Section 43.0307(a). In addition, the stormwater code enforcement unit investigates alleged illegal discharges and takes enforcement action against violators of the Stormwater Management and Discharge Control ordinance (San Diego Municipal Code Section 43.0304). The IWCP assisted the Stormwater Inspections Program by performing 70 industrial stormwater compliance inspections in the City of San Diego and providing the findings to the Stormwater Inspections Program.

2.7 STORMWATER DIVERSION

Municipal Low Flow Stormwater Diversion Systems

Waste streams originating in storm drains tributary to City of San Diego low flow diversion structures have been monitored to characterize the pollutant loads and ensure that the City's collection and treatment facilities will not be harmed by the pollutants in the accepted stormwater. Some low flow diversion systems are controlled by sensors that automatically shut the diversions off during rain events; others are manually diverted back to storm drains during rain events to protect the collection system and treatment facilities from hydraulic overloads. Analytical results have established that the pollutant loadings have not interfered with or passed through the treatment plant; therefore, existing plant processes are sufficient to treat the additional loads contributed as a result of the low flow diversions. In addition, operational experience has demonstrated that the automatic and manual controls have effectively prevented any hydraulic impacts on the collection or treatment system. The City is working with Participating Agencies to ensure any low flow diversion systems they may install, conform to these same standards and provide the same levels of collection system and treatment plant protection.

First Flush Industrial Stormwater Diversion Systems

In recognition of the fact that there may be situations where runoff from industrial or commercial facilities may not meet Regional Water Quality Control Board (RWQCB) discharge standards, the City has worked with industrial facilities to provide for capture and discharge to the sewer of first flush storm water runoff where it is clearly demonstrated that the pollutant and/or hydraulic load will not negatively affect the collection or treatment system. The industry is required to provide information about the tributary area, diversion mechanism, capture and holding facilities, and expected pollutants, and must demonstrate adequate discharge controls prior to receiving authorization for discharge. In general, facilities must capture and hold stormwater and may discharge it to sewer no sooner than twenty-four hours after the end of the last rain event. Careful evaluation of analytical data for proposed discharges, determination of available line capacity, and review of proposed discharge controls ensures that the industrial first flush discharges will not negatively impact the collection system or the treatment facilities.

2.8 PRETREATMENT HISTORY

Industrial wastewater control activities were initiated by the City in the late 1960s and informally continued through the 1970s. Sewerage service contracts with the Participating Agencies were adopted in 1960 and later became the basis for participation of the Participating Agencies in the IWCP, approved by the Environmental Protection Agency (EPA) in 1982.

- 1981 Industrial Survey conducted, building on work of 1970s.
- 1981-2 Consultants develop program structure and procedures; submit to EPA for approval.
- 1982 IWCP formally approved by EPA on July 1, 1982.
- 1983 Industrial Wastewater Ordinance, permit fees and trucked waste fees approved by City Council.
- 1983-5 Number of permits increased from 300 to more than 1200. Compliance conferences with IUs.
- 1985 NOVs initiated. IWCP audit by EPA and RWQCB results in findings of excellent data management, knowledgeable staff, and good procedures for permitting, inspecting, and sampling; need for stronger legal authority in the San Diego Municipal Code and with contract agencies.
- 1986 First Annual Pretreatment Report submitted.
- 1987 First Pretreatment Compliance Inspection (PCI). First Enforcement Response Plan developed. Interjurisdictional Pretreatment Agreements with Metro Agencies initiated.
- 1988 PCI by RWQCB results in no required actions.
- 1989 Estimated capital investment in pretreatment equipment by industries in the San Diego service region exceeds \$20 million.
- 1990-1 Consent Decree, EPA trial in federal court for secondary treatment, and Administrative Order.
- 1991-2 IWCP audit by EPA, SWRCB, and RWQCB in March 1991 followed by a Pretreatment Program Evaluation from May 1991 through August 1992.
- 1992 Technical fact sheets initiated; sampling frequencies modified to comply with Pretreatment Program Evaluation recommendations.
- 1993 Administrative Order issued to IWCP incorporating Consent Decree and Pretreatment Program Evaluation recommendations. All Administrative Order requirements completed by due dates, including fact sheets completed, SIU permits reissued, and Enforcement Response Plan submitted.
- 1994 Waiver application initiated by City.
- 1995 Waiver granted, new National Pollutant Discharge Elimination System (NPDES) Permit issued; PCI by SWRCB establishes no requirements; new Pretreatment Information Management System (PIMS) implemented; Administrative Civil Penalty policy implemented.
- 1996 Urban Area Pretreatment Program requirements satisfied; local limits study and innovative non-CIU contributory flow industrial pollutant loadings allocation strategy results in proposed modification of local limits; PCI by SWRCB establishes no requirements.

- 1997 Public participation meetings held by the City and RWQCB prior to adoption of Urban Area Pretreatment Program and new local limits; SIU permits modified to include new local limits.
- 1998 Tijuana Industrial Wastewater Control Training Project conducted with 30 trainees completing course in pretreatment facility inspections, laboratory procedures, and field work; City participates in national Silver Council / AMSA study; first Annual Local Limits re-evaluation confirms 1996 limits remain valid; graphs of heavy metals discharged by industry revised to include only SIU discharges; targeted commercial sectors issued BMP discharge authorizations.
- 1999 Tijuana Project continues with wastewater characterization study and laboratory personnel training; ordinance provisions relating to General and Specific Prohibitions and civil penalties strengthened; IWCP assumes implementation of regulations in 4 County Sanitation Districts.
- 2000 RWQCB report from December 1999 audit requires San Diego Municipal Code revisions to detail specific authorities and increase maximum criminal penalties to \$25,000 / day per violation; revision adopted by City Council in November 2000. Permit document generation and IWCP billing automated. IW Lab fully implements ICP-MS for all metals analyses.
- 2001 IW Lab personnel assist with translation of Ken Kerry Pretreatment Program training manual and videos into Spanish; Pt Loma Waiver Renewal Permit Application submitted.
- 2002 The RWQCB and EPA issue waiver permit for the Point Loma Treatment Plant. The South Bay Water Reclamation Plant comes on-line. IWCP provides inspector training in Tecate, Mexico and performs storm water compliance inspections at SIUs to assist the Storm Water Pollution Prevention Program. The IW Lab continues to provide sampling training and services in Tijuana, Tecate, Mexicali, and Ensenada, Mexico.
- 2003 New group created to administer source control mechanisms and respond to complaints. Increased focus on surveillance monitoring.
- 2004 IWCP continues to perform Storm Water P³ assistance, and to participate in cooperative program of technical assistance with the State of California and Mexico.
- 2005 IWCP initiates classification of Large User account billing rates under the 10/01/04 new rate structure.
- 2006 IWCP initiates regulation of remediation sites with free product or discharging > 14,000 gpd and construction dewatering sites discharging > 25,000 gpd as SIUs.
- 2007 IWCP and IW Lab participate in Business Process Re-engineering effort to develop Most Efficient Organization resulting in loss of 2 Inspector II positions, 1 Assistant Chemist position, and 1 Assistant Laboratory Technician position.
- 2008 IWCP performs study to identify sources of TDS to reclamation plants and adds TDS monitoring to new permits tributary to reclamation facilities; initiates rainwater diversion testing and certification requirements in permits; allocates 0.7 Inspector III position to sewer surcharge evaluation reviews and approvals.
- 2009 IWCP quantifies self-regenerating water softener TDS contributions from regulated industries.
- 2010 IWCP reviewed Interjurisdictional Pretreatment Agreements and Ordinances for all Participating Agencies to identify deficiencies.

- 2011 IWCP surveyed dental facilities to evaluate compliance with voluntary ADA BMPs; program automated billing for imported flows and hauled waste surcharges.
- 2012 IWCP developed proposed changes to San Diego Municipal Code and Participating Agencies Interjurisdictional Pretreatment Agreements.
- 2013 Independent audit of IWCP permit administration, billing, and laboratory operations.
- 2014 Cost of service developed for each IWCP activity.
- 2015 The IW Lab's Data Management and Field/Wet Chemistry groups were combined with the IWCP section, and the Inorganic and GC/MSA groups were combined with the Environmental Chemistry Services section.
- 2016 Modified permits to enforce an instantaneous limit for oil and grease instead of a daily maximum.
- 2017 Waiver granted, new NPDES Permit issued. The dental amalgam discharger inventory and survey forms were created.
- 2018 Independent review by a consultant conducted to determine IWCP's readiness to support the department's Pure Water effort and identify areas for improvement. Initial round of dental amalgam BMP surveys were mailed.
- 2019 Changes in the structure of IWCP and new management, field and administration positions added. New permitting procedure implemented to initiate the permitting process 6 months (previously 90 days) prior the expiration date. The dental amalgam BMP compliance report was sent to over 600 dental offices, nearly 550 forms completed and submitted. The industrial users inventory significantly updated.
- 2020 A new NPDES Permit for the NCWRP and Pure Water Facility was issued. IWCP restructuring into four sub-sections (SIU, ECS, Support Services, and Industrial Sampling) was completed, with enforcement distributed to the permitting sub-sections. Further updated the industrial users' inventory for the all areas tributary to NCWRP, film processors, and dry cleaners. Initiated permit requirements for flow proportioned sampling and a second, unannounced inspection at SIUs. Solicited Dental Rule one-time compliance reports from remaining dental offices and initiated enforcement actions for noncompliance.
- 2021 A new NPDES Permit for the SBWRP was issued. The pretreatment annual reports for PLWTP and SBWRP were combined for the first time. Flow proportioned monitoring was implemented.
- 2022 Facilities with processes subject to federal categorical pretreatment standards that do not discharge from the CIU processes and only have flows below the other permitting thresholds are now issued permits to better establish the requirements and ensure compliance; whereas, previously a conditional permit waiver was issued. Based on the 2021 Local Limit re-evaluation for the South Bay Water Reclamation Plant, TDS limits were added to SIU permits on a case by case basis and overview monitoring for manganese was added to SIU and groundwater permits.

CHAPTER 3 - DISCHARGE PERMITS

3.1 INTRODUCTION

The IWCP implements an industrial wastewater discharge permit system for the City of San Diego and 11 other Participating Agencies whose sewage is treated by the Point Loma Wastewater Treatment Plant or the South Bay Water Reclamation Plant. IWCP regulates pollutant discharges into the Metropolitan Sewerage System from industrial facilities by issuing permits that establish enforceable pollutant limits and authorize civil and criminal penalties for discharge violations. They also establish sampling, reporting, record keeping, and notification requirements. Permits are issued for a maximum of five years and are non-transferable.

3.2 PERMIT AUTHORITY

On June 6, 1983, the San Diego City Council adopted Ordinance Sections 64.01 through 64.05 of Chapter VI, Article 4 of the San Diego Municipal Code pertaining to industrial waste discharges, permits, and regulations. Section 64.07, establishing specific pretreatment regulations for wastes discharged from commercial food establishments, was added on July 11, 1988. Revisions adopted in 1988, 1989, 1993, and 2000 strengthened pretreatment provisions and authorized increased penalties. The current Chapter 6, Article 4 of the Municipal Code is available on the internet at: <https://www.sandiego.gov/city-clerk/officialdocs/municipal-code/chapter-6>

The IWCP implements the pretreatment program in all agencies served by the Metropolitan Sewerage System in accordance with contractual service agreements and Interjurisdictional Pretreatment Agreements signed by the City of San Diego and each of the Participating Agencies. These agreements establish IWCP's authority to implement and enforce pretreatment regulations in contributing agencies and require the agencies to adopt equivalent ordinances, penalties, and procedures for regulation of industrial users.

3.3 PERMIT CLASSIFICATIONS

Permit classifications include Industrial Class 1, Class 2, and Class 3; Trucked Waste permits; and Groundwater Discharge Permits.

Class 1 Permits: Class 1 dischargers are defined as those users with processes subject to federal categorical pretreatment standards. These users require source control, pretreatment, or both.

Class 2 Permits: Class 2 permits are issued to targeted industrial sectors, which have some toxic constituents in their discharge but are not subject to federal categorical pretreatment standards. Class 2 permits may include numeric limits, as at industrial laundries and membrane manufacturers discharging >25,000 gpd, or Best Management Practice requirements (BMPs), as at laboratories, radiator shops, and hospitals. Groundwater remediation projects receive Class 2 permits.

Class 2C Permits: Facilities that, in addition to conducting processes subject to federal categorical pretreatment standards that **do not discharge to sewer**, perform processes which have some toxic constituents in their discharge, but are not subject to federal categorical pretreatment standards.

Class 2Z Permits: Facilities that, in addition to conducting processes subject to federal categorical pretreatment standards that **do not generate process wastewater**, perform processes which have some toxic constituents in their discharge, but are not subject to federal categorical pretreatment standards.

Class 3 Permits: Class 3 permits are issued to targeted industrial sectors to regulate conventional pollutants. Class 3 facilities may include numeric limits, as at commercial laundries discharging > 25,000 gpd, or Best Management Practice requirements (BMPs), as at auto repair facilities and boat- and shipyards. Construction dewatering projects receive Class 3 permits.

Class 3C Permits: Facilities that, in addition to conducting processes subject to federal categorical pretreatment standards that **do not discharge to sewer**, perform processes that discharge process wastewater containing conventional pollutants.

Class 3Z Permits: Facilities that, in addition to conducting processes subject to federal categorical pretreatment standards that **do not generate process wastewater**, perform processes that discharge process wastewater containing conventional pollutants.

Class 4 (No permit required): Class 4 facilities include industries with sanitary flow only and Class 2 and 3 facilities with flows below permitting thresholds (25 gpd and 2500 gpd respectively); these Class 4 facilities are re-evaluated periodically.

Class 4C: Facilities with processes subject to federal categorical pretreatment standards that generate process wastewater and have elected to go zero discharge to sewer. These facilities are inspected annually and must also sign a Certification of Zero Discharge of Federally Regulated Wastewater as a condition of retaining their Class 4C permit.

Class 4Z: Facilities with processes subject to federal categorical pretreatment standards for Metal Finishing that generate no process wastewater. These facilities are inspected annually and must also sign a Certification of Zero Regulated Wastewater generated as a condition of retaining their Class 4Z permit.

Class 4M Best Management Practice (BMP) (No permit required): Dental Offices with processes subject to the federal categorical "Dental Rule" under 40 CFR Part 441. Dental offices that place or remove amalgam must operate under the BMP to maintain an amalgam separator and not discharge scrap amalgam or use certain kinds of line cleaners. These dental offices must also submit a one-time compliance report acknowledging they have implemented and are in compliance with the BMPs.

Class 5 (No permit required): Class 5 facilities include industries with sanitary flow only and minimal potential to ever generate industrial wastewater.

Trucked Waste Hauler Permits: Permits are issued to trucked waste haulers authorizing the disposal of wastes into the Metro System at designated dumpsites. Two types of waste hauler permits are issued:

Domestic: For hauling of domestic septic tank/cesspool, holding tank and portable toilet wastes. These permits are issued for one year. Referenced as Class 6 Permits in the IWCP's data system.

Industrial: For hauling of industrial wastes under generator-specific permits; wastes under one permit cannot be combined with any other waste. Referenced as Class 7 Permits in the IWCP's data system.

Trucked Waste Generator Permits: Generators that propose to have wastes hauled to the City sewer dumpsite must obtain a Trucked Waste Generator Permit. These permits specify a source, such as bilge water from a Navy ship and are issued for the duration of the job. The generator must collect a representative sample of the proposed discharge, analyze for pollutants known or expected to be present, and submit the results with the permit application. Referenced as Class 9 Permits in the IWCP's data system.

Temporary Groundwater Discharge Permits: These permits are issued for flows resulting from construction dewatering and groundwater remediation projects, where no alternative

disposal method is reasonably available. These permits are issued for a maximum of two years, after which time the generator must discharge under an NPDES permit; purchase sewer capacity, if available; or cease discharge. In 2006, IWCP began regulating groundwater remediation discharges >14,000 gpd or having free product; and construction dewatering discharges > 25,000 gpd as SIUs.

Class 2F and 4D Best Management Practice (BMP) Discharge Authorizations: These authorizations consist of a statement of BMP requirements followed by a certification of compliance for management and discharge of silver-rich solutions (2F) or dry-cleaning solvents (4D). When signed by the commercial discharger, the certification authorizes discharges in compliance with BMP requirements for a period of up to five years. Random inspections are performed after receipt of the certification to ensure compliance. Additionally, re-certification is required every six months. Implementation of the BMP Certification and Discharge Authorization programs in 1998, in lieu of the previously applied numeric limits, enabled the IWCP to extend coverage of BMP requirements with no increase in inspection staff and a reduction in laboratory sampling and analysis costs formerly associated with the targeted sectors.

Batch Discharge Authorizations: Batch Discharge Authorizations for one-time, or short-term non-routine discharges not otherwise covered by a current permit, are issued subject to review of analytical data from a sample of the proposed discharge and compliance with all applicable requirements and standards.

3.4 SIGNIFICANT INDUSTRIAL USERS

IWCP defines a SIU in accordance with Federal regulations, as an Industrial User that:

1. Is subject to federal categorical pretreatment standards under 40 CFR 403.6 and 40 CFR Chapter I, Subchapter N; and
2. Any other industrial user that:
 - (a) Discharges an average of 25,000 gallons per day or more of process wastewater to the POTW (excluding sanitary, non-contact cooling and boiler blowdown wastewater); or,
 - (b) Contributes a process wastestream which makes up 5 percent or more of the average dry weather hydraulic or organic capacity of the POTW treatment plant; or,
 - (c) Is designated as such by the Control Authority on the basis that the industrial user has a reasonable potential for adversely affecting the POTW's operation or for violating any pretreatment standard or requirement. For metals, IWCP policy defines "reasonable potential" as a facility having the potential to discharge 5% or more of the allowable industrial headworks loading in a single non-routine discharge. For groundwater remediation sites, the presence of free product or discharges >14,000 gpd have "reasonable potential" and are regulated as SIUs.

Streamlining regulations provide that IWCP may determine that an Industrial User subject to federal categorical pretreatment standards under 40 CFR 403.6 and 40 CFR Chapter I, Subchapter N is a Non-Significant Categorical Industrial User rather than a Significant Industrial User in accordance with requirements and conditions established at 40 CFR 403.3(v)(2). IWCP has not implemented this provision of the streamlining regulations.

All Class 1 permittees are SIUs. Class 2 and Class 3 permittees having flows > 25,000 gpd are also SIUs (flow SIUs). Groundwater remediation sites having free product or discharging > 14,000 gpd are also SIUs. There are also Class 2 and Class 3 permittees with the potential for slug loads or high strength discharge we choose to regulate as SIUs (slug SIUs).

3.5 IDENTIFICATION OF INDUSTRIAL USERS

The City of San Diego utilizes the following methods to maintain a complete and current Industrial User Inventory, and to identify new sources or SIUs:

1. Industrial User application requests
2. Referrals from the various departments within the City of San Diego or Participating Agencies
3. County of San Diego, Business Tax License list
4. Industry contacts refer competitors

3.6 SIU PERMIT REQUIREMENTS

IWCP's SIU permits identify pollutants of concern; list prohibited discharges; specify applicable federal or local limits, standards, and requirements; require access for sampling and inspections; describe sources and volume of the authorized industrial discharge; and specify self-monitoring and reporting requirements. Permits may also establish additional requirements and compliance schedules.

The San Diego Municipal Code authorizes the Program Manager to establish local limits (see Table 3.6-1) and apply those limits in user permits. Local limits were developed to apply only to SIU facilities: they are applied such that each SIU gets the full federal allowance for applicable federally regulated pollutants and the local limit for each locally regulated pollutant that is not federally regulated and that is discharged by the facility at a concentration higher than background levels. SIU sampling and facility inspection frequencies meet or exceed the required minimum standards set by regulations and EPA Guidance. SIU permits incorporate detailed fact sheets and, when necessary, require formal Slug Discharge Control Plans.

Table 3.6-1 LOCAL CONTRIBUTORY FLOW DISCHARGE LIMITS			
Pollutant	Instantaneous	Pollutant	Daily Maximum
pH	5.0 - 12.5	Cadmium	1.0 mg/L
Flash Point	> 140 Deg F	Chromium	5.0 mg/L
Plant and Animal-based Grease and Oil	500 mg/L	Copper	11.0 mg/L
Dissolved Sulfides	1.0 mg/L	Lead	5.0 mg/L
Temperature	< 150 Deg F	Nickel	13.0 mg/L
		Zinc	24.0 mg/L
		Cyanide, Total	1.9 mg/L

Note: Local limits apply to SIU discharges where the parameter is not subject to a federal CIU pretreatment standard and sampling has demonstrated that the facility discharges the pollutant at > background concentration levels.

3.7 ACTIVE PERMITS

At the end of the year, there were 1,756 active permits in the total metropolitan service area, of which 237 were tributary to SBWRP. This included Class 1, 2, 3 permits, Trucked Waste permits, and issued Pollution Prevention Best Management Practice Discharge Authorizations; Groundwater remediation and construction/dewatering permits are classified as Class 2 and 3 and could be flow or slug potential SIUs – see list on page 3-66. The facilities classified as Class 4 and 5, did not require a permit. The inventory of permits administered by IWCP is shown in Table 3.7-1.

Year	Class 1	Class 2 ¹	Class 3 ¹	CIU Class 4C, 4Z ⁵	GW ²	BMP ³	Trucked Waste	Total Permits ⁴	Class 4, 5 ⁶
2003	58	378	30		26	1,175	82	1,723	1,527
2004	60	368	35	39	19	1,144	85	1,692	1,572
2005	51	352	43	3536	34	1,142	83	1,671	1,858
2006	50	340	35	38	30	1,123	98	1,646	1,896
2007	49	324	37	37	34	1,077	107	1,594	1,962
2008	48	299	37	37	33	1,022	113	1,519	2,088
2009	42	297	44	33	33	835	118	1,336	2,160
2010	44	292	46	35	48	922	119	1,423	2,251
2011	43	285	46	34	40	890	114	1,378	2,324
2012	42	274	45	35	43	868	120	1,349	2,378
2013	41	266	44	38	42	855	112	1,318	2,373
2014	41	260	46	40	33	804	131	1,282	2,392
2015	41	258	55	40	39	779	115	1,248	2,378
2016	40	310	54	42	39	768	151	1,323	2,369
2017	39	302	56	40	35	766	149	1,312	2,480
2018	36	297	54	43	32	759	143	1,289	2,478
2019	36	291	58	36	37	369	137	891	2,263
2020	36	307	54	35	24	913	126	1,436	2,300
2021	36	452	72	36	33	927	133	1,620	2,300
2022 ⁷	37	516	95	35 ⁷	23	952	121	1,756	2,467

¹ Class 2 and 3 permits include flow and/or slug potential SIUs, and sub-classes 2C, 2Z, 3C, and 3Z.

² Groundwater discharge permits are either Class 2 (remediation) or Class 3 (construction dewatering).

³ Class 2F, 4D, and 4M Best Management Practice (BMP) Discharge Authorizations.

⁴ Includes BMP and Trucked Waste permits, Groundwater permits are already included in Class 2 and Class 3 figures.

⁵ Facilities with categorical processes but do not discharge or do not generate wastewater from regulated operation(s); these facilities are inspected annually to confirm CIU status with no generation/ no discharge. Prior to 2019, the Class 2C/2Z and 3C/3Z facilities were previously tallied with this CIU class; however, these IUs have industrial discharges and starting in 2019 they are accounted for in classes 2 and 3, respectively.

⁶ Active facilities that are dry or have industrial flows < permitting thresholds; no permit is required.

⁷ 4C and 4Z facilities are issued permits to better establish requirements and ensure compliance. Prior to 2022 conditional permit waivers were issued to these facilities.

IWCP continues to issue temporary Batch Discharge Authorizations in lieu of full permits wherever appropriate; IWCP processed 57 of these authorizations.

3.8 SIU PERMITS

Table 3.8-1 lists the number of active CIU, and non-categorical SIU permits as of December 31 for each year. Decreases from late 1990s to 2005 were due to either closure, relocation of manufacturing operations, or installation of technology that recycled or reclaimed all wastewater, thereby resulting in zero discharge of process water by former SIUs. In 2007, IWCP established criteria for regulating groundwater remediation facilities and construction dewatering operations as SIUs due to one or more of the following concerns: toxicity, fire/explosion hazard, or hydraulic capacity in the collection system.

Table 3.8-1 SIGNIFICANT INDUSTRIAL USERS PERMITTED METROWIDE			
Year	Categorical Significant Industrial Users (CIUs)	Non-Categorical Significant Industrial Users (SIUs) ¹	Total SIUs
2003	59	19	78
2004	60	21	81
2005	51	19	70
2006	50	20	70
2007	49	25	74
2008	48	24	72
2009	42	33	75
2010	44	38	82
2011	43	37	80
2012	42	35	77
2013	41	34	75
2014	41	33	74
2015	41	41	82
2016	40	39	79
2017	39	39	78
2018	36	42	78
2019	36	50	86
2020	36	38	74
2021	36	43	79
2022	37	37	74

¹ Includes Class 2, 3, and GW SIUs

3.9 CHANGES IN SIU INVENTORY

Table 3.9-1 Changes in SIU Inventory	
FACILITIES that BECAME SIUs	See report page 3-10
SIU FACILITIES INACTIVATED	See report page 3-12
SIU FACILITIES that REPORTED a NAME CHANGE	See report page 3-13
FORMER SIU FACILITIES that BECAME NON-SIUs	See report page 3-14

3.10 BASELINE MONITORING REPORTS REQUESTED OR RECEIVED

During this calendar year two Baseline Monitoring Reports (BMRs) were received at facilities not already operating under a SIU discharge permit. Facilities discharging under a BMR are listed in the BMR report on page 3-15.

3.11 DISTRIBUTION OF PERMITS AND INDUSTRIAL FLOWS

The following table lists the distribution of permits by Class and Area¹.

Table 3.11-1 DISTRIBUTION OF PERMITS ² AND INDUSTRIAL WASTE FLOW ³ BY AREA The geographical areas are described in Table 2.1-1 and Figure 2.1-1												
Area	Class 1	IW (gpd)	Class 2, 2C, 2Z	IW (gpd)	Class 3, 3C, 3Z	IW (gpd)	Class 4C, 4Z	IW (gpd)	BMP	Total Permits & BMPs	Total (gpd)	Class 4 and 5
01	0	0	6	4,404	1	5,550	1	0	43	51	9,954	37
02	5	35,727	227	548,975	4	44,611	1	0	29	266	629,313	247
03	11	4,141	102	51,953	11	135,483	5	1	87	216	191,577	261
04	0	0	27	30,741	1	560	0	0	65	93	31,301	90
05	3	10,290	26	96,374	11	3,008,507	0	0	114	154	3,115,171	212
06	1	23,650	11	874,959	4	7,234	3	0	28	47	905,843	107
07	0	0	4	22,002	2	3,888	0	0	19	25	25,890	26
08	1	156,585	13	582,104	9	92,065	1	1	29	53	830,754	84
09	0	0	9	389,509	5	68,666	0	0	74	88	458,175	172
10	0	0	7	11,463	3	29,669	0	0	40	50	41,132	99
11	1	73,101	22	1,253,404	9	468,286	2	0	7	41	1,794,791	121
12	2	170	5	5,762	10	407,655	6	13	11	34	413,587	107
13	0	0	11	37,136	11	52,712	0	0	116	138	89,848	208
14	0	0	1	1,600	0	0	0	0	12	13	1,600	11
15	0	0	0	0	0	0	0	0	9	9	0	12
16	3	38,683	11	35,231	2	8,515	7	35	63	86	82,429	182
17	0	0	0	0	0	0	0	0	2	2	0	6
18	0	0	3	4,140	0	0	0	0	63	66	4,140	61
19	0	0	7	11,980	5	18,008	2	0	39	53	29,988	110
20	4	34,120	8	20,252	3	720	4	5	55	74	55,092	74
21	3	950	6	2,384	0	0	1	0	22	32	3,334	88
22	1	20	2	1,434	1	2,577	0	0	6	10	4,031	28
32	0	0	0	0	0	0	0	0	3	3	0	13
33	0	0	3	550	1	11,600	0	0	4	8	12,150	27
34	1	171	3	453	1	21,580	2	0	11	18	22,204	57
35	0	0	1	27	0	0	0	0	0	1	27	25
36	1	46,616	1	9,070	1	750	0	0	1	4	56,436	2
Total	37	424,224	516	3,995,907	95	4,388,636	35	55	952	1,635	8,808,767	2,467

¹ The SBWRP inventory of permits are in parts of areas 12, 13, and 36.

² Totals do not include trucked waste permits.

³ Industrial wastewater (IW) flows are not metered at all facilities. The flows reported here are based on the information available for each industry and include data from meters, calculations, and estimates.

3.12 INSPECTION AND MONITORING REQUIREMENTS

When an application for a new permit is received, a site inspection of the discharger's facility and operations is conducted to identify and characterize wastewater flows and pollutants; obtain process information; determine applicable federal pretreatment standards, if any; locate discharge points where limits apply and compliance will be determined; and communicate permit requirements, such as Standard Conditions, General and Specific Prohibitions, and site-specific sampling, analysis, and reporting requirements.

SIU permits: After a permit is issued, the IWCP sampling workgroup makes periodic unannounced site visits to collect samples of the permittee's discharge over a 24-hour period, using automatic samplers; grab samples are collected to determine compliance with discharge standards for grease and oil, total toxic organics, cyanide, and pH. Samples are collected, preserved, and analyzed in accordance with requirements set forth at 40 CFR Part 136. Analytical results are used to determine compliance status, identify operational and housekeeping problems, and evaluate effectiveness of pretreatment equipment. Annual inspections are performed at all SIU facilities to evaluate on-going process and pretreatment operations and maintenance, identify operational changes requiring a permit amendment, evaluate the need for a slug control plan, and maintain the industry's awareness of permit requirements. SIUs also have self-monitoring (sampling and analysis) and reporting requirements as conditions of their permits.

Non-SIU permits: Permits include local limits or best management practices and semi-annual certification requirements. Sampling and analyses are performed to determine compliance with limits.

3.13 INDUSTRIAL WASTE SAMPLING AND ANALYTICAL SERVICES

In addition to industry monitoring, the City's EMTS Division sampling and laboratory services sections continue to:

- Conduct quarterly collection system sampling and analyses to provide data for the reevaluation of the local limits
- Conduct quarterly sampling and analyses of wastewater from the Participating Agencies to determine their respective sewage-strength contributions for billing purposes
- Conduct monitoring of trucked liquid waste discharges during open hours (72 hours/week) at Pump Station 1 (PS1)

3.14 SUMMARY OF SAMPLING AND INSPECTION STATISTICS

EMTS Sampling and laboratory services performed for industrial facilities included unannounced sampling visits, collecting samples, and performing pollutant analyses. Inspections and site assessments included tasks such as: initial inspections, annual inspections, renewal inspections, billing surcharge inspections, complaint investigations, rainwater diversion inspections, stormwater inspections, compliance inspections, site closure/permit inactivation assessments, and batch discharge site assessments. The sampling and inspection statistics for the last 10 years are presented in the table below.

Table 3.14-1
SUMMARY OF ROUTINE SAMPLING, CERTIFICATION AND INSPECTIONS

Action / Year	2013	2014	2015	2016	2017	2018	2019	2020	2021	2022
Facility inspections & site assessments	611	545	595	495	343	367	623	2,209	5,486	6,400
Unscheduled sampling events	2,241	2,050	1,597	1,736	1,587	1,458	1,391	950	1,042	1,415
IWCP Lab samples collected	5,100	4,639	3,826	3,948	3,812	3,686	3,437	2,419	2,537	3,441
IWCP Lab analyses performed	18,543	18,538	16,849	9,886	16,161	16,258	15,752	9,035	7,361	15,934
Self-Monitoring samples	2,880	2,643	2,547	2,535	2,791	2,847	2,842	2,471	2,278	2,266
Self-certifications	1,039	946	978	1,033	1,180	1,197	1,117	909	1,021	1,856
Self-Monitoring analyses and data evaluated by IWCP	12,961	12,245	12,127	11,637	12,335	13,217	13,128	13,054	12,194	12,359

3.15 TRUCKED WASTE PERMITS

Industrial trucked wastes originate from sources such as landfill leachate/condensate, dewatering of grease trap wastes, ship maintenance and repair, and private treatment system sludge disposal. The generator of the waste stream is permitted as an Industrial Trucked Waste Generator, and contracted haulers are permitted as Industrial Trucked Waste Haulers. Domestic wastes originate from portable toilets (construction sites, public events), sewage holding tanks, and septic tanks (non-sewered residences). Domestic Waste Hauler permits are issued to these haulers. The designated discharge point to the POTW for all hauled wastes is at PS1 on Harbor Drive. The total number of permits issued this year, the business names and type of permit are listed on page 3-61.

Approximately 60 million gallons of domestic and industrial wastes are received annually at PS1 from trucked waste haulers. Grease trap water was received after separation of grease, solids, and oils; this volume is decreasing as facilities that treat grease trap wastes are gaining sewer access, where they directly discharge to the collection system sewer instead of hauling the waste streams via trucks to PS1. Sludge and high strength waste streams were received from landfills, other POTWs, water treatment plants, and Indian reservations. All truckloads are logged in at the pump station and monthly billings are prepared by IWCP staff to recover costs of treatment and disposal. Monthly volumes of trucked wastes received at PS1 during the period covered in this report are shown in Trucked Waste Discharge totals per month and Trucked Industrial Discharge totals per month by Type are shown on pages 3-64 and 3-65, respectively.

In addition to the hauled liquid wastes received at PS1, approximately 17.2 million gallons of hauled domestic wastes were received by the El Cajon Department of Public Works.

Facilities Discharging to Treatment Plant that became SIUs in 2022

Report run on: Monday, February 13, 2023 5:40 pm

Page 1

Class 2

Facility	Permit	Name	Pmt Iss Dt	Comments
09-0048	02-A	Zoological Society of San Diego	31-Aug-2022	C2 flow SIU; IWW from cage/enclosure washing, pool O&M, vehicle washing, hospital lab and laundry. Att-Cs require flow proportioned meter at 100 with calibration log, ext drain study, habitat area and SW run-on maps. Insp month now Feb. rad/jas
20-0306	01-B	UT; SDG&E L1600 Replacement	25-May-2022	C2 flow and slug SIU. M SM for meter read/dates, IF, FRs, & auto shutdown rpt. Q SM for bzn, BTEX, TPH/O&G, flash, TCE, PCE. Q PM for same pollutants plus TDS & Mn due to NCWRP. Conn 200 M SM for meter reads/dates and flow rates.
20-0306	01-A	UT; SDG&E L1600 Replacement	27-Jan-2022	C2 flow and slug SIU. M SM for meter read/dates, IF, FRs, & auto shutdown rpt. Q SM for bzn, BTEX, TPH/O&G, flash, TCE, PCE. Q PM for same pollutants plus TDS & Mn due to NCWRP. jas
08-0659	01-A	UT; San Diego Int'l Airport Shuttle Lot	19-Jul-2022	C2 GW; M SM for meter reads, imp flow, max/min FRs, and COD/TSS; Q SM and PM for flash, O/G, TPH, Bzn, & BTEX; Min/max flow rate: 1-100 gpm. bdi
11-0629	01-A	UT; Michels Construction Inc	13-Dec-2022	C3 GW flow SIU with M SM for MRs, IF, max/min FRs, COD, TSS, FP, Bzn, BTEX, TPH, and lead. Q PM for same, except Pet HC & overview Mn -bdi Issued 13 Dec 2022. jas

Class count: 5

Class 3

Facility	Permit	Name	Pmt Iss Dt	Comments
05-1357	01-A	UT; Flatiron West Inc	03-Aug-2022	C3 flow SIU GW w/settling only as no POCs. M SM for meter reads, IF, max/min FRs, COD, and TSS. Q PM for COD, TSS & overview Mn -bdi 10 Oct 2022: Paper amended for new higher rate flow meter. jas
12-0333	01-A	UT; Dudek	01-Jul-2022	C3 GW flow SIU w/settling only as no POCs. M SM for meter reads, IF, max/min FRs, COD and TSS. Q PM for pollutants. jas
05-1353	01-A	UT; Flatiron West Inc	16-Aug-2022	C3 GW flow SIU w/settling. M SM for MRs, IF, max/min FRs, COD, TSS, and (precautionary for) Flash, Bzn, BTEX, & TPH. Q PM for COD, TSS, Bzn, BTEX, TPH & overview Mn -bdi
05-1352	01-B	UT; Flatiron West Inc	25-May-2022	C3 flow SIU GW w/settling only as no POCs. Meter changed and permit amended to increase flow rates. M SM for meter reads, IF, max/min FRs, COD, and TSS. Q PM for COD & TSS. - bdi/jas
05-1358	01-A	UT; Fairfield Development LP	11-Aug-2022	C3 GW flow SIU w/settling only as no POCs. M SM for meter reads, IF, max/min FRs, COD, and TSS. Q PM for COD & TSS. jas
08-0603	01-A	Conrac Managers SAN LLC	01-Jul-2022	C3 flow SIU performing exterior car washing. Q SM/PM for COD, TSS, and O&G and A SM to submit clarifier cleaning receipts. Att-C requires meter for flow proportioned monitoring.. rad/jas

Facilities Discharging to Treatment Plant that became SIUs in 2022

Report run on: Monday, February 13, 2023 5:40 pm

Page 2

Class **3**

<i>Facility</i>	<i>Permit</i>	<i>Name</i>	<i>Pmt Iss Dt</i>	<i>Comments</i>
05-1352	01-A	UT; Flatiron West Inc	10-Feb-2022	C3 flow SIU GW w/settling only as no POCs. M SM for meter reads, IF, max/min FRs, COD, and TSS. Q PM for COD & TSS. -bdi/jas
13-0553	01-A	AQX2 Inc DBA Aqua Clean Express	01-Jun-2022	C3 car wash discharging > 25,000 gpd. Q SM for COD, TSS, and flow reporting @ C110; Q PM for COD, TSS, and pH @ C110 and sump inspections @C111. Issued 03 May 2022. jas

Class count: **8**

Total count: **13**

SIU Permits Discharging to Treatment Plant Inactivated in 2022

Report run on: Monday, February 13, 2023 5:36 pm

Page 1

Class 2

Facility	Permit	Name	Pmt Inact Dt	Reason
08-0659	01-A	UT; San Diego Int'l Airport Shuttle Lot	02-Sep-2022	Project complete
13-0454	07-C	UT; Innovative Environmental Solutions	03-Feb-2022	OOB
16-0565	12-A	UT; Thrifty Oil Company # 043	27-Sep-2022	OOB
03-1526	01-A	UT; SDGE L1600 Dewater	18-Jul-2022	Work complete
20-0306	01-B	UT; SDG&E L1600 Replacement	27-Jul-2022	project complete
20-0306	01-A	UT; SDG&E L1600 Replacement	24-May-2022	
04-0569	01-B	UT; SC Valley Engineering Inc	31-May-2022	OOB
09-1018	01-B	UT; Holland Partner Group	20-Mar-2022	
08-0600	06-B	UT; Granite Construction Company	22-Jun-2022	OOB

Class count: 8

Class 3

Facility	Permit	Name	Pmt Inact Dt	Reason
12-0333	01-A	UT; Dudek	02-Sep-2022	Project complete
20-0304	01-A	UT; Blue Pacific Engineering and Construction	12-Jan-2022	OOB
33-0077	01-A	UT; Granite Construction - Lindo Lake Project	05-Apr-2022	OOB
05-1250	03-A	UT; 7510 Hazard LLC	31-Mar-2022	
11-0609	01-A	UT; Blue Pacific Engineering and Construction	04-Jan-2022	OOB
08-0658	01-A	UT; Dick Miller Inc	02-Sep-2022	Incorrect IU# for this address, facility also inactivated
08-0649	01-A	UT; Burns & McDonnell	03-Feb-2022	OOB
05-1351	01-A	UT; Flatiron West Inc	27-Jul-2022	project complete
33-0077	01-B	UT; Granite Construction - Lindo Lake Project	05-Apr-2022	OOB
03-1537	01-A	UT; Lennar	05-Apr-2022	OOB

Class count: 10

Total count: 18

SIUs Discharging to Treatment Plant with Name Change in 2022

Report run on: Tuesday, January 3, 2023 9:12 am

Page 1

Class **2**

<i>Facility</i>	<i>Pmt</i>	<i>Name</i>	<i>Pmt Iss Dt</i>	<i>Prior Name</i>
13-0530	02-A	UT; ETIC Engineering Inc	01-May-2022	UT; ExxonMobil Oil Corporation c/o ETIC

Class count: **1**

Class **3**

<i>Facility</i>	<i>Pmt</i>	<i>Name</i>	<i>Pmt Iss Dt</i>	<i>Prior Name</i>
12-0065	06-A	Emerald Textiles LLC	01-Oct-2022	Emerald Textiles Services San Diego LLC

Class count: **1**

Total count: **2**

SIUs Discharging to Treatment Plant that became NonSIUs in 2022

Report run on: Monday, February 13, 2023 5:46 pm

Page 1

Class 1

<i>Facility</i>	<i>Permit</i>	<i>Name</i>	<i>Pmt Inact Dt</i>	<i>Reason</i>
21-0331	03-A	Coating Services Group LLC	05-May-2022	Core (etching) operation discontinued

Class count: 1

Class 2

<i>Facility</i>	<i>Permit</i>	<i>Name</i>	<i>Pmt Inact Dt</i>	<i>Reason</i>
09-1013	03-A	UT; IQHQ RaDD I LLC	13-Feb-2022	Flow decreased to > 25,000 gpd

Class count: 1

Class 3

<i>Facility</i>	<i>Permit</i>	<i>Name</i>	<i>Pmt Inact Dt</i>	<i>Reason</i>
05-1250	03-A	UT; 7510 Hazard LLC	31-Mar-2022	Flow decreased to < 25,000 gpd
03-0966	04-A	WC IPA LLC	27-Feb-2022	OOB
10-0597	01-A	UT; Orion Construction Corporation	05-May-2022	Flow decreased to < 25,000 gpd

Class count: 3

Total count: 5

SIUs that are discharging under a BMR

Report run on: Tuesday, January 3, 2023 8:56 am

Page 1

<i>Name</i>	<i>Facility</i>	<i>BMR Received</i>	<i>Required</i>
AP Precision Metals	12-0144	17-Apr-2001	Y
ATK Space Systems Inc	03-0115	01-Dec-1992	Y
Action Powder Coating LLC	03-0717	21-Sep-1993	Y
Ajinomoto Althea Inc	02-0722	26-Oct-2022	Y
		16-Oct-2003	Y
		09-Mar-2004	Y
		23-Apr-2002	Y
Alphacoat Finishing LLC	03-0920	20-Jan-1999	Y
Anocote Metal Finishing Inc	03-1017	02-Sep-2004	Y
Chromalloy San Diego	05-0985	14-Dec-2009	Y
		07-Dec-2011	Y
Compucraft Industries Inc	21-0252	07-Sep-2001	Y
Creative Metal Industries	21-0248	22-Aug-2000	Y
Cue Health Inc	03-0801	22-Jan-2021	Y
Defender SD Manufacturing LLC	02-0439	06-Oct-2021	Y
		10-Feb-2010	Y
GKN Aerospace Chem-tronics Inc	16-0520	03-Dec-1992	Y
Garvin Industries	16-0033	23-Nov-2001	Y
General Dynamics NASSCO	11-0051	03-Dec-1992	Y
Golden State Metal Finishing	34-0070	26-Jan-2005	Y
Harcon Precision Metals Inc	12-0244	17-Jun-2010	Y
IriSys LLC	03-0779	17-Apr-2015	Y
K-Tube Corporation	20-0122	07-Jan-2006	Y
Kraft Heinz Foods Company	12-0154	30-Aug-2002	N
Kyocera International Inc	06-0058	12-Nov-1992	Y
L & T Precision Corporation	20-0109	21-Jun-2002	Y
Otay Mesa Energy Center LLC	36-0001	12-Mar-2007	Y
		20-Jun-2007	Y
Pacira Pharmaceuticals Inc	02-0762	26-Jul-2004	Y
		23-Jul-1997	Y
PolyPeptide Laboratories San Diego	03-1024	09-Apr-2002	Y
Somacis Inc	20-0043	09-Jun-1997	Y
Stallergenes Greer dba Allermed Laboratories Inc	05-0684	13-Nov-1992	Y
Suneva Medical Inc	02-0518	02-Sep-2005	Y
TTM Technologies Inc - San Diego Division	05-0997	22-Feb-1982	Y
The Argen Corporation	02-0582	30-Nov-1992	Y
USN;Naval Base Coronado - NASNI	08-0018	30-Nov-1992	Y
Valley Metals	20-0108	19-Nov-1998	Y
Valley Powder Coating Inc	22-0092	31-May-2021	Y
Veridiam Inc	16-0348	01-Feb-2000	Y
nVent - Schroff Inc	03-1203	12-Oct-2018	Y
Count:	34		

SIU Facilities Federal Category, Process, and Pretreatment Technology by Connection

Report run on: Tuesday, January 3, 2023 9:11 am

Page 1

<i>Facility Permit</i>	<i>Name</i>	<i>IW Discharged</i>	<i>Conn</i>	<i>Principle Process</i>	<i>Federal/</i>	<i>CFR</i>	<i>CFR</i>	<i>Order</i>	<i>Pre Treat</i>
		<i>(gpd)</i>			<i>Local</i>	<i>Part</i>	<i>Section</i>		<i>Code</i>
02-0112 07-A	University of California San Diego	174,800	100	Overview - Muir & Revelle colleges	Local	132		1	HAUL
								2	SOURCE
								3	1CRC
								4	DIVRTA
			200	Overview - medical school	Local	132		1	HAUL
								2	SOURCE
								3	1CRC
			300	Overview - northeast campus	Local	132		1	HAUL
								2	SOURCE
								3	1CRC
								4	DIVRTA
			500	Stein clinical sciences	Local	132		1	HAUL
								2	SOURCE
								3	1CRC
			600	Overview - northwest campus	Local			1	HAUL
								2	SOURCE
02-0332 07-A	Pall Filtration & Separations Group Inc	50,550	100	Lateral	Local			1	SOURCE
			110	Membrane mfg	Local			1	SOURCE
02-0439 04-A	Defender SD Manufacturing LLC	254	100	Industrial and sanitary	Federal	439	.46	1	SOURCE
								2	HAUL
02-0518 07-A	Suneva Medical Inc	770	100	Lateral	Local			1	SOURCE
								2	HAUL
								3	PH
			110	Pharmaceutical manufacturing	Federal	439	.47	1	SOURCE
						439	.27	2	HAUL
								3	PH
02-0582 07-A	The Argen Corporation	110	100	Sewer Lateral	Local				
			110	Precious Metals Forming	Federal	471	.45	1	SETTLE
								2	PH
								3	FILT-O
								4	ADS-C
								5	IX
			130	Ti anodizing - Zero generation	Local				
02-0722 09-A	Ajinomoto Althea Inc	1,694	100	Industrial and sanitary	Local			1	SOURCE
								2	BIOKIL
								3	HAUL
								4	OZONE
			110	Botox mixing/compounding and formulation	Federal	439	.47	1	SOURCE
								2	OZONE
								3	HAUL

SIU Facilities Federal Category, Process, and Pretreatment Technology by Connection

Report run on: Tuesday, January 3, 2023 9:11 am

Page 2

<i>Facility Permit</i>	<i>Name</i>	<i>IW Discharged (gpd)</i>	<i>Conn</i>	<i>Principle Process</i>	<i>Federal/ Local</i>	<i>CFR Part</i>	<i>CFR Section</i>	<i>Order</i>	<i>Pre Treat Code</i>
02-0762 06-A	Pacira Pharmaceuticals Inc	32,690	100	Building 1 lateral	Local			1	SOURCE
			110	Pharmaceutical mfg	Federal	439	.47	1	SPAR-A
								2	PH
								3	ADS-R
								4	STRP-S
03-0115 07-A	ATK Space Systems Inc	190	100	Bulidings 2 and 3	Local	132		1	RECYL
								2	HAUL
								3	SOURCE
			410	Abrasive Jet Machining	Federal	433	.17	1	CENT
								2	UF
03-0270 05-A	Ballast Point Brewery Miramar	46,600	100	Brewery	Local			1	SCREEN
								2	SETTLE
								3	PH
03-0347 05-B	Sungear	20	100	Sanitary and industrial	Local			1	SOURCE
								2	HAUL
			110	Etching rinses	Federal	433	.17	1	PH
								2	SOURCE
								3	HAUL
03-0717 09-A	Action Powder Coating LLC	1,500	110	Coating / cleaning	Federal	433	.17	1	EQUAL
								2	SETTLE
03-0779 05-A	IriSys LLC	285	100	Sanitary & industrial WW	Local	439	.47	1	SOURCE
			110	Elixir tank cleaning	Federal	439	.47	1	HAUL
			120	CIP of the tablet formulation equipment	Federal	439	.47	1	HAUL
			130	Small scale manufacturing	Local	439	.47	1	HAUL
			140	Compounding/mixing and formulation	Federal			1	HAUL
								2	SOURCE
03-0801 04-A	Cue Health Inc	125	100	Industrial & sanitary	Local			1	HAUL
								2	SOURCE
								3	EVAP
								4	RECYL
			110	Automation cell sanitation	Federal	433	.17	1	SOURCE
03-0920 07-A	Alphacoat Finishing LLC	375	110	Anodize, etch, and passivation	Federal	433	.17	1	PH
								2	BATCH
								3	P&S
			120	Chemfilm, dichromate seal, passivation	Federal	433	.17	1	PH
								2	BATCH
								3	P&S
								4	CR
								5	SD-FP
03-1017 04-A	Anocote Metal Finishing Inc	110	110	Etch, anodize, and cleaning rinses	Federal	433	.17	1	PH

SIU Facilities Federal Category, Process, and Pretreatment Technology by Connection

Report run on: Tuesday, January 3, 2023 9:11 am

Page 3

<i>Facility Permit</i>	<i>Name</i>	<i>IW Discharged (gpd)</i>	<i>Conn</i>	<i>Principle Process</i>	<i>Federal/ Local</i>	<i>CFR Part</i>	<i>CFR Section</i>	<i>Order</i>	<i>Pre Treat Code</i>
03-1017 04-A	Anocote Metal Finishing Inc	110	110					2	EQUAL
03-1024 02-A	PolyPeptide Laboratories San Diego	800	100	Industrial and sanitary	Local			1	SOURCE
			110	Labware cleaning - Angiotensin II mfrg	Federal	439	.37	2	HAUL
03-1070 05-A	Johnson Matthey Medical Products	245	100	Building 1 sewer lateral	Local			1	SOURCE
			110	Parts cleaning, tumbling	Federal	433	.17	2	HAUL
								1	SETTLE
								2	ELBOW
								3	SOURCE
								4	HAUL
			200	Building 2 sewer lateral	Local			1	SOURCE
								2	HAUL
03-1203 02-A	nVent - Schroff Inc	352	100	Industrial and sanitary	Local	132		3	SETTLE
			110	Tumble deburring	Federal	433	.17	2	SOURCE
								1	SOURCE
			130	Machining (coolant), heat treat (quench)	Local	433	.17	2	FILT-O
03-1300 03-A	JDZ Inc DBA AleSmith Brewing Company	10,200	110	Brewery	Local			1	HAUL
								2	SETTLE
03-1338 03-A	Saint Archer Brewing Company	14,000	110	Brewery	Local			3	SCREEN
								2	PH
03-1380 02-A	Santier Inc	139	110	Metal Finishing / Surface Treatment	Federal	433	.17	1	SETTLE
						471	.45	2	SCREEN
						471	.55	3	PH
								4	BATCH
								5	P&S
								6	COAG
								7	FLOC
								8	SD-FP
								9	FILT
								10	EVAP
05-0684 07-A	Stallergenes Greer dba Allermed Laboratories Inc	60	130	Wash/sterilize glassware	Federal	439	.26		HAUL
			140	Glassware/equip wash	Federal	439	.26		IX
			150	Media prep/tube wash	Federal	439	.26		EW
05-0985 06-A	Chromalloy San Diego	130	130	Fluorescent penetrant inspection (FPI)	Federal	433	.17		
05-0997 06-A	TTM Technologies Inc - San Diego Division	10,100	220	PCB Manufacturing	Federal	433	.17	1	BATCH
								2	IX
								3	EW

SIU Facilities Federal Category, Process, and Pretreatment Technology by Connection

Report run on: Tuesday, January 3, 2023 9:11 am

Page 4

<i>Facility Permit</i>	<i>Name</i>	<i>IW Discharged</i>	<i>Conn</i>	<i>Principle Process</i>	<i>Federal/</i>	<i>CFR</i>	<i>CFR</i>	<i>Order</i>	<i>Pre Treat</i>
		<i>(gpd)</i>			<i>Local</i>	<i>Part</i>	<i>Section</i>		<i>Code</i>
05-0997 06-A	TTM Technologies Inc - San Diego Division	10,100	220					4	EQUAL
			221	Gold Electro Plating	Federal	433	.17	5	PH
			222	Immersion Gold	Federal	433	.17	1	REC
			230	Film Developing	Local	130		2	IX
05-1019 06-B	USN;Marine Corps Air Station Miramar	22,400	100	Sanitary & Aircraft maintenance	Local	120		1	REC
						132		2	IX
								1	HAUL
05-1352 01-B	UT; Flatiron West Inc	2,500,000	100	Construction dewatering	Local	101		1	DIVRTA
								2	ELBOW
05-1353 01-A	UT; Flatiron West Inc	216,000	100	Construction dewatering	Local	101		3	SETTLE
								4	HAUL
05-1357 01-A	UT; Flatiron West Inc	216,000	100	Construction dewatering	Local	101		5	SOURCE
								1	SETTLE
05-1358 01-A	UT; Fairfield Development LP	43,200	100	Construction dewatering	Local	101		2	FILT-O
								1	SETTLE
06-0058 07-A	Kyocera International Inc	23,650	130	Ni plating, cleaning	Federal	433	.17	2	FILT-O
								1	FLOC
								2	THCK-G
								3	SD-FP
								4	FILT
								5	PH
			131	Au plating	Federal	433	.17	6	UF
								1	CN
								2	PH
06-0414 03-B	UT; SDSU Mission Valley Site Development	864,000	100	Construction dewatering	Local	101		3	FLOC
			200	Construction dewatering	Local	101		1	SETTLE
								2	FILT-O
								3	ADS-C
08-0008 07-A	UT; USN NBPL Defense Fuel Support Point	54,000	210	Fuel recovery	Local	101		1	SETTLE
								2	O/W
								3	DAF+C
			220	Groundwater remediation	Local	101		1	EQUAL
								2	O/W
								3	SAND

SIU Facilities Federal Category, Process, and Pretreatment Technology by Connection

Report run on: Tuesday, January 3, 2023 9:11 am

Page 5

<i>Facility Permit</i>	<i>Name</i>	<i>IW Discharged</i>	<i>Conn</i>	<i>Principle Process</i>	<i>Federal/</i>	<i>CFR</i>	<i>CFR</i>	<i>Order</i>	<i>Pre Treat</i>
		<i>(gpd)</i>			<i>Local</i>	<i>Part</i>	<i>Section</i>		<i>Code</i>
08-0008 07-A	UT; USN NBPL Defense Fuel Support Point	54,000	220					4 5	FILT-O RO
08-0018 07-A	USN;Naval Base Coronado - NASNI	156,585	100 120	NASNI pump station IWTP	Local Federal	433	.17	1 2 3 4 5 6 7 8 9	BATCH CHOX-O CR P&S PH SAND ADS-C SD-BF HAUL
			123	IWTP CN treatment	Federal	433	.17	1	CN
			140	Engine test cell cleaning	Federal	433	.15	1	ELBOW
			150	Oil recovery plant	Federal	433	.17	1 2 3 4 5	EQUAL O/W PPT DAF SD-FP
			160	Hydrostatic testing	Federal	433	.15		
			180	Pump/valve/hose testing	Federal	433	.17		
			190	Aircraft test pad cleaning	Federal	433	.15	1	O/W
			799	Contaminated stormwater	Local			1	ELBOW
08-0603 01-A	Conrac Managers SAN LLC	48,120	110	Car washing	Local	131		1 2 3	SETTLE ELBOW HAUL
09-0001 07-A	Alsco Inc	37,334	100	Commercial Laundry	Local	133		1 2 3 4	SETTLE EQUAL SCREEN ELBOW
09-0048 02-A	Zoological Society of San Diego	302,030	100	Zoo main section	Local			1 2 3	SCREEN SETTLE EQUAL
			200	Hospital	Local			1	SOURCE
09-0947 02-A	UT; Arcadis US Inc	22,000	100	GW construction w/contamination	Local	101		1 2 3 4 5	SETTLE FILT-O ADS-R EVAP HAUL

SIU Facilities Federal Category, Process, and Pretreatment Technology by Connection

Report run on: Tuesday, January 3, 2023 9:11 am

Page 6

<i>Facility Permit</i>	<i>Name</i>	<i>IW Discharged (gpd)</i>	<i>Conn</i>	<i>Principle Process</i>	<i>Federal/ Local</i>	<i>CFR Part</i>	<i>CFR Section</i>	<i>Order</i>	<i>Pre Treat Code</i>
09-0947 02-A	UT; Arcadis US Inc	22,000	100					6	ADS-C
			110	Opt/Amb regeneration	Local	101		1	EVAP
								2	COOL
								3	HAUL
								4	ADS-C
11-0016 06-B	USN;Naval Base San Diego	14,587	100	USN8 SWW: Piers 6, 7, 8 & Mole Pier	Local	134			
			200	Medical/Dental Clinics, Gym	Local				
			300	Auto Hobby Shop	Local			1	ELBOW
								2	SETTLE
								3	HAUL
			400	Vehicle Maint	Local			1	ELBOW
								2	RECYL
								3	HOLD
								4	HAUL
			500	Steam Clean, Hydrotest, Hydroblast	Local			1	ELBOW
								2	SETTLE
								3	HAUL
			600	NEX Car Wash; Engine cleaning	Local			1	ELBOW
								2	SETTLE
								3	HAUL
			799	Vault dewatering	Local				
			810	USN6 SWW: Piers 1 & 2, Quay Wall	Local	134			
			820	USN7 SWW: Piers 3, 4, 5, Graving Dock	Local	134		1	HOLD
			830	NC4M SWW: Piers 10, 12, 13	Local	134			
			850	Bilge and Oily Waste Treatment	Local	134		1	SCREEN
								2	EQUAL
								3	O/W
								4	PLATE
								5	PPT
								6	DAF
								7	THCK-G
								8	SD-FP
								9	HAUL
			900	Fire Fighting School	Local			1	SAND
11-0051 07-A	General Dynamics NASSCO	73,101	200	Bilge/Ballast/New Construction	Local			1	SETTLE
								2	O/W
			300	Overview - West End of Yard	Local				
			310	WWTF Effluent	Federal	433	.17	1	O/W
								2	PH

SIU Facilities Federal Category, Process, and Pretreatment Technology by Connection

Report run on: Tuesday, January 3, 2023 9:11 am

Page 7

<i>Facility Permit</i>	<i>Name</i>	<i>IW Discharged (gpd)</i>	<i>Conn</i>	<i>Principle Process</i>	<i>Federal/ Local</i>	<i>CFR Part</i>	<i>CFR Section</i>	<i>Order</i>	<i>Pre Treat Code</i>
11-0051 07-A	General Dynamics NASSCO	73,101	310					3	DAF
								4	COAG
								5	SD-FP
								6	HAUL
			600	Overview - East End of Yard	Local				
			620	VTC Separator	Local			1	SETTLE
								2	O/W
			798	Stormwater	Local				
			799	Seawater	Local				
11-0189 07-A	Cintas Corporation	32,286	110	Industrial Laundering	Local	133		1	SD-FP
								2	O/W
								3	SETTLE
								5	PH
								6	HAUL
11-0321 04-A	Star Laundry Services	38,970	100	Commercial Laundry	Local	133		1	NONE
11-0398 08-A	Unifirst Corporation	25,535	110	Industrial laundry	Local	133		1	SCREEN
								2	SETTLE
								3	LINT
								4	DAF
								5	PH
								6	HAUL
11-0444 06-A	CP Kelco	452,488	430	R&D Pilot Plant	Local	199		1	EQUAL
								2	PH
			799	Storm Water	Local				
			800	Kelco SBP & Cogen Plant processe	Local			1	PH
								2	EQUAL
11-0534 04-A	UT; City of San Diego - Storm	400,960	100	western lateral	Local	101		1	EQUAL
	Water Division		200	eastern lateral	Local	101		1	EQUAL
11-0629 01-A	UT; Michels Construction Inc	662,400	100	Construction dewatering	Local	101		1	SETTLE
								2	FILT-O
								3	ADS-C
			200	Construction dewatering	Local	101		1	SETTLE
								2	FILT-O
								3	ADS-C
			300	Construction dewatering	Local	101		1	SETTLE
								2	FILT-O
								3	ADS-C
12-0038 06-A	RJ Donovan Correctional Facility	13,700	100	Prison Sewer Main	Local	133		1	GRIND
								2	SCREEN
								3	SOURCE

SIU Facilities Federal Category, Process, and Pretreatment Technology by Connection

Report run on: Tuesday, January 3, 2023 9:11 am

Page 8

<i>Facility Permit</i>	<i>Name</i>	<i>IW Discharged (gpd)</i>	<i>Conn</i>	<i>Principle Process</i>	<i>Federal/ Local</i>	<i>CFR Part</i>	<i>CFR Section</i>	<i>Order</i>	<i>Pre Treat Code</i>
12-0065 06-A	Emerald Textiles Services San Diego LLC	100,390	110	Commercial laundry	Local	133		1 2 3 4 5	LINT SETTLE UF RECYL HAUL
12-0144 06-A	AP Precision Metals	100	110	Metal coating (iron phosphating)	Federal	433	.17	1 2 3	FILT-O SETTLE PH
12-0154 05-A	Kraft Heinz Foods Company	102,142	110	Food Manufacturing	Local	137		1 2 3 4 5	EQUAL SCREEN DAF+C GREASE HAUL
12-0212 03-A	Tarantino Wholesale Food Distributor	14,565	100	Lateral	Local	137		1 2 3	SETTLE SCREEN HAUL
			210	Sausage manufacturing	Local	137		1 2 3	SETTLE HAUL ELBOW
12-0220 06-A	Ajinomoto Foods North America Inc	83,300	110	Food manufacturing	Local	137		1 2 3 4	EQUAL SCREEN DAF+C HAUL
12-0244 03-A	Harcon Precision Metals Inc	70	110	Conversion coating & assoc processes	Federal	433	.17	1 2 3 4 5	PH MIXER SETTLE HAUL EVAP
12-0275 04-A	Jensen Meat Company Inc	32,300	110	Meat processing, cleaning/sanitizing	Local	137		1 2 3 4 5	SCREEN ELBOW SETTLE HAUL DIVRTA
12-0283 03-A	Spectex Inc dba Specialty Textile Services	47,853	110	Commerical Laundry	Local	133		1 2 3 4	SETTLE LINT UF HAUL
12-0285 03-A	US General Services Administration - SYLPOE	50	110	Waste activated sludge	Local			1 2 3	SCREEN EQUAL BIO-AS
			120	Untreated wastewater	Local			1	SCREEN

SIU Facilities Federal Category, Process, and Pretreatment Technology by Connection

Report run on: Tuesday, January 3, 2023 9:11 am

Page 9

<i>Facility Permit</i>	<i>Name</i>	<i>IW Discharged (gpd)</i>	<i>Conn</i>	<i>Principle Process</i>	<i>Federal/ Local</i>	<i>CFR Part</i>	<i>CFR Section</i>	<i>Order</i>	<i>Pre Treat Code</i>
12-0285 03-A	US General Services Administration - SYLPOE	50	130	Treated wastewater	Local			1 2 3 4 5 6 7	SCREEN EQUAL BIO-AS UF UV HAUL OZONE
13-0530 02-A	UT; ExxonMobil Oil Corporation c/o ETIC	14,400	100	Groundwater remediation	Local	101		1 2 3 4 5	O/W SETTLE FILT-O ADS-C HAUL
13-0549 03-A	UT; Brenntag Pacific Inc	10,080	100	Groundwater remediation	Local	101		1 2 3 4 5 6	O/W SETTLE CENT BIO+O2 FILT-O ADS-C
13-0553 01-A	AQX2 Inc DBA Aqua Clean Express	28,900	110 111	Car wash (sampling point) Car wash (inspect clarifier)	Local Local	131 131		1 2 3 4	SETTLE ELBOW RECYL SETTLE ELBOW HAUL
16-0033 07-A	Garvin Industries	75	110	Cleaning / iron phosphating / sealing	Federal	433	.17	1 2 3	PH SETTLE HAUL
16-0348 05-A	Veridiam Inc	2,378	110	Metal Forming/Cleaning	Federal	433 471 433 471 471 468	.15 .35 .17 .65 .95 .15	1 2 3 4 5 6 7	EQUAL PH P&S SD-FP RECYL BATCH HAUL
16-0520 06-B	GKN Aerospace Chem-tronics Inc	36,230	120 110	X-ray Processing MF and associated operations	Local Federal	130 433 433 130		1 2 3 4 5	ERU+2 EQUAL FLOC P&S PH HAUL
			210	MF and associated operations	Federal	433	.15	1	EQUAL

SIU Facilities Federal Category, Process, and Pretreatment Technology by Connection

Report run on: Tuesday, January 3, 2023 9:11 am

Page 10

<i>Facility Permit</i>	<i>Name</i>	<i>IW Discharged (gpd)</i>	<i>Conn</i>	<i>Principle Process</i>	<i>Federal/ Local</i>	<i>CFR Part</i>	<i>CFR Section</i>	<i>Order</i>	<i>Pre Treat Code</i>
16-0520 06-B	GKN Aerospace Chem-tronics Inc	36,230	210			433	.17	4	PH
			410	Chembrite rinses & labs	Federal	433	.17	1	PH
			420	Steam cleaning and hydrotesting	Federal	433	.17	1	SETTLE
								2	ELBOW
			430	X-ray processing	Local	130		1	RECOV
			450	Steam clean, dye pen testing	Federal	433	.17	1	ELBOW
			460	Dye penetrant testing	Federal	433	.17	1	ELBOW
			510	Dye penetrant testing	Federal	433	.17	1	ELBOW
			610	Dye penetrant testing	Federal	433	.17		
16-0785 06-A	UT; Ametek Inc	29,100	100	Groundwater remediation	Local	101		1	EQUAL
								2	STRP-A
								3	UV
								4	SETTLE
								5	FILT-O
								6	ADS-C
20-0043 07-A	Somacis Inc	32,108	110	PCB mfg	Federal	433	.17	1	IX
								2	EW
								3	BATCH
								4	RECYL
								5	PH
								6	FLOC
								7	FILT-O
								8	SD-FP
								9	HAUL
			111	immersion gold plating	Federal	433	.17	1	RECOV
								2	CN
			112	immersion gold plating final rinse	Federal	433	.17	1	RECYL
20-0108 06-A	Valley Metals	897	110	Metal forming/finishing	Federal	433	.17	1	UF
						471	.65	2	FILT
						471	.35	3	PH
								4	P&S
								5	O/W
								6	SETTLE
								8	SPAR-A
								9	DEAD
								10	RECYL
								11	PPT-F
								12	HAUL

SIU Facilities Federal Category, Process, and Pretreatment Technology by Connection

Report run on: Tuesday, January 3, 2023 9:11 am

Page 11

<i>Facility Permit</i>	<i>Name</i>	<i>IW Discharged (gpd)</i>	<i>Conn</i>	<i>Principle Process</i>	<i>Federal/ Local</i>	<i>CFR Part</i>	<i>CFR Section</i>	<i>Order</i>	<i>Pre Treat Code</i>
20-0108 06-A	Valley Metals	897	120	X-ray processing	Local	130		1	RECOV
								2	3CRC
20-0109 07-A	L & T Precision Corporation	35	120	Silkscreen Cleaning	Federal	433	.17	1	NONE
20-0122 05-B	K-Tube Corporation	1,080	100	Industrial and sanitary	Local			1	HAUL
			110	Power washing	Federal	433	.17	1	FILT-O
			120	Tube manufacturing	Federal	433	.17	1	FILT-O
								2	EVAP
								3	DIST
								4	PH
21-0248 06-A	Creative Metal Industries	90	110	Silkscreen Cleaning	Federal	433	.17	1	NONE
21-0252 06-A	Compucraft Industries Inc	340	110	Metal finishing	Federal	433	.17	1	PH
			120	Fabrication/machining	Federal	433	.17		
21-0288 02-A	Vision Systems Inc	520	110	Etch	Federal	433	.17	1	PH
			120	Chemfilm	Federal	433	.17	1	PH
								2	CN
								3	CR
								4	PPT
								5	FILT-O
22-0092 01-A	Valley Powder Coating Inc	20	110	Industrial	Federal	433	.17	1	SETTLE
								2	PH
25-0105 37-A	Otay Landfill Inc	1,000	100	landfill leachate	Local	120		1	NONE
38-A	Otay Landfill Inc	1,000	100	landfill leachate	Local	120		1	NONE
25-0379 07-A	Pio Pico Energy Center	13,700	100	Gas Turbine Power Plant	Local	121		1	FILT
								2	THCK-G
34-0070 05-A	Golden State Metal Finishing	171	110	Treated MF Rinses	Federal	433	.17	1	PH
36-0001 04-B	Otay Mesa Energy Center LLC	46,616	100	Industrial and sanitary	Federal	423	.17	1	SOURCE
			140	Turbine washing	Federal	423	.17	2	HAUL
36-0009 02-A	Pio Pico Energy Center	750	800	Power plant	Local			1	SETTLE
SIUs: 75									

SIU Facilities: Regulated Parameters by Connection

Report run on: Tuesday, January 3, 2023 9:11 am

Page 1

Facility	Pmt	Name	Address	Conn	Total IW (gpd)	Parmcode	City freq	Self freq	Cat	Period	Lower Limit	Upper Limit	Units
02-0112	07-A	University of California San Diego	9500 Gilman Dr 0089, La Jolla	100	77,500	COPPER	Q	Q	L	DM		11	mg/L
						PH	Q	Q	L	DM	5	12.5	pH
						PH HIGHEST	Q		L	DM		12.5	pH
						SULFIDE DISSOLVD	Q	Q	L	DM		1	mg/L
				200	18,800	COPPER	Q	Q	L	DM		11	mg/L
						PH	Q	Q	L	DM	5	12.5	pH
						PH HIGHEST	Q		L	DM		12.5	pH
						SULFIDE DISSOLVD	Q	Q	L	DM		1	mg/L
				300	75,300	COPPER	Q	Q	L	DM		11	mg/L
						PH	Q	Q	L	DM	5	12.5	pH
						PH HIGHEST	Q		L	DM		12.5	pH
						SULFIDE DISSOLVD	Q	Q	L	DM		1	mg/L
				500	3,200	COPPER	Q	Q	L	DM		11	mg/L
						PH	Q	Q	L	DM	5	12.5	pH
						PH HIGHEST	Q		L	DM		12.5	pH
						SULFIDE DISSOLVD	Q	Q	L	DM		1	mg/L
				600	0	COPPER	Q	Q	L	DM		11	mg/L
						PH	Q	Q	L	DM	5	12.5	pH
						PH HIGHEST	Q		L	DM		12.5	pH
						SULFIDE DISSOLVD	Q	Q	L	DM		1	mg/L
02-0332	07-A	Pall Filtration & Separations Group Inc	4116 Sorrento Valley Bl, San Diego	110	50,520	PH	Q	H	L	DM	5	12.5	pH
02-0439	04-A	Defender SD Manufacturing LLC	3443 Tripp Ct, San Diego	100	254	ACETONE:P-O	Q	Q	F	DM		4600	ug/L
										MO		1820	ug/L
						ETHYL ACET:P-O	Q	Q	F	DM		4600	ug/L
										MO		1820	ug/L
						ISOP ACETATE:P-O	Q	Q	F	DM		4600	ug/L
										MO		1820	ug/L
						METHYLE CL:P-O	Q	Q	F	DM		670	ug/L
										MO		160	ug/L
						N-AMYL ACET:P-O	Q	Q	F	DM		4600	ug/L
										MO		1820	ug/L
						PH	Q	Q	L	DM	5	12.5	pH
02-0518	07-A	Suneva Medical Inc	5870 Pacific Center Bl, San Diego	110	755	ACETONE:P-O	Q	Q	F	DM		20700	ug/L
										MO		8200	ug/L
						ETHYL ACET:P-O	Q	Q	F	DM		20700	ug/L
										MO		8200	ug/L
						ISOP ACETATE:P-O	Q	Q	F	DM		20700	ug/L
										MO		8200	ug/L
						METHYLE CL:P-O	Q	Q	F	DM		3000	ug/L
										MO		700	ug/L
						N-AMYL ACET:P-O	Q	Q	F	DM		20700	ug/L

SIU Facilities: Regulated Parameters by Connection

Report run on: Tuesday, January 3, 2023 9:11 am

Page 2

<i>Facility</i>	<i>Pmt</i>	<i>Name</i>	<i>Address</i>	<i>Conn</i>	<i>Total IW</i> (<i>gpd</i>)	<i>Parmcode</i>	<i>City</i> <i>freq</i>	<i>Self</i> <i>freq</i>	<i>Cat</i>	<i>Period</i>	<i>Lower</i> <i>Limit</i>	<i>Upper</i> <i>Limit</i>	<i>Units</i>
02-0518	07-A	Suneva Medical Inc	5870 Pacific Center Bl, San Diego	110	755	N-AMYL ACET:P-O PH	Q Q	Q Q	F L	MO DM	5	8200 12.5	ug/L pH
02-0582	07-A	The Argen Corporation	5855 Oberlin Dr, San Diego	110	97	CADMIUM	Q	Q	F	DM		.19	mg/L
						COPPER	Q	Q	F	DM		.09	mg/L
										MO		1.08	mg/L
						CYANIDE(T)	Q	Q	F	DM		.57	mg/L
										MO		.16	mg/L
						SILVER	Q	Q	F	DM		.07	mg/L
										MO		.23	mg/L
										MO		.1	mg/L
02-0722	09-A	Ajinomoto Althea Inc	6175 Lusk Bl, San Diego	110	360	ACETONE:P-O	Q	Q	F	DM		19600	ug/L
										MO		7770	ug/L
						ETHYL ACET:P-O	Q	Q	F	DM		19600	ug/L
										MO		7770	ug/L
						ISOP ACETATE:P-O	Q	Q	F	DM		19600	ug/L
										MO		7770	ug/L
						METHYLE CL:P-O	Q	Q	F	DM		2840	ug/L
										MO		660	ug/L
						N-AMYL ACET:P-O	Q	Q	F	DM		19600	ug/L
										MO		7770	ug/L
						PH	Q	Q	L	DM	5	12.5	pH
02-0762	06-A	Pacira Pharmaceuticals Inc	10450 Science Center Dr, San Diego	110	32,530	ACETONE:P-O	Q	Q	F	DM		20700	ug/L
										MO		8200	ug/L
						ETHYL ACET:P-O	Q	Q	F	DM		20700	ug/L
										MO		8200	ug/L
						ISOP ACETATE:P-O	Q	Q	F	DM		20700	ug/L
										MO		8200	ug/L
						METHYLE CL:P-O	Q	Q	F	DM		3000	ug/L
										MO		700	ug/L
						N-AMYL ACET:P-O	Q	Q	F	DM		20700	ug/L
										MO		8200	ug/L
						PH	Q	Q	L	DM	5	12.5	pH
						PH HIGHEST	A		L	DM		12.5	pH
03-0115	07-A	ATK Space Systems Inc	9603 Distribution Av, San Diego	410	60	CADMIUM	Q	Q	F	DM		.11	mg/L
										MO		.07	mg/L
						CHROMIUM	Q	Q	F	DM		2.77	mg/L
										MO		1.71	mg/L
						COPPER	Q	Q	F	DM		3.38	mg/L
										MO		2.07	mg/L
						CYANIDE(T)	Q	Q	F	DM		1.2	mg/L
										MO		.65	mg/L
						LEAD	Q	Q	F	DM		.69	mg/L

SIU Facilities: Regulated Parameters by Connection

Report run on: Tuesday, January 3, 2023 9:11 am

Page 3

Facility	Pmt	Name	Address	Conn	Total IW (gpd)	Parmcode	City freq	Self freq	Cat	Period	Lower Limit	Upper Limit	Units
03-0115	07-A	ATK Space Systems Inc	9603 Distribution Av, San Diego	410	60	LEAD	Q	Q	F	MO		.43	mg/L
						NICKEL	Q	Q	F	DM		3.98	mg/L
										MO		2.38	mg/L
						PH	Q	Q	L	DM	5	12.5	pH
						SILVER	Q	Q	F	DM		.43	mg/L
										MO		.24	mg/L
						TTO(413+433)-P	A	Q	F	DM		2130	ug/L
						ZINC	Q	Q	F	DM		2.61	mg/L
										MO		1.48	mg/L
03-0270	05-A	Ballast Point Brewery Miramar	9045 Carroll Wy, San Diego	100	46,600	FLOW RATE MAX		H	L	DM		370	gpm
						PH	Q	H	L	DM	5	12.5	pH
						PH HIGHEST	Q		L	DM		12.5	pH
						PH VIOL DAYS		H	L	DM		0	days
03-0347	05-B	Sungear	8535 Arjons Dr Suite G, San Diego	110	20	CADMIUM	Q	Q	F	DM		.11	mg/L
										MO		.07	mg/L
						CHROMIUM	Q	Q	F	DM		2.77	mg/L
										MO		1.71	mg/L
						COPPER	Q	Q	F	DM		3.38	mg/L
										MO		2.07	mg/L
						CYANIDE(T)	Q	Q	F	DM		1.2	mg/L
										MO		.65	mg/L
						LEAD	Q	Q	F	DM		.69	mg/L
										MO		.43	mg/L
						NICKEL	Q	Q	F	DM		3.98	mg/L
										MO		2.38	mg/L
						PH	Q	Q	L	DM	5	12.5	pH
						SILVER	Q	Q	F	DM		.43	mg/L
										MO		.24	mg/L
						TTO(413+433)-P	A	Q	F	DM		2130	ug/L
						ZINC	Q	Q	F	DM		2.61	mg/L
										MO		1.48	mg/L
03-0717	09-A	Action Powder Coating LLC	7949 Stromesa Ct Suite D, San Diego	110	1,500	CADMIUM	Q	Q	F	DM		.11	mg/L
										MO		.07	mg/L
						CHROMIUM	Q	Q	F	DM		2.77	mg/L
										MO		1.71	mg/L
						COPPER	Q	Q	F	DM		3.38	mg/L
										MO		2.07	mg/L
						CYANIDE(T)	Q	Q	F	DM		1.2	mg/L
										MO		.65	mg/L
						LEAD	Q	Q	F	DM		.69	mg/L
										MO		.43	mg/L
						NICKEL	Q	Q	F	DM		3.98	mg/L

SIU Facilities: Regulated Parameters by Connection

Report run on: Tuesday, January 3, 2023 9:11 am

Page 4

Facility	Pmt	Name	Address	Conn	Total IW (gpd)	Parmcode	City freq	Self freq	Cat	Period	Lower Limit	Upper Limit	Units
03-0717	09-A	Action Powder Coating LLC	7949 Stromesa Ct Suite D, San Diego	110	1,500	NICKEL PH PH HIGHEST SILVER TTO(413+433)-P ZINC	Q Q Q Q S Q	Q Q Q	F L L F F	MO DM DM DM DM DM	 5 2130 2.61	2.38 12.5 12.5 .43 .24 2130 2.61	mg/L pH pH mg/L mg/L ug/L mg/L
03-0779	05-A	IriSys LLC	6828 Nancy Ridge Dr Suite 100, San Diego	110	165	ACETONE:P-O ETHYL ACET:P-O ISOP ACETATE:P-O METHYLE CL:P-O N-AMYL ACET:P-O	Q Q Q Q	Q Q Q	F F F	DM DM DM DM	 3000 700	20700 8200 20700 8200 20700 700	ug/L ug/L ug/L ug/L ug/L ug/L
				120	5	PH ACETONE:P-O ETHYL ACET:P-O ISOP ACETATE:P-O METHYLE CL:P-O N-AMYL ACET:P-O	Q Q Q Q Q	Q Q Q	L F F	DM DM DM DM DM	 5 8200 20700	12.5 20700 8200 20700 8200 3000 700	pH ug/L ug/L ug/L ug/L ug/L ug/L
				140		PH ACETONE:P-O ETHYL ACET:P-O ISOP ACETATE:P-O METHYLE CL:P-O N-AMYL ACET:P-O	Q Q Q Q Q	Q Q Q	L F F	DM DM DM DM DM	 5 8200 20700	12.5 20700 8200 20700 8200 3000 700	pH ug/L ug/L ug/L ug/L ug/L ug/L
03-0801	04-A	Cue Health Inc	9877 Waples St, San Diego	110	100	PH CADMIUM	Q Q	Q Q	L F	DM DM	5 .11	12.5 mg/L	pH mg/L

SIU Facilities: Regulated Parameters by Connection

Report run on: Tuesday, January 3, 2023 9:11 am

Page 5

Facility	Pmt	Name	Address	Conn	Total IW (gpd)	Parmcode	City freq	Self freq	Cat	Period	Lower Limit	Upper Limit	Units
03-0801	04-A	Cue Health Inc	9877 Waples St, San Diego	110	100	CADMIUM	Q	Q	F	MO	.07		mg/L
						CHROMIUM	Q	Q	F	DM	2.77		mg/L
										MO	1.71		mg/L
						COPPER	Q	Q	F	DM	3.38		mg/L
										MO	2.07		mg/L
						CYANIDE(T)	Q	Q	F	DM	1.2		mg/L
										MO	.65		mg/L
						LEAD	Q	Q	F	DM	.69		mg/L
										MO	.43		mg/L
						NICKEL	Q	Q	F	DM	3.98		mg/L
										MO	2.38		mg/L
						PH	Q	Q	L	DM	5	12.5	pH
						SILVER	Q	Q	F	DM	.43		mg/L
										MO	.24		mg/L
						TTO(413+433)-P	S	Q	F	DM	2130		ug/L
						ZINC	Q	Q	F	DM	2.61		mg/L
03-0920	07-A	Alphacoat Finishing LLC	9352 Cabot Dr, San Diego	110	280					MO	1.48		mg/L
						CADMIUM	Q	Q	F	DM	.11		mg/L
										MO	.07		mg/L
						CHROMIUM	Q	Q	F	DM	2.77		mg/L
										MO	1.71		mg/L
						COPPER	Q	Q	F	DM	3.38		mg/L
										MO	2.07		mg/L
						CYANIDE(T)	Q	Q	F	DM	1.2		mg/L
										MO	.65		mg/L
						LEAD	Q	Q	F	DM	.69		mg/L
										MO	.43		mg/L
						NICKEL	Q	Q	F	DM	3.98		mg/L
										MO	2.38		mg/L
						PH	Q	Q	L	DM	5	12.5	pH
						SILVER	Q	Q	F	DM	.43		mg/L
										MO	.24		mg/L
						TTO(413+433)-P	A	Q	F	DM	2130		ug/L
						ZINC	Q	Q	F	DM	2.61		mg/L
										MO	1.48		mg/L
										DM	.11		mg/L
										MO	.07		mg/L
						CHROMIUM	Q	Q	F	DM	2.77		mg/L
										MO	1.71		mg/L
						COPPER	Q	Q	F	DM	3.38		mg/L
										MO	2.07		mg/L
						CYANIDE(T)	Q	Q	F	DM	1.2		mg/L
				120	90								
						CADMIUM	Q	Q	F	DM	.11		mg/L
										MO	.07		mg/L
						CHROMIUM	Q	Q	F	DM	2.77		mg/L
										MO	1.71		mg/L
						COPPER	Q	Q	F	DM	3.38		mg/L
										MO	2.07		mg/L
						CYANIDE(T)	Q	Q	F	DM	1.2		mg/L

SIU Facilities: Regulated Parameters by Connection

Report run on: Tuesday, January 3, 2023 9:11 am

Page 6

Facility	Pmt	Name	Address	Conn	Total IW (gpd)	Parmcode	City freq	Self freq	Cat	Period	Lower Limit	Upper Limit	Units
03-0920	07-A	Alphacoat Finishing LLC	9352 Cabot Dr, San Diego	120	90	CYANIDE(T) LEAD	Q Q	Q Q	F F	MO DM	.65 .69		mg/L mg/L
						NICKEL	Q	Q	F	DM	.43		mg/L
										MO	3.98		mg/L
						PH	Q	Q	L	DM	2.38		mg/L
						SILVER	Q	Q	F	DM	5 12.5		pH
										MO	.43		mg/L
						TTO(413+433)-P	A	Q	F	DM	.24		mg/L
						ZINC	Q	Q	F	DM	2130		ug/L
										MO	2.61		mg/L
03-1017	04-A	Anocote Metal Finishing Inc	7550 Trade St, San Diego	110	110	CADMIUM	Q	Q	F	DM	1.48		mg/L
										MO	.11		mg/L
						CHROMIUM	Q	Q	F	DM	.07		mg/L
										MO	2.77		mg/L
						COPPER	Q	Q	F	DM	1.71		mg/L
										MO	3.38		mg/L
						CYANIDE(T)	Q	Q	F	DM	2.07		mg/L
										MO	1.2		mg/L
						LEAD	Q	Q	F	DM	.65		mg/L
										MO	.69		mg/L
						NICKEL	Q	Q	F	DM	.43		mg/L
										MO	3.98		mg/L
						PH	Q	Q	L	DM	2.38		mg/L
						SILVER	Q	Q	F	DM	5 12.5		pH
										MO	.43		mg/L
						TTO(413+433)-P	A	Q	F	DM	.24		mg/L
						ZINC	Q	Q	F	DM	2130		ug/L
										MO	2.61		mg/L
03-1024	02-A	PolyPeptide Laboratories San Diego	9395 Cabot Dr, San Diego	110	5	CYANIDE(T)	S	Q	F	DM	1.48		mg/L
										MO	33.5		mg/L
03-1070	05-A	Johnson Matthey Medical Products	12205 World Trade Dr, San Diego	110	235	CADMIUM	Q	Q	F	DM	9.4		mg/L
										MO	.11		mg/L
						CHROMIUM	Q	Q	F	DM	.07		mg/L
										MO	2.77		mg/L
						COPPER	Q	Q	F	DM	1.71		mg/L
										MO	3.38		mg/L
						CYANIDE(T)	Q	Q	F	DM	2.07		mg/L
										MO	1.2		mg/L
						LEAD	Q	Q	F	DM	.65		mg/L
										MO	.69		mg/L
						NICKEL	Q	Q	F	DM	.43		mg/L
										MO	3.98		mg/L

SIU Facilities: Regulated Parameters by Connection

Report run on: Tuesday, January 3, 2023 9:11 am

Page 7

Facility	Pmt	Name	Address	Conn	Total IW (gpd)	Parmcode	City freq	Self freq	Cat	Period	Lower Limit	Upper Limit	Units
03-1070	05-A	Johnson Matthey Medical Products	12205 World Trade Dr, San Diego	110	235	NICKEL	Q	Q	F	MO		2.38	mg/L
						PH	Q	Q	L	DM	5	12.5	pH
						SILVER	Q	Q	F	DM		.43	mg/L
										MO		.24	mg/L
						TTO(413+433)-P	A	Q	F	DM		2130	ug/L
						ZINC	Q	Q	F	DM		2.61	mg/L
										MO		1.48	mg/L
03-1203	02-A	nVent - Schroff Inc	7328 Trade St, San Diego	110	345	CADMIUM	Q	Q	F	DM		.11	mg/L
										MO		.07	mg/L
						CHROMIUM	Q	Q	F	DM		2.77	mg/L
										MO		1.71	mg/L
						COPPER	Q	Q	F	DM		3.38	mg/L
										MO		2.07	mg/L
						CYANIDE(T)	Q	Q	F	DM		1.2	mg/L
										MO		.65	mg/L
						LEAD	Q	Q	F	DM		.69	mg/L
										MO		.43	mg/L
						NICKEL	Q	Q	F	DM		3.98	mg/L
										MO		2.38	mg/L
						PH	Q	Q	L	DM	5	12.5	pH
						SILVER	Q	Q	F	DM		.43	mg/L
										MO		.24	mg/L
						TTO(413+433)-P	A	Q	F	DM		2130	ug/L
						ZINC	Q	Q	F	DM		2.61	mg/L
										MO		1.48	mg/L
03-1300	03-A	JDZ Inc DBA AleSmith Brewing Company	9990 AleSmith Ct, San Diego	110	10,200	FLOW R MAX WET		Q	L	DM		0	gpm
						FLOW RATE MAX		Q	L	DM		100	gpm
						PH	Q	Q	L	DM	5	12.5	pH
						PH HIGHEST	Q		L	DM		12.5	pH
						PH VIOL DAYS		Q	L	DM		0	days
03-1338	03-A	Saint Archer Brewing Company	9550 Distribution Av, San Diego	110	14,000	FLOW RATE MAX		Q	L	DM		200	gpm
						PH	Q	Q	L	DM	5	12.5	pH
						PH HIGHEST	Q		L	DM		12.5	pH
						PH VIOL DAYS		Q	L	DM		0	days
03-1380	02-A	Santier Inc	10103 Carroll Canyon Rd, San Diego	110	107	CADMIUM	Q	Q	F	DM		.1	mg/L
										MO		.06	mg/L
						CHROMIUM	Q	Q	F	DM		2.51	mg/L
										MO		1.55	mg/L
						COPPER	Q	Q	F	DM		3.13	mg/L
										MO		1.8	mg/L
						CYANIDE(T)	Q	Q	F	DM		1.2	mg/L
										MO		.65	mg/L

SIU Facilities: Regulated Parameters by Connection

Report run on: Tuesday, January 3, 2023 9:11 am

Page 8

Facility	Pmt	Name	Address	Conn	Total IW (gpd)	Parmcode	City freq	Self freq	Cat	Period	Lower Limit	Upper Limit	Units
03-1380	02-A	Santier Inc	10103 Carroll Canyon Rd, San Diego	110	107	FLUORIDE	Q	Q	F	DM	106.9	mg/L	
						LEAD	Q	Q	F	DM	68.96	mg/L	
						MOLYBDENUM	Q	Q	F	DM	.62	mg/L	
						NICKEL	Q	Q	F	DM	.39	mg/L	
						PH	Q		L	DM	13.13	mg/L	
						SILVER	Q	Q	F	DM	5.82	mg/L	
						TTO(413+433)-P	A	Q	F	DM	3.05	mg/L	
						ZINC	Q	Q	F	DM	1.85	mg/L	
										DM	5	12.5	pH
										DM	.39	mg/L	
										DM	.22	mg/L	
										DM	1928	ug/L	
										DM	2.36	mg/L	
										DM	1.34	mg/L	
05-0684	07-A	Stallergenes Greer dba Allermed Laboratories Inc	7203 Convoy Ct, San Diego	130	20	ACETONE:P-O	S	Q	F	DM	20700	ug/L	
						ETHYL ACET:P-O	S	Q	F	DM	8200	ug/L	
						ISOP ACETATE:P-O	S	Q	F	DM	20700	ug/L	
						METHYLE CL:P-O	S	Q	F	DM	8200	ug/L	
						N-AMYL ACET:P-O	S	Q	F	DM	3000	ug/L	
										DM	700	ug/L	
										DM	20700	ug/L	
										DM	8200	ug/L	
										DM	20700	ug/L	
										DM	8200	ug/L	
										DM	20700	ug/L	
										DM	8200	ug/L	
										DM	20700	ug/L	
										DM	8200	ug/L	
										DM	20700	ug/L	
										DM	8200	ug/L	
										DM	20700	ug/L	
										DM	8200	ug/L	
										DM	20700	ug/L	
										DM	8200	ug/L	
										DM	20700	ug/L	
										DM	8200	ug/L	
										DM	20700	ug/L	
										DM	8200	ug/L	
										DM	20700	ug/L	
										DM	8200	ug/L	
										DM	20700	ug/L	
										DM	8200	ug/L	
										DM	20700	ug/L	
										DM	8200	ug/L	
										DM	20700	ug/L	
										DM	8200	ug/L	
										DM	20700	ug/L	
										DM	8200	ug/L	
										DM	20700	ug/L	
										DM	8200	ug/L	
										DM	20700	ug/L	
										DM	8200	ug/L	
										DM	20700	ug/L	
										DM	8200	ug/L	
										DM	20700	ug/L	
										DM	8200	ug/L	
										DM	20700	ug/L	
										DM	8200	ug/L	
										DM	20700	ug/L	
										DM	8200	ug/L	
										DM	20700	ug/L	
										DM	8200	ug/L	
										DM	20700	ug/L	
										DM	8200	ug/L	
										DM	20700	ug/L	
										DM	8200	ug/L	
										DM	20700	ug/L	
										DM	8200	ug/L	
										DM	20700	ug/L	
										DM	8200	ug/L	
										DM	20700	ug/L	
										DM	8200	ug/L	
										DM	20700	ug/L	
										DM	8200	ug/L	
										DM	20700	ug/L	
										DM	8200	ug/L	
										DM	20700	ug/L	
										DM	8200	ug/L	
										DM	20700	ug/L	
										DM	8200	ug/L	
										DM	20700	ug/L	
										DM	8200	ug/L	
										DM	20700	ug/L	
										DM	8200	ug/L	
										DM	20700	ug/L	
										DM	8200	ug/L	
										DM	20700	ug/L	
										DM	8200	ug/L	
										DM	20700	ug/L	
										DM	8200	ug/L	
										DM	20700	ug/L	
										DM	8200	ug/L	
										DM	20700	ug/L	
										DM	8200	ug/L	
										DM	20700	ug/L	
										DM	8200	ug/L	
										DM	20700	ug/L	
										DM	8200	ug/L	
										DM	20700	ug/L	
										DM	8200	ug/L	
										DM	20700	ug/L	
										DM	8200	ug/L	
										DM	20700	ug/L	
										DM	8200	ug/L	
										DM	20700	ug/L	
										DM	8200	ug/L	
										DM	20700	ug/L	
										DM	8200	ug/L	
										DM	20700	ug/L	
										DM	8200	ug/L	
										DM	20700	ug/L	
										DM	8200	ug/L	
										DM	20700	ug/L	
										DM	8200	ug/L	
										DM	20700	ug/L	
										DM	8200	ug/L	
										DM	20700	ug/L	
										DM	8200	ug/L	
										DM	20700	ug/L	
										DM	8200	ug/L	
										DM	20700	ug/L	
										DM	8200	ug/L	
										DM	20700	ug/L	
										DM	8200	ug/L	
										DM	20700	ug/L	
										DM	8200	ug/L	
										DM	20700	ug/L	
										DM	8200	ug/L	
										DM	20700	ug/L	
										DM	8200	ug/L	
										DM	20700	ug/L	
										DM	8200	ug/L	
										DM	20700	ug/L	
										DM	8200	ug/L	
										DM	20700	ug/L	
										DM	8200	ug/L	
										DM	20700	ug/L	
										DM	8200	ug/L	
										DM	20700	ug/L	
										DM	8200	ug/L	
										DM	20700	ug/L	
										DM	8200	ug/L	
										DM	20700	ug/L	
										DM	8200	ug/L	
										DM	20700	ug/L	
										DM	8200	ug/L	
										DM	20700	ug/L	
										DM	8200	ug/L	
										DM	20700	ug/L	
										DM	8200	ug/L	
										DM	20700	ug/L	
										DM	8200	ug/L	
										DM	20700	ug/L	
										DM	8200	ug/L	
										DM	20700	ug/L	
										DM	8200	ug/L	
										DM	20700	ug/L	
										DM	8200	ug/L	
										DM	20700	ug/L	
										DM	8200	ug/L	
										DM	20700	ug/L	
										DM	8200	ug/L	
										DM	20700	ug/L	
										DM	8200	ug/L	
		</											

SIU Facilities: Regulated Parameters by Connection

Report run on: Tuesday, January 3, 2023 9:11 am

Page 9

Facility	Pmt	Name	Address	Conn	Total IW (gpd)	Parmcode	City freq	Self freq	Cat	Period	Lower Limit	Upper Limit	Units
05-0684	07-A	Stallergenes Greer dba Allermed Laboratories Inc	7203 Convoy Ct, San Diego	150	15	N-AMYL ACET:P-O	S	Q	F	DM MO	20700 8200		ug/L ug/L
05-0985	06-A	Chromalloy San Diego	7007 Consolidated Wy, San Diego	130	130	CADMIUM	Q	Q	F	DM MO	.11 .07		mg/L mg/L
						CHROMIUM	Q	Q	F	DM MO	2.77 1.71		mg/L mg/L
						COPPER	Q	Q	F	DM MO	3.38 2.07		mg/L mg/L
						CYANIDE(T)	Q	Q	F	DM MO	1.2 .65		mg/L mg/L
						LEAD	Q	Q	F	DM MO	.69 .43		mg/L mg/L
						NICKEL	Q	Q	F	DM MO	3.98 2.38		mg/L mg/L
						PH	Q	Q	L	DM	5 12.5		pH
						SILVER	Q	Q	F	DM MO	.43 .24		mg/L mg/L
						TTO(413+433)-P	A	Q	F	DM	2130		ug/L
						ZINC	Q	Q	F	DM MO	2.61 1.48		mg/L mg/L
05-0997	06-A	TTM Technologies Inc - San Diego Division	5037 Ruffner St, San Diego	220	10,092	CADMIUM	Q	Q	F	DM MO	.11 .07		mg/L mg/L
						CHROMIUM	Q	Q	F	DM MO	2.77 1.71		mg/L mg/L
						COPPER	Q	Q	F	DM MO	3.38 2.07		mg/L mg/L
						LEAD	Q	Q	F	DM MO	.69 .43		mg/L mg/L
						NICKEL	Q	Q	F	DM MO	3.98 2.38		mg/L mg/L
						PH	Q	Q	L	DM	5 12.5		pH
						PH HIGHEST	Q		L	DM	12.5		pH
						SILVER	Q	Q	F	DM MO	.43 .24		mg/L mg/L
						TTO(413+433)-P	A	Q	F	DM	2130		ug/L
						ZINC	Q	Q	F	DM MO	2.61 1.48		mg/L mg/L
				221	100	CYANIDE(T)	Q	Q	F	DM MO	1.2 .65		mg/L mg/L
				222	57	CYANIDE(T)	Q	Q	F	DM MO	1.2 .65		mg/L mg/L
05-1019	06-B	USN;Marine Corps Air Station	45249 Miramar Wy, San	100	21,900	FLOW MAX			L	DM	1600000		gpd

SIU Facilities: Regulated Parameters by Connection

Report run on: Tuesday, January 3, 2023 9:11 am

Page 10

Facility	Pmt Name	Address	Conn	Total IW (gpd)	Parmcode	City	Self freq	Cat freq	Period	Lower Limit	Upper Limit	Units
05-1019	06-B USN;Marine Corps Air Station Miramar	45249 Miramar Wy, San Diego	100	21,900	FLOW RATE MAX OIL/GREASE PH	Q	Q	L	DM	1111	gm	
						Q	Q	L	DM	500	mg/L	
						Q	Q	L	DM	5	12.5	pH
05-1352	01-B UT; Flatiron West Inc	887 Sherman St, San Diego	100	2,500,000	FLOW R MAX WET FLOW RATE MAX		M	L	DM	0	gm	
							M	L	DM	1736	gm	
05-1353	01-A UT; Flatiron West Inc	5400 Friars Rd, San Diego	100	216,000	BNZ(W/OAGG) BTEX	Q	M	L	DM	50	ug/L	
						Q	M	L	DM	750	ug/L	
					FLOW R MAX WET FLOW RATE MAX		M	L	DM	0	gm	
							M	L	DM	150	gm	
					PETROLEUM HC TPH	Q	M	L	DM	500	mg/L	
							M	L	DM	500	mg/L	
05-1357	01-A UT; Flatiron West Inc	4747 Friars Rd, San Diego	100	216,000	FLOW R MAX WET FLOW RATE MAX		M	L	DM	0	gm	
							M	L	DM	500	gm	
05-1358	01-A UT; Fairfield Development LP	7050 Friars Rd, San Diego	100	43,200	FLOW R MAX WET FLOW RATE MAX		M	L	DM	0	gm	
							M	L	DM	30	gm	
06-0058	07-A Kyocera International Inc	8611 Balboa Av, San Diego	130	23,528	CADMIUM	Q	H	F	DM	.11	mg/L	
									MO	.07	mg/L	
					CHROMIUM	Q	H	F	DM	2.77	mg/L	
									MO	1.71	mg/L	
					COPPER	Q	H	F	DM	3.38	mg/L	
									MO	2.07	mg/L	
					LEAD	Q	H	F	DM	.69	mg/L	
									MO	.43	mg/L	
					NICKEL	Q	H	F	DM	3.98	mg/L	
									MO	2.38	mg/L	
					PH	Q	H	L	DM	5	12.5	pH
					PH HIGHEST	Q		L	DM	12.5	pH	
					SILVER	Q	H	F	DM	.43	mg/L	
									MO	.24	mg/L	
					TTO(413+433)-P ZINC	A	H	F	DM	2130	ug/L	
						Q	H	F	DM	2.61	mg/L	
									MO	1.48	mg/L	
			131	8,579	CYANIDE(A)	Q	H	F	DM	.86	mg/L	
									MO	.32	mg/L	
06-0414	03-B UT; SDSU Mission Valley Site Development	9449 Friars Rd, San Diego	100	144,000	BNZ(W/OAGG) BTEX	Q	Q	L	DM	50	ug/L	
						Q	Q	L	DM	750	ug/L	
					FLOW R MAX WET FLOW RATE MAX		M	L	DM	0	gm	
							M	L	DM	100	gm	
					PETROLEUM HC TPH	Q	Q	L	DM	500	mg/L	
							Q	L	DM	500	mg/L	
			200	720,000	BNZ(W/OAGG) BTEX	Q	Q	L	DM	50	ug/L	
						Q	Q	L	DM	750	ug/L	

SIU Facilities: Regulated Parameters by Connection

Report run on: Tuesday, January 3, 2023 9:11 am

Page 11

Facility	Pmt	Name	Address	Conn	Total IW (gpd)	Parmcode	City freq	Self freq	Cat	Period	Lower Limit	Upper Limit	Units
06-0414	03-B	UT; SDSU Mission Valley Site Development	9449 Friars Rd, San Diego	200	720,000	FLOW R MAX WET		M	L	DM	0		gpm
						FLOW RATE MAX		M	L	DM	500		gpm
						PETROLEUM HC	Q	Q	L	DM	500		mg/L
						TPH		Q	L	DM	500		mg/L
08-0008	07-A	UT; USN NBPL Defense Fuel Support Point	199 Rosecrans St, San Diego	210	4,000	FLOW R MAX DRY		Q	L	DM	130		gpm
						FLOW R MAX WET		Q	L	DM	75		gpm
						PETROLEUM HC	Q		L	DM	500		mg/L
						TPH		Q	L	DM	500		mg/L
				220	50,000	FLOW R MAX DRY		Q	L	DM	170		gpm
						FLOW R MAX WET		Q	L	DM	75		gpm
						PETROLEUM HC	Q		L	DM	500		mg/L
						TPH		Q	L	DM	500		mg/L
08-0018	07-A	USN;Naval Base Coronado - NASNI	NAS North Island, San Diego	100	156,585	OIL/GREASE	Q	Q	L	DM	500		mg/L
						PH	Q	Q	L	DM	5	12.5	pH
						SULFIDE DISSOLVD	Q	Q	L	DM	1		mg/L
				120	3,500	CADMIUM	Q	M	F	DM	.11		mg/L
										MO	.07		mg/L
						CHROMIUM	Q	M	F	DM	2.77		mg/L
										MO	1.71		mg/L
						COPPER	Q	M	F	DM	3.38		mg/L
										MO	2.07		mg/L
						LEAD	Q	M	F	DM	.69		mg/L
										MO	.43		mg/L
						NICKEL	Q	M	F	DM	3.98		mg/L
										MO	2.38		mg/L
						SILVER	Q	M	F	DM	.43		mg/L
										MO	.24		mg/L
						TTO(413+433)-P	A	M	F	DM	2130		ug/L
						ZINC	Q	M	F	DM	2.61		mg/L
										MO	1.48		mg/L
				123	730	CYANIDE(A)	Q	M	F	DM	.86		mg/L
										MO	.32		mg/L
				140	25	CADMIUM	Q	Q	F	DM	.69		mg/L
										MO	.26		mg/L
						CHROMIUM	Q	Q	F	DM	2.77		mg/L
										MO	1.71		mg/L
						COPPER	Q	Q	F	DM	3.38		mg/L
										MO	2.07		mg/L
						CYANIDE(T)	Q	Q	F	DM	1.2		mg/L
										MO	.65		mg/L
						LEAD	Q	Q	F	DM	.69		mg/L
										MO	.43		mg/L

SIU Facilities: Regulated Parameters by Connection

Report run on: Tuesday, January 3, 2023 9:11 am

Page 12

Facility	Pmt	Name	Address	Conn	Total IW (gpd)	Parmcode	City freq	Self freq	Cat	Period	Lower Limit	Upper Limit	Units
08-0018	07-A	USN;Naval Base Coronado - NASNI	NAS North Island, San Diego	140	25	NICKEL	Q	Q	F	DM	3.98		mg/L
										MO	2.38		mg/L
						SILVER	Q	Q	F	DM	.43		mg/L
										MO	.24		mg/L
						TTO(413+433)-P	A	Q	F	DM	2130		ug/L
						ZINC	Q	Q	F	DM	2.61		mg/L
										MO	1.48		mg/L
				150	30,000	CADMIUM	Q	M	F	DM	.11		mg/L
										MO	.07		mg/L
						CHROMIUM	Q	M	F	DM	2.77		mg/L
										MO	1.71		mg/L
						COPPER	Q	M	F	DM	3.38		mg/L
										MO	2.07		mg/L
						CYANIDE(T)	Q	M	F	DM	1.2		mg/L
										MO	.65		mg/L
						LEAD	Q	M	F	DM	.69		mg/L
										MO	.43		mg/L
						NICKEL	Q	M	F	DM	3.98		mg/L
										MO	2.38		mg/L
						SILVER	Q	M	F	DM	.43		mg/L
										MO	.24		mg/L
						TTO(413+433)-P	A	M	F	DM	2130		ug/L
						ZINC	Q	M	F	DM	2.61		mg/L
										MO	1.48		mg/L
				160	60	CADMIUM	Q	Q	F	DM	.69		mg/L
										MO	.26		mg/L
						CHROMIUM	Q	Q	F	DM	2.77		mg/L
										MO	1.71		mg/L
						COPPER	Q	Q	F	DM	3.38		mg/L
										MO	2.07		mg/L
						CYANIDE(T)	Q	Q	F	DM	1.2		mg/L
										MO	.65		mg/L
						LEAD	Q	Q	F	DM	.69		mg/L
										MO	.43		mg/L
						NICKEL	Q	Q	F	DM	3.98		mg/L
										MO	2.38		mg/L
						SILVER	Q	Q	F	DM	.43		mg/L
										MO	.24		mg/L
						TTO(413+433)-P	A	Q	F	DM	2130		ug/L
						ZINC	Q	Q	F	DM	2.61		mg/L
										MO	1.48		mg/L
				180	0	CADMIUM	Q	Q	F	DM	.11		mg/L

SIU Facilities: Regulated Parameters by Connection

Report run on: Tuesday, January 3, 2023 9:11 am

Page 13

Facility	Pmt	Name	Address	Conn	Total IW (gpd)	Parmcode	City freq	Self freq	Cat	Period	Lower Limit	Upper Limit	Units
08-0018	07-A	USN;Naval Base Coronado - NASNI	NAS North Island, San Diego	180	0	CADMIUM	Q	Q	F	MO	.07		mg/L
						CHROMIUM	Q	Q	F	DM	2.77		mg/L
										MO	1.71		mg/L
						COPPER	Q	Q	F	DM	3.38		mg/L
										MO	2.07		mg/L
						CYANIDE(T)	Q	Q	F	DM	1.2		mg/L
										MO	.65		mg/L
						LEAD	Q	Q	F	DM	.69		mg/L
										MO	.43		mg/L
						NICKEL	Q	Q	F	DM	3.98		mg/L
										MO	2.38		mg/L
						SILVER	Q	Q	F	DM	.43		mg/L
										MO	.24		mg/L
						TTO(413+433)-P	A	Q	F	DM	2130		ug/L
						ZINC	Q	Q	F	DM	2.61		mg/L
										MO	1.48		mg/L
				190	500	CADMIUM	Q	Q	F	DM	.69		mg/L
										MO	.26		mg/L
						CHROMIUM	Q	Q	F	DM	2.77		mg/L
										MO	1.71		mg/L
						COPPER	Q	Q	F	DM	3.38		mg/L
										MO	2.07		mg/L
						CYANIDE(T)	Q	Q	F	DM	1.2		mg/L
										MO	.65		mg/L
						LEAD	Q	Q	F	DM	.69		mg/L
										MO	.43		mg/L
						NICKEL	Q	Q	F	DM	3.98		mg/L
										MO	2.38		mg/L
						SILVER	Q	Q	F	DM	.43		mg/L
										MO	.24		mg/L
						TTO(413+433)-P	A	Q	F	DM	2130		ug/L
						ZINC	Q	Q	F	DM	2.61		mg/L
										MO	1.48		mg/L
				799	500	BNZ(W/OAGG)	Q	M	L	DM	500		ug/L
08-0603	01-A	Conrac Managers SAN LLC	3355 Admiral Boland Wy, San Diego	110	48,120	OIL/GREASE	Q	Q	L	DM	500		mg/L
						PH	Q		L	DM	5	12.5	pH
09-0001	07-A	Alsco Inc	705 W Grape St, San Diego	100	37,334	COPPER	Q	Q	L	DM	11		mg/L
						OIL/GREASE	Q	Q	L	DM	500		mg/L
						PH	Q	Q	L	DM	5	12.5	pH
						ZINC	Q	Q	L	DM	24		mg/L
09-0048	02-A	Zoological Society of San Diego	2920 Zoo Dr, San Diego	100	297,530	FLOW R MAX RESTR		M	L	DM	292		gpm
						FLOW R MAX UNRES		M	L	DM	500		gpm

SIU Facilities: Regulated Parameters by Connection

Report run on: Tuesday, January 3, 2023 9:11 am

Page 14

Facility	Pmt	Name	Address	Conn	Total IW (gpd)	Parmcode	City freq	Self freq	Cat	Period	Lower Limit	Upper Limit	Units
09-0048	02-A	Zoological Society of San Diego	2920 Zoo Dr, San Diego	100	297,530	PH	Q		L	DM	5	12.5	pH
				200	4,500	PH	Q		L	DM	5	12.5	pH
09-0947	02-A	UT; Arcadis US Inc	2200 Pacific Hy, San Diego	100	22,000	12-2CLETHA	Q	M	L	DM		500	ug/L
						3CLETHE	Q	M	L	DM		500	ug/L
						BNZ(W/OAGG)	Q	M	L	DM		50	ug/L
						BTEX	Q	M	L	DM		750	ug/L
						CHROMIUM	Q	M	L	DM		5	mg/L
						COPPER	Q	M	L	DM		11	mg/L
						FLOW R MAX WET		M	L	DM		0	gpm
						FLOW RATE MAX		M	L	DM		15	gpm
						LEAD	Q	M	L	DM		5	mg/L
						MERCURY	Q	M	L	DM		.2	mg/L
						NICKEL	Q	M	L	DM		13	mg/L
						PCBS	Q	M	L	DM		500	ug/L
						PETROLEUM HC	Q	M	L	DM		500	mg/L
						TPH		M	L	DM		500	mg/L
						VINYL CL	Q	M	L	DM		200	ug/L
						ZINC	Q	M	L	DM		24	mg/L
				110	300	12-2CLETHA	Q	Q	L	DM		500	ug/L
						3CLETHE	Q	Q	L	DM		500	ug/L
						BNZ(W/OAGG)	Q	Q	L	DM		50	ug/L
						BTEX	Q	Q	L	DM		750	ug/L
						CHROMIUM	Q	Q	L	DM		5	mg/L
						COPPER	Q	Q	L	DM		11	mg/L
						FLOW RATE MAX		Q	L	DM		5	gpm
						LEAD	Q	Q	L	DM		5	mg/L
						MERCURY	Q	Q	L	DM		.2	mg/L
						NICKEL	Q	Q	L	DM		13	mg/L
						PCBS	Q	Q	L	DM		500	ug/L
						PETROLEUM HC	Q	Q	L	DM		500	mg/L
						TPH		Q	L	DM		500	mg/L
						VINYL CL	Q	Q	L	DM		200	ug/L
						ZINC	Q	Q	L	DM		24	mg/L
11-0016	06-B	USN;Naval Base San Diego	32nd St @ Harbor Dr, San Diego	820	0	FLOW R MAX DRY		S	L	DM		750	gpm
						FLOW R MAX RESTR		S	L	DM		350	gpm
						FLOW R MAX WET		S	L	DM		750	gpm
				830	43,979	OIL/GREASE	Q		L	DM		500	mg/L
						PH	M		L	DM	5	12.5	pH
				850	43,912	CADMIUM	Q	Q	L	DM		1	mg/L
						CHROMIUM	Q	Q	L	DM		5	mg/L
						COPPER	Q	Q	L	DM		11	mg/L
						LEAD	Q	Q	L	DM		5	mg/L

SIU Facilities: Regulated Parameters by Connection

Report run on: Tuesday, January 3, 2023 9:11 am

Page 15

Facility	Pmt	Name	Address	Conn	Total IW (gpd)	Parmcode	City freq	Self freq	Cat	Period	Lower Limit	Upper Limit	Units
11-0016	06-B	USN;Naval Base San Diego	32nd St @ Harbor Dr, San Diego	850	43,912	NICKEL	Q	Q	L	DM	13		mg/L
						ZINC	Q	Q	L	DM	24		mg/L
11-0051	07-A	General Dynamics NASSCO	2798 Harbor Dr, San Diego	200	5,742	CADMIUM	Q	Q	L	DM	1		mg/L
						CHROMIUM	Q	Q	L	DM	5		mg/L
						COPPER	Q	Q	L	DM	11		mg/L
						LEAD	Q	Q	L	DM	5		mg/L
						NICKEL	Q	Q	L	DM	13		mg/L
						OIL/GREASE	Q	Q	L	DM	500		mg/L
						PH	Q	Q	L	DM	5	12.5	pH
						ZINC	Q	Q	L	DM	24		mg/L
				300	51,895	OIL/GREASE	Q	Q	L	DM	500		mg/L
						PH	Q	Q	L	DM	5	12.5	pH
				310	51,853	CADMIUM	Q	Q	F	DM	.11		mg/L
										MO	.07		mg/L
						CHROMIUM	Q	Q	F	DM	2.77		mg/L
										MO	1.71		mg/L
						COPPER	Q	Q	F	DM	3.38		mg/L
										MO	2.07		mg/L
						CYANIDE(T)	Q	Q	F	DM	1.2		mg/L
										MO	.65		mg/L
						LEAD	Q	Q	F	DM	.69		mg/L
										MO	.43		mg/L
						NICKEL	Q	Q	F	DM	3.98		mg/L
										MO	2.38		mg/L
						SILVER	Q	Q	F	DM	.43		mg/L
										MO	.24		mg/L
						TTO(413+433)-P	A	Q	F	DM	2130		ug/L
						ZINC	Q	Q	F	DM	2.61		mg/L
										MO	1.48		mg/L
				600	21,206	FLOW R MAX DRY				L	DM	750	gpm
						FLOW R MAX WET				L	DM	500	gpm
						OIL/GREASE	Q	Q	L	DM	500		mg/L
						PH	Q	Q	L	DM	5	12.5	pH
11-0189	07-A	Cintas Corporation	675 32nd St, San Diego	110	32,286	CADMIUM	Q	Q	L	DM	1		mg/L
						CHROMIUM	Q	Q	L	DM	5		mg/L
						COPPER	Q	Q	L	DM	11		mg/L
						LEAD	Q	Q	L	DM	5		mg/L
						NICKEL	Q	Q	L	DM	13		mg/L
						OIL/GREASE	Q	Q	L	DM	500		mg/L
						PH	Q	Q	L	DM	5	12.5	pH
						ZINC	Q	Q	L	DM	24		mg/L
11-0321	04-A	Star Laundry Services	3410 Main St, San Diego	100	38,970	OIL/GREASE	Q	Q	L	DM	500		mg/L

SIU Facilities: Regulated Parameters by Connection

Report run on: Tuesday, January 3, 2023 9:11 am

Page 16

Facility	Pmt	Name	Address	Conn	Total IW (gpd)	Parmcode	City freq	Self freq	Cat	Period	Lower Limit	Upper Limit	Units
11-0321	04-A	Star Laundry Services	3410 Main St, San Diego	100	38,970	PH	Q	Q	L	DM	5	12.5	pH
11-0398	08-A	Unifirst Corporation	4041 Market St, San Diego	110	25,535	CADMIUM	Q	Q	L	DM		1	mg/L
						CHROMIUM	Q	Q	L	DM		5	mg/L
						COPPER	Q	Q	L	DM		11	mg/L
						LEAD	Q	Q	L	DM		5	mg/L
						NICKEL	Q	Q	L	DM		13	mg/L
						OIL/GREASE	Q	Q	L	DM		500	mg/L
						PH	Q	Q	L	DM	5	12.5	pH
						PH HIGHEST	A		L	DM		12.5	pH
						ZINC	Q	Q	L	DM		24	mg/L
11-0444	06-A	CP Kelco	2025 E Harbor Dr, San Diego	430	44,000	PH	M	M	L	DM	5	12.5	pH
						PH HIGHEST	Q		L	DM		12.5	pH
						SULFIDE DISSOLVD	M	Q	L	DM		1	mg/L
						ZINC	Q	Q	L	DM		24	mg/L
				800	408,488	PH	M	M	L	DM	5	12.5	pH
						PH HIGHEST	M		L	DM		12.5	pH
						SULFIDE DISSOLVD	M	Q	L	DM		1	mg/L
						ZINC	Q	Q	L	DM		24	mg/L
11-0534	04-A	UT; City of San Diego - Storm Water Division	111 W Harbor Dr, San Diego	100	226,980	FLOW R MAX COMB		M	L	DM		500	gpm
11-0629	01-A	UT; Michels Construction Inc	1709 Main St, San Diego	100	288,000	BNZ(W/OAGG)	Q	M	L	DM		50	ug/L
						BTEX	Q	M	L	DM		750	ug/L
						FLOW R MAX WET		M	L	DM		0	gpm
						FLOW RATE MAX		M	L	DM		200	gpm
						LEAD	Q	M	L	DM		5	mg/L
						PETROLEUM HC	Q	M	L	DM		500	mg/L
						TPH		M	L	DM		500	mg/L
				200	259,200	BNZ(W/OAGG)	Q	M	L	DM		50	ug/L
						BTEX	Q	M	L	DM		750	ug/L
						FLOW R MAX WET		M	L	DM		0	gpm
						FLOW RATE MAX		M	L	DM		180	gpm
						LEAD	Q	M	L	DM		5	mg/L
						PETROLEUM HC	Q	M	L	DM		500	mg/L
						TPH		M	L	DM		500	mg/L
				300	115,200	BNZ(W/OAGG)	Q	M	L	DM		50	ug/L
						BTEX	Q	M	L	DM		750	ug/L
						FLOW R MAX WET		M	L	DM		0	gpm
						FLOW RATE MAX		M	L	DM		80	gpm
						LEAD	Q	M	L	DM		5	mg/L
						PETROLEUM HC	Q	M	L	DM		500	mg/L
						TPH		M	L	DM		500	mg/L
12-0038	06-A	RJ Donovan Correctional Facility	480 Alta Rd, San Diego	100	13,700	OIL/GREASE	H	Q	L	DM		500	mg/L

SIU Facilities: Regulated Parameters by Connection

Report run on: Tuesday, January 3, 2023 9:11 am

Page 17

Facility	Pmt	Name	Address	Conn	Total IW (gpd)	Parmcode	City freq	Self freq	Cat	Period	Lower Limit	Upper Limit	Units
12-0038	06-A	RJ Donovan Correctional Facility	480 Alta Rd, San Diego	100	13,700	PH	H	Q	L	DM	5	12.5	pH
12-0065	06-A	Emerald Textiles Services San Diego LLC	1725 Dornoch Ct, San Diego	110	100,390	COPPER	Q	M	L	DM		11	mg/L
						FLOW RATE MAX		M	L	DM		98	gpm
						OIL/GREASE	Q	M	L	DM		500	mg/L
						PH	Q	M	L	DM	5	12.5	pH
						PH HIGHEST	Q		L	DM		12.5	pH
						SULFIDE DISSOLVD	Q	M	L	DM		1	mg/L
						TDS	Q	M	L	DM		1300	mg/L
						ZINC	Q	M	L	DM		24	mg/L
12-0144	06-A	AP Precision Metals	1215 30th St, San Diego	110	100	CADMIUM	Q	Q	F	DM		.11	mg/L
										MO		.07	mg/L
						CHROMIUM	Q	Q	F	DM		2.77	mg/L
										MO		1.71	mg/L
						COPPER	Q	Q	F	DM		3.38	mg/L
										MO		2.07	mg/L
						CYANIDE(T)	Q	Q	F	DM		1.2	mg/L
										MO		.65	mg/L
						LEAD	Q	Q	F	DM		.69	mg/L
										MO		.43	mg/L
						NICKEL	Q	Q	F	DM		3.98	mg/L
										MO		2.38	mg/L
						PH	Q	Q	L	DM	5	12.5	pH
						SILVER	Q	Q	F	DM		.43	mg/L
										MO		.24	mg/L
						TTO(413+433)-P	A	Q	F	DM		2130	ug/L
						ZINC	Q	Q	F	DM		2.61	mg/L
										MO		1.48	mg/L
12-0154	05-A	Kraft Heinz Foods Company	7878 Airway Rd, San Diego	110	102,142	OIL/GREASE	Q	M	L	DM		500	mg/L
						PH	Q	M	L	DM	5	12.5	pH
						PH HIGHEST	Q		L	DM		12.5	pH
						SULFIDE DISSOLVD	Q	Q	L	DM		1	mg/L
						TEMP	Q	M	L	DM		65.5	DegC
12-0212	03-A	Tarantino Wholesale Food Distributor	7651 Saint Andrews Av, San Diego	100	6,555	OIL/GREASE	Q	Q	L	DM		500	mg/L
						PH	Q	Q	L	DM	5	12.5	pH
						SULFIDE DISSOLVD	Q	Q	L	DM		1	mg/L
				210	8,010	OIL/GREASE	Q	Q	L	DM		500	mg/L
						PH	Q	Q	L	DM	5	12.5	pH
						SULFIDE DISSOLVD	Q	Q	L	DM		1	mg/L
12-0220	06-A	Ajinomoto Foods North America Inc	8411 Siempre Viva Rd, San Diego	110	83,300	OIL/GREASE	Q	M	L	DM		500	mg/L
						PH	Q	M	L	DM	5	12.5	pH
						PH HIGHEST	Q		L	DM		12.5	pH
						SULFIDE DISSOLVD	Q	M	L	DM		1	mg/L

SIU Facilities: Regulated Parameters by Connection

Report run on: Tuesday, January 3, 2023 9:11 am

Page 18

Facility	Pmt	Name	Address	Conn	Total IW (gpd)	Parmcode	City freq	Self freq	Cat	Period	Lower Limit	Upper Limit	Units
12-0220	06-A	Ajinomoto Foods North America Inc	8411 Siempre Viva Rd, San Diego	110	83,300	TDS TEMP	Q Q	M M	L L	DM DM		1300 65.5	mg/L DegC
12-0244	03-A	Harcon Precision Metals Inc	1790 Dornoch Ct, San Diego	110	70	CADMIUM	S	S	F	DM		.11	mg/L
						CHROMIUM	S	S	F	DM		.07	mg/L
						COPPER	S	S	F	DM		2.77	mg/L
						CYANIDE(T)	S	S	F	DM		1.71	mg/L
						LEAD	S	S	F	DM		3.38	mg/L
						NICKEL	S	S	F	DM		2.07	mg/L
						OIL/GREASE	S	S	L	DM		1.2	mg/L
						PH	S	S	L	DM	5	.65	mg/L
						SILVER	S	S	F	DM		.69	mg/L
						TTO(413+433)-P	A	S	F	DM		.43	mg/L
						ZINC	S	S	F	DM		2.38	mg/L
12-0275	04-A	Jensen Meat Company Inc	2550 Britannia Bl Suite 101, San Diego	110	32,300	COPPER	Q	Q	L	DM		500	mg/L
						OIL/GREASE	Q	Q	L	DM		12.5	pH
						PH	Q	Q	L	DM	5	12.5	pH
						PH HIGHEST	Q	Q	L	DM		1	mg/L
12-0283	03-A	Spectex Inc dba Specialty Textile Services	1333 30th St Suite A, San Diego	110	47,853	SULFIDE DISSOLVD	Q	Q	L	DM		500	mg/L
						OIL/GREASE	Q	Q	L	DM		12.5	pH
						PH	Q	Q	L	DM	5	12.5	pH
						PH HIGHEST	Q	Q	L	DM		1	mg/L
						SULFIDE DISSOLVD	Q	Q	L	DM		1	mg/L
12-0285	03-A	US General Services Administration - SYLPOE	720 E San Ysidro Bl, San Diego	110	50	SULFIDE DISSOLVD	Q	Q	L	DM		10000	mg/L
						TSS	Q	M	L	DM			
13-0530	02-A	UT; ExxonMobil Oil Corporation c/o ETIC	745 H St, Chula Vista	100	14,400	111-3CLETH	Q	Q	L	DM		500	ug/L
						12-2CLETHA	Q	Q	L	DM		500	ug/L
						3CLETHE	Q	Q	L	DM		500	ug/L
						4CLETHE	Q	Q	L	DM		700	ug/L
						BNZ(W/OAGG)	Q	Q	L	DM		50	ug/L
						BTEX	Q	Q	L	DM		750	ug/L
						CHLOROFORM	Q	Q	L	DM		600	ug/L
						FLOW RATE MAX		M	L	DM		20	gpm
						PETROLEUM HC	Q	Q	L	DM		500	mg/L
						TPH		Q	L	DM		500	mg/L

SIU Facilities: Regulated Parameters by Connection

Report run on: Tuesday, January 3, 2023 9:11 am

Page 19

Facility	Pmt	Name	Address	Conn	Total IW (gpd)	Parmcode	City freq	Self freq	Cat	Period	Lower Limit	Upper Limit	Units
13-0549	03-A	UT; Brenntag Pacific Inc	1888 Nirvana Av, Chula Vista	100	10,080	3CLETHE	Q	Q	L	DM		26	ug/L
						4CLETHE	Q	Q	L	DM		700	ug/L
						BNZ(W/OAGG)	Q	Q	L	DM		50	ug/L
						BTEX	Q	Q	L	DM		750	ug/L
						FLOW MAX		M	L	DM		10080	gpd
						FLOW RATE MAX		M	L	DM		20	gpm
13-0553	01-A	AQX2 Inc DBA Aqua Clean	4290 Main St, Chula Vista	110	28,900	PH	Q		L	DM	5	12.5	pH
		Express		111	28,900	INDSUMP	Q		L	DM		50	Grade
16-0033	07-A	Garvin Industries	316 Millar Av, El Cajon	110	75	CADMIUM	Q	Q	F	DM		.11	mg/L
										MO		.07	mg/L
						CHROMIUM	Q	Q	F	DM		2.77	mg/L
										MO		1.71	mg/L
						COPPER	Q	Q	F	DM		3.38	mg/L
										MO		2.07	mg/L
						CYANIDE(T)	Q	Q	F	DM		1.2	mg/L
										MO		.65	mg/L
						LEAD	Q	Q	F	DM		.69	mg/L
										MO		.43	mg/L
						NICKEL	Q	Q	F	DM		3.98	mg/L
										MO		2.38	mg/L
						PH	Q	Q	L	DM	5	12.5	pH
						SILVER	Q	Q	F	DM		.43	mg/L
										MO		.24	mg/L
						TTO(413+433)-P	S	Q	F	DM		2130	ug/L
						ZINC	Q	Q	F	DM		2.61	mg/L
										MO		1.48	mg/L
16-0348	05-A	Veridiam Inc	1717 Cuyamaca St, El Cajon	110	3,243	AMMONIA	Q	Q	F	DM		6.71	mg/L
										MO		2.95	mg/L
						CADMIUM	Q	Q	F	DM		.07	mg/L
										MO		.04	mg/L
						CHROMIUM	Q	Q	F	DM		1.4	mg/L
										MO		.86	mg/L
						COPPER	Q	Q	F	DM		2.11	mg/L
										MO		1.29	mg/L
						CYANIDE(T)	Q	Q	F	DM		.59	mg/L
										MO		.32	mg/L
						FLUORIDE	Q	Q	F	DM		1.31	mg/L
										MO		.58	mg/L
						LEAD	Q	Q	F	DM		.42	mg/L
										MO		.26	mg/L
						NICKEL	Q	Q	F	DM		2.01	mg/L
										MO		1.2	mg/L

SIU Facilities: Regulated Parameters by Connection

Report run on: Tuesday, January 3, 2023 9:11 am

Page 20

Facility	Pmt	Name	Address	Conn	Total IW (gpd)	Parmcode	City freq	Self freq	Cat	Period	Lower Limit	Upper Limit	Units
16-0348	05-A	Veridiam Inc	1717 Cuyamaca St, El Cajon	110	3,243	PH SILVER	Q Q	Q Q	L F	DM DM MO	5 .27 .15	12.5 mg/L mg/L	pH
						TTO(413+433)-P ZINC	A Q	Q Q	F F	DM DM MO	1332 1.58 .9	ug/L mg/L mg/L	
16-0520	06-B	GKN Aerospace Chem-tronics Inc	1150 W Bradley Av, El Cajon	110	20,527	CADMIUM	Q	Q	F	DM MO	.6 .23	mg/L mg/L	
						CHROMIUM	Q	Q	F	DM MO	2.77 1.71	mg/L mg/L	
						COPPER	Q	Q	F	DM MO	3.38 2.07	mg/L mg/L	
						CYANIDE(T)	Q	Q	F	DM MO	1.2 .65	mg/L mg/L	
						LEAD	Q	Q	F	DM MO	.69 .43	mg/L mg/L	
						NICKEL	Q	Q	F	DM MO	3.98 2.38	mg/L mg/L	
						PH	Q	Q	L	DM	5	12.5	pH
						PH HIGHEST	Q		L	DM		12.5	pH
						SILVER	Q	Q	F	DM MO	.43 .24	mg/L mg/L	
						TTO(413+433)-P ZINC	A Q	Q Q	F F	DM DM MO	2130 2.61 1.48	ug/L mg/L mg/L	
				210	13,429	CADMIUM	Q	Q	F	DM MO	.62 .23	mg/L mg/L	
						CHROMIUM	Q	Q	F	DM MO	2.77 1.71	mg/L mg/L	
						COPPER	Q	Q	F	DM MO	3.38 2.07	mg/L mg/L	
						CYANIDE(T)	Q	Q	F	DM MO	1.2 .65	mg/L mg/L	
						LEAD	Q	Q	F	DM MO	.69 .43	mg/L mg/L	
						NICKEL	Q	Q	F	DM MO	3.98 2.38	mg/L mg/L	
						PH	Q	Q	L	DM	5	12.5	pH
						PH HIGHEST	Q		L	DM		12.5	pH
						SILVER	Q	Q	F	DM MO	.43 .24	mg/L mg/L	
						TTO(413+433)-P	A	Q	F	DM		2130	ug/L

SIU Facilities: Regulated Parameters by Connection

Report run on: Tuesday, January 3, 2023 9:11 am

Page 21

Facility	Pmt	Name	Address	Conn	Total IW (gpd)	Parmcode	City freq	Self freq	Cat	Period	Lower Limit	Upper Limit	Units
16-0520	06-B	GKN Aerospace Chem-tronics Inc	1150 W Bradley Av, El Cajon	210	13,429	ZINC	Q	Q	F	DM		2.61	mg/L
										MO		1.48	mg/L
				410	1,065	CADMIUM	Q	Q	F	DM		.11	mg/L
										MO		.07	mg/L
						CHROMIUM	Q	Q	F	DM		2.77	mg/L
										MO		1.71	mg/L
						COPPER	Q	Q	F	DM		3.38	mg/L
										MO		2.07	mg/L
						CYANIDE(T)	Q	Q	F	DM		1.2	mg/L
										MO		.65	mg/L
						LEAD	Q	Q	F	DM		.69	mg/L
										MO		.43	mg/L
						NICKEL	Q	Q	F	DM		3.98	mg/L
										MO		2.38	mg/L
						PH	Q	Q	L	DM	5	12.5	pH
						SILVER	Q	Q	F	DM		.43	mg/L
										MO		.24	mg/L
						TTO(413+433)-P	A	Q	F	DM		2130	ug/L
						ZINC	Q	Q	F	DM		2.61	mg/L
										MO		1.48	mg/L
				420	220	CADMIUM	Q	Q	F	DM		.11	mg/L
										MO		.07	mg/L
						CHROMIUM	Q	Q	F	DM		2.77	mg/L
										MO		1.71	mg/L
						COPPER	Q	Q	F	DM		3.38	mg/L
										MO		2.07	mg/L
						CYANIDE(T)	Q	Q	F	DM		1.2	mg/L
										MO		.65	mg/L
						LEAD	Q	Q	F	DM		.69	mg/L
										MO		.43	mg/L
						NICKEL	Q	Q	F	DM		3.98	mg/L
										MO		2.38	mg/L
						SILVER	Q	Q	F	DM		.43	mg/L
										MO		.24	mg/L
						TTO(413+433)-P	A	Q	F	DM		2130	ug/L
						ZINC	Q	Q	F	DM		2.61	mg/L
										MO		1.48	mg/L
				450	200	CADMIUM	Q	Q	F	DM		.11	mg/L
										MO		.07	mg/L
						CHROMIUM	Q	Q	F	DM		2.77	mg/L
										MO		1.71	mg/L
						COPPER	Q	Q	F	DM		3.38	mg/L

SIU Facilities: Regulated Parameters by Connection

Report run on: Tuesday, January 3, 2023 9:11 am

Page 22

Facility	Pmt	Name	Address	Conn	Total IW (gpd)	Parmcode	City freq	Self freq	Cat	Period	Lower Limit	Upper Limit	Units
16-0520	06-B	GKN Aerospace Chem-tronics Inc	1150 W Bradley Av, El Cajon	450	200	COPPER	Q	Q	F	MO	2.07		mg/L
						CYANIDE(T)	Q	Q	F	DM	1.2		mg/L
										MO	.65		mg/L
						LEAD	Q	Q	F	DM	.69		mg/L
										MO	.43		mg/L
						NICKEL	Q	Q	F	DM	3.98		mg/L
										MO	2.38		mg/L
						SILVER	Q	Q	F	DM	.43		mg/L
										MO	.24		mg/L
						TTO(413+433)-P	A	Q	F	DM	2130		ug/L
						ZINC	Q	Q	F	DM	2.61		mg/L
										MO	1.48		mg/L
				460	200	CADMIUM	Q	Q	F	DM	.11		mg/L
										MO	.07		mg/L
						CHROMIUM	Q	Q	F	DM	2.77		mg/L
										MO	1.71		mg/L
						COPPER	Q	Q	F	DM	3.38		mg/L
										MO	2.07		mg/L
						CYANIDE(T)	Q	Q	F	DM	1.2		mg/L
										MO	.65		mg/L
						LEAD	Q	Q	F	DM	.69		mg/L
										MO	.43		mg/L
						NICKEL	Q	Q	F	DM	3.98		mg/L
										MO	2.38		mg/L
						SILVER	Q	Q	F	DM	.43		mg/L
										MO	.24		mg/L
						TTO(413+433)-P	A	Q	F	DM	2130		ug/L
						ZINC	Q	Q	F	DM	2.61		mg/L
										MO	1.48		mg/L
				510	129	CADMIUM	Q	Q	F	DM	.11		mg/L
										MO	.07		mg/L
						CHROMIUM	Q	Q	F	DM	2.77		mg/L
										MO	1.71		mg/L
						COPPER	Q	Q	F	DM	3.38		mg/L
										MO	2.07		mg/L
						CYANIDE(T)	Q	Q	F	DM	1.2		mg/L
										MO	.65		mg/L
						LEAD	Q	Q	F	DM	.69		mg/L
										MO	.43		mg/L
						NICKEL	Q	Q	F	DM	3.98		mg/L
										MO	2.38		mg/L
						SILVER	Q	Q	F	DM	.43		mg/L

SIU Facilities: Regulated Parameters by Connection

Report run on: Tuesday, January 3, 2023 9:11 am

Page 23

Facility	Pmt	Name	Address	Conn	Total IW (gpd)	Parmcode	City freq	Self freq	Cat	Period	Lower Limit	Upper Limit	Units
16-0520	06-B	GKN Aerospace Chem-tronics Inc	1150 W Bradley Av, El Cajon	510	129	SILVER	Q	Q	F	MO	.24		mg/L
						TTO(413+433)-P	A	Q	F	DM	2130		ug/L
						ZINC	Q	Q	F	DM	2.61		mg/L
										MO	1.48		mg/L
				610	90	CADMIUM	Q	Q	F	DM	.11		mg/L
										MO	.07		mg/L
						CHROMIUM	Q	Q	F	DM	2.77		mg/L
										MO	1.71		mg/L
						COPPER	Q	Q	F	DM	3.38		mg/L
										MO	2.07		mg/L
						CYANIDE(T)	Q	Q	F	DM	1.2		mg/L
										MO	.65		mg/L
						LEAD	Q	Q	F	DM	.69		mg/L
										MO	.43		mg/L
						NICKEL	Q	Q	F	DM	3.98		mg/L
										MO	2.38		mg/L
						SILVER	Q	Q	F	DM	.43		mg/L
										MO	.24		mg/L
						TTO(413+433)-P	A	Q	F	DM	2130		ug/L
						ZINC	Q	Q	F	DM	2.61		mg/L
										MO	1.48		mg/L
16-0785	06-A	UT; Ametek Inc	790 Greenfield Dr, El Cajon	100	29,100	3CLETHE	Q	Q	L	DM	26		ug/L
						4CLETHE	Q	Q	L	DM	700		ug/L
						FLOW R MAX DRY		M	L	DM	50		gpm
						FLOW R MAX RESTR		M	L	DM	20		gpm
						FLOW R MAX WET		M	L	DM	0		gpm
20-0043	07-A	Somacis Inc	13500 Danielson St, Poway	110	32,108	CADMIUM	Q	Q	F	DM	.11		mg/L
										MO	.07		mg/L
						CHROMIUM	Q	Q	F	DM	2.77		mg/L
										MO	1.71		mg/L
						COPPER	Q	Q	F	DM	3.38		mg/L
										MO	2.07		mg/L
						LEAD	Q	Q	F	DM	.69		mg/L
										MO	.43		mg/L
						NICKEL	Q	Q	F	DM	3.98		mg/L
										MO	2.38		mg/L
						PH	Q	Q	L	DM	5	12.5	pH
						PH HIGHEST	S		L	DM		12.5	pH
						SILVER	Q	Q	F	DM	.43		mg/L
										MO	.24		mg/L
						TTO(413+433)-P	A	Q	F	DM	2130		ug/L
						ZINC	Q	Q	F	DM	2.61		mg/L

SIU Facilities: Regulated Parameters by Connection

Report run on: Tuesday, January 3, 2023 9:11 am

Page 24

Facility	Pmt	Name	Address	Conn	Total IW (gpd)	Parmcode	City freq	Self freq	Cat	Period	Lower Limit	Upper Limit	Units
20-0043	07-A	Somacis Inc	13500 Danielson St, Poway	110	32,108	ZINC	Q	Q	F	MO	1.48		mg/L
				111	5	CYANIDE(A)	Q	Q	F	DM	.86		mg/L
										MO	.32		mg/L
				112	165	CYANIDE(T)	Q	Q	F	DM	1.2		mg/L
										MO	.65		mg/L
20-0108	06-A	Valley Metals	13125 Gregg St, Poway	110	779	AMMONIA	Q	Q	F	DM	447.11		mg/L
										MO	196.68		mg/L
						CADMIUM	Q	Q	F	DM	.11		mg/L
										MO	.07		mg/L
						CHROMIUM	Q	Q	F	DM	1.25		mg/L
										MO	.75		mg/L
						COPPER	Q	Q	F	DM	3.38		mg/L
										MO	2.07		mg/L
						CYANIDE(T)	Q	Q	F	DM	.66		mg/L
										MO	.33		mg/L
						FLUORIDE	Q	Q	F	DM	69.67		mg/L
										MO	30.88		mg/L
						LEAD	Q	Q	F	DM	.93		mg/L
										MO	.51		mg/L
						NICKEL	Q	Q	F	DM	1.8		mg/L
										MO	1.09		mg/L
						PH	Q	Q	L	DM	5	12.5	pH
						PH HIGHEST	Q		L	DM		12.5	pH
						SILVER	Q	Q	F	DM	.43		mg/L
										MO	.24		mg/L
						TTO(413+433)-P	A	Q	F	DM	2130		ug/L
						ZINC	Q	Q	F	DM	3.36		mg/L
										MO	1.66		mg/L
20-0109	07-A	L & T Precision Corporation	12105 Kirkham Rd, Poway	120	35	CADMIUM	Q	Q	F	DM	.11		mg/L
										MO	.07		mg/L
						CHROMIUM	Q	Q	F	DM	2.77		mg/L
										MO	1.71		mg/L
						COPPER	Q	Q	F	DM	3.38		mg/L
										MO	2.07		mg/L
						CYANIDE(T)	Q	Q	F	DM	1.2		mg/L
										MO	.65		mg/L
						LEAD	Q	Q	F	DM	.69		mg/L
										MO	.43		mg/L
						NICKEL	Q	Q	F	DM	3.98		mg/L
										MO	2.38		mg/L
						PH	Q	Q	L	DM	5	12.5	pH
						SILVER	Q	Q	F	DM	.43		mg/L

SIU Facilities: Regulated Parameters by Connection

Report run on: Tuesday, January 3, 2023 9:11 am

Page 25

Facility	Pmt	Name	Address	Conn	Total IW (gpd)	Parmcode	City freq	Self freq	Cat	Period	Lower Limit	Upper Limit	Units
20-0109	07-A	L & T Precision Corporation	12105 Kirkham Rd, Poway	120	35	SILVER	Q	Q	F	MO	.24		mg/L
						TTO(413+433)-P	A	Q	F	DM	2130		ug/L
						ZINC	Q	Q	F	DM	2.61		mg/L
										MO	1.48		mg/L
20-0122	05-B	K-Tube Corporation	13400 Kirkham Wy, Poway	110	250	CADMIUM	Q	Q	F	DM	.11		mg/L
										MO	.07		mg/L
						CHROMIUM	Q	Q	F	DM	2.77		mg/L
										MO	1.71		mg/L
						COPPER	Q	Q	F	DM	3.38		mg/L
										MO	2.07		mg/L
						CYANIDE(T)	Q	Q	F	DM	1.2		mg/L
										MO	.65		mg/L
						LEAD	Q	Q	F	DM	.69		mg/L
										MO	.43		mg/L
						NICKEL	Q	Q	F	DM	3.98		mg/L
										MO	2.38		mg/L
						PH	Q	Q	L	DM	5	12.5	pH
						PH HIGHEST	S		L	DM	12.5		pH
						SILVER	Q	Q	F	DM	.43		mg/L
										MO	.24		mg/L
						TTO(413+433)-P	A	Q	F	DM	2130		ug/L
						ZINC	Q	Q	F	DM	2.61		mg/L
										MO	1.48		mg/L
				120	830	CADMIUM	Q	Q	F	DM	.11		mg/L
										MO	.07		mg/L
						CHROMIUM	Q	Q	F	DM	2.77		mg/L
										MO	1.71		mg/L
						COPPER	Q	Q	F	DM	3.38		mg/L
										MO	2.07		mg/L
						CYANIDE(T)	Q	Q	F	DM	1.2		mg/L
										MO	.65		mg/L
						LEAD	Q	Q	F	DM	.69		mg/L
										MO	.43		mg/L
						NICKEL	Q	Q	F	DM	3.98		mg/L
										MO	2.38		mg/L
						PH	Q	Q	L	DM	5	12.5	pH
						PH HIGHEST	S		L	DM	12.5		pH
						SILVER	Q	Q	F	DM	.43		mg/L
										MO	.24		mg/L
						TTO(413+433)-P	A	Q	F	DM	2130		ug/L
						ZINC	Q	Q	F	DM	2.61		mg/L
										MO	1.48		mg/L

SIU Facilities: Regulated Parameters by Connection

Report run on: Tuesday, January 3, 2023 9:11 am

Page 26

Facility	Pmt	Name	Address	Conn	Total IW (gpd)	Parmcode	City freq	Self freq	Cat	Period	Lower Limit	Upper Limit	Units
21-0248	06-A	Creative Metal Industries	10039 Prospect Av Suite E, Santee	110	90	CADMIUM	Q	Q	F	DM	.11		mg/L
										MO	.07		mg/L
						CHROMIUM	Q	Q	F	DM	2.77		mg/L
										MO	1.71		mg/L
						COPPER	Q	Q	F	DM	3.38		mg/L
										MO	2.07		mg/L
						CYANIDE(T)	Q	Q	F	DM	1.2		mg/L
										MO	.65		mg/L
						LEAD	Q	Q	F	DM	.69		mg/L
										MO	.43		mg/L
						NICKEL	Q	Q	F	DM	3.98		mg/L
										MO	2.38		mg/L
						PH	Q	Q	L	DM	5	12.5	pH
						SILVER	Q	Q	F	DM	.43		mg/L
										MO	.24		mg/L
						TTO(413+433)-P	A	Q	F	DM	2130		ug/L
						ZINC	Q	Q	F	DM	2.61		mg/L
										MO	1.48		mg/L
21-0252	06-A	Compucraft Industries Inc	8787 Olive Ln, Santee	110	170	CADMIUM	Q	Q	F	DM	.11		mg/L
										MO	.07		mg/L
						CHROMIUM	Q	Q	F	DM	2.77		mg/L
										MO	1.71		mg/L
						COPPER	Q	Q	F	DM	3.38		mg/L
										MO	2.07		mg/L
						CYANIDE(T)	Q	Q	F	DM	1.2		mg/L
										MO	.65		mg/L
						LEAD	Q	Q	F	DM	.69		mg/L
										MO	.43		mg/L
						NICKEL	Q	Q	F	DM	3.98		mg/L
										MO	2.38		mg/L
						OIL/GREASE	Q	Q	L	DM	500		mg/L
						PH	Q	Q	L	DM	5	12.5	pH
						PH HIGHEST	A		L	DM	12.5		pH
						SILVER	Q	Q	F	DM	.43		mg/L
										MO	.24		mg/L
						TTO(413+433)-P	S	Q	F	DM	2130		ug/L
						ZINC	Q	Q	F	DM	2.61		mg/L
										MO	1.48		mg/L
				120	170	CADMIUM	Q	Q	F	DM	.11		mg/L
										MO	.07		mg/L
						CHROMIUM	Q	Q	F	DM	2.77		mg/L
										MO	1.71		mg/L

SIU Facilities: Regulated Parameters by Connection

Report run on: Tuesday, January 3, 2023 9:11 am

Page 27

Facility	Pmt	Name	Address	Conn	Total IW (gpd)	Parmcode	City freq	Self freq	Cat	Period	Lower Limit	Upper Limit	Units
21-0252	06-A	Compucraft Industries Inc	8787 Olive Ln, Santee	120	170	COPPER	Q	Q	F	DM		3.38	mg/L
										MO		2.07	mg/L
						CYANIDE(T)	Q	Q	F	DM		1.2	mg/L
										MO		.65	mg/L
						LEAD	Q	Q	F	DM		.69	mg/L
										MO		.43	mg/L
						NICKEL	Q	Q	F	DM		3.98	mg/L
										MO		2.38	mg/L
						OIL/GREASE	Q	Q	L	DM		500	mg/L
						PH	Q	Q	L	DM	5	12.5	pH
						PH HIGHEST	A		L	DM		12.5	pH
						SILVER	Q	Q	F	DM		.43	mg/L
										MO		.24	mg/L
						TTO(413+433)-P	S	Q	F	DM		2130	ug/L
						ZINC	Q	Q	F	DM		2.61	mg/L
										MO		1.48	mg/L
21-0288	02-A	Vision Systems Inc	11322 N Woodside Av, Santee	110	260	CADMIUM	Q	Q	F	DM		.11	mg/L
										MO		.07	mg/L
						CHROMIUM	Q	Q	F	DM		2.77	mg/L
										MO		1.71	mg/L
						COPPER	Q	Q	F	DM		3.38	mg/L
										MO		2.07	mg/L
						CYANIDE(T)	Q	Q	F	DM		1.2	mg/L
										MO		.65	mg/L
						LEAD	Q	Q	F	DM		.69	mg/L
										MO		.43	mg/L
						NICKEL	Q	Q	F	DM		3.98	mg/L
										MO		2.38	mg/L
						PH	Q	Q	L	DM	5	12.5	pH
						SILVER	Q	Q	F	DM		.43	mg/L
										MO		.24	mg/L
						TTO(413+433)-P	S	Q	F	DM		2130	ug/L
						ZINC	Q	Q	F	DM		2.61	mg/L
										MO		1.48	mg/L
				120	260	CADMIUM	Q	Q	F	DM		.11	mg/L
										MO		.07	mg/L
						CHROMIUM	Q	Q	F	DM		2.77	mg/L
										MO		1.71	mg/L
						COPPER	Q	Q	F	DM		3.38	mg/L
										MO		2.07	mg/L
						CYANIDE(A)	Q	Q	F	DM		.86	mg/L
										MO		.32	mg/L

SIU Facilities: Regulated Parameters by Connection

Report run on: Tuesday, January 3, 2023 9:11 am

Page 28

Facility	Pmt	Name	Address	Conn	Total IW (gpd)	Parmcode	City freq	Self freq	Cat	Period	Lower Limit	Upper Limit	Units
21-0288	02-A	Vision Systems Inc	11322 N Woodside Av, Santee	120	260	LEAD	Q	Q	F	DM	.69		mg/L
						NICKEL	Q	Q	F	DM	.43		mg/L
						PH	Q	Q	L	DM	3.98		mg/L
						SILVER	Q	Q	F	DM	2.38		mg/L
						TTO(413+433)-P	S	Q	F	DM	5	12.5	pH
						ZINC	Q	Q	F	DM	.43		mg/L
										MO	.24		mg/L
										DM	2130		ug/L
										DM	2.61		mg/L
										MO	1.48		mg/L
22-0092	01-A	Valley Powder Coating Inc	6530 Federal Bl, Lemon Grove	110	20	CADMIUM	Q	Q	F	DM	.11		mg/L
						CHROMIUM	Q	Q	F	DM	.07		mg/L
						COPPER	Q	Q	F	DM	2.77		mg/L
						CYANIDE(T)	Q	Q	F	DM	1.71		mg/L
						LEAD	Q	Q	F	DM	3.38		mg/L
						NICKEL	Q	Q	F	DM	2.07		mg/L
						PH	Q	Q	L	DM	1.2		mg/L
						SILVER	Q	Q	F	DM	.65		mg/L
						TTO(413+433)-P	S	Q	F	DM	5	12.5	pH
						ZINC	Q	Q	F	DM	.43		mg/L
										MO	.69		mg/L
										DM	.43		mg/L
										MO	3.98		mg/L
										DM	2.38		mg/L
										DM	5	12.5	pH
										DM	.43		mg/L
										MO	.24		mg/L
										DM	2130		ug/L
										DM	2.61		mg/L
										MO	1.48		mg/L
25-0105	37-A	Otay Landfill Inc	1700 Maxwell Rd, Chula Vista	100	1,000	CADMIUM	M	N	L	DM	1		mg/L
						CHROMIUM	M	N	L	DM	5		mg/L
						COPPER	M	N	L	DM	11		mg/L
						LEAD	M	N	L	DM	5		mg/L
						NICKEL	M	N	L	DM	13		mg/L
						OIL/GREASE	M	N	L	DM	500		mg/L
						PH	M	N	L	DM	5	12.5	pH
						ZINC	M	N	L	DM	24		mg/L
	38-A	Otay Landfill Inc	1700 Maxwell Rd, Chula Vista	100	1,000	CADMIUM	M	M	L	DM	1		mg/L
						CHROMIUM	M	M	L	DM	5		mg/L
						COPPER	M	M	L	DM	11		mg/L
						LEAD	M	M	L	DM	5		mg/L
						NICKEL	M	M	L	DM	13		mg/L
						OIL/GREASE	M	M	L	DM	500		mg/L

SIU Facilities: Regulated Parameters by Connection

Report run on: Tuesday, January 3, 2023 9:11 am

Page 29

<i>Facility</i>	<i>Pmt</i>	<i>Name</i>	<i>Address</i>	<i>Conn</i>	<i>Total IW</i> <i>(gpd)</i>	<i>Parmcode</i>	<i>City</i> <i>freq</i>	<i>Self</i> <i>freq</i>	<i>Cat</i>	<i>Period</i>	<i>Lower</i> <i>Limit</i>	<i>Upper</i> <i>Limit</i>	<i>Units</i>
25-0105	38-A	Otay Landfill Inc	1700 Maxwell Rd, Chula Vista	100	1,000	PH ZINC	M M	M M	L L	DM DM	5	12.5 24	pH mg/L
25-0379	07-A	Pio Pico Energy Center	7363 Calzada de la Fuente, San Diego	100	13,700	PH	Q	M	L	DM	5	12.5	pH
34-0070	05-A	Golden State Metal Finishing	2737 Via Orange Wy Suite 104, Spring Valley	110	171	CADMIUM	Q	Q	F	DM		.11	mg/L
										MO		.07	mg/L
						CHROMIUM	Q	Q	F	DM		2.77	mg/L
										MO		1.71	mg/L
						COPPER	Q	Q	F	DM		3.38	mg/L
										MO		2.07	mg/L
						CYANIDE(T)	Q	Q	F	DM		1.2	mg/L
										MO		.65	mg/L
						LEAD	Q	Q	F	DM		.69	mg/L
										MO		.43	mg/L
						NICKEL	Q	Q	F	DM		3.98	mg/L
										MO		2.38	mg/L
						PH	Q	Q	L	DM	5	12.5	pH
						SILVER	Q	Q	F	DM		.43	mg/L
										MO		.24	mg/L
						TTO(413+433)-P	A	Q	F	DM		2130	ug/L
						ZINC	Q	Q	F	DM		2.61	mg/L
										MO		1.48	mg/L
36-0001	04-B	Otay Mesa Energy Center LLC	606 De La Fuente Ct, San Diego	100	46,616	CHROMIUM	Q	Q	F	DM		.2	mg/L
						OIL/GREASE	Q	Q	L	DM		500	mg/L
						PH	Q	Q	L	DM	5	12.5	pH
						PH HIGHEST	A		L	DM		12.5	pH
						SULFIDE DISSOLVD	Q	Q	L	DM		1	mg/L
						TDS	Q	Q	L	DM		2000	mg/L
						ZINC	Q	Q	F	DM		.99	mg/L
				140	15	COPPER	S	S	F	DM		1	mg/L

Inspections performed at SIUs in 2022

Report run on: Tuesday, January 3, 2023 8:58 am

Page 1

<i>Facility Name</i>	<i>Inspection Type</i>	<i>Completed</i>
02-0112 University of California San Diego	Rainwater Diversion Inspection	13-Jul-2022
	Annual/Renewal Inspection	13-Jul-2022
	Sewer Surcharge Inspection	13-Jul-2022
02-0332 Pall Filtration & Separations Group Inc	Site Visit not elsewhere classified	20-May-2022
	Stormwater Inspection	23-Aug-2022
	Annual/Renewal Inspection	23-Aug-2022
02-0439 Defender SD Manufacturing LLC	Site Visit not elsewhere classified	06-Apr-2022
	Stormwater Inspection	15-Jul-2022
	Annual/Renewal Inspection	15-Jul-2022
02-0518 Suneva Medical Inc	Annual/Renewal Inspection	20-Jan-2022
	Stormwater Inspection	20-Jan-2022
	Annual/Renewal Inspection	09-Aug-2022
02-0582 The Argen Corporation	Stormwater Inspection	09-Aug-2022
	Annual/Renewal Inspection	27-Sep-2022
	Stormwater Inspection	27-Sep-2022
02-0722 Ajinomoto Althea Inc	Sewer Surcharge Inspection	27-Sep-2022
	Stormwater Inspection	18-May-2022
	Annual/Renewal Inspection	18-May-2022
02-0762 Pacira Pharmaceuticals Inc	Stormwater Inspection	29-Nov-2022
	Annual/Renewal Inspection	29-Nov-2022
	Sewer Surcharge Inspection	29-Nov-2022
03-0115 ATK Space Systems Inc	Annual/Renewal Inspection	28-Feb-2022
	Stormwater Inspection	28-Feb-2022
	Site Visit not elsewhere classified	15-Mar-2022
03-0270 Ballast Point Brewery Miramar	Stormwater Inspection	18-Jan-2022
	Annual/Renewal Inspection	18-Jan-2022
	Sewer Surcharge Inspection	19-Jan-2022
03-0347 Sungear	Site Visit not elsewhere classified	15-Nov-2022
	Annual/Renewal Inspection	10-Nov-2022
	Stormwater Inspection	10-Nov-2022
03-0717 Action Powder Coating LLC	Site Visit not elsewhere classified	18-Jan-2022
	Site Visit not elsewhere classified	04-Aug-2022
	Stormwater Inspection	25-Oct-2022
03-0779 IriSys LLC	Annual/Renewal Inspection	25-Oct-2022
	Site Visit not elsewhere classified	15-Apr-2022
	Stormwater Inspection	09-Sep-2022
03-0801 Cue Health Inc	Annual/Renewal Inspection	09-Sep-2022
	Site Visit not elsewhere classified	06-May-2022
	Sewer Surcharge Inspection	20-Sep-2022
03-0920 Alphacoat Finishing LLC	Annual/Renewal Inspection	20-Sep-2022
	Stormwater Inspection	20-Sep-2022
	Stormwater Inspection	10-Mar-2022
03-0966 WC IPA LLC	Annual/Renewal Inspection	10-Mar-2022
	Attachment C Confirmation	16-Dec-2022
	Inactivation Request - Site Visit	23-Feb-2022
03-1017 Anocote Metal Finishing Inc	Site Visit not elsewhere classified	21-Apr-2022
	Stormwater Inspection	11-Oct-2022
	Annual/Renewal Inspection	11-Oct-2022
03-1024 PolyPeptide Laboratories San Diego	Site Visit not elsewhere classified	15-Apr-2022
	Sewer Surcharge Inspection	20-Oct-2022
	Annual/Renewal Inspection	20-Oct-2022
	Stormwater Inspection	20-Oct-2022

Inspections performed at SIUs in 2022

Report run on: Tuesday, January 3, 2023 8:58 am

Page 2

<i>Facility Name</i>	<i>Inspection Type</i>	<i>Completed</i>
03-1070 Johnson Matthey Medical Products	Site Visit not elsewhere classified	11-Jan-2022
	Site Visit not elsewhere classified	05-May-2022
	Annual/Renewal Inspection	07-Jul-2022
	Stormwater Inspection	07-Jul-2022
03-1203 nVent - Schroff Inc	Site Visit not elsewhere classified	21-Apr-2022
	Annual/Renewal Inspection	26-Sep-2022
	Stormwater Inspection	26-Sep-2022
03-1300 JDZ Inc DBA AleSmith Brewing Company	Annual/Renewal Inspection	25-Mar-2022
	Sewer Surcharge Inspection	25-Mar-2022
	Stormwater Inspection	25-Mar-2022
03-1338 Saint Archer Brewing Company	Stormwater Inspection	28-Oct-2022
	Annual/Renewal Inspection	28-Oct-2022
03-1380 Santier Inc	Stormwater Inspection	26-Jan-2022
	Annual/Renewal Inspection	26-Jan-2022
03-1537 UT; Lennar	Inactivation Request - Site Visit	08-Mar-2022
04-0569 UT; SC Valley Engineering Inc	Site Visit not elsewhere classified	10-Mar-2022
	Inactivation Request - Site Visit	13-May-2022
05-0684 Stallergenes Greer dba Allermid Laboratories Inc	Annual/Renewal Inspection	01-Dec-2022
	Stormwater Inspection	01-Dec-2022
05-0985 Chromalloy San Diego	Stormwater Inspection	28-Jan-2022
	Sewer Surcharge Inspection	28-Jan-2022
	Annual/Renewal Inspection	28-Jan-2022
05-0997 TTM Technologies Inc - San Diego Division	Stormwater Inspection	17-Nov-2022
	Annual/Renewal Inspection	17-Nov-2022
05-1019 USN;Marine Corps Air Station Miramar	Rainwater Diversion Inspection	16-Feb-2022
	Annual/Renewal Inspection	16-Feb-2022
05-1351 UT; Flatiron West Inc	Inactivation Request - Site Visit	26-Jul-2022
05-1352 UT; Flatiron West Inc	Annual/Renewal Inspection	04-Feb-2022
05-1353 UT; Flatiron West Inc	Initial Inspection	04-Aug-2022
05-1357 UT; Flatiron West Inc	Initial Inspection	25-Jul-2022
05-1358 UT; Fairfield Development LP	Initial Inspection	01-Aug-2022
06-0058 Kyocera International Inc	Site Visit not elsewhere classified	19-Jul-2022
	Stormwater Inspection	26-Aug-2022
	Annual/Renewal Inspection	26-Aug-2022
	Sewer Surcharge Inspection	18-Oct-2022
06-0414 UT; SDSU Mission Valley Site Development	Annual/Renewal Inspection	08-Feb-2022
	Site Visit not elsewhere classified	12-Apr-2022
08-0008 UT; USN NBPL Defense Fuel Support Point	Annual/Renewal Inspection	29-Nov-2022
08-0018 USN;Naval Base Coronado - NASNI	Annual/Renewal Inspection	17-May-2022
	Site Visit not elsewhere classified	16-Aug-2022
08-0600 UT; Granite Construction Company	Inactivation Request - Site Visit	14-Jun-2022
08-0603 Conrac Managers SAN LLC	Initial Inspection	13-Apr-2022
	Stormwater Inspection	13-Apr-2022
	Sewer Surcharge Inspection	13-Apr-2022
08-0649 UT; Burns & McDonnell	Inactivation Request - Site Visit	13-Jan-2022
08-0659 UT; San Diego Int'l Airport Shuttle Lot	Initial Inspection	07-Jul-2022
	Inactivation Request - Site Visit	30-Aug-2022
	Sewer Surcharge Inspection	30-Mar-2022
09-0001 AlSCO Inc	Annual/Renewal Inspection	30-Mar-2022
	Stormwater Inspection	30-Mar-2022

Inspections performed at SIUs in 2022

Report run on: Tuesday, January 3, 2023 8:58 am

Page 3

<i>Facility</i>	<i>Name</i>	<i>Inspection Type</i>	<i>Completed</i>
09-0048	Zoological Society of San Diego	Annual/Renewal Inspection	27-Oct-2022
09-0947	UT; Arcadis US Inc	Annual/Renewal Inspection	28-Jun-2022
		Site Visit not elsewhere classified	16-Aug-2022
11-0016	USN;Naval Base San Diego	Annual/Renewal Inspection	23-Feb-2022
11-0051	General Dynamics NASSCO	Annual/Renewal Inspection	02-Nov-2022
11-0189	Cintas Corporation	Sewer Surcharge Inspection	06-Jan-2022
		Stormwater Inspection	06-Jan-2022
		Annual/Renewal Inspection	06-Jan-2022
		Stormwater Inspection	19-Oct-2022
		Annual/Renewal Inspection	19-Oct-2022
		Sewer Surcharge Inspection	01-Nov-2022
11-0321	Star Laundry Services	Sewer Surcharge Inspection	17-Feb-2022
		Stormwater Inspection	17-Feb-2022
		Annual/Renewal Inspection	17-Feb-2022
		Annual/Renewal Inspection	13-Dec-2022
		Stormwater Inspection	13-Dec-2022
		Sewer Surcharge Inspection	13-Dec-2022
11-0398	Unifirst Corporation	Annual/Renewal Inspection	03-Mar-2022
		Stormwater Inspection	03-Mar-2022
		Sewer Surcharge Inspection	03-Mar-2022
11-0444	CP Kelco	Annual/Renewal Inspection	16-Nov-2022
11-0534	UT; City of San Diego - Storm Water Division	Annual/Renewal Inspection	17-Jun-2022
11-0629	UT; Michels Construction Inc	Initial Inspection	06-Dec-2022
		Site Visit not elsewhere classified	23-Dec-2022
12-0038	RJ Donovan Correctional Facility	Annual/Renewal Inspection	08-Nov-2022
12-0065	Emerald Textiles LLC	Site Visit not elsewhere classified	24-Feb-2022
12-0065	Emerald Textiles Services San Diego LLC	Sewer Surcharge Inspection	28-Apr-2022
		Stormwater Inspection	28-Apr-2022
		Annual/Renewal Inspection	28-Apr-2022
12-0144	AP Precision Metals	Annual/Renewal Inspection	14-Apr-2022
		Stormwater Inspection	14-Apr-2022
12-0154	Kraft Heinz Foods Company	Site Visit not elsewhere classified	19-May-2022
		Stormwater Inspection	23-Dec-2022
		Annual/Renewal Inspection	23-Dec-2022
12-0212	Tarantino Wholesale Food Distributor	Site Visit not elsewhere classified	03-Feb-2022
		Stormwater Inspection	12-Jul-2022
		Sewer Surcharge Inspection	12-Jul-2022
		Annual/Renewal Inspection	12-Jul-2022
12-0220	Ajinomoto Foods North America Inc	Annual/Renewal Inspection	20-Jan-2022
		Stormwater Inspection	20-Jan-2022
		Sewer Surcharge Inspection	20-Jan-2022
12-0244	Harcon Precision Metals Inc	Site Visit not elsewhere classified	19-May-2022
		Annual/Renewal Inspection	18-Oct-2022
		Stormwater Inspection	25-Oct-2022
		Sewer Surcharge Inspection	25-Oct-2022
12-0275	Jensen Meat Company Inc	Stormwater Inspection	03-Feb-2022
		Rainwater Diversion Inspection	03-Feb-2022
		Sewer Surcharge Inspection	03-Feb-2022
		Annual/Renewal Inspection	03-Feb-2022
12-0283	Spectex Inc dba Specialty Textile Services	Site Visit not elsewhere classified	27-Jan-2022
		Sewer Surcharge Inspection	26-Jul-2022

Inspections performed at SIUs in 2022

Report run on: Tuesday, January 3, 2023 8:58 am

Page 4

<i>Facility Name</i>	<i>Inspection Type</i>	<i>Completed</i>
12-0283 Spectex Inc dba Specialty Textile Services	Stormwater Inspection	26-Jul-2022
	Annual/Renewal Inspection	26-Jul-2022
12-0285 US General Services Administration - SYLPOE	Site Visit not elsewhere classified	22-Jun-2022
	Annual/Renewal Inspection	28-Dec-2022
12-0312 ImageFIRST	Site Visit not elsewhere classified	10-Mar-2022
	Initial Inspection	21-Dec-2022
	Sewer Surcharge Inspection	21-Dec-2022
	Stormwater Inspection	21-Dec-2022
12-0333 UT; Dudek	Initial Inspection	27-Jun-2022
	Inactivation Request - Site Visit	09-Aug-2022
13-0530 UT; ExxonMobil Oil Corporation c/o ETIC	Annual/Renewal Inspection	15-Apr-2022
13-0549 UT; Brenntag Pacific Inc	Annual/Renewal Inspection	09-Nov-2022
13-0553 AQX2 Inc DBA Aqua Clean Express	Site Visit not elsewhere classified	03-Mar-2022
	Initial Inspection	29-Mar-2022
	Site Visit not elsewhere classified	12-Apr-2022
16-0033 Garvin Industries	Annual/Renewal Inspection	21-Apr-2022
16-0348 Veridiam Inc	Annual/Renewal Inspection	06-Dec-2022
16-0520 GKN Aerospace Chem-tronics Inc	Annual/Renewal Inspection	28-Jul-2022
16-0565 UT; Thrifty Oil Company # 043	Inactivation Request - Site Visit	21-Sep-2022
16-0785 UT; Ametek Inc	Annual/Renewal Inspection	20-Jul-2022
20-0026 General Atomics Aeronautical Systems Inc	Annual/Renewal Inspection	03-Mar-2022
20-0043 Somacis Inc	Annual/Renewal Inspection	16-Nov-2022
20-0108 Valley Metals	Annual/Renewal Inspection	23-Mar-2022
20-0109 L & T Precision Corporation	Annual/Renewal Inspection	07-Apr-2022
20-0122 K-Tube Corporation	Site Visit not elsewhere classified	31-May-2022
	Annual/Renewal Inspection	18-Oct-2022
20-0306 UT; SDG&E L1600 Replacement	Site Visit not elsewhere classified	15-Apr-2022
	Inactivation Request - Site Visit	30-Jun-2022
21-0248 Creative Metal Industries	Annual/Renewal Inspection	15-Dec-2022
21-0252 Compucraft Industries Inc	Annual/Renewal Inspection	02-Mar-2022
21-0288 Vision Systems Inc	Annual/Renewal Inspection	27-Sep-2022
21-0331 Coating Services Group LLC	Annual/Renewal Inspection	03-Feb-2022
22-0092 Valley Powder Coating Inc	Site Visit not elsewhere classified	10-Feb-2022
	Annual/Renewal Inspection	24-Jun-2022
33-0077 UT; Granite Construction - Lindo Lake Project	Inactivation Request - Site Visit	29-Mar-2022
34-0070 Golden State Metal Finishing	Annual/Renewal Inspection	05-May-2022
36-0001 Otay Mesa Energy Center LLC	Site Visit not elsewhere classified	25-Jan-2022
	Annual/Renewal Inspection	06-Jul-2022
36-0009 Pio Pico Energy Center	Site Visit not elsewhere classified	15-Mar-2022
	Annual/Renewal Inspection	04-Aug-2022
36-0012 Otay Landfill Inc	Annual/Renewal Inspection	22-Aug-2022
Count:	194	

Active Groundwater Permits

Report run on: Tuesday, January 3, 2023 8:55 am

Page 1

Class 2

Facility	Permit	Name	Address
05-1189	04-A	UT; Thrifty Oil Company #405	2505 Morena Bl, San Diego
06-0414	03-B	UT; SDSU Mission Valley Site Development	9449 Friars Rd, San Diego
08-0008	07-A	UT; USN NBPL Defense Fuel Support Point	199 Rosecrans St, San Diego
09-0947	02-A	UT; Arcadis US Inc	2200 Pacific Hy, San Diego
09-1013	04-A	UT; IQHQ RaDD I LLC	850 Pacific Hy, San Diego
10-0499	04-A	UT; BBC Environmental Inc	Various (Metro Area), San Diego
11-0241	05-B	UT; St Vincent De Paul Village	1501 Imperial Av, San Diego
11-0592	02-A	UT; Apex Companies LLC	3504 Main St, San Diego
11-0629	01-A	UT; Michels Construction Inc	1709 Main St, San Diego
13-0530	02-A	UT; ExxonMobil Oil Corporation c/o ETIC	745 H St, Chula Vista
13-0549	03-A	UT; Brenntag Pacific Inc	1888 Nirvana Av, Chula Vista
16-0785	06-A	UT; Ametek Inc	790 Greenfield Dr, El Cajon

12

Class 3

Facility	Permit	Name	Address
02-1603	01-A	UT; Ohla USA Inc	4767 Executive Dr, San Diego
04-0435	05-A	UT; La Jolla LLC	7817 Ivanhoe Av, San Diego
05-1352	01-B	UT; Flatiron West Inc	887 Sherman St, San Diego
05-1353	01-A	UT; Flatiron West Inc	5400 Friars Rd, San Diego
05-1357	01-A	UT; Flatiron West Inc	4747 Friars Rd, San Diego
05-1358	01-A	UT; Fairfield Development LP	7050 Friars Rd, San Diego
10-0597	02-C	UT; City; PUD Water Distribution Division	6500 Imperial Av, San Diego
11-0534	04-A	UT; City of San Diego - Storm Water Division	111 W Harbor Dr, San Diego

8

Class 4

Facility	Permit	Name	Address
04-0380	01-A	UT; City Environmental Services	1700 Seaworld Dr, San Diego

1

Grand total: 21

Trucked Waste Permits Issued in 2022

Report run on: Tuesday, January 3, 2023 10:17 am

Page 1

Class 6 - Domestic Waste Hauler

Name	Facility	Permit	Expires	Waste Type
A&A Best Septic Pumping	25-0613	02-A	01-Apr-2023	Domestic
A-Pot Rentals Inc	25-0020	28-A	01-Feb-2023	Domestic
A1 Septic Services	25-0563	04-A	01-Apr-2023	Domestic
Abbott Septic Service	25-0458	08-A	01-Feb-2023	Domestic
Action Cleaning Corporation	25-0040	29-A	01-Dec-2023	Domestic
Acuario Sanitation	25-0461	08-A	01-Apr-2023	Domestic
All American Septic Pumping & Services Inc	25-0558	04-A	01-Mar-2023	Domestic
All In Pumping	25-0611	02-A	01-May-2023	Domestic
All-Pro Septicworks LLC	25-0635	01-A	01-Jun-2023	Domestic
Amerivet Contracting Inc	25-0620	02-A	01-Sep-2023	Domestic
Anytime Septic Service Inc	25-0017	23-A	01-Mar-2023	Domestic
Black Gold Industries	25-0320	15-A	01-Sep-2023	Domestic
California Marine Cleaning	25-0330	14-A	01-Mar-2023	Domestic
Center Septic	25-0097	26-A	01-Jul-2023	Domestic
Chariot Restrooms	25-0537	04-A	01-Jun-2023	Domestic
Diamond Environmental Services	25-0106	26-A	01-Dec-2023	Domestic
Downstream Services Inc	25-0592	03-A	01-Dec-2023	Domestic
Dr Septic	25-0632	01-A	01-May-2023	Domestic
JC Environmental Company Inc	25-0594	03-A	01-May-2023	Domestic
JMB Sanitation	25-0289	16-A	01-Sep-2023	Domestic
Jims Appollo Septic Service	25-0463	08-A	01-May-2023	Domestic
Liquid Environmental Solutions of California	25-0042	28-A	01-Mar-2023	Domestic
McKenna Septic & Sewer Services	25-0455	09-A	01-Jul-2023	Domestic
Modern Septic Service Inc	25-0033	28-A	01-Jul-2023	Domestic
NRC Environmental Services Inc	25-0332	14-A	01-May-2023	Domestic
National Construction Rentals Inc	25-0231	18-A	01-Aug-2023	Domestic
Naval Engineering Support Inc	25-0618	02-A	01-Sep-2023	Domestic
Ocean Blue Environmental Inc.	25-0268	05-A	01-Jan-2023	Domestic
Pacific Tank Cleaning Services	25-0626	01-A	01-Jan-2023	Domestic
Patriot Environmental Services Inc	25-0638	01-A	01-Nov-2023	Domestic
Patriot Portable Restrooms	25-0636	01-A	01-Sep-2023	Domestic
Posh Privy	25-0506	06-A	01-Jul-2023	Domestic
Pumpman SoCal	25-0630	01-A	01-Jul-2023	Domestic
Rocket Johns Inc	25-0615	02-A	01-Jul-2023	Domestic
Safiro Portable Toilets	25-0099	26-A	01-Jul-2023	Domestic
Septic Solutions	25-0449	07-A	01-Jan-2023	Domestic
Sludgebusters Septic Service	25-0037	29-A	01-Nov-2023	Domestic
So Cal Sanitation	25-0331	09-A	01-Aug-2023	Domestic
South Bay Sandblasting & Tank Cleaning	25-0546	04-A	01-Aug-2023	Domestic
Sunrise Pumping Service	25-0598	03-A	01-Jul-2023	Domestic
T-Y Nursery Inc	25-0612	02-A	01-Apr-2023	Domestic
United Rentals (NA) Inc; DBA Reliable Onsite Svcs	25-0604	03-A	01-Oct-2023	Domestic
United Site Services	25-0631	01-A	01-May-2023	Domestic
Water Quality Specialists	25-0509	06-A	01-Jun-2023	Domestic
Class count:		44		

Class 7 - Industrial Waste Hauler

Name	Facility	Permit	Expires	Waste Type
Action Cleaning Corporation	25-0008	28-A	01-Apr-2023	Other IW
Affordable Grease Pumping	25-0619	02-A	01-Sep-2023	Grease Traps
All American Septic Pumping & Services Inc	25-0559	04-A	01-Mar-2023	Other IW
Alpha Petroleum Transport Inc. II	25-0601	03-A	01-Sep-2023	

Trucked Waste Permits Issued in 2022

Report run on: Tuesday, January 3, 2023 10:17 am

Page 2

Class 7 - Industrial Waste Hauler

Name	Facility	Permit	Expires	Waste Type
Black Gold Industries	25-0321	15-A	01-Sep-2023	Other IW
Burns and Sons Trucking Inc	25-0622	02-A	01-Oct-2023	Other IW
California Marine Cleaning	25-0329	14-A	01-Mar-2023	Other IW
Cecilias Safety Service Inc	25-0476	07-A	01-Jul-2023	Other IW
Diamond Environmental Services	25-0107	26-A	01-Dec-2023	
Downstream Services Inc	25-0262	16-A	01-Mar-2023	Other IW
JC Environmental Company Inc	25-0413	10-A	01-May-2023	Other IW
Liquid Environmental Solutions of California	25-0015	28-A	01-Mar-2023	Other IW
McKenna Septic Services	25-0597	03-A	01-Jul-2023	
Modern Septic Service Inc	25-0061	20-A	01-Dec-2023	Other IW
NRC Environmental Services Inc	25-0333	14-A	01-May-2023	Other IW
Ocean Blue Environmental Services Inc	25-0267	13-A	01-Jun-2023	Other IW
Pacific Tank Cleaning Services	25-0428	10-A	01-Oct-2023	Other IW
Patriot Environmental Services Inc	25-0639	01-A	01-Nov-2023	Other IW
Rust & Sons Trucking Inc	25-0621	02-A	01-Oct-2023	Other IW
Sludgebusters Inc	25-0128	21-A	01-Feb-2023	Other IW
South Bay Sandblasting & Tank Cleaning Inc	25-0282	17-A	01-Dec-2023	
Statewide Stripes Inc.	25-0634	01-A	01-Jun-2023	Other IW
Stone Brewing Company	25-0553	05-A	01-Nov-2023	
Sunrise Pumping Service	25-0599	03-A	01-Jul-2023	
United Site Services	25-0641	01-A	01-Dec-2023	Other IW
VLS San Diego, LLC	25-0004	28-A	01-Aug-2023	Other IW
Water Quality Specialists	25-0510	06-A	01-Jun-2023	Other IW

Class count:

27

Class 9 - Trucked Industrial Waste Generator

Name	Facility	Permit	Expires	Waste Type
AT&T	25-0477	14-A	01-Jul-2023	Other IW
Action Cleaning Corporation	25-0196	53-A	01-May-2023	Other IW
Affordable Grease Pumping	25-0432	11-A	01-Sep-2023	Other IW
All Seasons RV Park	25-0233	20-A	01-Nov-2023	Sludge
All Seasons RV Park	25-0233	21-A	01-Nov-2023	Sludge
Barona Resort & Casino	25-0129	24-A	01-Mar-2023	Sludge
Barona Resort and Casino	25-0589	03-A	01-Mar-2023	Other IW
Cal Fire La Cima Conservation Camp	25-0184	22-A	01-Dec-2023	Sludge
Cameron Corners Gas	25-0637	01-A	01-Oct-2023	Other IW
Campo Group Inc.	25-0501	05-A	01-Jul-2023	Other IW
City; Environmental Svcs - Miramar Landfill	25-0557	05-A	01-Feb-2023	Condensate
City; Environmental Svcs Miramar Landfill	25-0389	22-A	01-Jan-2023	Other IW
County of San Diego DPW Heise Park WWTP	25-0468	17-A	01-Oct-2023	Sludge
County of San Diego DPW Heise Park WWTP	25-0468	18-A	01-Oct-2023	Sludge
County of San Diego DPW Julian WWTP	25-0325	24-A	01-Oct-2023	Sludge
County of San Diego DPW Julian WWTP	25-0325	25-A	01-Oct-2023	Sludge
County of San Diego DPW Rancho Del Campo WWTI	25-0244	27-A	01-May-2023	Sludge
County of San Diego DPW Rancho Del Campo WWTI	25-0244	28-A	01-May-2023	Sludge
Fairbanks Ranch Community Services District	25-0410	06-A	01-Sep-2023	Sludge
Golden Acorn Casino	25-0197	45-A	01-May-2023	Sludge
Golden Acorn Casino	25-0197	46-A	01-May-2023	Sludge
Heinz San Diego	25-0462	08-A	01-May-2023	Other IW
JACOBS ENG. On Behalf of SDCWA	25-0614	01-A	01-Jan-2023	Other IW
Jamul Indian Village Development Corp	25-0485	11-A	01-Jun-2023	Other IW
Jamul Indian Village Development Corp	25-0485	12-A	01-Jun-2023	Other IW

Trucked Waste Permits Issued in 2022

Report run on: Tuesday, January 3, 2023 10:17 am

Page 3

Class 9 - Trucked Industrial Waste Generator

Name	Facility	Permit	Expires	Waste Type
Jamul Indian Village Development Corp	25-0491	13-A	01-Jun-2023	Other IW
Jamul Indian Village Development Corp	25-0491	14-A	01-Jun-2023	Other IW
Jamul Indian Village Development Corp	25-0495	09-A	01-Jun-2023	Other IW
Lake Morena's Oak Shores Mutual Water	25-0459	08-A	01-Feb-2023	Other IW
Lilac Enterprises - Hideaway Lake Mobile Estates	25-0142	23-A	01-Mar-2023	Sludge
Liquid Environmental Solutions of California	25-0048	44-A	01-Mar-2023	Grease Traps
Oak Tree Ranch Inc	25-0157	24-A	01-Jun-2023	Sludge
Olivenhain Municipal Water District	25-0187	19-A	01-Jul-2023	Other IW
Otay Landfill Inc	25-0105	35-A	01-Dec-2022	Condensate
Otay Landfill Inc	25-0105	36-A	01-Dec-2022	Condensate
Otay Landfill Inc	25-0105	37-A	01-Dec-2023	Condensate
Otay Landfill Inc	25-0105	38-A	01-Dec-2023	Condensate
Pauma Valley CSD	25-0311	18-A	01-Oct-2023	Sludge
Pio Pico Energy Center	25-0379	07-A	01-Aug-2023	Other IW
Quiroz Recycling	25-0551	03-A	01-Feb-2023	Rainwater
Ramona MWD (San Vicente Water Reclamation Plant	25-0349	13-A	01-Apr-2023	Other IW
Ramona MWD San Vicente WWTP	25-0133	23-A	01-Jan-2023	Sludge
San Diego County Regional Airport Authority	25-0587	02-A	01-Sep-2022	Maintenance
San Marcos Energy LLC	25-0343	16-A	01-Aug-2023	Condensate
Skyline Ranch Country Club	25-0246	20-A	01-Jul-2023	Sludge
Skyline Ranch Country Club	25-0246	21-A	01-Jul-2023	Sludge
Sony Electronics Inc	25-0617	02-A	01-Oct-2023	Other IW
Statewide Stripes Inc	25-0633	01-A	01-Jun-2023	Other IW
Stone Brewing Company	25-0411	21-A	01-Nov-2023	Sludge
Stone Brewing Company	25-0411	22-A	01-Nov-2023	Sludge
Stone Brewing Company	25-0412	21-A	01-Nov-2023	Sludge
Stone Brewing Company	25-0412	22-A	01-Nov-2023	Sludge
Sycamore Energy LLC	25-0344	15-A	01-Aug-2023	Condensate
Sycamore Landfill Inc	25-0167	31-A	01-Oct-2022	Condensate
Sycamore Landfill Inc	25-0167	32-A	01-Oct-2023	Condensate
Sycamore Landfill Inc	25-0167	33-A	01-Oct-2023	Condensate
Sycuan Casino	25-0358	18-A	01-Jul-2023	Other IW
US Customs and Border Protection	25-0640	01-A	01-Nov-2023	Other IW
USN;Remote Training Site Warner Springs (RTSWS)	25-0265	19-A	01-Jan-2023	Other Non-IW
Valley View Casino & Hotel	25-0172	24-A	01-Jul-2023	Sludge
Viejas Tribal Government	25-0130	25-A	01-Feb-2023	Sludge
YYK Enterprise Operations LLC	25-0629	01-A	01-Jan-2023	Rainwater

Class count: 62

Grand total: 133

Trucked Waste Discharge totals per month in 2022

Report run on: Tuesday, January 3, 2023 10:07 am

Page 1

<i>Waste Type</i>	<i>Domestic</i>	<i>Industrial</i>	Totals
Month	gals per month	gals per month	
January	2,124,865	2,318,760	4,443,625
February	2,007,950	2,418,300	4,426,250
March	2,334,430	2,704,340	5,038,770
April	2,162,400	2,046,155	4,208,555
May	2,155,580	2,050,820	4,206,400
June	2,211,860	1,964,205	4,176,065
July	2,349,034	1,971,785	4,320,819
August	2,508,582	2,026,495	4,535,077
September	2,457,716	1,622,120	4,079,836
October	2,273,777	1,656,610	3,930,387
November	2,373,963	1,598,640	3,972,603
December	2,323,332	1,785,465	4,108,797
Totals	27,283,489	24,163,695	51,447,184

Trucked Industrial Discharge totals per month by Type in 2022

Report run on: Tuesday, January 3, 2023 10:17 am

Page 1

<i>Waste Type</i>	<i>High Strength/Sludge</i>	<i>Other Industrial</i>	Totals
Month	gals per month	gals per month	
January	369,160	1,949,600	2,318,760
February	307,800	2,110,500	2,418,300
March	210,700	2,493,640	2,704,340
April	182,900	1,863,255	2,046,155
May	193,400	1,857,420	2,050,820
June	174,400	1,789,805	1,964,205
July	175,300	1,796,485	1,971,785
August	154,300	1,872,195	2,026,495
September	170,300	1,451,820	1,622,120
October	115,500	1,541,110	1,656,610
November	122,600	1,476,040	1,598,640
December	246,660	1,538,805	1,785,465
Totals	2,423,020	21,740,675	24,163,695

Active Permits Metrowide at Year End

Report run on: Monday, January, 3 2022 9:49 am

<i>Class</i>	<i>Name</i>	<i>Area</i>	<i>SIU</i>	<i>Facility</i>	<i>Permit</i>	<i>Address</i>
2	HP Inc	01	N	01-0013	05-A	16399 W Bernardo Dr San Diego
4Z	BAE Systems, Information Electronics Sy	01	N	01-0021	04-A	16250 Technology Pl San Diego
4Z	BAE Systems, Information Electronics Sy	01	N	01-0021	05-A	16250 Technology Pl San Diego
4	Rancho Bernardo Automotive	01	N	01-0043	00-A	11651 Iberia Pl San Diego
3	Rancho Bernardo Car Wash LLC	01	N	01-0049	03-A	16757 Bernardo Center Dr San Diego
4	RB Car Care Center	01	N	01-0049	02-A	16757 Bernardo Center Dr San Diego
4	Westwood Shell	01	N	01-0066	01-A	16998 W Bernardo Dr San Diego
4M	Rancho Bernardo Dental Arts	01	N	01-0084	03-A	16810 Bernardo Center Dr San Diego
5	eFactor Media Inc	01	N	01-0085	00-B	17150 Via Del Campo Suite 303 San Diego
5	NCR Corporation	01	N	01-0103	00-A	17095 Via Del Campo San Diego
2	General Atomics - EMS	01	N	01-0110	06-A	16761 Via Del Campo Ct San Diego
5	Metacomp / Patriot Scientific	01	N	01-0113	01-A	10989 Via Frontera San Diego
4M	Peter Da DDS Inc	01	N	01-0124	02-A	11645 Duenda Rd San Diego
2F	RB Westwood Dental Care	01	N	01-0124	01-A	11645 Duenda Rd San Diego
2F	Bernardo West Chiropractic	01	N	01-0127	01-A	16776 Bernardo Center Dr Suite 101 San Diego
4M	Rancho Bernardo Advanced Dental Care	01	N	01-0129	04-A	16766 Bernardo Center Dr Suite 212 San Diego
4	Rancho Bernardo Pet Hospital	01	N	01-0130	03-A	16588 Bernardo Center Dr Suite 160 San Diego
4M	Clark Henderson	01	N	01-0131	05-A	16959 Bernardo Center Dr Suite 103 San Diego
2F	Bernardo Heights Vet Hospital	01	N	01-0134	01-A	15721 Bernardo Heights Py Suite K San Diego
4M	Center for Oral Health	01	N	01-0135	03-A	11777 Bernardo Plaza Ct Suite 102 San Diego
4M	Sam Kamgar-Parsi DDS	01	N	01-0136	02-A	11777 Bernardo Plaza Ct Suite 106 San Diego
2F	Sam Parsi DDS	01	N	01-0136	01-A	11777 Bernardo Plaza Ct Suite 106 San Diego
4	Surface Optics Corporation	01	N	01-0142	01-A	11555 Rancho Bernardo Rd San Diego
4	SAIC	01	N	01-0143	02-A	16701 W Bernardo Dr San Diego
4	Bernardo Heights Country Club	01	N	01-0144	01-A	16066 Bernardo Heights Py San Diego
4	QED Bioscience Inc	01	N	01-0156	01-A	11021 Via Frontera Suite 203 San Diego
4	CVS/pharmacy # 3914	01	N	01-0160	04-A	11655 Duenda Rd San Diego
4	GP Specialists	01	N	01-0162	02-A	15970 Bernardo Center Dr San Diego
5	Medical Offices	01	N	01-0166	01-A	17140 Bernardo Center Dr Suite 150 San Diego
4	Electronic Manufacturing Technology Inc.	01	N	01-0168	01-A	16464 Via Esprillo San Diego
5	3D Systems	01	N	01-0173	02-A	16550 W Bernardo Dr Bldg 5 San Diego
4	Quik-Pak	01	N	01-0175	01-A	10987 Via Frontera San Diego
2	Millennium Health LLC	01	N	01-0178	01-A	16981 Via Tazon San Diego
5	Toshiba America Electronics	01	N	01-0183	01-A	15015 Avenue of Science San Diego
5	Ram Protective Coatings	01	N	01-0184	01-A	18332 Saint Etienne Ln San Diego
5	Details Inc	01	N	01-0186	01-A	18333 Saint Etienne Ln San Diego
5	P R Electronics	01	N	01-0187	01-A	11225 W Bernardo Ct Suite A San Diego
5	Slacker Radio	01	N	01-0190	01-A	16935 W Bernardo Dr Suite 270 San Diego
5	FLW Inc	01	N	01-0191	01-A	16496 Bernardo Center Dr Suite 208 San Diego
5	Microsemi Corporation	01	N	01-0194	01-A	15822 Bernardo Center Dr Suite B San Diego
5	Cymer Inc	01	N	01-0196	02-A	11045 Technology Pl San Diego
4	On-ramp Wireless Inc	01	N	01-0198	01-A	10920 Via Frontera San Diego
5	Fastec Imaging Corporation	01	N	01-0200	02-A	17150 Via Del Campo Ct Suite 301 San Diego
5	AGIGA Tech Inc	01	N	01-0201	01-A	12220 World Trade Dr Suite 200 San Diego
5	Smart Bidders	01	N	01-0202	01-A	18736 Caminito Cantilena Suite B San Diego

Active Permits Metrowide at Year End

Report run on: Monday, January, 3 2022 9:49 am

<i>Class</i>	<i>Name</i>	<i>Area</i>	<i>SIU</i>	<i>Facility</i>	<i>Permit</i>	<i>Address</i>
5	Business Assessment	01	N	01-0206	02-A	16870 W Bernardo Dr Suite 400 San Diego
4	Business Assessment	01	N	01-0207	02-A	11421 W Bernardo Ct San Diego
5	Quasar	01	N	01-0208	02-A	16744 W Bernardo Dr San Diego
4	Business Assessment	01	N	01-0210	01-A	15870 Bernardo Center Dr San Diego
4	Pacific Research Network Inc	01	N	01-0211	01-A	16766 Bernardo Center Dr Suite 102 San Diego
2	QED Bioscience Inc	01	N	01-0212	01-A	10919 Technology Pl Suite C San Diego
4	Twinning Laboratories	01	N	01-0214	01-A	15950 Bernardo Center Dr Suite J San Diego
5	General Analytical Labs	01	N	01-0216	01-A	16780 W Bernardo Dr San Diego
5	Future Home Power	01	N	01-0218	01-A	10805 Rancho Bernardo Rd Suite 110 San Diego
2	Crown Bioscience	01	N	01-0220	01-A	16550 W Bernardo Dr Suite 525 San Diego
4	DRS Daylight Solutions	01	N	01-0221	01-A	16465 Via Esprillo San Diego
4M	Pediatric Dentistry & Ortho	01	N	01-0222	01-A	11616 Iberia Pl San Diego
4M	Dr Virginia Mattson DMD	01	N	01-0223	01-A	11717 Bernardo Plaza Ct Suite 100 San Diego
4M	Nelson Howard DDS Inc	01	N	01-0224	01-A	12540 Oaks North Dr Suite A3 San Diego
4M	Carmel Village Dental	01	N	01-0225	01-A	12125 Alta Carmel Ct Suite 330 San Diego
4M	Robert B Folk DDS	01	N	01-0226	01-A	11777 Bernardo Plaza Ct Suite 209 San Diego
4M	Classic Dental Smiles	01	N	01-0227	01-A	16766 Bernardo Center DR Suite 100 San Diego
4M	Tracey Lysander DDS	01	N	01-0228	01-A	11665 Avena Pl Suite 105 San Diego
4M	Femme Abrosio DDS	01	N	01-0229	01-A	16918 Dove Canyon Rd Suite 204 San Diego
4M	Bernardo Dental Office	01	N	01-0230	01-A	16466 Bernardo Center Dr Suite 185 San Diego
4M	Mort Tuchin DDS	01	N	01-0231	01-A	16766 Bernardo Center DR Suite 106 San Diego
4M	Steve Schneider DDS	01	N	01-0232	01-A	11770 Bernardo Plaza CT Suite 260 San Diego
4M	Keith Henderson DDS	01	N	01-0233	02-A	16766 Bernardo Center Dr Ste 201 San Diego
4M	Personilized Family Dentistry	01	N	01-0234	01-A	15805 Bernardo Center Dr Suite 115 San Diego
4M	Town Center Dentistry	01	N	01-0235	01-A	11968 Bernardo Plaza Dr San Diego
4M	Plaza Dentistry	01	N	01-0236	01-A	16769 Bernardo Center Dr Suite 17 San Diego
4M	Rancho Bernardo Cosmetic & Family Den	01	N	01-0237	01-A	12405 Rancho Bernardo Rd San Diego
4M	Dr Susa Hong DDS	01	N	01-0239	01-A	11848 Bernardo Plaza Ct Unit 220 San Diego
4M	RGB Dental	01	N	01-0240	01-A	16471 Bernardo Center Dr Suite 200A San Diego
4M	James Spalenka DDS	01	N	01-0241	01-A	16766 Bernardo Center Dr Suite 105 San Diego
4M	Del Sur Ranch Dental	01	N	01-0242	01-A	16460 Paseo del Sur Suite C105 San Diego
4M	Bernardo Heights Dental Group	01	N	01-0243	01-A	15731 Bernardo Heights Py Suite 101 San Diego
4M	Sabre Springs Dental	01	N	01-0244	01-A	12640 Sabre Springs Py Suite 103 San Diego
4M	Reza Hekmat	01	N	01-0245	01-A	11665 Avena Pl Suite 104 San Diego
4M	Dental Care of Rancho Bernardo	01	N	01-0247	01-A	12120 Alta Carmel Ct Suite 410C San Diego
4M	Pearl Cosmetic and Family Dentistry	01	N	01-0249	01-A	13522 Sabre Sring Py Suite 201 San Diego
4M	Carmel Plaza Dental	01	N	01-0250	01-A	11738 Carmel Mountain Rd Suite 170 San Diego
4M	Smile 4S Ranch	01	N	01-0251	01-A	16918 Dove Canyon Rd Suite 201 San Diego
4M	Bold Smiles Dental	01	N	01-0252	01-A	16625 Dove Canyon Rd Suite 103 San Diego
4M	Dr Jeffrey Bloch	01	N	01-0253	01-A	11777 Bernardo Plaza Ct Suite 101 San Diego
4M	Carmel Ranch Dental Care	01	N	01-0254	01-A	12075 Carmel Mountain Rd San Diego
4M	Signature Dental	01	N	01-0255	01-A	16471 Bernardo Center Dr Suite 200 San Diego
4M	Dentistry 4S Ranch	01	N	01-0256	01-A	10432 Reserve Dr Suite 110 San Diego
4M	Signature Orthodontics	01	N	01-0257	01-A	16918 Dove Canyon Rd Suite 202 San Diego
4	Business Assessment	01	N	01-0263	01-A	16915 Via Del Campo San Diego

Active Permits Metrowide at Year End

Report run on: Monday, January, 3 2022 9:49 am

<i>Class</i>	<i>Name</i>	<i>Area</i>	<i>SIU</i>	<i>Facility</i>	<i>Permit</i>	<i>Address</i>
2	Applied Biomedical Science Institute	01	N	01-0268	01-A	11011 Via Frontera Suite D San Diego
4	Business Assessment	01	N	01-0269	01-A	16275 Technology Pl Rancho Bernardo
4	Business Assessment	02	N	02-0030	01-A	10170 Sorrento Valley Rd San Diego
2	Salk Institute for Biological Studies	02	N	02-0033	03-A	10010 N Torrey Pines Rd La Jolla
2	California Medical Innovations Institute Ir	02	N	02-0037	06-A	11107 Roselle St Suite 211 San Diego
2	Scripps Memorial Hospital	02	N	02-0040	03-A	9888 Genesee Av La Jolla
2	Sanford Burnham Prebys Medical Discove	02	N	02-0043	05-A	10901 N Torrey Pines Rd La Jolla
2	BioAtla LLC	02	N	02-0057	01-A	11085 Torreyana Rd San Diego
2	General Atomics	02	N	02-0059	03-A	3550 General Atomics Ct San Diego
2Z	General Atomics	02	N	02-0059	04-A	3550 General Atomics Ct San Diego
5	Datacap Inc	02	N	02-0093	01-A	11558 Sorrento Valley Rd Suite 7 San Diego
2	University of California San Diego	02	Y	02-0112	06-B	9500 Gilman Dr 0089 La Jolla
2	University of California San Diego	02	Y	02-0112	07-A	9500 Gilman Dr 0089 La Jolla
2	Xen Biofluidx Inc	02	N	02-0124	03-A	11495 Sorrento Valley Rd San Diego
5	BPC Printers	02	N	02-0134	03-A	4202 Sorrento Valley Bl Suite S San Diego
2	Ultima Genomics Inc	02	N	02-0222	01-A	10855 Sorrento Valley Rd Suite 101 San Diego
4	Business Assessment	02	N	02-0234	01-A	11760 Sorrento Valley Rd San Diego
4	J S & R Inc	02	N	02-0267	00-A	10741 Roselle St San Diego
2	Quidel Corporation	02	N	02-0313	05-A	10165 Mc Kellar Ct San Diego
4	City; Police Dept Northern Div	02	N	02-0315	01-A	4275 Eastgate Ml San Diego
5	Whittier Institute For Diabetes	02	N	02-0329	01-A	9894 Genesee Av La Jolla
2	Neuvogen	02	N	02-0331	03-A	11095 Flintkote Av Suite C San Diego
2	Pall Filtration & Separations Group Inc	02	Y	02-0332	07-A	4116 Sorrento Valley Bl San Diego
2	Dermtech Inc	02	N	02-0334	03-A	11099 N Torrey Pines Rd Suite 100 La Jolla
2F	Graphics Unlimited	02	N	02-0364	02-A	10477 Roselle St Suite B San Diego
4	Rancho Car Wash	02	N	02-0366	01-A	2661 Via De La Valle San Diego
2	Explora Biolabs	02	N	02-0367	01-A	4224 Campus Point Ct Suite 100 San Diego
2	Leidos	02	N	02-0387	03-A	4161 Campus Point Ct San Diego
4	Business Assessment	02	N	02-0392	05-A	3030 Science Park Rd San Diego
4	Business Assessment	02	N	02-0403	06-A	9727 Pacific Heights Bl San Diego
4	Del Mar Hilton	02	N	02-0412	00-A	15575 Jimmy Durante Bl San Diego
2	FedEx Freight Inc	02	N	02-0429	03-A	5550 Eastgate Ml San Diego
2	FedEx Freight Inc	02	N	02-0429	04-A	5550 Eastgate Ml San Diego
4	Business Assessment	02	N	02-0433	01-A	9775 Towne Centre Dr San Diego
4	Business Assessment	02	N	02-0434	06-A	10933 N Torrey Pines Rd Suite 200 La Jolla
2	Organogenesis Inc	02	N	02-0434	05-A	10933 N Torrey Pines Rd Suite 200 La Jolla
4	Business Assessment	02	N	02-0437	02-A	3033 Science Park Rd San Diego
1	Defender SD Manufacturing LLC	02	Y	02-0439	04-A	3443 Tripp Ct San Diego
2	Agilent Technologies	02	N	02-0441	06-A	11011 N Torrey Pines Rd La Jolla
2	Morpheus Biolabs	02	N	02-0445	02-A	6650 Lusk Bl Suite B106 San Diego
4	Americana Car Wash	02	N	02-0455	00-A	9510 Scranton Rd San Diego
4	Americana Car Wash	02	N	02-0455	01-A	9510 Scranton Rd San Diego
4	Business Assessment	02	N	02-0482	02-A	10350 Barnes Canyon Rd Suite 100 San Diego
2	Abzena	02	N	02-0485	05-A	6325 Lusk Bl San Diego
5	Photon Research Association	02	N	02-0494	00-A	5720 Oberlin Dr San Diego

Active Permits Metrowide at Year End

Report run on: Monday, January, 3 2022 9:49 am

<i>Class</i>	<i>Name</i>	<i>Area</i>	<i>SIU</i>	<i>Facility</i>	<i>Permit</i>	<i>Address</i>
4	Precision Engine Controls Corp	02	N	02-0496	01-A	11661 Sorrento Valley Rd San Diego
2	Tanvex BioPharma USA Inc	02	N	02-0501	06-A	10394 Pacific Center Ct San Diego
3	Del Mar Highlands Carwash	02	N	02-0509	01-A	12889 El Camino Real San Diego
2	Tanabe Research Laboratories	02	N	02-0510	05-A	4540 Towne Centre Ct San Diego
1	Suneva Medical Inc	02	Y	02-0518	06-A	5870 Pacific Center Bl San Diego
3	Penhall Company	02	N	02-0527	05-A	5775 Eastgate Dr San Diego
4	Business Assessment	02	N	02-0528	01-A	5510 Morehouse Dr Suite 198 San Diego
4	Del Mar Shell	02	N	02-0549	00-A	2205 Via De La Valle San Diego
2	BD Biosciences	02	N	02-0553	04-A	10995 Torreyana Rd San Diego
5	ECO ATM	02	N	02-0559	00-A	10121 Barnes Canyon Rd San Diego
2	Drug Delivery Experts LLC	02	N	02-0560	02-A	11494 Sorrento Valley Rd Suite J San Diego
2	Integrated Microwave Corporation	02	N	02-0574	01-A	11353 Sorrento Valley Rd San Diego
1	The Argen Corporation	02	Y	02-0582	07-A	5855 Oberlin Dr San Diego
4	Business Assessment	02	N	02-0583	06-A	10355 Science Center Dr Suite 110 San Diego
2	DNA Trix Therapeutics Ti	02	N	02-0583	05-A	10355 Science Center Dr Suite 110 San Diego
4	Trex Enterprises Corporation	02	N	02-0597	02-A	10455 Pacific Center Ct San Diego
2	Bioserv Corporation	02	N	02-0603	04-A	5340 Eastgate Ml San Diego
4	Business Assessment	02	N	02-0612	03-A	10665 Sorrento Valley Rd San Diego
2	Kumquat Bioscience Inc	02	N	02-0619	03-A	10770 Wateridge Cr Suite 120 San Diego
4	Vaxiion	02	N	02-0625	02-A	11585 Sorrento Valley Rd Suite 105 San Diego
4	Business Assessment	02	N	02-0626	03-A	11545 Sorrento Valley Rd Suite 310 San Diego
2	Debut Biotechnology Inc	02	N	02-0626	04-A	11545 Sorrento Valley Rd Suite 310 San Diego
4	Business Assessment	02	N	02-0627	05-A	9717 Pacific Heights Bl Suite A San Diego
4	Business Assessment	02	N	02-0630	06-A	11010 Torreyana Rd San Diego
2	Foundation Medicine	02	N	02-0630	07-A	11010 Torreyana Rd San Diego
4	Business Assessment	02	N	02-0631	03-A	11455 Sorrento Valley Rd San Diego
4	Business Assessment	02	N	02-0634	02-A	6255 Ferris Sq San Diego
4	Qualcomm Inc	02	N	02-0640	01-A	4243 Campus Point Ct San Diego
2	Janssen Research & Development LLC	02	N	02-0641	04-A	3210 Merryfield Rw San Diego
2	Janssen Research & Development LLC	02	N	02-0641	05-A	3210 Merryfield Rw San Diego
4	Torrey Pines High School	02	N	02-0666	02-A	3710 Del Mar Heights Rd San Diego
4	James Mahooti DDS	02	N	02-0669	02-A	9450 Scranton Rd 109 San Diego
4M	Sorrento Brite Smile Dental	02	N	02-0669	03-A	9450 Scranton Rd 109 San Diego
4M	TERENCE B PEGEL DDS INC	02	N	02-0673	02-A	11772 Sorrento Valley Rd 201 San Diego
4	Business assessment	02	N	02-0674	03-A	6790 Top Gun St Suite 11 San Diego
4	Business Assessment	02	N	02-0678	02-A	4920 Carroll Canyon Rd San Diego
4	Hy-Lang Electric California	02	N	02-0680	02-A	7181 Construction Ct San Diego
4M	San Diego Dental Studio	02	N	02-0683	02-A	6635 Flanders Dr Suite E San Diego
4	IGO Medical Group of San Diego	02	N	02-0687	02-A	9339 Genesee Av Suite 220 San Diego
4	Primesource	02	N	02-0692	01-A	6160 Marindustry Dr Suite A San Diego
4	Sorrento Valley Dental Group	02	N	02-0695	03-A	5955 Mira Mesa Bl Suite E San Diego
4M	Mira Mesa Dental Care	02	N	02-0696	03-A	6755 Mira Mesa Bl Suite 142 San Diego
4	Robert La Civita DDS	02	N	02-0697	02-A	5830 Oberlin Dr Suite 105 San Diego
4M	Dixon Pediatric Dental	02	N	02-0698	02-A	5627 Oberlin Dr 100 San Diego
4M	Diamond Dental Studio	02	N	02-0699	02-A	5425 Oberlin Dr 101 San Diego

Active Permits Metrowide at Year End

Report run on: Monday, January, 3 2022 9:49 am

<i>Class</i>	<i>Name</i>	<i>Area</i>	<i>SIU</i>	<i>Facility</i>	<i>Permit</i>	<i>Address</i>
5	Konnetica	02	N	02-0703	02-A	9833 Pacific Heights Bl Suite C San Diego
4	Tandem Diabetes	02	N	02-0709	04-A	11025 Roselle St Suite 100 San Diego
4	Qualcomm	02	N	02-0712	01-A	5525 Morehouse Dr San Diego
4	Vacant	02	N	02-0715	05-A	3545 Cray Ct La Jolla
2	Ajinomoto Althea Inc	02	N	02-0722	08-A	6175 Lusk Bl San Diego
1	Ajinomoto Althea Inc	02	Y	02-0722	09-A	6175 Lusk Bl San Diego
4	Vons # 2119	02	N	02-0728	02-A	3850 Valley Centre Dr San Diego
2	Scripps Green Hospital and Clinic	02	N	02-0729	02-A	10666 N Torrey Pines Rd La Jolla
2	The Scripps Research Institute	02	N	02-0730	03-A	10466 N Torrey Pines Rd La Jolla
4	Business Assessment	02	N	02-0731	03-A	3525 John Hopkins Ct San Diego
4	Shell Car Wash & Express Lube	02	N	02-0732	01-A	3861 Valley Centre Dr San Diego
4	Motorola	02	N	02-0733	01-A	6450 Sequence Dr San Diego
5	Technology Insights	02	N	02-0741	02-A	6540 Lusk Bl San Diego
2	Signal Pharmaceuticals LLC	02	N	02-0745	05-A	10300 Campus Point Dr Suite 100 San Diego
2	Eurofins-Advantar Laboratories Inc	02	N	02-0748	03-A	5451 Oberlin Dr San Diego
4	Business Assessment	02	N	02-0751	04-A	3115 Merryfield Rw San Diego
2	Novartis Institute for Biomedical Research	02	N	02-0752	04-A	10675 John Jay Hopkins Dr San Diego
2	Novartis Institute for Functional Genomics	02	N	02-0752	03-A	10675 John Jay Hopkins Dr San Diego
2	Pfizer La Jolla Laboratories	02	N	02-0756	02-A	10777 Science Center Dr San Diego
2	Pfizer La Jolla Laboratories	02	N	02-0756	03-A	10777 Science Center Dr San Diego
4	UCSD Immunogenetics & Transplants	02	N	02-0758	01-A	9894 Genesee Av Suite 101 La Jolla
1	Pacira Pharmaceuticals Inc	02	Y	02-0762	06-A	10450 Science Center Dr San Diego
4	Integra Neurocare	02	N	02-0765	01-A	5955 Pacific Center Bl San Diego
4	Business Assessment	02	N	02-0766	04-A	11575 Sorrento Valley Rd Suite 210 San Diego
5	Qualcomm	02	N	02-0767	01-A	5775 Morehouse Dr San Diego
2	Biomatrica	02	N	02-0772	02-A	5627 Oberlin Dr Suite 120 San Diego
4	Torrey Pines Golf Course	02	N	02-0775	01-A	11480 N Torrey Pines Rd La Jolla
2	BD Biosciences	02	N	02-0776	04-A	11077 N Torrey Pines Rd La Jolla
2	Synthorx Inc	02	N	02-0777	04-A	11099 N Torrey Pines Rd Suite 200 La Jolla
2	Sunstate Equipment Company	02	N	02-0779	03-A	5590 Eastgate Ml San Diego
2	Sunstate Equipment Company	02	N	02-0779	04-A	5590 Eastgate Ml San Diego
4	MWWD Vactor Truck Dump Site	02	N	02-0782	01-A	Roselle St San Diego
4	San Diego Jewish Academy	02	N	02-0783	01-A	11860 Carmel Creek Rd San Diego
2	Poseida Therapeutics	02	N	02-0786	02-A	9390 Towne Centre Dr Suite 200 San Diego
2	InhibRx Inc	02	N	02-0787	02-A	11025 N Torrey Pines Rd Suite 200 La Jolla
2	Halozyme Therapeutics Inc	02	N	02-0800	03-A	11388 Sorrento Valley Rd Suite 200 San Diego
4	Jewels by Tashne	02	N	02-0802	01-A	2683 Via De La Valle Suite F San Diego
2	The Scripps Research Institute	02	N	02-0803	03-A	3528 General Atomics Ct San Diego
2	Pfenex Inc	02	N	02-0804	04-A	10790 Roselle St San Diego
2	Sorrento Therapeutics Inc	02	N	02-0806	03-A	4955 Directors Pl San Diego
4	Business Assessment	02	N	02-0809	04-A	11760 Sorrento Valley Rd Suite E San Diego
2	ActivX Biosciences Inc	02	N	02-0812	03-A	11025 N Torrey Pines Rd Suite 120 La Jolla
4	Business Assessment	02	N	02-0813	02-A	9393 Towne Centre Dr Suite 130 San Diego
2	EpicentRx	02	N	02-0818	03-A	11099 N Torrey Pines Rd Suite 160 La Jolla
4	Cryocor Inc	02	N	02-0821	01-A	9717 Pacific Heights Bl San Diego

Active Permits Metrowide at Year End

Report run on: Monday, January, 3 2022 9:49 am

<i>Class</i>	<i>Name</i>	<i>Area</i>	<i>SIU</i>	<i>Facility</i>	<i>Permit</i>	<i>Address</i>
4	Pet Net Pharmaceuticals Inc	02	N	02-0823	02-A	11388 Sorrento Valley Rd Suite 100 San Diego
2	Fate Therapeutics	02	N	02-0824	04-A	3535 General Atomics Ct Suite 200 San Diego
2	BASF Enzymes LLC	02	N	02-0825	02-A	3550 John Hopkins Ct San Diego
2	Sequenom Inc	02	N	02-0827	02-A	3595 John Hopkins Ct San Diego
4	ABX Collision	02	N	02-0829	04-A	11875 Sorrento Valley Rd San Diego
4	Fedex Ground	02	N	02-0833	01-A	9999 OLSON Dr Suite 100 San Diego
2	Roswell Biotechnologies	02	N	02-0838	02-A	11095 Flintkote Av Suite A San Diego
5	Entrada Networks Inc	02	N	02-0839	01-A	10070 Mesa Rim Rd San Diego
4	BD Diagnostics-GeneOhm Sciences	02	N	02-0843	03-A	6146 Nancy Ridge Dr Suite 101 San Diego
3	EDCO Disposal Corp	02	N	02-0845	02-A	9790 Olson Dr San Diego
4	EDCO Disposal Corp	02	N	02-0845	03-A	9790 Olson Dr San Diego
4	Pacific Bell	02	N	02-0845	01-A	9790 Olson Dr San Diego
4	Business Assessment	02	N	02-0850	03-A	3398 Carmel Mountain Rd San Diego
5	Agouron Pharmaceuticals	02	N	02-0858	01-A	11085 N Torrey Pines Rd La Jolla
4	Optimer Pharmaceuticals Inc	02	N	02-0859	02-A	10110 Sorrento Valley Rd Suite C San Diego
2	Vertex Pharmaceuticals	02	N	02-0863	04-A	3215 Merryfield Rw San Diego
5	Lattice Semiconductor	02	N	02-0864	01-A	5355 Mira Sorrento Pl Suite 100 San Diego
5	Medis Products	02	N	02-0866	02-A	4186 Sorrento Valley Bl San Diego
2	Genalyte Inc	02	N	02-0868	03-A	10520 Wateridge Cr San Diego
4	Business Assessment	02	N	02-0871	02-A	11578 Sorrento Valley Rd San Diego
4	Business Assessment	02	N	02-0872	04-A	9381 Judicial Dr Suite 160 San Diego
5	Center for Neurologic Study	02	N	02-0875	01-A	9850 Genesee Av Suite 320 La Jolla
4	San Diego Sports Med & Family Health C	02	N	02-0876	03-A	3880 Valley Centre Dr Suite 201 San Diego
2	Emergent Travel Health Inc	02	N	02-0877	03-A	3985 Sorrento Valley Bl Suite A San Diego
2	Genopis Inc	02	N	02-0880	03-A	10390 Pacific Center Ct Space 2 San Diego
2	Inovio Pharmaceuticals Inc	02	N	02-0883	03-A	10480 Wateridge Cr San Diego
2	Perkin Elmer DBA Nexcelom Bioscience	02	N	02-0884	04-A	11100 Roselle St Suite B San Diego
4	Business Assessment	02	N	02-0885	03-A	11588 Sorrento Valley Rd Suite 16 San Diego
2	US Specialty Labs	02	N	02-0885	02-A	11588 Sorrento Valley Rd Suite 16 San Diego
4	Business Assessment	02	N	02-0886	02-A	9393 Towne Centre Dr Suite 120 San Diego
2	Molecular Diagnostic Services	02	N	02-0889	02-A	4204 Sorrento Valley Bl Suite G San Diego
2C	Ajinomoto Althea Inc	02	N	02-0892	03-A	11040 Roselle St San Diego
4	Business Assessment	02	N	02-0895	02-A	11772 Sorrento Valley Rd San Diego
2	Metacrine Inc	02	N	02-0897	03-A	3985 Sorrento Valley Bl Suite C San Diego
5	Cricket Communications	02	N	02-0901	01-A	4031 Sorrento Valley Bl San Diego
4	Business Assessment	02	N	02-0902	04-A	5871 Oberlin Dr Suite 100 San Diego
2	Vividion Therapeutics Inc	02	N	02-0902	03-A	5871 Oberlin Dr Suite 100 San Diego
2	Genomatica Inc	02	N	02-0905	03-A	4757 Nexus Centre Dr San Diego
2	Sorrento Therapeutics Inc	02	N	02-0906	04-A	9380 Judicial Dr San Diego
2	Tanvex BioPharma USA Inc	02	N	02-0908	03-A	10421 Pacific Center Ct San Diego
4	Oracle America Inc	02	N	02-0910	04-A	9515 Towne Centre Dr San Diego
2	Neurocrine Biosciences Inc	02	N	02-0913	01-A	12780 El Camino Real San Diego
2	ADARx Pharmaceuticals Inc	02	N	02-0914	02-A	5871 Oberlin Dr Suite 200 San Diego
4	Business Assessment	02	N	02-0916	04-A	4045 Sorrento Valley Bl San Diego
4	Pathway Genomics	02	N	02-0916	03-A	4045 Sorrento Valley Bl San Diego

Active Permits Metrowide at Year End

Report run on: Monday, January, 3 2022 9:49 am

<i>Class</i>	<i>Name</i>	<i>Area</i>	<i>SIU</i>	<i>Facility</i>	<i>Permit</i>	<i>Address</i>
4	NxGen Biosciences Inc	02	N	02-0919	01-A	4050 Sorrento Valley Bl Suite D San Diego
2	Eli Lilly and Company	02	N	02-0920	01-A	10290 Campus Point Dr San Diego
2	Pacific Biosciences of CA Inc	02	N	02-0921	01-A	6965 Lusk Bl San Diego
5	Qualcomm	02	N	02-0922	01-A	9940 Barnes Canyon Ra San Diego
4	Business Assessment	02	N	02-0923	01-A	4835 Eastgate Ml San Diego
5	Qualcomm	02	N	02-0929	01-A	10185 McKellar Ct San Diego
4	Universal Stabilizer Technology	02	N	02-0933	01-A	4050 Sorrento Valley Bl Suite L San Diego
4	Business Assessment	02	N	02-0940	03-A	6330 Nancy Ridge Dr Suite 107 San Diego
2	Precision Diagnostics	02	N	02-0943	02-A	4215 Sorrento Valley Bl San Diego
2	EPIC Sciences	02	N	02-0945	02-A	9381 Judicial Dr Suite 200 San Diego
4	Entropic Communications Inc	02	N	02-0946	01-A	9276 Scranton Rd Suite 200 San Diego
4	Inovations Research	02	N	02-0948	01-A	11568 Sorrento Valley Rd Suite 8 San Diego
4	Business Assessment	02	N	02-0950	03-A	11535 Sorrento Valley Rd Suite 400 San Diego
2	Phanes Therapeutics	02	N	02-0950	04-A	11535 Sorrento Valley Rd Suite 400 San Diego
4	Petritech Inc	02	N	02-0953	01-A	10373 Roselle St Suite 100 San Diego
4	Business Assessment	02	N	02-0957	03-A	3010 Science Park Rd San Diego
2	Scripps Research, Calibr Division	02	N	02-0958	02-A	11119 N Torrey Pines Rd La Jolla
4	Sheatech Inc	02	N	02-0959	01-A	9833 Pacific Heights Bl Suite D San Diego
4	Business Assessment	02	N	02-0965	02-A	11839 Sorrento Valley Rd San Diego
4	Abide Therapeutics	02	N	02-0966	02-A	10835 Road to the Cure Suite 250 San Diego
2	Lundbeck	02	N	02-0966	03-A	10835 Road to the Cure Suite 250 San Diego
4	Business Assessment	02	N	02-0968	02-A	4545 Towne Centre Ct San Diego
2	The Center for Aquaculture Technologies	02	N	02-0971	01-A	8395 Camino Santa Fe Suite E San Diego
4	Business Assessment	02	N	02-0974	01-A	11555 Sorrento Valley Rd Suite 100 San Diego
4	Business Assessment	02	N	02-0975	02-A	4025 Sorrento Valley Bl San Diego
4	Business Assessment	02	N	02-0975	03-A	4025 Sorrento Valley Bl San Diego
4	Litel Instruments	02	N	02-0976	01-A	6142 Nancy Ridge Dr Suite 102 San Diego
2	Ambrx Inc	02	N	02-0977	02-A	10975 N Torrey Pines Rd San Diego
4	Business Assessment	02	N	02-0978	03-A	6330 Nancy Ridge Dr Suite 106 San Diego
4	Raylight Chemokine Pharmaceuticals Inc	02	N	02-0980	01-A	10931 N Torrey Pines Rd Suite 105 La Jolla
4M	Mario N Alberti Dental Office	02	N	02-0982	02-A	4520 Executive Dr Suite 250 San Diego
2	L-3 Communications	02	N	02-0984	02-A	10180 Barnes Canyon Rd San Diego
4	Linear Measurements Inc	02	N	02-0987	01-A	4174 Sorrento Valley Bl San Diego
4	Business Assessment	02	N	02-0988	02-A	4690 Executive Dr La Jolla
5	ST Microelectronics	02	N	02-0988	01-A	4690 Executive Dr La Jolla
4	Ocean Aero	02	N	02-0989	01-A	10350 Sorrento Valley Rd San Diego
4	Vektrex Electronic Systems Inc	02	N	02-0990	01-A	10225 Barnes Canyon Rd Ste A213 San Diego
5	ASE US	02	N	02-0991	01-A	5405 Morehouse Dr San Diego
4	Tristan Technologies Inc	02	N	02-1000	01-A	6191 E Cornerstone Ct Ste 107 San Diego
4	Business Assessment	02	N	02-1001	02-A	10151 Pacific Mesa Bl 107 San Diego
4	Business Assessment	02	N	02-1002	02-A	3020 Callan Rd San Diego
2	Synthetic Genomics Inc	02	N	02-1002	01-A	3020 Callan Rd San Diego
5	Occupational Services	02	N	02-1004	01-A	6397 Nancy Ridge Dr San Diego
2	California Medical Innovations Institute Ir	02	N	02-1005	03-A	11175 Flintkote Av Suite A San Diego
2	Neurophth Therapeutics Inc	02	N	02-1009	02-A	6042 W Cornerstone Ct Suite D San Diego

Active Permits Metrowide at Year End

Report run on: Monday, January, 3 2022 9:49 am

<i>Class</i>	<i>Name</i>	<i>Area</i>	<i>SIU</i>	<i>Facility</i>	<i>Permit</i>	<i>Address</i>
2	Veterinary Specialty Hospital	02	N	02-1011	02-A	10435 Sorrento Valley Rd San Diego
5	Veterinary Specialty Hospital	02	N	02-1011	03-A	10435 Sorrento Valley Rd San Diego
2	Firmenich Inc	02	N	02-1013	03-A	4767 Nexus Center Dr San Diego
2	Sanford-Burnham Medical Research Instit	02	N	02-1014	03-A	10905 Road to the Cure San Diego
2	BD Point of Care	02	N	02-1015	01-A	10865 Road to the Cure Suite 200 San Diego
4	Business Assessment	02	N	02-1016	04-A	3956 Sorrento Valley Bl Suite 600 San Diego
4	Synthetic Genomics Inc	02	N	02-1018	01-A	11149 N Torrey Pines Rd La Jolla
2	Ferring Research Institute Inc	02	N	02-1022	01-A	4245 Sorrento Valley Bl San Diego
2	Capricor Inc	02	N	02-1024	02-A	10865 Road to the Cure Suite 150 San Diego
2	ArthroSi Therapeutics Inc	02	N	02-1025	02-A	9855 Towne Centre Dr Suite 200 San Diego
4	Business Assessment	02	N	02-1025	01-A	9855 Towne Centre Dr Suite 200 San Diego
2	Avidity Biosciences Inc	02	N	02-1027	01-A	10975 N Torrey Pines Rd Suite 150 La Jolla
4	Business Assessment	02	N	02-1027	02-A	10975 N Torrey Pines Rd Suite 150 La Jolla
2	Quasar Federal Systems Inc	02	N	02-1029	01-A	5754 Pacific Center Bl Suite 203 San Diego
4	Business Assessment	02	N	02-1030	02-A	10201 Wateridge Circle San Diego
2	Shoreline Biosciences Inc	02	N	02-1033	02-A	11408 Sorrento Valley Rd San Diego
4	Business Assessment	02	N	02-1034	02-A	11575 Sorrento Valley Rd Suite 218 San Diego
4	Business Assessment	02	N	02-1037	04-A	10275 Science Center Dr Suite 200 San Diego
2	Zentalis Pharmaceuticals	02	N	02-1037	05-A	10275 Science Center Dr Suite 200 San Diego
2	Bastyr University San Diego	02	N	02-1038	01-A	4106 Sorrento Valley Bl San Diego
2	Aspen Neurosciences	02	N	02-1041	02-A	10835 Road to the Cure Suite 100 San Diego
4	Morpheus Biolabs	02	N	02-1042	02-A	6640 Lusk Bl Suite A105 San Diego
2	Astellas Research Institute of America	02	N	02-1043	02-A	3565 General Atomics Ct Suite 200 San Diego
4	Business Assessment	02	N	02-1043	03-A	3565 General Atomics Ct Suite 200 San Diego
5	Homestead Studio Suites	02	N	02-1044	01-A	9880 Pacific Heights Bl San Diego
5	Woodfin Suites Hotel	02	N	02-1045	01-A	10044 Pacific Mesa Bl San Diego
2	Triton Algae Innovations	02	N	02-1048	01-A	11760 Sorrento Valley Rd Suite P&R San Diego
4M	Del Mar View Dental Care	02	N	02-1054	02-A	13983 Mango Dr Suite 101 Del Mar
2	Angiocrine Bioscience Inc	02	N	02-1056	02-A	11575 Sorrento Valley Rd Suite 217 San Diego
4	Business Assessment	02	N	02-1057	02-A	3950 Sorrento Valley Bl Suite 100 San Diego
4	Invivogen	02	N	02-1057	01-A	3950 Sorrento Valley Bl Suite 100 San Diego
2	Adipogen Corporation	02	N	02-1060	02-A	9853 Pacific Heights Bl Suite L San Diego
5	Liquid Environmental Solutions	02	N	02-1061	01-A	11855 Sorrento Valley Rd Suite C San Diego
2	Truvian Sciences	02	N	02-1062	01-A	10300 Campus Point Dr Suite 190 San Diego
5	Pacific Ergonomics	02	N	02-1066	02-A	10457 Roselle St Suite F San Diego
2	Persephone Biosciences Inc	02	N	02-1069	02-A	10835 Road to the Cure Suite 150 San Diego
2C	NuVasive Inc	02	N	02-1071	01-A	7475 Lusk Bl San Diego
4	Business Assessment	02	N	02-1073	01-A	6042 W Cornerstone Ct Suite B San Diego
2	Takeda Development Center Americas Inc	02	N	02-1074	01-A	9625 Towne Centre Dr San Diego
5	Blue-Green Construction Inc	02	N	02-1076	01-A	12526 High Bluff Dr Suite 300 San Diego
2	Gene Therapy Systems Inc	02	N	02-1078	01-A	6044 W Cornerstone Ct Suite E San Diego
2	Cardiff Oncology	02	N	02-1079	01-A	11055 Flintkote Av Suite B San Diego
4	Rayotek Scientific	02	N	02-1080	01-A	11499 Sorrento Valley Rd San Diego
4	Aspen Neurosciences	02	N	02-1083	04-A	10835 Road to the Cure Suite 205 San Diego
2	Zeno Management Inc	02	N	02-1083	03-A	10835 Road to the Cure Suite 205 San Diego

Active Permits Metrowide at Year End

Report run on: Monday, January, 3 2022 9:49 am

<i>Class</i>	<i>Name</i>	<i>Area</i>	<i>SIU</i>	<i>Facility</i>	<i>Permit</i>	<i>Address</i>
2	Explora Biolabs	02	N	02-1084	02-A	10835 Road to the Cure Suite 130 San Diego
4	Vacant Restaurant & Brewery	02	N	02-1087	01-A	8980 La Jolla Village Dr San Diego
4M	Clear Choice Dental Implant Center	02	N	02-1088	02-A	4910 Directors Pl Suite 300 San Diego
2	Genesis Healthcare Partners PC	02	N	02-1090	01-A	9853 Pacific Heights Bl Suite B San Diego
2	Eurofins DiscoverX	02	N	02-1093	01-A	11180 Roselle St Suite D San Diego
2	VA San Diego Healthcare System	02	N	02-1095	01-A	3350 La Jolla Village Dr San Diego
2	VA San Diego Healthcare System	02	N	02-1095	02-A	3350 La Jolla Village Dr San Diego
4	Business Assessment	02	N	02-1097	02-A	10421 Pacific Center Ct Suite 200 San Diego
2	Lundbeck	02	N	02-1099	01-A	10865 Road to the Cure Suite 210 San Diego
2	Sanford Consortium for Regenerative Mec	02	N	02-1100	01-A	2880 Torrey Pines Scenic Dr La Jolla
2	ImmunityBio	02	N	02-1101	02-A	3530 John Hopkins Ct San Diego
4	Douglas Karan Grooming	02	N	02-1103	01-A	3861 Valley Centre Dr Unit B San Diego
4	Binding Site	02	N	02-1110	01-A	5889 Oberlin Dr Suite 101 San Diego
4	ChemBridge Corporation	02	N	02-1111	01-A	11199 Sorrento Valley Rd San Diego
5	Biophase.com	02	N	02-1114	01-A	5405 Morehouse Dr Unit 135 San Diego
5	Kyocera Communications Inc	02	N	02-1115	01-A	9520 Towne Centre Dr San Diego
5	Legend Films	02	N	02-1116	01-A	3721 Valley Centre Dr Suite 500 San Diego
5	Amkor Technology	02	N	02-1118	01-A	5465 Morehouse Dr San Diego
5	Altera Corp	02	N	02-1122	01-A	9330 Scranton Rd Suite 400 San Diego
4	Vacant	02	N	02-1129	01-A	6044 Cornerstone Ct A2 San Diego
2	aTyr Pharma Inc	02	N	02-1130	01-A	3545 John Hopkins Ct Suite 250 San Diego
4	Business Assessment	02	N	02-1134	02-A	11575 Sorrento Valley Rd Suite 200 San Diego
2	Sarmal Inc	02	N	02-1135	01-A	11095 Flintkote Av Suite E San Diego
4	Vet Therapeutics Inc	02	N	02-1137	01-A	10451 Roselle St Suite 200A San Diego
5	Arm Holdings US Inc	02	N	02-1138	01-A	5355 Mira Sorrento Pl Suite 290 San Diego
4	Hi-Tech Stencil	02	N	02-1139	02-A	10225 Barnes Canyon Rd Suite A109 San Diego
5	LMI Global Inc	02	N	02-1140	01-A	11211 Sorrento Valley Dr Suite E San Diego
5	Net Burner	02	N	02-1141	01-A	5405 Morehouse Dr Suite 200 San Diego
4	Simco Electronics	02	N	02-1142	01-A	5764 Pacific Center Bl Suite 101 San Diego
2	NanoSD Inc	02	N	02-1144	02-A	11575 Sorrento Valley Rd Suite 211 San Diego
5	AristaMD Inc	02	N	02-1145	01-A	11099 N Torrey Pines Rd Suite 250 San Diego
4	Polaris Pharmaceuticals Inc	02	N	02-1146	01-A	9373 Towne Centre Dr Suite 150 San Diego
2	Lowy Medical Research Institute	02	N	02-1148	01-A	3366 N Torrey Pines Ct Suite 300 La Jolla
4	Business Assessment	02	N	02-1149	02-A	6195 E Cornerstone Ct Suite 109 San Diego
2	EZ Labs	02	N	02-1149	01-A	6195 E Cornerstone Ct Suite 109 San Diego
4C	Quantum Design	02	N	02-1151	02-A	10309 Pacific Center Ct San Diego
4C	Quantum Design	02	N	02-1151	03-A	10309 Pacific Center Ct San Diego
4	Business Assessment	02	N	02-1156	01-A	10070 Barnes Canyon Rd San Diego
4	Business Assessment	02	N	02-1157	01-A	9710 Scranton Rd Suite 360 San Diego
2	Shanghai Pharma Biotherapeutics USA In	02	N	02-1159	02-A	3545 John Hopkins Ct Suite 160 San Diego
5	Del Mar Heights Veterinary Hospital	02	N	02-1160	01-A	2626 Del Mar Heights Rd Suite B San Diego
2	Sorrento Therapeutics Inc	02	N	02-1163	02-A	4122 Sorrento Valley Bl Suite 105 San Diego
2	LabFellows Inc	02	N	02-1164	02-A	11011 N Torrey Pines Rd Suite 135 La Jolla
2	LabFellows Inc	02	N	02-1164	02-B	11011 N Torrey Pines Rd Suite 135 La Jolla
2	COI Pharmaceuticals Inc	02	N	02-1167	01-A	11099 N Torrey Pines Rd Suite 290 La Jolla

Active Permits Metrowide at Year End

Report run on: Monday, January, 3 2022 9:49 am

<i>Class</i>	<i>Name</i>	<i>Area</i>	<i>SIU</i>	<i>Facility</i>	<i>Permit</i>	<i>Address</i>
4M	Del Mar Professional Dental Group	02	N	02-1168	02-A	13983 Mango Dr Suite 106 San Diego
5	Del Mar Aesthetics	02	N	02-1170	01-A	13983 Mango Dr Suite 102 San Diego
2	Neurocrine Biosciences	02	N	02-1171	02-A	10420 Wateridge Cr San Diego
2	La Jolla Infectious Disease Institute	02	N	02-1172	02-A	3962 Sorrento Valley Bl Suite 500 San Diego
4	Business Assessment	02	N	02-1176	02-A	11025 N Torrey Pines Rd Suite 140 San Diego
2	Spatial Genomics Inc	02	N	02-1177	02-A	11585 Sorrento Valley Rd Suite 107 San Diego
4	GWR Instruments Inc	02	N	02-1178	01-A	5985 Pacific Center Bl Suite 203 San Diego
2	Treeline Biosciences Inc	02	N	02-1179	02-A	11180 Roselle St Suite A San Diego
2	Epigen Biosciences Inc	02	N	02-1180	01-A	10225 Barnes Canyon Rd Suite A104 San Diego
4	Turning Point Therapeutics Inc	02	N	02-1182	01-A	10628 Science Center Dr Suite 200 San Diego
5	TSRI Hazen Lab	02	N	02-1184	01-A	10630 John Jay Hopkins Dr San Diego
4	Zoom Technology USA Inc	02	N	02-1185	01-A	5830 Oberlin Dr Suite 203 San Diego
2	Mesa Biotech	02	N	02-1186	02-A	6190 E Cornerstone Ct Suite 101 San Diego
5	Rohm Electronics	02	N	02-1187	01-A	6020 W Cornerstone St Suite 320 San Diego
5	Texas Instruments Inc	02	N	02-1188	01-A	9276 Scranton Rd Suite 450 San Diego
2	Oncosec Medical Inc	02	N	02-1189	03-A	3565 General Atomics Ct Unit 100 San Diego
4	Business Assessment	02	N	02-1191	01-A	6042 W Cornerstone Ct Suite A San Diego
2	EZ Labs LLC	02	N	02-1191	02-A	6042 W Cornerstone Ct Suite A San Diego
2	Amaratek	02	N	02-1193	01-A	10441 Roselle St Suite A San Diego
2	SD Chem Inc	02	N	02-1194	01-A	5940 Pacific Mesa Ct Suite 202 San Diego
5	Office Building	02	N	02-1195	01-A	11975 El Camino Real Suite 300 San Diego
2	Biopeptide Co Inc	02	N	02-1198	01-A	10457 Roselle St Suite I San Diego
2	OEP Innovations Inc	02	N	02-1204	01-A	5820 Oberlin Dr Suite 101 San Diego
2	Chemcyte Inc	02	N	02-1205	01-A	4206 Sorrento Valley Bl Suite A San Diego
4	Business Assessment	02	N	02-1207	02-A	11760 Sorrento Valley Rd San Diego
2	Blue Nalu Inc	02	N	02-1208	01-A	6197 E Cornerstone Ct Suite 111 San Diego
2	Exon Biosystems	02	N	02-1210	01-A	6440 Lusk Bl Suite D110 San Diego
2	LeGene Biosciences	02	N	02-1216	02-A	10225 Barnes Canyon Rd Suite A107 San Diego
2	NuMega Resonance Labs Inc	02	N	02-1218	02-A	11526 Sorrento Valley Rd Suite B2 San Diego
2	Orphagen Pharmaceuticals	02	N	02-1221	02-A	11558 Sorrento Valley Rd Suite 4 San Diego
5	Raytheon	02	N	02-1223	01-A	9985 Pacific Heights Bl Suite 200 San Diego
2	Rendu USA Inc	02	N	02-1225	01-A	6048 W Cornerstone Ct Suite B San Diego
5	Stemedica Cell Technology	02	N	02-1226	01-A	5375 Mira Sorrento Pl Suite 100 San Diego
2	Immunicom Inc	02	N	02-1227	02-A	6048 W Cornerstone Ct Suite D San Diego
4	Business Assessment	02	N	02-1228	01-A	5940 Pacific Mesa Ct Suite 209 San Diego
2	CUE Health Inc	02	N	02-1229	02-A	4980 Carroll Canyon Rd Suite 100 San Diego
2	Zyagen	02	N	02-1231	02-A	10225 Barnes Canyon Rd Suite 205 San Diego
5	HLS Research	02	N	02-1233	01-A	3366 N Torrey Pines Ct Suite 310 La Jolla
2	Explora Biolabs	02	N	02-1236	01-A	11175 Flintkote Av Suite B San Diego
2	Abwiz Bio Inc	02	N	02-1237	02-A	9823 Pacific Heights Bl Suite J San Diego
4	Drawbridge Health	02	N	02-1238	02-A	11555 Sorrento Valley Rd Suite 102 San Diego
4	San Diego Fertility Center	02	N	02-1239	01-A	11425 El Camino Real San Diego
2	AlivaMab Discovery Services	02	N	02-1240	01-A	10581 Roselle St Suite 115 San Diego
2	Receptos Services LLC	02	N	02-1241	02-A	3033 Science Park Rd Suite 300 San Diego
2	Vividion Therapeutics	02	N	02-1242	01-A	5820 Nancy Ridge Dr San Diego

Active Permits Metrowide at Year End

Report run on: Monday, January, 3 2022 9:49 am

<i>Class</i>	<i>Name</i>	<i>Area</i>	<i>SIU</i>	<i>Facility</i>	<i>Permit</i>	<i>Address</i>
2	Astute Medical Inc	02	N	02-1245	01-A	3550 General Atomics Ct Bldg San Diego
2	Obsidian Sensors Inc	02	N	02-1253	02-A	5754 Pacific Center Bl Suite 201 San Diego
5	Helen Jane Dyson	02	N	02-1256	01-A	10550 N Torrey Pines Rd Suite MB2 San Diego
2	Oerlikon Metco	02	N	02-1257	01-A	11760 Sorrento Valley Rd Suite D San Diego
4	Shell Gas Station	02	N	02-1259	01-A	3015 Del Mar Heights Rd San Diego
5	Xencor Inc	02	N	02-1260	01-A	12770 High Bluff Dr San Diego
5	Quintiles	02	N	02-1261	01-A	10188 Telesis Ct Suite 400 San Diego
2	Acculab Life Sciences LLC	02	N	02-1263	01-A	11107 Roselle St Suite 103 San Diego
2	BioNano Genomics Inc	02	N	02-1264	01-A	9540 Towne Centre Dr Suite 100 San Diego
2	Hamari Chemicals USA Inc	02	N	02-1266	02-A	11558 Sorrento Valley Rd Suite 3 San Diego
2	Matrix Sensors Inc	02	N	02-1267	01-A	4122 Sorrento Valley Bl Suite 101 San Diego
2	Tenova Pharmaceuticals	02	N	02-1268	01-A	6650 Lusk Bl Suite B107 San Diego
5	Equitable Advisors	02	N	02-1269	01-A	4370 La Jolla Village Dr Suite 400 San Diego
5	Elcelyx Therapeutics Inc	02	N	02-1270	01-A	11975 El Camino Real Suite 305 San Diego
5	Retrophin	02	N	02-1274	01-A	12255 El Camino Real Suite 250 San Diego
2	Otonomy Incorporated	02	N	02-1275	01-A	4796 Executive Dr San Diego
2	BP Bioscience Center	02	N	02-1276	01-A	10628 Science Center Dr Suite 150 San Diego
2	Bioduro LLC	02	N	02-1277	01-A	11011 Torreyana Rd Suite 100 San Diego
5	Empire Steel Building	02	N	02-1278	01-A	5230 Carroll Canyon Rd Suite 300 San Diego
4	Business Assessment	02	N	02-1279	02-A	6181 E Cornerstone Ct Suite 103 San Diego
2	Innovega Inc	02	N	02-1279	01-A	6181 E Cornerstone Ct Suite 103 San Diego
5	Covance Inc	02	N	02-1283	01-A	10300 Campus Point Dr Suite 225 San Diego
5	Business Assessment	02	N	02-1287	01-A	10451 Roselle St Suite 300 San Diego
2	American Testing Labs	02	N	02-1288	02-A	5820 Oberlin Dr Suite 108 San Diego
2	Miltenyi Biotec Inc	02	N	02-1295	01-A	6125 E Cornerstone Ct San Diego
2	Miltenyi Biotec Inc	02	N	02-1295	01-B	6125 E Cornerstone Ct San Diego
5	Billups Rothenburg	02	N	02-1297	01-A	4178 Sorrento Valley Bl Unit H San Diego
5	Biopioneer Inc	02	N	02-1298	01-A	3956 Sorrento Valley Rd Unit 200 San Diego
4	Business Assessment	02	N	02-1299	02-A	10225 Barnes Canyon Rd Suite 103 San Diego
2	Nacalai USA Inc	02	N	02-1299	01-A	10225 Barnes Canyon Rd Suite 103 San Diego
2	Certis Oncology Solutions Inc	02	N	02-1302	02-A	5626 Oberlin Dr Suite 110 San Diego
2	Beckton Dickson	02	N	02-1305	01-A	10020 Pacific Mesa Bl San Diego
2	Singular Genomics Systems Inc	02	N	02-1310	01-A	3033 Science Park Rd Suite 220 San Diego
5	Business Assessment	02	N	02-1311	02-A	10835 Road to the Cure Suite 230 San Diego
2	Neuropore Therapies Inc	02	N	02-1311	01-A	10835 Road to the Cure Suite 230 San Diego
2	ImmunoScape	02	N	02-1312	02-A	11575 Sorrento Valley Rd Suite 204F San Diego
2	Imagion Biosystems LLC	02	N	02-1313	02-A	10355 Science Center Dr Suite 210 San Diego
4	The Fishel Company	02	N	02-1316	01-A	5878 Autoport Mall San Diego
4	Business Assessment	02	N	02-1317	01-A	4050 Sorrento Valley Bl Suite O San Diego
2	Helix Opco LLC	02	N	02-1318	01-A	9875 Towne Centre Dr Suite 100 San Diego
2	Gossamer Bio Inc	02	N	02-1319	01-A	3013 Science Park Rd Suite 200 San Diego
2	Birdrock Laboratories	02	N	02-1321	02-A	10581 Roselle St Suite 120 San Diego
4	Business Asssessment	02	N	02-1321	03-A	10581 Roselle St Suite 120 San Diego
2	NanoImaging Services	02	N	02-1323	01-A	4940 Carrol Canyon Rd Suite 115 San Diego
2	Heron Therapeutics	02	N	02-1324	01-A	4242 Campus Point Ct Suite 200 San Diego

Active Permits Metrowide at Year End

Report run on: Monday, January, 3 2022 9:49 am

<i>Class</i>	<i>Name</i>	<i>Area</i>	<i>SIU</i>	<i>Facility</i>	<i>Permit</i>	<i>Address</i>
5	Angiocrine Bioscience	02	N	02-1325	01-A	11575 Sorrento Valley Rd Suite 205 San Diego
2	Mesa Tech International Inc	02	N	02-1326	01-A	6190 Cornerstone Ct Suite E220 San Diego
2	InvivoGen	02	N	02-1327	01-A	10515 Vista Sorrento Py San Diego
2	Crinetics Pharmaceuticals Inc	02	N	02-1329	01-A	10222 Barnes Canyon Rd Bldg 2 San Diego
2	TP Therapeutics	02	N	02-1331	01-A	10628 Science Center Dr Suite 100 San Diego
2	Turning Point Therapeutics	02	N	02-1331	02-A	10628 Science Center Dr Suite 100 San Diego
5	Pacific Sothebys International Realty	02	N	02-1333	01-A	16745 W Bernardo DR Ste 200 San Diego
4	Business Assessment	02	N	02-1335	01-A	6450 Lusk Bl Suite E109 San Diego
4	Synthetic Genomics Inc	02	N	02-1336	01-A	11099 N Torrey Pines Rd Suite 150 San Diego
2	Invivoscribe Technologies Inc	02	N	02-1337	01-A	10222 Barnes Canyon Rd Bldg 1 San Diego
2	Helix Opco LLC	02	N	02-1338	01-A	6925 Lusk Bl Suite 100 San Diego
2	Signal Pharmaceuticals LLC	02	N	02-1340	02-A	4242 Campus Point Ct Suite 300 San Diego
2	DTx Pharma Inc	02	N	02-1341	02-A	10655 Sorrento Valley Rd Suite 100 San Diego
4	Vacant	02	N	02-1342	01-A	4242 Campus Point Ct Suite 600 San Diego
2	Novartis Gene Therapies Inc	02	N	02-1345	01-A	10210 Campus Point Dr Suite 350 San Diego
2	Mabplex	02	N	02-1348	01-A	10210 Campus Point Dr Suite 100 San Diego
4	Business Assessment	02	N	02-1349	02-A	10835 Road to the Cure Suite 140 San Diego
2	Erasca Inc	02	N	02-1349	01-A	10835 Road to the Cure Suite 140 San Diego
2	DMG of North County Inc	02	N	02-1351	01-A	11943 El Camino Real Suite 220 San Diego
4	Vacant	02	N	02-1352	01-A	4224 Campus Point Ct Suite 200 San Diego
5	TSRI Skaggs NMR	02	N	02-1354	01-A	10582 John Jay Hopkins Rd San Diego
2	Escient Pharmaceuticals	02	N	02-1355	01-A	10578 Science Center Dr Suite 250 San Diego
4	Business Assessment	02	N	02-1358	02-A	5717 Pacific Center Bl Suite 200 San Diego
2	Curology	02	N	02-1358	01-A	5717 Pacific Center Bl Suite 200 San Diego
2	Arcturus Therapeutics Inc	02	N	02-1359	01-A	10578 Science Center Dr Suite 150 San Diego
2	Polaris Pharmaceuticals	02	N	02-1360	01-A	10675 Sorrento Valley Rd Suite 200 San Diego
2	Biosplice Therapeutics Inc	02	N	02-1361	01-A	9360 Towne Centre Dr San Diego
4	Turning Point Therapeutics	02	N	02-1362	01-A	10678 Science Center Dr Suite 100 San Diego
5	AveXis, Inc.	02	N	02-1363	01-A	4224 Campus Point Ct Suite 105 San Diego
5	City Tacos	02	N	02-1364	01-A	11045 Roselle St Suite 100 San Diego
4	Acea Biosciences Inc	02	N	02-1365	01-A	4224 Campus Point Ct Suite 210 San Diego
4	Business Assessment	02	N	02-1368	01-A	11494 Sorrento Valley Bl Ste E San Diego
2	Integrated DNA Technologies	02	N	02-1369	01-A	5626 Oberlin Dr Ste 100 San Diego
4	Business Assessment	02	N	02-1370	02-A	4940 Carroll Canyon Rd Ste 100 San Diego
2	Cosmobiolabs Inc	02	N	02-1371	01-A	4940 Carroll Canyon Rd Ste 110 San Diego
2	Viscient Biosciences	02	N	02-1373	02-A	11575 Sorrento Valley Rd Ste 208 San Diego
2	Stratify Genomics Inc	02	N	02-1376	01-A	11575 Sorrento Valley Rd Suite 214 San Diego
2	Nielsen Biosciences Inc	02	N	02-1377	01-A	11125 Flintkote Av Suite G San Diego
2	Decipher Biosciences Inc	02	N	02-1380	01-A	6925 Lusk Bl Ste 200 San Diego
2	Plexium Inc	02	N	02-1381	01-A	11494 Sorrento Valley Rd Suite A San Diego
4	Vacant	02	N	02-1382	01-A	10265 Science Center Dr San Diego
2	AcelaBio (US) Inc	02	N	02-1384	01-A	10581 Roselle St Suite 110 San Diego
4M	Torrey Pines Pediatric Dentistry and Adult	02	N	02-1385	01-A	12395 El Camino Real St Suite 312 San Diego
4M	Dr Martin Abelar DDS	02	N	02-1386	01-A	11515 El Camino Real Suite 110 San Diego
4M	Roya Mirkhan DMD Inc	02	N	02-1389	01-A	12395 El Camino Real Suite 314 San Diego

Active Permits Metrowide at Year End

Report run on: Monday, January, 3 2022 9:49 am

<i>Class Name</i>	<i>Area</i>	<i>SIU</i>	<i>Facility</i>	<i>Permit</i>	<i>Address</i>
4M Torrey Del Mar Dentistry	02	N	02-1390	01-A	13859 Carmel Valley Rd Suite D San Diego
2 Lung Biotechnology PBC	02	N	02-1392	01-A	5580 Morehouse Dr Suite 200 San Diego
4M Carmel Valley Dental	02	N	02-1393	01-A	12750 Carmel Country Rd Suite 206 San Diego
4M Del Mar Endodontics	02	N	02-1394	01-A	12750 Carmel County Rd Suite 201 San Diego
2 Organogenesis Inc	02	N	02-1396	01-A	3040 Science Park Rd Suite 2000 San Diego
4M Carmel Valley Pediatric Dentistry	02	N	02-1397	01-A	12395 El Camino Real Suite 218 San Diego
4M Del Mar Laser Dentistry & Ortho	02	N	02-1399	01-A	12750 Crmel Country Rd Suite 215 San Diego
4M Carmel Heights Dentistry	02	N	02-1402	01-A	12750 Carmel Country Rd Suite 209 San Diego
4 Business Assessment	02	N	02-1403	02-A	11045 Roselle St Suite 130 San Diego
2 Solve Therapeutics Inc	02	N	02-1403	03-A	11045 Roselle St Suite 130 San Diego
2 Locanabio Inc	02	N	02-1404	01-A	3545 John Hopkins Ct Suite 200 San Diego
4 Business Assessment	02	N	02-1405	02-A	10355 Science Center Dr Suite 150 San Diego
2 Foundation Medicine Inc	02	N	02-1405	01-A	10355 Science Center Dr Suite 150 San Diego
2 Janssen R&D	02	N	02-1406	01-A	11388 Sorrento Valley Rd Suite 300 San Diego
5 Business Assessment	02	N	02-1407	01-A	11107 Roselle St Suite 223 San Diego
2 Cradle Genomics Inc	02	N	02-1408	01-A	4755 Nexus Center Dr San Diego
2 Blacksmith Medicines Inc	02	N	02-1409	01-A	10578 Science Center Dr Suite 205 San Diego
2 Quantitative Biosciences Inc	02	N	02-1411	01-A	6185 E Cornerstone Ct Suite 107 San Diego
4 Business Assessment	02	N	02-1412	01-A	5590 Morehouse Dr San Diego
2 Pipeline Therapeutics	02	N	02-1413	01-A	10578 Science Center Dr Suite 200 San Diego
2 Boundless Bio Inc	02	N	02-1415	01-A	11099 N Torrey Pines Rd Suite 280 San Diego
2 TriLink Biotechnologies LLC	02	N	02-1416	01-A	10770 Wateridge Cr Suite 200 San Diego
4 Business Assessment	02	N	02-1417	01-A	10421 Wateridge Cr San Diego
4 TriLink Biotechnologies LLC	02	N	02-1418	01-A	10770 Wateridge Cr Suite 110 San Diego
2 Mapp Biopharmaceutical Inc	02	N	02-1419	01-A	4921 Directors Pl Suite 100 San Diego
2 Native Microbials Inc	02	N	02-1423	01-A	10255 Science Center Dr Suite C2 San Diego
2 Autobahn Therapeutics Inc	02	N	02-1426	01-A	9880 Campus Point Dr Suite 440 San Diego
2 LifeNet Health Inc	02	N	02-1427	01-A	4224 Campus Point Ct Suite 120 San Diego
3 UT; DPR Construction	02	N	02-1428	01-A	3115 Merryfield Rw San Diego
3 UT; DPR Construction	02	N	02-1428	02-A	3115 Merryfield Rw San Diego
4M LaJolla Cosmetic Dentistry & Ortho	02	N	02-1431	01-A	4510 Executive Dr Suite 205 San Diego
2 Explora Biolabs	02	N	02-1432	01-A	9880 Campus Point Dr Suite 10 San Diego
2 Scianalytical Strategies Inc	02	N	02-1433	01-A	9880 Campus Point Dr Suite 20 San Diego
2 Thermo Fisher Scientific	02	N	02-1434	01-A	9880 Campus Point Dr Suite 30 San Diego
2 Molecular Assemblies Inc	02	N	02-1435	01-A	9880 Campus Point Dr Suite 110 San Diego
2 Boundless Bio Inc	02	N	02-1436	03-A	9880 Campus Point Dr Suite 120 San Diego
2 RayzeBio Inc	02	N	02-1436	02-A	9880 Campus Point Dr Suite 120 San Diego
2 Element Biosciences Inc	02	N	02-1437	01-A	9880 Campus Point Dr Suite 210 San Diego
2 Biota Technology Inc	02	N	02-1440	01-A	9880 Campus Point Dr Suite 430 San Diego
2 Wugen Inc	02	N	02-1440	02-A	9880 Campus Point Dr Suite 430 San Diego
4M UTC Periodontics and Oral Implantology	02	N	02-1441	01-A	4510 Executive Dr Suite 202 San Diego
2 Nucleix Inc	02	N	02-1443	01-A	10675 Sorrento Valley Rd Suite 250 San Diego
2 Explora Biolabs	02	N	02-1444	01-A	10865 Road to the Cure Suite B1 San Diego
4M Sherman Lin, DDS	02	N	02-1446	01-A	5820 Oberlin Dr Suite 109 San Diego
4M Ucare Dental	02	N	02-1447	01-A	6255 Lusk Bl Suite 250 San Diego

Active Permits Metrowide at Year End

Report run on: Monday, January, 3 2022 9:49 am

<i>Class</i>	<i>Name</i>	<i>Area</i>	<i>SIU</i>	<i>Facility</i>	<i>Permit</i>	<i>Address</i>
2	3DT Holdings LLC	02	N	02-1448	01-A	11107 Roselle St Suite 213 San Diego
4	Pacific Integrated Energy Inc	02	N	02-1449	01-A	11555 Sorrento Valley Rd Suite 204 San Diego
5	Business Assessment	02	N	02-1450	01-A	6142 Nancy Ridge Rd Suite 102 San Diego
4M	A+ Family Dentistry	02	N	02-1451	01-A	6755 Mira Mesa Bl Suite 218 San Diego
4	Business Assessment	02	N	02-1454	02-A	10675 Sorrento Valley Rd Suite 100 San Diego
2	Histogen Inc	02	N	02-1454	01-A	10675 Sorrento Valley Rd Suite 100 San Diego
4M	Fen-Hui Chen DDS Inc	02	N	02-1455	01-A	4510 Executive Dr Suite 101 San Diego
4M	Sorrento Dental Care	02	N	02-1457	01-A	9254 Scranton Rd Suite 108 San Diego
4M	Dr. Gary B. Carr, DDS	02	N	02-1458	02-A	6235 Lusk Bl San Diego
4M	Jeffrey L Muehl DDS, APCD	02	N	02-1460	01-A	11199 Sorrento Valley Rd Suite 208 San Diego
2	UC San Diego Health CALM	02	N	02-1463	01-A	10300 Campus Point Dr Suite 150 San Diego
2	Biological Dynamics	02	N	02-1465	01-A	9381 Judicial Dr Suite 120 San Diego
4	Business Assessment	02	N	02-1467	01-A	10220 Sorrento Valley Rd San Diego
2	Shoreline Biosciences Inc	02	N	02-1467	02-A	10220 Sorrento Valley Rd San Diego
2	Bioform Solutions	02	N	02-1469	01-A	11575 Sorrento Valley Rd Suite 215 San Diego
4	Business Assessment	02	N	02-1469	02-A	11575 Sorrento Valley Rd Suite 215 San Diego
2	Nitto BioPharma Inc	02	N	02-1477	01-A	10618 Science Center Dr San Diego
4	Business Assessment	02	N	02-1478	01-A	9393 Towne Centre Dr San Diego
5	University of CA Vet Medical Center-San	02	N	02-1479	01-A	10435 Sorrento Valley Rd Floor 2 San Diego
4	Business Assessment	02	N	02-1482	01-A	11588 Sorrento Valley Rd Suite 22 San Diego
4	Business Assessment	02	N	02-1483	01-A	11588 Sorrento Valley Rd Suite 6 San Diego
4	Business Assessment	02	N	02-1489	01-A	5810 Nancy Ridge Dr San Diego
4	Business Assessment	02	N	02-1490	01-A	5580 Morehouse Dr Suite 100 San Diego
2	Viacyte Inc	02	N	02-1490	02-A	5580 Morehouse Dr Suite 100 San Diego
4	Business Assessment	02	N	02-1491	01-A	5580 Morehouse Dr 110 San Diego
4	Business Assessment	02	N	02-1492	01-A	5580 Morehouse Dr Suite 210 San Diego
4	Business Assessment	02	N	02-1494	01-A	10171 Pacific Mesa Bl 303 San Diego
4	Kinnate Biopharma	02	N	02-1496	01-A	11975 El Camino Real Suite 101 San Diego
2	Infinity Laboratories	02	N	02-1497	01-A	10151 Pacific Mesa Bl Suite 107 San Diego
4	Business Assessment	02	N	02-1500	01-A	10260 Sorrento Valley Rd San Diego
2	Scripps Heath - Orthopedic Research	02	N	02-1503	01-A	10255 Science Center Dr Suite B1 San Diego
4	Business Assessment	02	N	02-1505	01-A	11545 Sorrento Valley Rd Suite 315 San Diego
2	Zoetis Reference Laboratories	02	N	02-1506	01-A	10455 Sorrento Valley Rd Suite 100 San Diego
4	Business Assessment	02	N	02-1507	01-A	9276 Scranton Rd San Diego
4	Business Assessment	02	N	02-1508	01-A	9330 Scranton Rd San Diego
2	RayzeBio Inc	02	N	02-1509	01-A	5505 Morehouse Dr Suite 300 San Diego
2	Neogenomics Laboratories	02	N	02-1512	01-A	4570 Executive Dr Suite 250 San Diego
2	Glysens Inc	02	N	02-1513	01-A	3931 Sorrento Valley Bl Suite 110 San Diego
4	Business Assessment	02	N	02-1514	02-A	11045 Roselle St Suite 120 San Diego
2	Encodia Inc	02	N	02-1514	01-A	11045 Roselle St Suite 120 San Diego
2	Rejuvenate Bio Inc	02	N	02-1515	01-A	11425 Sorrento Valley Rd Suite 3 San Diego
5	National Resilience Inc	02	N	02-1516	01-A	9310 Athena Cr Suite 130 San Diego
5	Far-Tech	02	N	02-1519	01-A	3550 General Atomics Ct Bldg 2226 San Diego
2	Jumpcode Genomics Inc	02	N	02-1522	01-A	4755 Nexus Center Dr Suite 100 San Diego
4	Business Assessment	02	N	02-1523	01-A	4570 Executive Dr Suite 350 San Diego

Active Permits Metrowide at Year End

Report run on: Monday, January, 3 2022 9:49 am

<i>Class</i>	<i>Name</i>	<i>Area</i>	<i>SIU</i>	<i>Facility</i>	<i>Permit</i>	<i>Address</i>
4	Business Assessment	02	N	02-1524	01-A	4150 Campus Point Ct San Diego
4	Business Assessment	02	N	02-1526	01-A	9276 Scranton Rd Suite 300 San Diego
4	Business Assessment	02	N	02-1527	01-A	9330 Scranton Rd San Diego
4	Business Assessment	02	N	02-1528	01-A	11085 N Torrey Pines Rd Bldg 1 San Diego
4	Pacific Integrated Energy	02	N	02-1529	01-A	6650 Lusk Bl Suite B104 San Diego
4	Business Assessment	02	N	02-1532	01-A	4224 Campus Point Ct Suite 205 San Diego
5	The Skaggs Institute for Chemical Biology	02	N	02-1534	01-A	10596 N Torrey Pines Rd Unit 300G San Diego
2	Sapphire Biotech Inc	02	N	02-1536	01-A	6191 E Cornerstone Ct Suite 114 San Diego
5	LabFellows Inc	02	N	02-1541	01-A	9310 Athena Cr Suite 2140 San Diego
2	Mirati Therapeutics Inc	02	N	02-1542	01-A	3545 Cray Ct San Diego
2	San Diego BioMedical Research Institute	02	N	02-1543	01-A	3525 John Hopkins Ct Suite 200 San Diego
2	Electronic Biosciences	02	N	02-1544	01-A	5754 Pacific Center Bl Suite 204 San Diego
4	Business Assessment	02	N	02-1546	01-A	9820 Towne Centre Dr San Diego
2	Quantum-Si Inc	02	N	02-1548	01-A	5510 Morehouse Dr Suite 400 San Diego
2	Arrowhead Pharmaceuticals	02	N	02-1550	01-A	11404 Sorrento Valley Rd San Diego
5	Veterinary Specialty Hospital	02	N	02-1551	01-A	10435 Sorrento Valley Rd Floor 1 San Diego
3	UT; Shimmick Construction	02	N	02-1553	01-A	4940 Eastgate Mall San Diego
4	Business Assessment	02	N	02-1554	01-A	10180 Telesis Ct San Diego
2	i-Mab Biopharma US Limited	02	N	02-1556	01-A	5601 Oberlin Dr Suite 110 San Diego
4	Business Assessment	02	N	02-1557	01-A	11011 N Torrey Pines Rd Suite 130 San Diego
2	Kura Oncology	02	N	02-1559	01-A	5510 Morehouse Dr Suite 110 San Diego
2	Prominex Inc	02	N	02-1560	01-A	6181 E Cornerstone Ct Suite 106 San Diego
2	BioFluidica Inc	02	N	02-1562	01-A	3377 Carmel Mountain Rd Suite 100 San Diego
2	AxisPharm	02	N	02-1565	01-A	5820 Oberlin Dr Suite 104 San Diego
2	Altos Labs Inc	02	N	02-1568	01-A	5510 Morehouse Dr Suite 300 San Diego
4	Business Assessment	02	N	02-1569	01-A	10945 Vista Sorrento Py San Diego
4	Business Assessment	02	N	02-1570	01-A	11558 Sorrento Valley Rd Suite 6 San Diego
2	Asha Pharma LLC	02	N	02-1571	01-A	11107 Roselle St Suite 215 San Diego
4	Business Assessment	02	N	02-1572	01-A	10955 Vista Sorrento Py Suite 200 San Diego
2	Cello Therapeutics	02	N	02-1573	01-A	5945 Pacific Center Bl Suite 507 San Diego
5	City; North City Water Reclamation Plant	02	N	02-1577	01-A	4949 Eastgate Ml San Diego
2	Business Assessment	02	N	02-1584	01-A	11055 Roselle St Suite 100 San Diego
4	Business Assessment	02	N	02-1585	01-A	11120 Roselle St Suite C1 San Diego
2	Business Assessment	02	N	02-1586	01-A	10240 Sorrento Valley Rd Suite 100 San Diego
4	Business Assessment	02	N	02-1587	01-A	11125 Flintkote Av Suite F San Diego
4	Altos Labs, Inc.	02	N	02-1591	01-A	5510 Morehouse Dr Suite 200 San Diego
4	Business Assessment	02	N	02-1595	01-A	10201 Wateridge Cr San Diego
4	Business Assessment	02	N	02-1597	01-A	12400 High Bluff Dr San Diego
4	Business Assessment	02	N	02-1599	01-A	10421 Wateridge Cr Suite 200 San Diego
4	Business Assessment	02	N	02-1600	01-A	9330 Scranton Rd Suite 200 San Diego
5	Turnstone Biologics, Inc.	02	N	02-1601	01-A	9310 Athena Cr Suite 300 San Diego
3	UT; Ohla USA Inc	02	N	02-1603	01-A	4767 Executive Dr San Diego
4	Business Assessment	02	N	02-1604	01-A	12250 El Camino Real San Diego
2	Equillium Inc	02	N	02-1606	01-A	10355 Science Center Dr Suite 270 San Diego
4	Business Assessment	02	N	02-1607	01-A	10240 Sorrento Valley Rd Suite 300 San Diego

Active Permits Metrowide at Year End

Report run on: Monday, January, 3 2022 9:49 am

<i>Class</i>	<i>Name</i>	<i>Area</i>	<i>SIU</i>	<i>Facility</i>	<i>Permit</i>	<i>Address</i>
4	Business Assessment	02	N	02-1620	01-A	11010 Roselle St San Diego
4	Business Assessment	02	N	02-1621	01-A	6150 Nancy Ridge Dr Suite A San Diego
4	Business Assessment	02	N	02-1626	01-A	3390 Carmel Mountain Rd San Diego
4	Business Assessment	02	N	02-1630	01-A	6027 Edgewood Bend Ct San Diego
4	Business Assessment	02	N	02-1631	01-A	9330 Scranton Rd Suite 500 San Diego
4	Northrop Grumman Space Technology	03	N	03-0007	03-A	15120 Innovation Dr San Diego
4	City; Miramar Water Treatment Plant	03	N	03-0035	02-A	10710 Scripps Lake Dr San Diego
4	City; Miramar Water Treatment Plant	03	N	03-0035	03-A	10710 Scripps Lake Dr San Diego
4	Business Assessment	03	N	03-0039	01-A	9650 Miramar Rd San Diego
5	AKON Auto Center	03	N	03-0042	02-A	9585 Black Mountain Rd Suite A San Diego
4	The Smog Station 1	03	N	03-0042	01-A	9585 Black Mountain Rd Suite A San Diego
4	Mission Janitorial Supplies	03	N	03-0056	00-A	9292 Activity Rd San Diego
2	Velocity Truck Centers SD	03	N	03-0077	06-A	6066 Miramar Rd San Diego
1	ATK Space Systems Inc	03	Y	03-0115	07-A	9603 Distribution Av San Diego
4	Right Manufacturing LLC	03	N	03-0139	01-A	7949 Stromesa Ct Suite G San Diego
4	Julie's Cleaners	03	N	03-0157	00-A	9923 Carmel Mountain Rd San Diego
4	Business Assessment	03	N	03-0163	01-A	7588 Trade St San Diego
4	Vanguard Space Technologies Inc	03	N	03-0175	02-A	9431 Dowdy Dr San Diego
3	Stars & Stripes Car Wash	03	N	03-0181	02-A	5716 Miramar Rd San Diego
4C	Presidio Components Inc	03	N	03-0191	06-A	7169 Construction Ct San Diego
4C	Presidio Components Inc	03	N	03-0191	07-A	7169 Construction Ct San Diego
4	Kel Coatings Inc	03	N	03-0249	01-A	8646 Commerce Av Suite A San Diego
2	SDCCD; Miramar College	03	N	03-0254	04-A	10440 Black Mountain Rd San Diego
3	Ballast Point Brewery Miramar	03	Y	03-0270	04-A	9045 Carroll Wy San Diego
3	Ballast Point Brewery Miramar	03	Y	03-0270	05-A	9045 Carroll Wy San Diego
4	Elkays Electronics Inc dba Western Radio	03	N	03-0271	01-A	7558 Trade St San Diego
2	Herc Equipment Rental	03	N	03-0293	04-A	8014 Miramar Rd San Diego
5	Havoc Publishing	03	N	03-0316	01-A	9808 Waples St San Diego
3	DARPRO Solutions Division of Darling I	03	N	03-0332	05-A	8096 Miramar Rd San Diego
4	Miramar Automotive	03	N	03-0335	01-A	9280 Kearny Mesa Rd San Diego
5	Westside Building Material LLC	03	N	03-0341	01-A	7465 Carroll Rd San Diego
4	Culinary Concepts	03	N	03-0343	00-A	8575 Commerce Av San Diego
4	KJM Enterprises Inc	03	N	03-0345	01-A	9590 Distribution Av San Diego
1	Sungear	03	Y	03-0347	05-B	8535 Arjons Dr Suite G San Diego
2	Cutwater Spirits	03	N	03-0351	01-A	9750 Distribution Av San Diego
4	Rick's RV Service	03	N	03-0354	03-A	9210 Mira Este Ct San Diego
5	Design Institute	03	N	03-0356	01-A	8515 Commerce Av San Diego
4	Shell Oil Company	03	N	03-0359	00-A	9840 Miramar Rd San Diego
4	Budget Transmission	03	N	03-0399	01-A	7629 Carroll Rd San Diego
4	Hydranautics	03	N	03-0408	05-A	8270 Miralani Dr San Diego
5	MicroElectronics	03	N	03-0413	01-A	6351 Nancy Ridge Dr San Diego
4	Business Assessment	03	N	03-0435	03-A	10240 Flanders Ct San Diego
4	August European Motors Inc	03	N	03-0436	01-A	9705 Candida St San Diego
5	G B Sales	03	N	03-0451	01-A	7720 Kenamar Ct Suite A San Diego
4	Black Mountain Body & Paint	03	N	03-0455	01-A	9513 Black Mountain Rd Suite B San Diego

Active Permits Metrowide at Year End

Report run on: Monday, January, 3 2022 9:49 am

<i>Class</i>	<i>Name</i>	<i>Area</i>	<i>SIU</i>	<i>Facility</i>	<i>Permit</i>	<i>Address</i>
2F	IPM Lithographics Inc	03	N	03-0460	01-A	9040 Carroll Wy Suite 9 San Diego
5	Mitchell International	03	N	03-0473	01-B	9889 Willow Creek Rd San Diego
2	Bio-Edge Inc	03	N	03-0475	02-A	6369 Nancy Ridge Dr San Diego
4	Transmasters Transmissions	03	N	03-0477	01-A	8008 Miramar Rd Suite A San Diego
4	Miramar Mobil	03	N	03-0484	01-A	9790 Miramar Rd San Diego
2	Innominata dba GenBio	03	N	03-0488	04-A	15222 Avenue of Science Suite A San Diego
4	Business Assessment	03	N	03-0493	02-A	8270 Miramar Rd San Diego
4	Hanson Aggregates	03	N	03-0494	02-A	9255 Camino Santa Fe San Diego
4	Business Assessment	03	N	03-0499	01-A	6350 Nancy Ridge Dr Suite 105 San Diego
4	Business Assessment	03	N	03-0502	01-A	9373 Activity Rd Suite K San Diego
4	Marmol Export	03	N	03-0511	01-A	7992 Miramar Rd San Diego
4	General Atomics Aeronautical Systems In	03	N	03-0513	03-A	13330 N Evening Creek Dr San Diego
5	Featuristics Machine Inc	03	N	03-0526	02-A	7014 Carroll Rd San Diego
4	Jiffy Lube	03	N	03-0527	01-A	6696 Miramar Rd Suite K San Diego
2	Brightview Landscape Development	03	N	03-0530	03-A	8450 Miramar Pl San Diego
3	Clean Harbors Environmental Services Inc	03	N	03-0535	06-A	6465 Marindustry Dr San Diego
4	Clean Harbors Environmental Services Inc	03	N	03-0535	07-A	6465 Marindustry Dr San Diego
2	ProciseDx	03	N	03-0539	03-A	9449 Carroll Park Dr San Diego
4	Verari Systems Inc	03	N	03-0539	02-A	9449 Carroll Park Dr San Diego
2	LabCorp	03	N	03-0544	02-A	13112 Evening Creek S Dr San Diego
4	Hi-Tech Electronic Manufacturing	03	N	03-0547	02-A	7420 Carroll Rd San Diego
4	Time Warner Cable	03	N	03-0554	01-A	8949 Ware Ct San Diego
4	Business Assessment	03	N	03-0558	01-A	9030 Kenamar Dr Suite 309 San Diego
4	MG Ink Inc	03	N	03-0572	01-A	8475 Commerce Av San Diego
5	Tippet Inc	03	N	03-0577	01-A	8504 Commerce Av Suite A San Diego
5	Quest Building Products	03	N	03-0579	03-A	8860 Kenamar Dr Suite 301 San Diego
5	Mira Mesa Automotive	03	N	03-0584	01-A	9513 Black Mountain Rd Suite D San Diego
4Z	Century Tubes Inc	03	N	03-0586	04-A	7910 Dunbrook Rd San Diego
4C	Century Tubes Inc	03	N	03-0586	05-A	7910 Dunbrook Rd San Diego
4	Mira Mesa Car Wash	03	N	03-0587	01-A	6795 Mira Mesa Bl San Diego
5	Sunfusion Energy Systems	03	N	03-0592	02-A	9020 Kenamar Dr Suite 204 San Diego
4	Trident Technologies	03	N	03-0598	01-A	8885 Rehco Rd San Diego
4	Blatchfords Oriental Rug Clean	03	N	03-0616	00-A	7848 Silverton Av Suite G San Diego
4	Custom Engineering Plastics	03	N	03-0620	00-B	8558 Miramar Pl San Diego
2	Nucelis Inc	03	N	03-0626	02-A	6465 Nancy Ridge Dr San Diego
2	Cibus US LLC	03	N	03-0633	04-A	6455 Nancy Ridge Dr San Diego
4	Arya Cleaners	03	N	03-0638	01-A	8250 Mira Mesa Bl Suite D San Diego
4	Magma Mesa Ridge Technologies	03	N	03-0641	00-A	9918 Via Pasar San Diego
5	Santa Fe Business Center	03	N	03-0643	01-A	7310 Miramar Rd San Diego
4	Eagle Mold Technologies	03	N	03-0645	02-A	7716 Arjons Dr San Diego
4	Mesa Distributing Company Inc	03	N	03-0646	00-A	9184 Rehco Rd San Diego
4	Japanese Auto Tech	03	N	03-0649	01-A	6696 Miramar Rd Suite N San Diego
2	Codex DNA	03	N	03-0650	02-A	9535 Waples St Suite 100 San Diego
4	Challenge Press	03	N	03-0662	00-A	7848 Silverton Av Suite D San Diego
4	Rusty Surfboards	03	N	03-0675	01-A	8495 Commerce Av San Diego

Active Permits Metrowide at Year End

Report run on: Monday, January, 3 2022 9:49 am

<i>Class</i>	<i>Name</i>	<i>Area</i>	<i>SIU</i>	<i>Facility</i>	<i>Permit</i>	<i>Address</i>
4	BD Bioscience (PharMingen)	03	N	03-0684	02-A	8049 Arjons Dr San Diego
2	Prometheus Laboratories Inc	03	N	03-0685	03-A	9410 Carroll Park Dr San Diego
4M	Village Center Dentistry	03	N	03-0686	02-A	9982 Scripps Ranch Bl San Diego
4	All American Car Wash dba MMAS	03	N	03-0687	01-A	10641 Camino Ruiz San Diego
4	CA Botana International Inc	03	N	03-0690	02-A	9365 Waples St Suite A San Diego
4	Concentra Urgent Care	03	N	03-0692	02-A	7590 Miramar Rd Suite C San Diego
4	Business Assessment	03	N	03-0695	01-A	6335 Marindustry Dr San Diego
2	Retrogen Inc	03	N	03-0696	02-A	6645 Nancy Ridge Dr San Diego
4	Hitachi Data Systems	03	N	03-0698	01-A	10277 Scripps Ranch Bl San Diego
4	United States Postal Service	03	N	03-0712	03-A	11251 Rancho Carmel Dr Suite 1603 San Diego
1	Action Powder Coating LLC	03	Y	03-0717	09-A	7949 Stromesa Ct Suite D San Diego
4	Coast Precision Enterprises	03	N	03-0720	00-A	8636 Commerce Av San Diego
4	City; Police Dept NE Div	03	N	03-0725	01-A	13396 Salmon River Rd San Diego
5	Marshall's Industrial Hardware	03	N	03-0731	00-A	8423 Production Av San Diego
2	Scripps Laboratories	03	N	03-0738	03-A	6838 Flanders Dr San Diego
4	King Lee Technologies	03	N	03-0741	02-A	8949 Kenamar Dr Suite 107 San Diego
4	Shell Equilon Enterprises LLC	03	N	03-0748	01-A	9490 Mira Mesa Bl San Diego
2	Inova Diagnostics Inc	03	N	03-0752	04-A	9900 Old Grove Rd San Diego
4C	Sheffield Platers Inc	03	N	03-0753	05-A	9850 Waples St San Diego
4C	Sheffield Platers Inc	03	N	03-0753	06-A	9850 Waples St San Diego
4	LA Chemical	03	N	03-0755	01-A	7920 Stromesa Ct San Diego
4	Qualcomm	03	N	03-0756	02-A	9380 Waples St Suite 102 San Diego
4	AJ-USA Inc	03	N	03-0757	00-A	6620 Mira Mesa Bl San Diego
4	Aurora Behavioral Health Care	03	N	03-0761	01-A	11878 Avenue of Industry San Diego
4	Turbine Components Inc	03	N	03-0762	03-A	8985 Crestmar Pt San Diego
4	Sharp Rees-Stealy Med Group	03	N	03-0766	02-A	8901 Activity Rd San Diego
5	Sharp Rees-Stealy Med Group	03	N	03-0766	03-A	8901 Activity Rd San Diego
4	Eastgate Auto Center & Body	03	N	03-0775	01-A	7998 Miramar Rd Suite B San Diego
2	Gen-Probe Inc	03	N	03-0777	04-A	10210 Genetic Center Dr San Diego
1	IriSys LLC	03	Y	03-0779	05-A	6828 Nancy Ridge Dr Suite 100 San Diego
2	Miramar Bobcat Inc	03	N	03-0780	05-A	9370 Miramar Rd San Diego
4	Vildosola Racing	03	N	03-0790	02-A	7734 Formula Pl San Diego
2	HY Medical Technologies	03	N	03-0791	04-A	6555 Nancy Ridge Dr Suite 300 San Diego
4	Shell	03	N	03-0794	02-A	8920 Miramar Rd San Diego
4	Desert View Auto	03	N	03-0795	02-A	8775 Miramar Pl San Diego
2	Chemtron Biotech Inc	03	N	03-0797	02-A	9245 Brown Deer Rd Suite B San Diego
4	Titan Scan Systems	03	N	03-0800	01-A	9020 Activity Rd San Diego
1	Cue Health Inc	03	Y	03-0801	04-A	9877 Waples St San Diego
4	Prop-Art DuPont Design Inc	03	N	03-0805	01-A	9555 Distribution Av San Diego
2	Alan Laboratories	03	N	03-0810	02-A	6555 Nancy Ridge Dr Suite 300A San Diego
4	Electronic Surface Mounted Ind	03	N	03-0814	01-A	6731 Cobra Wy San Diego
4	Sony Display Systems Service	03	N	03-0815	01-A	7825 Trade St Suite 110 San Diego
4M	William E Gable DDS	03	N	03-0838	02-A	9855 Erma Rd Suite 138 San Diego
4	Sidney L Spector DDS PC	03	N	03-0840	02-A	9855 Erma Rd San Diego
4	Scripps Ranch Medical Clinic	03	N	03-0842	02-A	9999 Mira Mesa Bl San Diego

Active Permits Metrowide at Year End

Report run on: Monday, January, 3 2022 9:49 am

<i>Class</i>	<i>Name</i>	<i>Area</i>	<i>SIU</i>	<i>Facility</i>	<i>Permit</i>	<i>Address</i>
4	Crittenden Communications Inc	03	N	03-0844	01-A	9920 Scripps Lake Dr Suite 104 San Diego
4	Scripps Ranch Veterinary Hospital	03	N	03-0845	02-A	9990 Scripps Ranch Bl San Diego
4M	Jennifer Caruso DMD	03	N	03-0853	02-A	11279 Camino Ruiz San Diego
4M	Horizon Dental Care	03	N	03-0855	03-A	10737 Camino Ruiz Suite 225 San Diego
4M	S. Vivien B. Chadkewicz, DMD	03	N	03-0856	03-A	10737 Camino Ruiz Suite 205 San Diego
4M	Mallempalli	03	N	03-0857	03-A	9359 Mira Mesa Bl San Diego
4M	William Britton Jr DDS	03	N	03-0858	02-A	9292 Mira Mesa Bl San Diego
4M	Wilfred Baltazar Jr DDS	03	N	03-0859	02-A	9329 Mira Mesa Bl San Diego
4M	Mesa Dental Group	03	N	03-0863	02-A	9225 Mira Mesa Bl Suite 212 San Diego
4M	Erik Ferrer DDS	03	N	03-0864	02-A	9373 Mira Mesa Bl San Diego
4	Rancho Mesa Animal Hospital	03	N	03-0865	03-A	8710 Miramar Rd San Diego
4	Carmel Mountain Ranch Vet Hosp	03	N	03-0871	02-A	11925 Carmel Mountain Rd Suite 802 San Diego
4	Emerald Publications	03	N	03-0877	02-A	12395 World Trade Dr San Diego
4M	Pegah Salami	03	N	03-0879	03-A	12396 World Trade Dr Suite 208 San Diego
4M	Irene Sacamay Olaes DMD	03	N	03-0881	03-A	12335 World Trade Dr Suite 1B San Diego
4	Joel Switzer DMD	03	N	03-0882	02-A	12396 World Trade Dr Suite 209 San Diego
4M	Peak Dental	03	N	03-0885	03-A	9320 Carmel Mountain Rd Suite A San Diego
4M	Adrian F Naguit DDS	03	N	03-0887	03-A	9888H Carmel Mountain Rd San Diego
4M	Walter D Andrada DDS	03	N	03-0888	02-A	9330 Carmel Mountain Rd Suite B San Diego
4	CVS Pharmacy # 9102	03	N	03-0889	03-A	10575 Scripps Poway Py San Diego
4	Mobil Oil Corporation	03	N	03-0892	01-A	10555 Scripps Poway Py San Diego
4	CVS Pharmacy # 9177	03	N	03-0893	03-A	8260 Mira Mesa Bl San Diego
4	Delta Group Electronics Inc	03	N	03-0894	03-A	10180 Scripps Ranch Bl San Diego
2	Biomyx Inc	03	N	03-0898	03-A	10054 Mesa Ridge Ct Suite 112 San Diego
4	CVS Pharmacy # 9197	03	N	03-0904	03-A	9225 Twin Trails Dr San Diego
2	Emergent Travel Health Inc	03	N	03-0905	06-A	6275 Nancy Ridge Dr Ste 110 San Diego
4	Clay Chapman Photography	03	N	03-0908	02-A	7965 Silverton Av Suite 1305 San Diego
4	Rite Aid # 5662	03	N	03-0918	02-A	11845 Carmel Mountain Rd San Diego
1	Alphacoat Finishing LLC	03	Y	03-0920	06-A	9352 Cabot Dr San Diego
1	Alphacoat Finishing LLC	03	Y	03-0920	07-A	9352 Cabot Dr San Diego
5	Circuit Board Consortium	03	N	03-0924	01-A	9747 Businesspark Av San Diego
5	Pacific Design Specialists Inc	03	N	03-0925	01-A	5230 Carroll Canyon Rd Suite 102 San Diego
4	Federal Express Corporation	03	N	03-0927	01-A	10585 Heater Ct San Diego
4	Business Assessment	03	N	03-0928	03-A	9880 Mesa Rim Rd San Diego
5	Opticomm	03	N	03-0929	01-A	6827 Nancy Ridge Dr San Diego
2	Diamond Environmental Services	03	N	03-0934	04-A	9174 Rehco Rd San Diego
5	ProSource of San Diego	03	N	03-0936	02-A	6730 Top Gun St San Diego
4	American Sputtering Technology	03	N	03-0946	01-A	13240 Evening Creek Dr San Diego
4	Carmel Mountain Ranch Country Club	03	N	03-0948	01-A	14050 Carmel Ridge Rd San Diego
4	Sterigenics	03	N	03-0950	01-A	7695 Formula Pl San Diego
4	Scripps Poway Hand Car Wash & Detailir	03	N	03-0952	01-A	12033 Scripps Summit Dr San Diego
2	Rush Truck Center	03	N	03-0954	05-A	8464 Miramar Rd San Diego
2	Dexcom Inc	03	N	03-0955	02-A	6340 Sequence Dr San Diego
4	Vacant	03	N	03-0956	03-A	6350 Sequence Dr San Diego
4	Dexcom Inc	03	N	03-0957	04-A	6290 Sequence Dr San Diego

Active Permits Metrowide at Year End

Report run on: Monday, January, 3 2022 9:49 am

<i>Class</i>	<i>Name</i>	<i>Area</i>	<i>SIU</i>	<i>Facility</i>	<i>Permit</i>	<i>Address</i>
4	Pyramid Precision Machine	03	N	03-0959	01-A	6721 Cobra Wy San Diego
4	Seal Furniture & Systems Inc	03	N	03-0962	01-A	6720 Top Gun St San Diego
4	Aroma Housewares	03	N	03-0963	01-A	6469 Flanders Dr San Diego
4	Global Moving Systems Inc	03	N	03-0964	01-A	6460 Flanders Dr San Diego
2	Designer Molecules Inc	03	N	03-0965	04-A	10080 Willow Creek Rd San Diego
4	Business Assessment	03	N	03-0966	05-A	6550 Mira Mesa Bl San Diego
3	WC IPA LLC	03	Y	03-0966	04-A	6550 Mira Mesa Bl San Diego
4	Big O Tires	03	N	03-0968	01-A	12093 Scripps Summit Dr Suite A San Diego
4	Rhino Lining	03	N	03-0971	01-A	9151 Rehco Rd San Diego
4	Albertsons # 6770	03	N	03-0976	03-A	10740 Westview Py San Diego
4	CVS/pharmacy #3068	03	N	03-0982	04-A	10776 Westview Py San Diego
5	Viplex Industries	03	N	03-0983	01-A	8680 Miralani Dr Suite 135 San Diego
4	CVS Pharmacy # 9192	03	N	03-0984	03-A	14589 Camino Del Norte San Diego
2	MicroConstants Inc	03	N	03-0985	03-A	9050 Camino Santa Fe San Diego
2	ICHOR Medical Systems	03	N	03-0987	02-A	6310 Nancy Ridge Dr Suite 107 San Diego
4	MarketQuest Group Adv Business Produc	03	N	03-0988	01-A	9606 Kearny Villa Rd San Diego
4	Stanley Steemer	03	N	03-0989	01-A	9655 Via Excelencia San Diego
5	Equity Management Inc	03	N	03-0990	01-A	7756 Trade St Suite C San Diego
2	City; Environmental Services Dept	03	N	03-0993	03-A	8353 Miramar Pl San Diego
4	Streeter Printing Inc	03	N	03-0996	02-A	9880 Via Pasar Suite C San Diego
4	General Atomics (AMTD)	03	N	03-0997	01-A	6995 Flanders Dr San Diego
2	Bionano Genomics	03	N	03-0999	03-A	6777 Nancy Ridge Dr San Diego
4	Dye Precision Inc	03	N	03-1003	02-A	10637 Scripps Summit Ct San Diego
2	Nexus DX	03	N	03-1004	04-A	6759 Mesa Ridge Rd Suite 100 San Diego
4	Vulcan Materials	03	N	03-1007	02-A	10050 Black Mountain Rd San Diego
4	Pacific Coast Foam LLC	03	N	03-1011	01-A	8585 Miramar Pl San Diego
2	San Diego Reference Laboratory	03	N	03-1014	03-A	6565 Nancy Ridge Dr San Diego
4	Specialty Manufacturing Inc	03	N	03-1015	02-A	6790 Nancy Ridge Dr San Diego
2	Neuroservice USA	03	N	03-1016	02-A	6190 E Cornerstone Ct Suite 106 San Diego
1	Anocote Metal Finishing Inc	03	Y	03-1017	04-A	7550 Trade St San Diego
5	All American Semiconductor	03	N	03-1022	01-A	9585 Candida St San Diego
4	Turnkey Manufacturing Solutions Americ	03	N	03-1023	01-A	9339 Carroll Park Dr Suite B San Diego
1	PolyPeptide Laboratories San Diego	03	Y	03-1024	02-A	9395 Cabot Dr San Diego
2	Stemedica Cell Technologies Inc	03	N	03-1026	02-A	6350 Nancy Ridge Dr Suite 102 San Diego
4	Tandem Metal Products Inc	03	N	03-1029	01-A	09076 Carroll Wy San Diego
4	Deck Coating Specialists Inc	03	N	03-1032	01-A	8636 Production Av Suite B San Diego
2	Biocept Inc	03	N	03-1035	04-A	9955 Mesa Rim Rd San Diego
4	Target # 305	03	N	03-1047	03-A	8251 Mira Mesa Bl San Diego
4	Zoltek Materials Group	03	N	03-1049	01-A	9151 Rehco Rd Suite B San Diego
2	Integrated DNA Technologies	03	N	03-1052	02-A	6828 Nancy Ridge Dr Suite 400 San Diego
4	Anacomp	03	N	03-1053	03-A	15378 Avenue of Science Suite 222 San Diego
5	Masterson Creative	03	N	03-1056	01-A	7434 Trade St San Diego
5	Domestic Linen Supply Company Inc	03	N	03-1058	01-A	7734 Arjons Dr Suite B San Diego
2	Combi-Blocks Inc	03	N	03-1060	02-A	7949 Silverton Av Suite 915 San Diego
4	West Coast Specialties Inc	03	N	03-1061	01-A	7686 Formula Pl San Diego

Active Permits Metrowide at Year End

Report run on: Monday, January, 3 2022 9:49 am

<i>Class</i>	<i>Name</i>	<i>Area</i>	<i>SIU</i>	<i>Facility</i>	<i>Permit</i>	<i>Address</i>
2	Advin Biotech Inc	03	N	03-1067	03-A	10237 Flanders Ct San Diego
5	Cadence Design Systems Inc	03	N	03-1069	01-A	15015 Avenue of Science Suite 100 San Diego
1	Johnson Matthey Medical Products	03	Y	03-1070	05-A	12205 World Trade Dr San Diego
4	Qualcomm	03	N	03-1076	02-A	9393 Waples St Suite 150 San Diego
2	Alere San Diego Inc	03	N	03-1081	03-A	9995 Summers Ridge Rd San Diego
4	Business Assessment	03	N	03-1081	04-A	9995 Summers Ridge Rd San Diego
4C	Hi-Z Technology	03	N	03-1084	04-A	7606 Miramar Rd Suite 7400 San Diego
4C	Hi-Z Technology	03	N	03-1084	05-A	7606 Miramar Rd Suite 7400 San Diego
5	Commercial Builders Inc	03	N	03-1085	01-A	9550 Waples St Suite 105 San Diego
4C	Miramar Metal Processing of San Diego	03	N	03-1086	04-A	9090 Kenamar Dr Suite A San Diego
4C	Miramar Metal Processing of San Diego	03	N	03-1086	05-A	9090 Kenamar Dr Suite A San Diego
4	Pacific Coast Autobody	03	N	03-1087	01-A	8360 Miramar Pl San Diego
4	FrutStix	03	N	03-1092	02-A	8221 Arjons Dr Suite A San Diego
4M	Ray Derakshan DMD	03	N	03-1094	02-A	11134 Rancho Carmel Dr Suite 103 San Diego
4M	Pierce Family Dentistry	03	N	03-1099	02-A	13161 Black Mountain Rd Unit 5 San Diego
4	General Atomics Lynx Systems Group	03	N	03-1107	01-A	13322 N Evening Creek Dr San Diego
4	Mad Engine Inc	03	N	03-1110	01-A	6650 Top Gun St San Diego
4	Meggitt San Diego Inc.	03	N	03-1110	02-A	6650 Top Gun St San Diego
4	RM Hasson Inc Painting Contractors	03	N	03-1113	01-A	7392 Trade St San Diego
4	Cypress Semiconductor	03	N	03-1116	01-A	12230 World Trade Dr Suite 200 San Diego
4	GE Mobile Water Inc	03	N	03-1117	01-A	8586 Miramar Pl San Diego
4	Business Assessment	03	N	03-1119	01-A	7965 Dunbrook Rd Unit G San Diego
4	San Diego Mold Corporation	03	N	03-1125	02-A	7975 Dunbrook Rd Suite H San Diego
4M	Dr Gregory Friedman DMD Inc	03	N	03-1126	03-A	10755 Scripps Poway Py Suite K San Diego
4	MOD Squad Dental	03	N	03-1126	02-A	10755 Scripps Poway Py Suite K San Diego
2	The Binding Site	03	N	03-1135	01-A	6730 Mesa Ridge Rd San Diego
4	Business Assessment	03	N	03-1136	03-A	12278 Scripps Summit Dr San Diego
2	Catalent San Diego Inc	03	N	03-1143	01-A	7330 Carroll Rd San Diego
4	VIP Auto	03	N	03-1146	01-A	9485 Black Mountain Rd San Diego
4	Scripps Health	03	N	03-1147	01-A	9535 Waples St Suite 150 San Diego
4	Tech Finish Car Salon	03	N	03-1148	01-A	7352 Trade St San Diego
2	San Diego Air Pollution Control District	03	N	03-1149	02-A	10124 Old Grove Rd San Diego
5	Mervyn's Department Store	03	N	03-1150	01-A	8140 Mira Mesa Bl San Diego
5	Target Stores	03	N	03-1151	01-A	8251 Mira Mesa Bl San Diego
5	Black Angus	03	N	03-1152	01-A	10750 Camino Ruiz San Diego
2	Allele Biotechnology and Pharmaceuticals	03	N	03-1157	02-A	6868 Nancy Ridge Dr Suite 100 San Diego
2	Agilent Technologies	03	N	03-1160	02-A	6779 Mesa Ridge Rd Suite 100 San Diego
2	The Banck Center	03	N	03-1161	02-A	8716 Production Av San Diego
4	Teledyne Advanced Pollution Instrumenta	03	N	03-1162	01-A	9480 Carroll Park Dr San Diego
4	Western Titanium Inc	03	N	03-1164	01-A	8015 Silverton Av San Diego
4	Business Assessment	03	N	03-1165	02-A	6364 Ferris Sq San Diego
4	Business Assessment	03	N	03-1168	01-A	10340 CAMINO SANTA FE San Diego
2	Invetech	03	N	03-1175	01-A	9980 Huennekens St Suite 140 San Diego
3	JuneShine	03	N	03-1176	05-A	10051 Old Grove Rd San Diego
5	Residence Inn	03	N	03-1188	01-A	12011 Scripps Highlands Dr San Diego

Active Permits Metrowide at Year End

Report run on: Monday, January, 3 2022 9:49 am

<i>Class</i>	<i>Name</i>	<i>Area</i>	<i>SIU</i>	<i>Facility</i>	<i>Permit</i>	<i>Address</i>
4	Business Assessment	03	N	03-1189	01-A	10239 Flanders Ct San Diego
2	pSemi Corp	03	N	03-1190	03-A	9380 Carroll Park Dr San Diego
3	Stella Polly Inc dba Mikkeller San Diego	03	N	03-1194	02-A	9368 Cabot Dr San Diego
5	ACON Laboratories	03	N	03-1195	02-A	6865 Flanders Dr Suite B San Diego
4	Ann's Alterations & Dry Clean	03	N	03-1200	01-A	8660 Miramar Rd Suite E San Diego
1	nVent - Schroff Inc	03	Y	03-1203	02-A	7328 Trade St San Diego
2C	AEM (Holdings) Inc	03	N	03-1206	03-A	6610 Cobra Wy San Diego
4M	Pacific Dental	03	N	03-1208	02-A	9330 Mira Mesa Bl Suite B San Diego
4	Anderson Chiropractic & Wellness	03	N	03-1212	01-A	10585 Scripps Poway Py San Diego
5	PETE's Paleo	03	N	03-1218	02-A	7678 Miramar Rd San Diego
4	Tandem Metal Products Inc	03	N	03-1222	01-A	9076 Carroll Wy San Diego
5	ROHM Semiconductor USA LLC	03	N	03-1224	01-A	6815 Flanders Dr Suite 150 San Diego
4	Aurora Fine Chemicals LLC - USA	03	N	03-1225	01-A	7929 Silverton Dr Suite 609 San Diego
2	MyChem Labs LLC	03	N	03-1226	02-A	9215 Brown Deer Rd Suite A San Diego
5	Quest-Rep Inc/Xilinx Inc	03	N	03-1227	01-A	6496 Weathers Pl Suite 210 San Diego
4	Deft Precision Machining	03	N	03-1229	01-A	7394 Trade St San Diego
5	Heilind	03	N	03-1231	01-A	9400 Activity Rd Suite C San Diego
4	Challenger Sheet Metal Inc	03	N	03-1232	01-A	9450 Candida St San Diego
4	Focalspot Inc	03	N	03-1233	01-A	9915 Businesspark Av Suite A San Diego
4	Milpower	03	N	03-1235	01-A	10180 Scripps Ranch Bl Suite 100 San Diego
4	Tri-Consolidated Manufacturing Inc	03	N	03-1236	01-A	10635 Scripps Ranch Bl Suite G San Diego
4	South Coast Specialty Systems	03	N	03-1237	01-A	7966 Arjons Dr Suite C San Diego
4	Symcoat Metal Processing Inc	03	N	03-1238	02-A	7887 Dunbrook Rd Suite C San Diego
5	Walters Wholesale Electric Co	03	N	03-1239	01-A	10031 Old Grove Rd San Diego
4	Advanced International Technology	03	N	03-1240	01-A	9909 Hibert St Suite A San Diego
4	Aurum Assembly Plus Inc	03	N	03-1241	01-A	8829 Production Av San Diego
5	Sony Online Entertainment	03	N	03-1242	01-A	8958 Terman Ct San Diego
5	AV Net	03	N	03-1245	01-A	15231 Avenue of Science San Diego
5	Chase Pacific	03	N	03-1246	01-A	10636 Scripps Summit Ct Suite 101 San Diego
5	Allied Electronics	03	N	03-1247	01-A	15373 Innovation Dr Suite 380 San Diego
5	Bager Electronics Inc	03	N	03-1248	01-A	15373 Innovation Dr Suite 205 San Diego
4	Quality Manufacturing Services Inc (QMS	03	N	03-1250	01-A	8460 Production Av Suite A San Diego
5	Vitronics Corp	03	N	03-1252	01-A	10965 Chardonnay Pl San Diego
5	Sherwin-Williams	03	N	03-1254	02-A	11975 Carmel Mountain Rd Unit 608 San Diego
4	RF Industries	03	N	03-1255	01-A	7610 Miramar Rd Suite 6000 San Diego
5	Pacific Sun Pool & Spa	03	N	03-1257	01-A	8550 Production Av San Diego
5	Credo Sheet Metal	03	N	03-1258	01-A	12164 Middlebrook Sq San Diego
5	North County Metals	03	N	03-1259	01-A	12753 War Horse St San Diego
2	Allele Biotechnology & Pharmaceuticals I	03	N	03-1262	02-A	6404 Nancy Ridge Dr San Diego
4	Mad Engine LLC	03	N	03-1268	01-A	6740 Cobra Wy Suite 100 San Diego
5	Advanced Semiconductor Tech	03	N	03-1271	01-A	9340 Carmel Mountain Rd Unit E San Diego
2	Sorrento Therapeutics	03	N	03-1276	01-A	8395 Camino Santa Fe Suite A San Diego
4	Symtek Corp	03	N	03-1280	01-A	8451 Miralani Dr Suite L San Diego
4	DaVita Carmel Mountain	03	N	03-1282	01-A	9850 Carmel Mountain Rd San Diego
5	Rancho Engraving Inc	03	N	03-1283	01-A	12265 World Trade Dr Suite A San Diego

Active Permits Metrowide at Year End

Report run on: Monday, January, 3 2022 9:49 am

<i>Class</i>	<i>Name</i>	<i>Area</i>	<i>SIU</i>	<i>Facility</i>	<i>Permit</i>	<i>Address</i>
4	Longship Brewery	03	N	03-1289	01-A	10320 Camino Santa Fe Suite C San Diego
4	Amuza Inc DBA Eicom USA	03	N	03-1297	01-A	7098 Miratech Dr Suite 100 San Diego
4	SonTek a Xylem Brand	03	N	03-1298	01-A	9940 Summers Ridge Rd San Diego
2	Cidara Therapeutics	03	N	03-1299	02-A	6310 Nancy Ridge Dr Suite 101 San Diego
3	JDZ Inc DBA AleSmith Brewing Compan	03	Y	03-1300	02-A	9990 AleSmith Ct San Diego
3	JDZ Inc DBA AleSmith Brewing Compan	03	Y	03-1300	03-A	9990 AleSmith Ct San Diego
5	Consolidated Electrical Distributors Inc	03	N	03-1304	01-A	12396 World Trade Dr Suite 217 San Diego
4	Business Assessment	03	N	03-1305	02-A	7919 Silverton Av Suite 404 San Diego
4	PTI Inc	03	N	03-1307	01-A	13320 N Evening Creek Dr San Diego
4	Pro Systems AV	03	N	03-1309	01-A	8525 Camino Sante Fe Dr Suite D San Diego
4	Applied Micro Circuit Corp	03	N	03-1310	01-A	10052 Mesa Ridge Ct Suite 102 San Diego
4	Efficient Lighting	03	N	03-1311	01-A	4526 Trade St Suite C San Diego
4	Empire Electrical Supply	03	N	03-1312	01-A	8825 Rehco Rd Suite D San Diego
4	Quality Systems Integrated Corp	03	N	03-1313	01-A	7098 Miratech Dr Suite 107 San Diego
4	I O Select Inc	03	N	03-1314	01-A	9835 Carroll Centre Rd San Diego
4	LG Electronics MobileComm USA	03	N	03-1315	01-A	10225 Willow Creek Rd San Diego
4	Duck Foot Brewery	03	N	03-1318	01-A	8920 Kenamar Dr Suite 210 San Diego
4	Enterprise Truck Rental	03	N	03-1319	01-A	6330 Marindustry Dr San Diego
2	Microbiologics Inc	03	N	03-1320	02-A	6725 Mesa Ridge Rd Suite 140 San Diego
2	Bioclone	03	N	03-1323	02-A	6393 Nancy Ridge Dr Suite A San Diego
2	Cell Biolabs Inc	03	N	03-1324	02-A	7758 Arjons Dr San Diego
2	Sekisui Diagnostics LLC	03	N	03-1327	02-A	6659 Top Gun St San Diego
2	Innovative Cell Technologies/Phoenix Flo	03	N	03-1329	02-A	6790 Top Gun St Suite 1 San Diego
4	Business Assessment	03	N	03-1330	01-A	10054 Mesa Ridge Ct Suite 118 San Diego
2	Maxmed Laboratory	03	N	03-1331	02-A	8370 Juniper Creek Ln Suite 1 San Diego
4	PharMerica	03	N	03-1333	01-A	8930 Activity Rd Suite K San Diego
4	Empire Solar Group	03	N	03-1334	03-A	9040 Carroll Wy Suite 3 San Diego
3	Saint Archer Brewing Company	03	Y	03-1338	03-A	9550 Distribution Av San Diego
2	Arena Pharmaceuticals	03	N	03-1339	01-A	6154 Nancy Ridge Dr San Diego
2	Epitope Diagnostics Inc	03	N	03-1340	02-A	7110 Carroll Rd San Diego
2	Tioga Research	03	N	03-1341	02-A	6330 Nancy Ridge Dr Suite 102 San Diego
4	Pure Project Brewing	03	N	03-1342	01-A	9030 Kenamar Dr Suite 308 San Diego
4	Anocote Powder	03	N	03-1344	01-A	8745 Production Av Suite A San Diego
2	Abbott	03	N	03-1345	02-A	9940 Mesa Rim Rd San Diego
4	Carbomer Inc	03	N	03-1346	01-A	6324 Ferris Sq Suite B San Diego
5	Bioformatix Inc	03	N	03-1347	01-A	12396 World Trade Dr Suite 315 San Diego
4	Steren Electronics	03	N	03-1348	01-A	6920 Carroll Rd San Diego
5	RM Structures	03	N	03-1349	01-A	8515 Arjons Dr Suite E San Diego
5	Xtreme Gadget	03	N	03-1350	01-A	7736 Arjons Dr San Diego
2	Gentarget Inc	03	N	03-1351	02-A	7930 Arjons Dr Suite B San Diego
2	Azure Institute	03	N	03-1352	01-A	10125 Mesa Rim Rd San Diego
4	Tecnova Advanced Systems DBA Tecnad	03	N	03-1353	01-A	9770 Carroll Centre Rd San Diego
5	Medigene Inc	03	N	03-1354	01-A	10650 Scripps Ranch Bl Suite 206 San Diego
5	Research Works	03	N	03-1356	01-A	12396 World Trade Dr Suite 313 San Diego
4	Genemay Inc	03	N	03-1357	01-A	7905 Silverton Av Suite 101 San Diego

Active Permits Metrowide at Year End

Report run on: Monday, January, 3 2022 9:49 am

<i>Class</i>	<i>Name</i>	<i>Area</i>	<i>SIU</i>	<i>Facility</i>	<i>Permit</i>	<i>Address</i>
5	Eskew Mold	03	N	03-1358	01-A	8525 Arjons Dr Suite M San Diego
4	Knife Merchant	03	N	03-1360	01-A	7933 Silverton Av Suite 710 San Diego
2	Accriva Diagnostics	03	N	03-1362	01-A	6260 Sequence Dr San Diego
3	Kuni Services Building	03	N	03-1364	01-A	9115 Activity Rd San Diego
5	ICHOR Medical Systems	03	N	03-1366	02-A	6310 Nancy Ridge Dr Suite 106 San Diego
2	Ajinomoto Althea Inc	03	N	03-1368	01-A	9393 Waples St Suite 110 San Diego
3	White Labs Inc	03	N	03-1369	01-A	9495 Candida St San Diego
2	BioLegend Inc	03	N	03-1370	01-A	8999 BioLegend Wy San Diego
4	Newtopia Cydery	03	N	03-1373	01-A	10045 Carroll Canyon Rd Suite A San Diego
4	Mike Hess Brewery Co.	03	N	03-1376	01-A	7955 Silverton Av Suite 100 San Diego
4	Evoqua Water Technologies	03	N	03-1379	01-A	12316 World Trade Dr Suite 108 San Diego
1	Santier Inc	03	Y	03-1380	02-A	10103 Carroll Canyon Rd San Diego
3	Juice Delivery LLC dba Solti	03	N	03-1381	01-A	8380 Miralani Dr Suite A San Diego
2	STA Pharmaceutical	03	N	03-1382	01-A	6114 Nancy Ridge Dr San Diego
4	Business Assessment	03	N	03-1386	01-A	9215 Brown Deer St Suite B San Diego
5	Coram CVS/Specialty Infusion Services #	03	N	03-1388	01-A	12310 World Trade Dr Suite 200 San Diego
2	HD Biosciences	03	N	03-1392	01-A	6122 Nancy Ridge Dr San Diego
2	Quidel Cardiovascular Inc	03	N	03-1393	01-A	9965 Summers Ridge Rd San Diego
2	Wildcat Discovery Technologies Inc	03	N	03-1394	01-A	6255 Ferris Sq Suite A San Diego
2	CalAsia Pharmaceuticals DBA Plex Pharm	03	N	03-1395	01-A	6330 Nancy Ridge Dr Suite 105 San Diego
2	Eurofins Beacon Discovery	03	N	03-1396	01-A	6118 Nancy Ridge Dr San Diego
2	Inception Therapeutics	03	N	03-1398	01-A	6175 Nancy Ridge Dr San Diego
2	Nexogen Inc	03	N	03-1400	01-A	7939 Silverton Av Suite 806 San Diego
2	BroadPharm Inc	03	N	03-1402	01-A	6625 Top Gun St Suite 103 San Diego
2	AventGen	03	N	03-1403	01-A	6162 Nancy Ridge Dr Suite 150 San Diego
2	Latitude Pharmaceuticals Inc	03	N	03-1405	01-A	9675 Business Park Av San Diego
2	Verity Analytics LLC	03	N	03-1406	01-A	8888 Miramar Rd Suite 4 San Diego
2	ChemDiv Inc	03	N	03-1407	01-A	10320 Camino Santa Fe Suite B San Diego
5	Sharp Rees-Stealy	03	N	03-1408	01-A	10670 Wexford St San Diego
4	Invoak Brewing	03	N	03-1412	01-A	8860 Kenmar Dr Suite 308 San Diego
4M	Tooth Foundation Periodontics & Dental I	03	N	03-1413	01-A	12778 Rancho Penesquitos Bl Suite B San Diego
4	Business Assessment	03	N	03-1414	01-A	6124 Nancy Ridge Dr San Diego
4M	Scripps Poway Dental Care	03	N	03-1419	01-A	10549 Scripps Poway Py Suite I San Diego
4M	Childrens Dentistry of San Diego	03	N	03-1420	01-A	10717 Camino Ruiz Suite 103 San Diego
4M	San Diego Periodontics & Implants	03	N	03-1421	01-A	10672 Wexford St Suite 220 San Diego
4M	Scripps Ranch Family Dentistry	03	N	03-1422	01-A	10299 Scripps Tr Suite F San Diego
4M	Yumin Tu DDS	03	N	03-1423	01-A	10737 Camino Ruiz Suite 230 San Diego
4M	Sabre Springs Dentistry	03	N	03-1424	01-A	11385 Poway Rd Suite 103 San Diego
4M	Gary Pulsipher DDS	03	N	03-1425	01-A	10737 Camino Ruiz Suite 210 San Diego
4M	Seaside Pediatric Dentistry	03	N	03-1426	01-A	12036 Scripps Highland Dr Suite 100 San Diego
4M	Scripps Rock Dental	03	N	03-1427	01-A	12112 Scripps Summit Dr Suite C San Diego
4M	Rite Family Dental	03	N	03-1428	01-A	12330 Carmel Mountain Rd Suite C4 San Diego
4M	ABC Childrens Dentistry	03	N	03-1429	01-A	12778 Rancho Penasquitos Bl Suite A San Diego
4M	World of Smiles Pediatric Dentistry	03	N	03-1430	01-A	10672 Wexford ST Suite 285 San Diego
4M	Westview Dental Office	03	N	03-1431	01-A	13350 Camino Del Sur Suite 6 San Diego

Active Permits Metrowide at Year End

Report run on: Monday, January, 3 2022 9:49 am

<i>Class Name</i>	<i>Area</i>	<i>SIU</i>	<i>Facility</i>	<i>Permit</i>	<i>Address</i>
4M Carmel Mountain Dentistry	03	N	03-1432	01-A	10175 Rancho Carmel DR Suite 125 San Diego
2 Abzena San Diego	03	N	03-1433	01-A	8810 Rehco Rd Suite E San Diego
4M Del Sur Dentistry	03	N	03-1434	01-A	14701 Via Bettona Suite 215 San Diego
4M Pierce Family Dentistry	03	N	03-1435	01-A	13161 Black Mountain Rd Suite 5 San Diego
4M Arleen Crisostomo-Weeks DDS	03	N	03-1436	01-A	9750 Miramar Rd Suite 100 San Diego
4M Carmel Mountain Dental Office	03	N	03-1437	01-A	14391 Penasquitos Dr Suite A San Diego
4M Penaquitos Point Family Dentistry	03	N	03-1438	01-A	12798 Rancho Penasquitos Bl Suite I San Diego
4M A Professional Dental Corp	03	N	03-1439	01-A	13161 Black Mountain Rd Suite 3 San Diego
4M Robert Schaffer DDS	03	N	03-1440	01-A	12750 Carmel Country Rd Suite 205 San Diego
2 Conju-Probe LLC	03	N	03-1442	01-A	10054 Mesa Ridge Ct Suite 108 San Diego
3 UT; Garden Communities	03	N	03-1443	01-A	11005 Westview Py San Diego
4M Stonecrest Dental Group	03	N	03-1444	01-A	3737 Murphy Canyon Rd Suite C-2 San Diego
2 Sekisui Diagnostics	03	N	03-1445	01-A	6740 Cobra Wy Suite 200 San Diego
2 Cell Applications Inc	03	N	03-1446	01-A	6455 Weathers Pl San Diego
4M Michael Maude DDS	03	N	03-1447	01-A	9340 Carmel Mountain Rd Suite D San Diego
4M EZ Smile Dental	03	N	03-1448	01-A	8226 Miramar Rd San Diego
4M Quy Lam Nguyen DDS	03	N	03-1449	01-A	8963 Mira Mesa Bl San Diego
4M Kidz Place Dentistry	03	N	03-1450	01-A	4765 Carmel Mountain Rd Suite 210 San Diego
4M Mirta Javidan DMD	03	N	03-1451	01-A	9420 Mira Mesa Bl Suite G San Diego
4M Torrey Hills Dental	03	N	03-1452	01-A	4765 Carmel Mountain Rd Suite 101 San Diego
4M Scripps West Dental	03	N	03-1453	01-A	9420 Mira Mesa Bl Suite D San Diego
2 BPS Bioscience Inc	03	N	03-1454	01-A	6405 Mira Mesa Bl Suite 100 San Diego
4M Miramar Dental Group	03	N	03-1455	01-A	7094 Miramar Rd Suite 112 San Diego
4M Torrey Hills Family Dentistry	03	N	03-1456	01-A	4765 Carmel Mountain Rd Suite 209 San Diego
4M Smile Art Dentistry	03	N	03-1457	01-A	9932 Mercy Rd Suite 104 San Diego
4M Scripps Ranch periodontics & Implants	03	N	03-1458	01-A	9855 Erma Rd Suite 110 San Diego
4M Ruby Reyes DDS	03	N	03-1459	01-A	9225 Mira Mesa Bl Suite 104 San Diego
4M Modern Dentistry	03	N	03-1460	01-A	4765 Carmel Mountain Rd Suite 208 San Diego
4M Excel Dental	03	N	03-1461	01-A	9225 Mira Mesa Bl Suite 103 San Diego
4M Melina Marino DDS	03	N	03-1462	01-A	8901 Activity Rd Suite 203 San Diego
4 Business Assessment	03	N	03-1463	01-A	8926 Ware Ct San Diego
4M Carmel Mountain Dental Care	03	N	03-1464	01-A	9310 Carmel Mountain Rd Suite A San Diego
4M Dr Natalya Carmichael	03	N	03-1465	01-A	9728 Carmel Mountain Rd Suite B San Diego
4M Benjamin J Lin DDS Inc	03	N	03-1466	01-A	9870 Hilbert St Suite D-12 San Diego
4 AFM Microelectronics Inc	03	N	03-1467	01-A	7915 Silverton Av Suite 315 San Diego
4M A+ Dental	03	N	03-1468	01-A	4653 Carmel Mountain Rd Suite 306 San Diego
4M Davis Orthodontics	03	N	03-1469	01-A	9420 Mira Mesa Bl Suite J San Diego
4M Brian Davey DDS	03	N	03-1470	01-A	7805 Highlands Village Pl Suite G105 San Dieg
4M Katherine Lee Lackner DDS	03	N	03-1471	01-A	9855 Erma Rd Suite 109 San Diego
4M Yam Gan DMD	03	N	03-1472	01-A	9606 Tierra Grande St Suite 205 San Diego
4M Ranch Penasquitos Dental Center	03	N	03-1473	01-A	9955 Carmel Mountain Rd Suite 4 San Diego
4M PQ Family Dental	03	N	03-1474	01-A	13223 Black Mountain Rd Suite 4 San Diego
4 Harland Brewing Co, LLC	03	N	03-1475	01-A	10115 Carroll Canyon Rd San Diego
4M Sunshine Dental Office	03	N	03-1476	01-A	9888 Carmel Mountain Rd Suite B San Diego
4M Carmel Valley Dentist Office	03	N	03-1477	01-A	5550 Carmel Mountain Rd Suite 101 San Diego

Active Permits Metrowide at Year End

Report run on: Monday, January, 3 2022 9:49 am

<i>Class Name</i>	<i>Area</i>	<i>SIU</i>	<i>Facility</i>	<i>Permit</i>	<i>Address</i>
4M The Dentistry Collective	03	N	03-1478	01-A	11610 Ibera Pl Suite 202 San Diego
4M Del Mar Dental Arts	03	N	03-1479	01-A	12750 Carmel Country Rd Suite 213 San Diego
4M Pacific Highlands Dentistry Dental Group	03	N	03-1480	01-A	5965 Village Wy Suite E206 San Diego
4M Rancho Penasquitos Dentistry Dental Group	03	N	03-1481	01-A	9840 Carmel Mountain Rd San Diego
4M Scripps Pediatric Dentistry	03	N	03-1482	01-A	9840 Hilbert St Suite B4 San Diego
4M Mira Mesa Dental & Orthodontics	03	N	03-1483	01-A	9750 Miramar Rd Suite 260 San Diego
4M Fritzi Perez-Myers DMD	03	N	03-1484	01-A	9750 Miramar Rd Suite 160 San Diego
4M Scripps Family & Cosmetic Dentistry	03	N	03-1485	01-A	9855 Erma Rd Suite 137 San Diego
4M Evelyn Grace S Neglerio DMD Inc	03	N	03-1486	01-A	13295 Black Mountain Rd San Diego
4M Carmel Mountain Oral & Facial Surgery	03	N	03-1487	01-A	9912 Carmel Mountain Rd Suite A San Diego
4M Sean Daniels	03	N	03-1488	01-A	9750 Miramar Rd Suite 375 San Diego
4M Mira Mesa Family Dentistry	03	N	03-1489	01-A	9225 Mira Mesa Bl Suite 218 San Diego
4M Transdental Family Care	03	N	03-1490	01-A	9009 Mira Mesa Bl San Diego
4M Rancho Dental Care	03	N	03-1493	01-A	9912 Carmel Mountain Rd Suite B San Diego
4M Huan-Tony Ngo DDS	03	N	03-1495	01-A	10717 Camino Ruiz Suite 155 San Diego
4M Ricardo Peralta DDS Inc	03	N	03-1497	02-A	9855 Erma Rd Suite 103 San Diego
4M Neal Pham DDS	03	N	03-1498	01-A	9888 Carroll Centre Rd Suite 102 San Diego
3 Athletic Brewing Company LLC	03	N	03-1504	01-A	7606 Trade St San Diego
2 Scripps Health	03	N	03-1505	01-A	9535 Waples St Suite 200 San Diego
2 Micronoma	03	N	03-1506	01-A	6342 Ferris Sq Fl 1 San Diego
2 Coastal Analytical	03	N	03-1507	01-A	6342 Ferris Sq Fl 2 San Diego
2 IEH Coastal Analytical dba IEH Laboratories	03	N	03-1507	01-B	6342 Ferris Sq Fl 2 San Diego
4 Business Assessment	03	N	03-1511	01-A	9980 Huennekens St Suite 250 San Diego
4 Guthrie Ciderworks	03	N	03-1513	01-A	6496 Marindustry Dr Suite D San Diego
4 Business Assessment	03	N	03-1514	01-A	6330 Nancy Ridge Dr Suite 108 San Diego
4 Bio Blocks	03	N	03-1515	01-A	9885 Mesa Rim Rd Suite 101 San Diego
2 Clarus Analytical LLC	03	N	03-1517	01-A	8545 Arjons Dr Suite A San Diego
2 Infinite Chemical Analysis Labs LLC	03	N	03-1518	01-A	8380 Miramar Ml Suite 102 San Diego
2 Reveal Bioscience	03	N	03-1520	01-A	6760 Top Gun St Suite 110 San Diego
2 IXCells Biotechnologies	03	N	03-1521	01-A	7270 Trade St Suite 102 San Diego
2 InnoPep	03	N	03-1522	01-A	10239 Flanders Ct Suite 102 San Diego
2 Eton Bioscience	03	N	03-1527	01-A	10179 Huennekens St Suite 201 San Diego
4 Business Assessment	03	N	03-1528	01-A	10045 Mesa Rim Rd San Diego
2 Trutino Biosciences	03	N	03-1529	01-A	10179 Huennekens St Suite 101 San Diego
2 Diagnologix LLC	03	N	03-1530	01-A	10179 Huennekens St Suite 206 San Diego
2 Zenobia Therapeutics	03	N	03-1531	01-A	9265 Activity Rd Suite 104 San Diego
2 ThermoFisher Scientific	03	N	03-1535	01-A	9440 Carroll Park Dr San Diego
4 Business Assessment	03	N	03-1536	01-A	6370 Nancy Ridge Dr San Diego
3 UT; Lennar	03	Y	03-1537	01-A	9245 Camino Santa Fe San Diego
2 Somatek Inc	03	N	03-1538	01-A	9466 Black Mountain Rd Suite 150 San Diego
4 Brew Zone SD	03	N	03-1539	01-A	7396 Trade St Unit A San Diego
4 Business Assessment	03	N	03-1545	01-A	9530 Cabot Dr San Diego
4 Meggitt San Diego Inc.	03	N	03-1546	01-A	10547 Viper Wy San Diego
2 Nano Pharma Solutions	03	N	03-1547	01-A	9853 Pacific Heights Bl Suite O San Diego
2 Pulse Electronics Inc	03	N	03-1549	01-A	15255 Innovation Dr Suite 100 San Diego

Active Permits Metrowide at Year End

Report run on: Monday, January, 3 2022 9:49 am

<i>Class Name</i>	<i>Area</i>	<i>SIU</i>	<i>Facility</i>	<i>Permit</i>	<i>Address</i>
4 Business Assessment	03	N	03-1553	01-A	6620 Mesa Ridge Rd San Diego
4 Enterprise Rent-A-Car #32F8	03	N	03-1554	01-A	9292 Miramar Rd 28 San Diego
2 Qureator Inc	03	N	03-1556	01-A	7094 Miratech Dr Suite 110 San Diego
2 Glubio Therapeutics	03	N	03-1557	01-A	10239 Flanders Ct Suite 101 San Diego
4 Business Assessment	03	N	03-1559	01-A	6825 Flanders Dr San Diego
2 US Specialty Labs	03	N	03-1560	01-A	15150 Avenue of Science Suite 100 San Diego
4 Business Assessment	03	N	03-1563	01-A	10641 Scripps Summit Ct San Diego
4 Business Assessment	03	N	03-1564	01-A	10636 Scripps Summit Ct Suite 100 San Diego
4 Business Assessment	03	N	03-1565	01-A	10020 Huennekens St San Diego
4 Business Assessment	03	N	03-1566	01-A	7420 Carroll Rd San Diego
4 Business Assessment	03	N	03-1567	01-A	10247 Flanders Ct San Diego
4 Business Assessment	03	N	03-1571	01-A	6134 Nancy Ridge Dr San Diego
2 Bud's Radiator Service	04	N	04-0005	04-A	7464 Draper Av La Jolla
4 Roberts Auto Service	04	N	04-0010	00-A	4630 Mission Bay Dr San Diego
4 Print-O-Mat	04	N	04-0012	01-A	1116 Silverado St La Jolla
2 Sea World San Diego	04	N	04-0016	06-A	500 Sea World Dr San Diego
4 Culligan Water Conditioning	04	N	04-0030	00-A	970 Turquoise St San Diego
4 Pinky's Printing	04	N	04-0094	01-A	1035 Silverado St La Jolla
4 Quality Tool & Manufacturing Company	04	N	04-0095	01-A	4647 De Soto St San Diego
4 Pacific Beach Car Wash	04	N	04-0134	02-A	2075 Balboa Av San Diego
4 La Jolla Blueprint Company	04	N	04-0155	00-A	7442 Girard Av La Jolla
4 San Diego Princess Resorts	04	N	04-0160	00-A	1404 Vacation Rd San Diego
4 Colonial Inn	04	N	04-0168	00-A	910 Prospect St La Jolla
4 La Jolla Marriott Hotel	04	N	04-0169	00-A	4240 La Jolla Village Dr La Jolla
4 Hotel La Jolla	04	N	04-0171	00-A	7955 La Jolla Shores Dr La Jolla
4 Torrey Pines Convalescent Hosp	04	N	04-0173	01-A	2552 Torrey Pines Rd La Jolla
4 The Cloisters of La Jolla	04	N	04-0174	00-A	7160 Fay Av La Jolla
4 Mossy Ford	04	N	04-0175	01-A	4570 Mission Bay Dr San Diego
4 Coast Sports Cars	04	N	04-0178	01-A	2680 Garnet Av San Diego
4 Express Tire	04	N	04-0188	01-A	1011 Grand Av San Diego
4 Steve Auto Repair	04	N	04-0189	01-A	4515 Gresham St San Diego
4 Dana Inn & Marina	04	N	04-0190	00-A	1710 W Mission Bay Dr San Diego
2 Mission Bay Aquatic Center	04	N	04-0196	02-A	1001 Santa Clara Pl San Diego
4 La Jolla Car Wash	04	N	04-0198	01-A	891 Turquoise St San Diego
4 NOAA/NMFS/Southwest Fisheries Scienc	04	N	04-0200	03-A	8604 La Jolla Shores Dr La Jolla
2 UCSD Scripps Institution of Oceanograph	04	N	04-0211	03-A	8602 La Jolla Shores Dr La Jolla
5 Freeze Frame Inc	04	N	04-0228	02-A	1720 South Shores Rd San Diego
4 Roos German Motors	04	N	04-0240	01-A	5165 Cass St San Diego
4 Steves Auto Repair	04	N	04-0242	02-A	1370 Garnet Av San Diego
4 Beach Cities Auto Repair	04	N	04-0243	00-A	4448 Lamont St San Diego
2 Sea World Research Institute - Hubbs	04	N	04-0244	01-A	2595 Ingraham St San Diego
4 Sea World Research-Hubbs	04	N	04-0244	00-A	2595 Ingraham St San Diego
4 Fleisher Products Inc	04	N	04-0248	01-A	4666 Cass St San Diego
4 Mission Beach Silkscreen Print	04	N	04-0249	02-A	807 Pismo Ct San Diego
5 City Boxing Training Center	04	N	04-0251	03-A	1559 Garnet Av San Diego

Active Permits Metrowide at Year End

Report run on: Monday, January, 3 2022 9:49 am

<i>Class</i>	<i>Name</i>	<i>Area</i>	<i>SIU</i>	<i>Facility</i>	<i>Permit</i>	<i>Address</i>
4	Pearl Wash	04	N	04-0252	02-A	600 Pearl St La Jolla
2	Driscoll Mission Bay	04	N	04-0253	01-A	1500 Quivira Wy San Diego
2	Driscoll Mission Bay	04	N	04-0253	02-A	1500 Quivira Wy San Diego
4	Presidio Medical Group	04	N	04-0261	03-A	4440 Lamont St San Diego
4	Daisy Cleaners	04	N	04-0265	02-A	1664 Garnet Av San Diego
4	Hyatt Regency La Jolla	04	N	04-0270	01-A	3777 La Jolla Village Dr San Diego
4M	Open Wide La Jolla	04	N	04-0280	03-A	7509 Draper Av Suite B La Jolla
4	La Jolla Veterinary Hospital	04	N	04-0282	03-A	7520 Fay Av La Jolla
4	La Jolla Oral Maxillofacial	04	N	04-0283	02-A	7855 Fay Av Suite 240 La Jolla
4M	JEFFREY JAVELET DDS	04	N	04-0284	02-A	7855 Fay Av Suite 210 La Jolla
4M	Torrey Pines Dental Arts	04	N	04-0288	02-A	9850 Genesee Av Suite 720 La Jolla
4M	Scripps Center For Dental Care	04	N	04-0289	02-A	9850 Genesee Av Suite 620 La Jolla
4	North County Ob-Gyn Med Group	04	N	04-0290	02-A	9850 Genesee Av Suite 600 La Jolla
4	Lawrence Dinenberg MD	04	N	04-0292	02-A	9834 Genesee Av Suite 125 La Jolla
4	La Jolla Sports Orthopedics	04	N	04-0293	02-A	9834 Genesee Av Suite 228 La Jolla
4M	Darryl Abramson DDS Inc	04	N	04-0294	04-A	9850 Genesee Av Suite 200 La Jolla
4M	David Kitchen DDS	04	N	04-0295	02-A	9850 Genesee Av Suite 540 La Jolla
4	Alicia K Kennedy DDS	04	N	04-0300	03-A	7334 Girard Av Suite 101 La Jolla
4M	Purely Dental La Jolla	04	N	04-0300	04-A	7334 Girard Av Suite 101 La Jolla
4M	Robert A Rees DDS	04	N	04-0303	03-A	7761 Herschel Av La Jolla
2F	Michael Reynolds DDS	04	N	04-0305	01-A	7742 Herschel Av Suite 1 La Jolla
4M	La Jolla Dental Care	04	N	04-0306	04-A	7737 Herschel Av La Jolla
4M	La Jolla Endodontics	04	N	04-0314	02-A	4130 La Jolla Village Dr Suite 205 La Jolla
4M	Erez Nosrati	04	N	04-0317	03-A	525 Nautilus St La Jolla
4	Jacob Russell DDS	04	N	04-0317	02-A	525 Nautilus St La Jolla
4	La Jolla Light Newspapers	04	N	04-0319	01-A	565 Pearl St Suite 300 La Jolla
4	Aegis Entertainment	04	N	04-0322	01-B	888 Prospect St Suite 240 La Jolla
4M	Frederick U Soldau DDS Inc	04	N	04-0323	02-A	850 Prospect St Suite 1 La Jolla
4	Paul Dougherty/Stanley N DDS	04	N	04-0324	02-A	850 Prospect St Suite 5 La Jolla
4M	Stanley Nakamura DDS	04	N	04-0324	03-A	850 Prospect St Suite 5 La Jolla
4M	Peter Nordland DMD	04	N	04-0325	02-A	850 Prospect St Suite 7 La Jolla
4	Stephen Lockwood DMD	04	N	04-0327	02-A	4150 Regents Park Rw Suite 230 La Jolla
2	Progenesis	04	N	04-0328	02-A	4150 Regents Park Rw Suite 245 La Jolla
4	UCSD Orthomed	04	N	04-0329	02-A	4150 Regents Park Rw Suite 300 La Jolla
4M	Rick K Yamada DDS	04	N	04-0341	02-A	8950 Villa La Jolla Dr Suite A128 La Jolla
4M	La Jolla Dental	04	N	04-0343	04-A	8950 Villa La Jolla Dr Suite C210 La Jolla
4	Thomas H Lange DDS Inc	04	N	04-0344	02-A	8950 Villa La Jolla Dr Suite 1150 La Jolla
4M	Robert Kim DDS	04	N	04-0345	03-A	8950 Villa La Jolla Dr Suite B124 La Jolla
4	David Eshom DDS & Carolyn White DDS	04	N	04-0348	01-B	8861 Villa La Jolla Dr Suite 501 La Jolla
4M	Pacific SmileKrafters	04	N	04-0349	03-A	4603 Cass St San Diego
4M	Pacific Beach Family Dental	04	N	04-0351	02-A	4776 Cass St San Diego
4M	Dr Robert Fremont	04	N	04-0353	02-A	4527 Fanuel St San Diego
4	Pacific Beach Veterinary Clinic	04	N	04-0355	02-A	1362 Garnet Av San Diego
4M	Mission Bay Dental	04	N	04-0356	02-A	1324 Garnet Av San Diego
4M	Christine Altrock DDS	04	N	04-0357	03-A	2187 Garnet Av San Diego

Active Permits Metrowide at Year End

Report run on: Monday, January, 3 2022 9:49 am

<i>Class</i>	<i>Name</i>	<i>Area</i>	<i>SIU</i>	<i>Facility</i>	<i>Permit</i>	<i>Address</i>
4	Jack White DDS	04	N	04-0357	02-A	2187 Garnet Av San Diego
4M	Matthew S Cowman DDS	04	N	04-0358	03-A	1300 Grand Av Suite E San Diego
4M	Ana Simerlein DDS	04	N	04-0360	02-A	1919 Grand Av San Diego
4	Cosmetic Dentristry Center of San Diego	04	N	04-0362	04-A	945 Hornblend St Suite B San Diego
4M	Vaida Avery DDS Inc.	04	N	04-0363	03-A	2036 Hornblend St San Diego
4	Gregory L Friedman DMD Inc	04	N	04-0365	02-A	10755 Scripps Poway Py Suite K San Diego
4M	J H Fallon DDS	04	N	04-0366	02-A	4633 Ingraham St Suite A San Diego
4M	Bacino Dentistry	04	N	04-0368	03-A	4747 Mission Bl Suite 2 San Diego
4	Vons # 323	04	N	04-0371	02-A	7544 Girard Av La Jolla
4	Movin Shoes Inc	04	N	04-0374	02-A	1892 Garnet Av San Diego
4	UT; City Environmental Services	04	N	04-0380	01-A	1700 Seaworld Dr San Diego
4	Scripps Clinic	04	N	04-0383	02-A	9844 Genesee Av Suite 400 La Jolla
4	Mission Bay Golf Course	04	N	04-0387	01-A	2702 North Mission Bay Dr San Diego
4	Doctor Detail	04	N	04-0390	01-A	2974 Garnet Av San Diego
4	Bristol Farms # 2312	04	N	04-0391	02-A	8510 Genesee Av San Diego
4	Enterprise Rent A Car	04	N	04-0394	02-A	2710 Garnet Av Suite 110 San Diego
4	Pacific Shellfish Inc	04	N	04-0395	01-A	5040 Cass St San Diego
2	Tempo Therapeutics Inc	04	N	04-0400	02-A	3030 Bunker Hill St Suite 104 San Diego
4M	Tiki Lam DDS	04	N	04-0403	02-A	7334 Girard Av Suite 102 La Jolla
4	Cal's Radiator & Automotive Repair	04	N	04-0404	01-A	2909 Damon Av Unit B San Diego
4	Synthasome Inc	04	N	04-0405	01-A	3030 Bunker Hill St Suite 308 San Diego
2	Vaccine Research Institute of San Diego	04	N	04-0405	02-A	3030 Bunker Hill St Suite 308 San Diego
4M	Joseph D'Angelo	04	N	04-0410	02-A	1111 Torrey Pines Rd Suite 101 San Diego
4	Dualtone Automotive Inc	04	N	04-0411	01-A	4745 Mission Bay Dr San Diego
4	Business Assessment	04	N	04-0416	02-A	3030 Bunker Hill St Suite 100 San Diego
2	Genelux Corporation	04	N	04-0418	03-A	3030 Bunker Hill St Suite 310 San Diego
4	Business Assessment	04	N	04-0422	01-A	3030 Bunker Hill St Suite 114 San Diego
4	Tera Biotechnology	04	N	04-0424	01-A	3030 Bunker Hill St Suite 307 San Diego
2	Mabwell Therapeutics Inc	04	N	04-0430	01-A	505 S Coast Bl Suite 301 San Diego
4	Biosensors International	04	N	04-0431	01-A	505 S Coast Bl Suite 206 San Diego
4	Mpex Pharmaceuticals Inc	04	N	04-0432	01-A	3030 Bunker Hill St Suite 200 San Diego
5	Tempo Therapeutics, Inc.	04	N	04-0432	02-A	3030 Bunker Hill St Suite 200 San Diego
4	VLP Biotech Inc	04	N	04-0433	01-A	3030 Bunker Hill St Suite 350 San Diego
4	Ansata Therapeutics Inc	04	N	04-0434	01-A	505 S Coast Bl Suite 412 San Diego
3	UT; La Jolla LLC	04	N	04-0435	04-A	7817 Ivanhoe Av San Diego
3	UT; La Jolla LLC	04	N	04-0435	05-A	7817 Ivanhoe Av San Diego
5	Diamond Head Inn	04	N	04-0440	01-A	605 Diamond St San Diego
4	Business Assessment	04	N	04-0443	01-A	3030 Bunker Hill St Suite 216 San Diego
4	La Jolla Shores Hotel	04	N	04-0447	01-A	8110 Camino del Oro La Jolla
4	Dunn-Edwards Paint	04	N	04-0456	01-A	5180 Mission Bl San Diego
4	Reza Kasiri DDS	04	N	04-0458	01-A	2138 Garnet Av San Diego
4	Seagull Cleaner	04	N	04-0460	01-A	5568 La Jolla Bl San Diego
4	Westwood Orthodontics	04	N	04-0462	01-A	4633 Ingraham St Suite C San Diego
4M	Marsha Mirkin DMD	04	N	04-0463	02-A	4633 Ingraham St Suite B San Diego
4	GAIA Medica Institute Inc	04	N	04-0465	01-A	505 S Coast Bl Suite 104 San Diego

Active Permits Metrowide at Year End

Report run on: Monday, January, 3 2022 9:49 am

<i>Class</i>	<i>Name</i>	<i>Area</i>	<i>SIU</i>	<i>Facility</i>	<i>Permit</i>	<i>Address</i>
4	Village Gifts and Engraving	04	N	04-0466	01-A	7660 Fay Av Unit D San Diego
2	Lassogen Inc	04	N	04-0469	01-A	3030 Bunker Hill St Suite 220 San Diego
2	AltheaDx Inc	04	N	04-0471	02-A	3030 Bunker Hill St Suite 300 San Diego
2	Cassia LLC	04	N	04-0472	02-A	3030 Bunker Hill St Suite 214 San Diego
4	Mission Bay Motel	04	N	04-0474	01-A	4780 Mission Bay Dr San Diego
5	Multi Tenant Retail and Office Spaces	04	N	04-0475	01-A	7825 Fay Av San Diego
5	Frazee Paint	04	N	04-0476	01-A	980 Hornblend St San Diego
5	Skip Products	04	N	04-0477	01-A	14 Venice Ct San Diego
4	Sun Sheet Metal	04	N	04-0478	01-A	5131 Santa Fe St San Diego
2	AnaBios Corporation	04	N	04-0481	02-A	3030 Bunker Hill St Suite 312 San Diego
4	Critical Diagnostics	04	N	04-0482	01-A	3030 Bunker Hill St Suite 117A San Diego
4	Business Assessment	04	N	04-0483	01-A	3030 Bunker Hill St Suite 117C San Diego
2	Exokeryx Inc	04	N	04-0484	01-A	3030 Bunker Hill St Suite 117D San Diego
2	Explora Biolabs	04	N	04-0486	02-A	3030 Bunker Hill St Suite 118 San Diego
2	SkylineDx USA Inc	04	N	04-0488	01-A	3030 Bunker Hill St Suite 230 San Diego
3	UT; Harbach Residence	04	N	04-0492	03-A	5372 Calumet Av La Jolla
2	Biotronik CRC Inc	04	N	04-0494	01-A	505 S Coast Bl Suite 106 La Jolla
4	Business Assessment	04	N	04-0497	01-A	3030 Bunker Hill St Suite 107 San Diego
4	Biopart Labs	04	N	04-0498	01-A	6523 La Jolla Bl San Diego
2	Proteogenomics Research Institute	04	N	04-0499	01-A	505 S Coast Bl Suite 209 San Diego
4	Coastal Environments	04	N	04-0500	01-A	2166 Avenida de la Playa Suite E La Jolla
2	Cenna Biociences Inc	04	N	04-0502	01-A	505 S Coast Bl Suite 302 La Jolla
5	Vaping Lab	04	N	04-0503	01-A	5785 La Jolla Bl San Diego
5	Mabwell Therapeutics	04	N	04-0505	02-A	505 S Coast Bl Suite 307 La Jolla
2	Singlera Genomics Inc	04	N	04-0505	01-A	505 S Coast Bl Suite 307 La Jolla
2	AerNos Inc	04	N	04-0511	01-A	3030 Bunker Hill St Suite 105 San Diego
5	Business Assessment	04	N	04-0511	02-A	3030 Bunker Hill St Suite 105 San Diego
4M	Jeffrey H Lind DMD	04	N	04-0518	01-A	4130 La Jolla Village Dr Suite 202 San Diego
4M	Dougherty Dental	04	N	04-0519	01-A	7776 Ivanhoe Av Suite 120 La Jolla
4M	La Jolla Dental Office	04	N	04-0520	01-A	7334 Girard Av Suite 104 San Diego
4M	NeNi Shriver DDS	04	N	04-0521	01-A	7817 Ivanhoe Av Suite 304 San Diego
4M	David Sabourin DDS	04	N	04-0522	01-A	9850 Genesee Av Suite 760 La Jolla
4M	Sea Side Dental	04	N	04-0523	01-A	8950 Villa La Jolla DR Suite A105 La Jolla
4M	Bird Rock Dental	04	N	04-0524	01-A	5731 La Jolla Bl La Jolla
4M	Life Smiles Dental Care	04	N	04-0525	01-A	4130 La Jolla Village Dr Suite 105 La Jolla
4M	Transdental Family Care	04	N	04-0526	01-A	864 Prospect St La Jolla
4M	SeaSide Smiles	04	N	04-0527	01-A	875 Prospect ST Suite 202 La Jolla
4M	Katherine Thompson DDS	04	N	04-0528	01-A	8950 Villa La Jolla Dr Suite A207 La Jolla
4M	John J Taddey DDS Inc	04	N	04-0529	01-A	875 Prospect St Suite 301 La Jolla
4M	The Shores Dental	04	N	04-0530	01-A	7855 Fay Av Suite 260 La Jolla
4M	La Jolla Dental Group	04	N	04-0531	01-A	8950 Villa La Jolla Dr Suite 120B La Jolla
4M	Lena Turner DMD	04	N	04-0532	01-A	7759 Herschel Av Suite D La Jolla
4M	Harmony Dental Group	04	N	04-0533	01-A	8950 Villa La Jolla Dr Suite B101 La Jolla
2	J Craig Venter Institute	04	N	04-0534	01-A	4120 Capricorn Ln La Jolla
4M	La Jolla Village Smiles Dentistry and Imp	04	N	04-0535	01-A	8657 La Jolla Village Dr Suite 211 La Jolla

Active Permits Metrowide at Year End

Report run on: Monday, January, 3 2022 9:49 am

<i>Class Name</i>	<i>Area</i>	<i>SIU</i>	<i>Facility</i>	<i>Permit</i>	<i>Address</i>
4M Edent Shira Shasho DMD	04	N	04-0536	01-A	1038 Grand Av San Diego
4M Kwang Park DDS	04	N	04-0537	01-A	3023 Bunker Hill St Suite 101 San Diego
4M PB Smiles Dentistry	04	N	04-0538	01-A	1975 Garnet Av Suite E San Diego
4M All Coast Dental	04	N	04-0539	01-A	2180 Garnet Av Suite 1-K San Diego
4M Andrew J Demeyer DDS	04	N	04-0540	01-A	4707 Mission Bl San Diego
4M Aryan Dental Corp	04	N	04-0541	01-A	4501 Mission Bay Dr Suite 2E San Diego
4M PB Smile Studio	04	N	04-0542	01-A	4460 Olney St San Diego
4M Richard Bialick PhD, DDS Inc	04	N	04-0543	01-A	8950 Villa La Jolla Dr Suite B220 La Jolla
4M Grand Dental Spa	04	N	04-0544	01-A	1776 Grand Av San Diego
4M Sanjay Dhir DDS Inc	04	N	04-0545	01-A	3939 Governor Dr Suite A San Diego
4M Regents Dental Group	04	N	04-0546	01-A	4150 Regents Park Rw Suite 215 San Diego
4M Clark Henderson Dental Corporation	04	N	04-0547	01-A	3226 Governor Dr San Diego
4M Bruce R Brumm	04	N	04-0548	01-A	3957 Governor Dr San Diego
4M Lakhani DDS Inc	04	N	04-0549	01-A	4655 Cass ST Suite 100 San Diego
4M Purely Dental La Jolla	04	N	04-0554	02-A	7334 Girard Av Suite 101 San Diego
4M W. Peter Nordland DMD Inc	04	N	04-0558	02-A	850 Prospect St 7 San Diego
4M La Jolla Dental Image	04	N	04-0561	01-A	4150 Regents Park Rw Suite 200 La Jolla
2 Linnaeus Bioscience Inc	04	N	04-0566	01-A	3030 Bunker Hill St Suite 201 San Diego
2 UT; SC Valley Engineering Inc	04	Y	04-0569	01-B	717 Pacific Beach Dr San Diego
2 Abterra Bio	04	N	04-0570	01-A	3030 Bunker Hill St Suite 218 San Diego
4 Business Assessment	04	N	04-0571	01-A	3030 Bunker Hill St Suite 117B San Diego
2 Cureline Molecular Services LLC	04	N	04-0572	01-A	3030 Bunker Hill St Suite 306 San Diego
4 Business Assessment	04	N	04-0573	01-A	3030 Bunker Hill St Suite 319 San Diego
2 Multimeric Biotherapeutics Inc	04	N	04-0574	01-A	3030 Bunker Hill St Suite 115B San Diego
2 Boz Life Science Research and Teaching I	04	N	04-0575	01-A	3030 Bunker Hill St Suite 102 San Diego
2 Arrowhead Mountain Spring Water Comp	05	N	05-0011	01-A	8025 Engineer Rd San Diego
4 Ready Refresh by Nestle	05	N	05-0011	02-A	8025 Engineer Rd San Diego
4 Atlas Lithograph Company Inc	05	N	05-0012	03-A	7807 Ostrow St San Diego
2 University of San Diego	05	N	05-0013	02-A	5998 Alcala Park San Diego
2 University of San Diego	05	N	05-0013	03-A	5998 Alcala Park San Diego
4 Three Bakers	05	N	05-0022	00-A	8280 Clairemont Mesa Bl San Diego
2 Children's Hospital and Health Center	05	N	05-0035	02-B	3020 Children's Wy San Diego
2 Rady Children's Hospital San Diego	05	N	05-0035	03-A	3020 Children's Wy San Diego
2 Rady Children's Hospital San Diego	05	N	05-0035	03-B	3020 Children's Wy San Diego
2 Sharp Memorial Hospital	05	N	05-0039	03-A	7901 Frost St San Diego
4 Cubic Transportation Systems Inc	05	N	05-0048	01-A	5650 Kearny Mesa Rd San Diego
4 San Diego L D S Cannery	05	N	05-0051	00-A	4720 Mercury St San Diego
4 Pepsi Beverages Company	05	N	05-0064	06-A	7995 Armour St San Diego
4 Golden Ink Litho & Design	05	N	05-0080	02-A	7602 Vickers St San Diego
5 Good Earth	05	N	05-0086	00-B	7922 Armour St San Diego
4 San Diego Volvo	05	N	05-0098	01-A	5316 Kearny Mesa Rd San Diego
2 Sherwin Williams	05	N	05-0100	05-A	6625 Miramar Rd San Diego
2 City; Equipment Division - Rose Canyon	05	N	05-0111	03-A	3775 Morena Bl San Diego
4 Alturdyne	05	N	05-0141	00-A	8050 Armour St San Diego
4 Pacific Nissan Auto Body	05	N	05-0184	00-A	4700 Santa Fe St San Diego

Active Permits Metrowide at Year End

Report run on: Monday, January, 3 2022 9:49 am

<i>Class</i>	<i>Name</i>	<i>Area</i>	<i>SIU</i>	<i>Facility</i>	<i>Permit</i>	<i>Address</i>
4	Hastings Rod Manufacturing	05	N	05-0198	01-A	7569 Convoy Ct San Diego
4	Forman Machinery	05	N	05-0226	00-A	5111 Santa Fe St Suite J San Diego
4	Industrial Asphalt	05	N	05-0251	00-A	8150 Friars Rd San Diego
4	Instruments Inc	05	N	05-0267	01-A	7263 Engineer Rd Suite G San Diego
4	KJOS Music	05	N	05-0279	02-A	4382 Jutland Dr San Diego
4	Millers Carpet Care	05	N	05-0305	00-A	7952 Convoy Ct San Diego
4	Ocean Instruments Inc	05	N	05-0306	00-A	5312 Banks St San Diego
4	Bumba Lumber	05	N	05-0310	02-A	5325 Grant St San Diego
2	San Diego Transit Corporation	05	N	05-0384	02-A	4630 Ruffner St San Diego
2	San Diego Transit Corporation	05	N	05-0384	03-A	4630 Ruffner St San Diego
4	Balboa Chrysler-Plymouth	05	N	05-0387	01-A	8010 Balboa Av San Diego
4	City; Police Dept Western Div	05	N	05-0398	01-A	5215 Gaines St San Diego
4	Motel 6 # 014	05	N	05-0419	00-A	2424 Hotel Circle N Cr San Diego
4	Shutter Mart of California	05	N	05-0437	00-A	1022 W Morena Bl San Diego
2	SDCCD; Mesa College	05	N	05-0446	02-A	7250 Mesa College Dr San Diego
4	San Diego Volvo	05	N	05-0454	01-A	8080 Armour St San Diego
2	CALTRANS - Kearny Mesa	05	N	05-0467	04-A	7181 Opportunity Rd San Diego
2	CALTRANS - Kearny Mesa	05	N	05-0467	05-A	7181 Opportunity Rd San Diego
4	Manson's BMW	05	N	05-0479	01-A	2005 Morena Bl San Diego
4	Firestone	05	N	05-0482	01-A	4161 Convoy St San Diego
4	BMW of San Diego	05	N	05-0511	02-A	5090 Kearny Mesa Rd San Diego
4	SDG&E - Beach Cities C&O Center	05	N	05-0513	05-A	4848 Santa Fe St San Diego
4	Rayne San Diego Inc	05	N	05-0522	00-A	4635 Ruffner St San Diego
2	Kearny Mesa Acura	05	N	05-0533	03-A	5202 Kearny Mesa Rd San Diego
4	Witt Lincoln Mercury	05	N	05-0541	01-A	588 Camino Del Rio N San Diego
4	Coral Pool Supply	05	N	05-0544	01-A	4377 Convoy St San Diego
4	Mission Bay Automotive	05	N	05-0553	01-A	1125 Morena Bl San Diego
4	Crowne Plaza San Diego	05	N	05-0557	01-A	2270 Hotel Circle N San Diego
4	Fabulous Inns of America	05	N	05-0558	00-A	2485 Hotel Circle Pl San Diego
4	Sharp Knollwood Convalescent Hospital	05	N	05-0559	00-A	7944 Birmingham Dr San Diego
4	SDUSD; San Diego Unified School Distri	05	N	05-0563	01-A	2351 Cardinal Ln San Diego
4	Lloyd Pest Control	05	N	05-0565	00-A	935 Sherman St San Diego
4	Fuller Electric Corporation	05	N	05-0567	00-A	1018 Cudahy Pl San Diego
4	Accurate Elastomer Products	05	N	05-0571	02-A	4370 Jutland Dr San Diego
4	Mission Center Texaco	05	N	05-0572	00-A	5465 Mission Center Rd San Diego
4	San Diego County Office of Education	05	N	05-0580	02-A	6401 Linda Vista Rd San Diego
4	Caliber Collision Centers	05	N	05-0582	01-A	7515 Dagget St San Diego
4	Allenwest Inc	05	N	05-0602	01-A	8245 Ronson Rd Suite I San Diego
4	Lexus Kearny Mesa	05	N	05-0604	00-A	4970 Kearny Mesa Rd San Diego
4	University City Service Center	05	N	05-0608	01-A	3901 Governor Dr San Diego
4	K & S Automotive	05	N	05-0609	01-A	3865 Convoy St San Diego
4	Kragen Auto Parts	05	N	05-0610	01-A	3950 Convoy St San Diego
4	BMW of San Diego	05	N	05-0625	04-A	7860 Balboa Av San Diego
4	Penske Automotive Collison Center	05	N	05-0625	05-A	7860 Balboa Av San Diego
4	Costa Verde Car Wash	05	N	05-0628	00-A	8805 Costa Verde Bl San Diego

Active Permits Metrowide at Year End

Report run on: Monday, January, 3 2022 9:49 am

<i>Class</i>	<i>Name</i>	<i>Area</i>	<i>SIU</i>	<i>Facility</i>	<i>Permit</i>	<i>Address</i>
2	Rapid Transmissions	05	N	05-0635	01-A	3905 Convoy St San Diego
4	Ingersoll-Rand	05	N	05-0639	02-A	7950 Dagget St San Diego
4	Holiday Inn	05	N	05-0648	00-A	9335 Kearny Mesa Rd San Diego
4	Freeway Auto Body	05	N	05-0649	01-A	7455 Raytheon Rd San Diego
2	SDUSD; San Diego Unified School Distri	05	N	05-0656	05-A	4710 Cardin St San Diego
4	Kearny Mesa Toyota	05	N	05-0661	01-A	4910 Kearny Mesa Rd San Diego
3	Shell #3784	05	N	05-0664	01-A	6125 Balboa Av San Diego
3	Kwik N' Kleen	05	N	05-0666	01-A	4315 Genesee Av San Diego
4	University City Mobil	05	N	05-0667	01-A	3861 Governor Dr San Diego
2	SDG&E - Miramar Facility	05	N	05-0669	04-A	6875 Consolidated Wy San Diego
4	Napa Auto Parts	05	N	05-0674	04-A	7440 Convoy Ct San Diego
4	Cardinal Health	05	N	05-0680	01-A	7515 Metropolitan Dr Suite 410 San Diego
1	Stallergenes Greer dba Allarmed Laborato	05	Y	05-0684	07-A	7203 Convoy Ct San Diego
4	Business Assessment	05	N	05-0687	02-A	8050 Othello Av San Diego
4	Hawthorne Power Systems	05	N	05-0687	01-A	8050 Othello Av San Diego
5	Paradowskis Swim & Sport	05	N	05-0688	01-A	7962 Convoy Ct San Diego
2	Kenyon Machine Inc	05	N	05-0689	02-A	5002 Santa Fe St Suite E San Diego
4	Superior Motors of San Diego Inc dbaKen	05	N	05-0689	03-A	5002 Santa Fe St Suite E San Diego
4	Mike Muckley Photography	05	N	05-0717	01-A	8057 Raytheon Rd Suite 1 San Diego
5	Anthony's Fish Grotto	05	N	05-0726	00-A	5232 Lovelock St San Diego
4	County; Animal Control - Central	05	N	05-0735	00-A	5480 Gaines St San Diego
4	Fire Art Foundry	05	N	05-0737	00-A	7914 Ronson Rd Suite D San Diego
4	Allan Company	05	N	05-0744	01-A	6733 Consolidated Wy San Diego
2	AntiCancer Inc	05	N	05-0750	02-A	7917 Ostrow St San Diego
4	Professional Photographic Services	05	N	05-0758	01-A	1011 Buenos Av San Diego
4	SDUSD; Maintenance and Operations	05	N	05-0759	02-A	4860 Ruffner St San Diego
4	Diatron Corporation	05	N	05-0766	00-A	4878 Ronson Ct Suite I San Diego
4	Property Insight	05	N	05-0770	01-A	3750 Convoy St Suite 200 San Diego
4	FTS Auto Repair LLC	05	N	05-0778	02-A	7954 Dagget St San Diego
5	Todd Pipe and Supply	05	N	05-0779	00-A	1004 Cudahy Pl San Diego
4	Mossy Nissan Kearny Mesa	05	N	05-0781	02-A	8118 Clairemont Mesa Bl San Diego
4	Rancho Jeep Eagle	05	N	05-0781	01-B	8118 Clairemont Mesa Bl San Diego
5	Deck Coating Specialists	05	N	05-0785	02-A	6980 Convoy Ct San Diego
4	Complex Graphics	05	N	05-0787	01-A	7188 Clairemont Mesa Bl San Diego
5	Alliant Tech Systems	05	N	05-0790	01-A	8880 Daggett St San Diego
4	Warren's Carpet Cleaning	05	N	05-0793	02-A	5183 Mercury Pt San Diego
4	Alpha Die Cutting Company	05	N	05-0795	02-A	4878 Ronson Ct Suite E&H San Diego
4	Health Center Texaco	05	N	05-0796	01-A	2777 Health Center Dr San Diego
4	International Engine Works	05	N	05-0799	02-A	1201 Knoxville St San Diego
4	Sharp Outpatient Imaging Center	05	N	05-0800	02-A	3075 Health Center Dr San Diego
3	La Mesa RV Center Inc	05	N	05-0801	02-A	7430 Copley Park Pl San Diego
4	Campos Photography	05	N	05-0806	02-A	4879 Ronson Rd Suite B San Diego
4	Chandler Packaging	05	N	05-0808	02-A	7595 Raytheon Rd San Diego
2	MM San Diego LLC - Miramar	05	N	05-0809	06-A	5244 Convoy St San Diego
4	Bay Park Pet Clinic	05	N	05-0810	02-A	1102 Morena Bl San Diego

Active Permits Metrowide at Year End

Report run on: Monday, January, 3 2022 9:49 am

<i>Class</i>	<i>Name</i>	<i>Area</i>	<i>SIU</i>	<i>Facility</i>	<i>Permit</i>	<i>Address</i>
4	Tops Cleaners	05	N	05-0818	02-A	855 Morena Bl San Diego
4	Clairemont Town Square Cleaners	05	N	05-0828	03-A	4839 Clairemont Dr Suite E San Diego
4	University Cleaners	05	N	05-0831	02-A	3546 Ashford St San Diego
4	La Jolla Cleaners	05	N	05-0832	01-A	8508 Genesee Av San Diego
4M	Cassell Dentistry	05	N	05-0837	03-A	591 Camino De La Reina Suite 412 San Diego
4	Jon W Cassell DDS	05	N	05-0837	02-A	591 Camino De La Reina Suite 412 San Diego
4M	Libby Dental	05	N	05-0847	03-A	2333 Camino Del Rio S Suite 310 San Diego
4	William Shoemaker DO	05	N	05-0850	02-A	9040 Friars Rd 230 San Diego
4M	Rio Vista Family Dentistry	05	N	05-0855	03-A	8590 Rio San Diego Dr 110 San Diego
4M	Kearny Mesa Dentistry	05	N	05-0862	02-A	4488 Convoy St G San Diego
4M	Dr Robert Bosworth DDS	05	N	05-0864	02-A	7675 Dagget St 160 San Diego
4M	Anthony Tai Q Pham DDS	05	N	05-0865	03-A	4240 Kearny Mesa Rd 117 San Diego
2F	Francis Parker School	05	N	05-0866	02-A	6501 Linda Vista Rd San Diego
4	Gregory Davis DDS Inc	05	N	05-0872	02-A	4626 Mercury St San Diego
4	SOS Printing	05	N	05-0874	02-A	8135 Ronson Rd San Diego
4M	Tai Huynh DDS	05	N	05-0881	02-A	2363 Ulric St A San Diego
4	True Smile Dental	05	N	05-0882	02-A	2171 Ulric St 100 San Diego
4M	Robert Chin DDS	05	N	05-0886	02-A	6545 Balboa Av Suite A San Diego
4M	Balboa Dentistry	05	N	05-0894	04-A	5222 Balboa Av 72 San Diego
4	Russell E Haag DDS	05	N	05-0898	02-A	3805 Clairemont Dr Suite A San Diego
4M	Barbara Young DDS	05	N	05-0901	03-A	3764 Clairemont Dr San Diego
4M	Bay Park Dental Group	05	N	05-0905	02-A	2619 Clairemont Dr San Diego
4M	Clairemont Family Dental Off	05	N	05-0906	02-A	3670 Clairemont Dr 14 San Diego
4M	William Briggs DDS	05	N	05-0909	02-A	3782 Clairemont Dr San Diego
4M	Friendly Family Dental	05	N	05-0910	02-A	3774 Clairemont Dr San Diego
4M	Village Children Dentistry	05	N	05-0911	03-A	3065 Clairemont Dr Suite C San Diego
4M	RB Hancock/GJ Stratigopoulos	05	N	05-0912	02-A	4808 Clairemont Mesa Bl San Diego
2F	L C Family Dental Care	05	N	05-0913	01-A	5527 Clairemont Mesa Bl San Diego
4M	Samson Yang DMd Inc	05	N	05-0913	02-A	5527 Clairemont Mesa Bl San Diego
4M	Serena Family Dental	05	N	05-0914	04-A	4453 Clairemont Mesa Bl San Diego
4M	Western Dental	05	N	05-0916	02-A	3802 Clairemont Mesa Bl San Diego
4	Town Square Family Dentistry	05	N	05-0919	02-A	4921 Clairemont Dr Suite A San Diego
4	SDUSD; Madison High School	05	N	05-0920	02-A	4833 Doliva Dr San Diego
4M	Anton F Misleh DDS	05	N	05-0922	03-A	4320 Genesee Av 204 San Diego
4	Robert J Bey DDS	05	N	05-0924	02-A	4690 Genesee Av San Diego
4M	Paul C Davis DDS Inc	05	N	05-0927	02-A	4320 Genesee Av 102 San Diego
4M	Anita Varzi DDS	05	N	05-0929	02-A	4295 Gesner St 2E San Diego
4	Ricardo Hernandez DDS	05	N	05-0935	02-A	3737 Moraga Av San Diego
4M	N2 Periodontics & Implants	05	N	05-0937	02-A	3737 Moraga Av A104 San Diego
4M	Stanley Baquial DDS	05	N	05-0941	02-A	3737 Moraga Av B309 San Diego
4M	Toma & Petros DDS Inc	05	N	05-0942	02-A	3737 Moraga Av B311 San Diego
4	David Milder DDS MD	05	N	05-0943	02-A	3737 Moraga Av 216 San Diego
4M	Randy L Wolff DDS	05	N	05-0944	03-A	3737 Moraga Av A302 San Diego
4M	Faye Tada DDS	05	N	05-0945	02-A	3737 Moraga Av B410 San Diego
4M	Harriet Seldin DMD	05	N	05-0946	04-A	3737 Moraga Av B113 San Diego

Active Permits Metrowide at Year End

Report run on: Monday, January, 3 2022 9:49 am

<i>Class</i>	<i>Name</i>	<i>Area</i>	<i>SIU</i>	<i>Facility</i>	<i>Permit</i>	<i>Address</i>
4M	Douglas N Christiansen DDS	05	N	05-0947	03-A	3737 Moraga Av B400 San Diego
4M	Edmund W Jay DDS	05	N	05-0949	02-A	3737 Moraga Av B300 San Diego
4M	Integrity Dental	05	N	05-0950	02-A	3737 Moraga Av Suite B206 San Diego
4M	Bay Breeze Dental	05	N	05-0951	02-A	3737 Moraga Av B414 San Diego
4M	Dr Svarney	05	N	05-0952	03-A	3737 Morago Av B200 San Diego
4	Gregg W Beaty Dmd	05	N	05-0952	02-A	3737 Morago Av B200 San Diego
4M	Boston Dental Group	05	N	05-0954	02-A	7612 Linda Vista Rd 112 San Diego
4M	Andrew Firtel DDS Inc	05	N	05-0956	02-A	3222 Governor Dr San Diego
4M	Claudia Florescu DDS	05	N	05-0961	03-A	7748 Regents Rd Suite 301 San Diego
4M	Dr Roland Goldberg	05	N	05-0964	03-A	8915 Town Centre Dr Suite 112 San Diego
4M	Richard Harmetz DDS	05	N	05-0966	02-A	8899 University Center Ln Suite 180 San Diego
4M	Center for Dental Health La Jolla	05	N	05-0967	03-A	8899 University Center Ln Suite 190 San Diego
2F	North County Orthopaedic Medical Group	05	N	05-0969	01-A	8929 University Center Ln Suite 100 San Diego
4M	Stephen Doan DDS	05	N	05-0970	03-A	8899 University Center Ln Suite 110 San Diego
5	Tanabe USA Inc	05	N	05-0973	01-A	7930 Convoy Ct San Diego
4	Stadium Cleaners	05	N	05-0974	02-A	5694 Mission Center Rd Suite 601 San Diego
4	Albertsons	05	N	05-0977	02-A	7715 Balboa Av San Diego
4	SDUSD; Clairemont High School	05	N	05-0981	02-A	4150 Ute Dr San Diego
4	Tropical Shade Masters Inc	05	N	05-0983	02-A	5151 Santa Fe St Suite E San Diego
4	Industrial Metal Supply	05	N	05-0984	01-A	7550 Ronson Rd San Diego
1	Chromalloy San Diego	05	Y	05-0985	05-A	7007 Consolidated Wy San Diego
1	Chromalloy San Diego	05	Y	05-0985	06-A	7007 Consolidated Wy San Diego
4	M2 Collision Centers	05	N	05-0990	01-A	7484 Raytheon Rd San Diego
5	Nobel Associates	05	N	05-0993	01-A	4350 La Jolla Village Dr Suite 300 San Diego
4	Testing Engineers San Diego	05	N	05-0995	01-A	7895 Convoy Ct Suite 18 San Diego
1	TTM Technologies Inc - San Diego Divisi	05	Y	05-0997	06-A	5037 Ruffner St San Diego
4	Vons # 2040	05	N	05-1001	02-A	5555 Balboa Av San Diego
4	United Parcel Service	05	N	05-1008	02-A	7925 Ronson Rd San Diego
4	Nico and Associates	05	N	05-1009	01-A	7160 Convoy Ct San Diego
2	Allied Waste Services of San Diego	05	N	05-1014	04-A	8364 Clairemont Mesa Bl San Diego
4	Senekoe Embossing & Foil Stamping	05	N	05-1015	02-A	4888 Ronson Ct Suite H San Diego
4	Riverwalk Golf Club	05	N	05-1016	01-A	1150 Fashion Valley Rd San Diego
4	San Diego Metal Graphics	05	N	05-1017	02-A	7902 Dagget St Suite J San Diego
2Z	USN;Marine Corps Air Station Miramar	05	Y	05-1019	06-B	45249 Miramar Wy San Diego
4	Bonded Carpet & Windows	05	N	05-1020	01-A	7831 Ostrow St San Diego
4M	Million Dollar Smile	05	N	05-1022	06-A	3737 Moraga Av Suite B307 San Diego
2	Absorption Systems California LLC	05	N	05-1023	02-A	7901 Vickers St San Diego
4	AutoMac Body Shop	05	N	05-1027	01-A	8016 Raytheon Rd Suite B San Diego
4	Specialist Printing & Direct Mail	05	N	05-1028	02-A	4887 Ronson Ct San Diego
4	OCB Reprographics	05	N	05-1030	01-A	7584 Metropolitan Dr San Diego
4M	Soft Touch Dental Group	05	N	05-1034	03-A	3735 Clairemont Mesa Bl San Diego
4M	William Bremner DDS	05	N	05-1035	02-A	3660 Clairemont Dr Suite 11 San Diego
4	Justin Y Seng DDS	05	N	05-1036	02-A	4698 Convoy St Suite 203 San Diego
4	HealthSouth UTC SurgiCenter	05	N	05-1037	01-A	8929 University Center Ln Suite 103 San Diego
4	SBC Services Inc	05	N	05-1040	01-A	7910 Othello St San Diego

Active Permits Metrowide at Year End

Report run on: Monday, January, 3 2022 9:49 am

<i>Class</i>	<i>Name</i>	<i>Area</i>	<i>SIU</i>	<i>Facility</i>	<i>Permit</i>	<i>Address</i>
4	Aronovsky Photography Studio	05	N	05-1045	01-A	7969 Engineer Rd Suite 202 San Diego
2	Illumina Inc	05	N	05-1052	03-A	5200 Illumina Wy San Diego
2	Illumina Inc	05	N	05-1052	04-A	5200 Illumina Wy San Diego
4	Direct to Press	05	N	05-1055	01-A	7373 Convoy Ct Suite B San Diego
4	The Hose Pros	05	N	05-1057	01-A	7375 Convoy Ct San Diego
4	Kirwan Company	05	N	05-1059	01-A	7377 Convoy Ct San Diego
4	REXEL	05	N	05-1062	02-A	7380 Convoy Ct San Diego
4	Pacific Pathology Inc	05	N	05-1065	01-A	4945 Mercury St San Diego
2	Mercedes Benz of San Diego	05	N	05-1067	02-A	4750 Kearny Mesa Rd San Diego
4	Mercedes Benz Body Shop	05	N	05-1068	01-A	7905 Dagget St San Diego
4	JC Service	05	N	05-1070	01-A	7879 Raytheon Rd San Diego
4	G & M Oil Company # 174	05	N	05-1071	02-A	7737 Balboa Av San Diego
4	Piersall's Linda Vista Buggy Bath Carwash	05	N	05-1072	01-A	2165 Comstock St San Diego
4	San Diego Kitchen and Bath	05	N	05-1073	01-A	5145 Morena Pl San Diego
4	Clean Air Power	05	N	05-1074	01-A	5141 Santa Fe St San Diego
4	Specialist Printing & Direct Mail	05	N	05-1077	01-A	4974 Mercury St San Diego
4	San Diego Center for Sports Medicine	05	N	05-1078	01-A	8010 Frost St Suite 510 San Diego
4	Sharp Perinatal Center	05	N	05-1079	01-A	8010 Frost St Suite M San Diego
4	CASEI Compressed Air Systems Engineer	05	N	05-1080	01-A	7374 Convoy Ct San Diego
4	Transmasters Transmissions	05	N	05-1082	01-A	2920 Damon St Suite A San Diego
4	One Time Auto Smog & Repair	05	N	05-1083	01-A	2920 Damon Av Suite C San Diego
4	Lo Sieu Smog Test Only Center	05	N	05-1084	01-A	2920 Damon Av Suite B San Diego
4	Econo Lube N Tune	05	N	05-1085	01-A	2924 Damon Av San Diego
2	Reva Medical LLC	05	N	05-1088	01-A	5751 Copley Dr Suite B San Diego
4	Carpet Cleaner's Emporium	05	N	05-1092	01-A	7528 Clairemont Mesa Bl San Diego
4	McCormack Dental Imaging Inc	05	N	05-1097	02-A	1550 Hotel Circle N Suite 340 San Diego
4	USN;CA Army National Guard; SD FMS	05	N	05-1098	02-A	3171 Armstrong St San Diego
3	G & M Oil Company # 54	05	N	05-1099	02-A	8110 Balboa Av San Diego
4	Amico Scientific Corporation	05	N	05-1100	01-A	1161 Cushman Av San Diego
5	Cimtrek Inc	05	N	05-1101	01-A	1152 Morena Bl San Diego
4	Manncorp	05	N	05-1102	01-A	4901 Morena Bl San Diego
5	Shugarman's Bath	05	N	05-1103	01-A	1154 Morena Bl San Diego
4	Pressnet Express Inc	05	N	05-1104	01-A	7824 Convoy Ct San Diego
4M	Spilotro Periodontics	05	N	05-1105	02-A	3805 Clairemont Dr Suite B San Diego
4	Carmax Store # 7653	05	N	05-1109	01-A	7766 Balboa Av San Diego
5	Cox Communications	05	N	05-1110	01-A	5651 Copley Dr San Diego
3	Anheuser-Busch LLC dba Anheuser-Busch	05	N	05-1112	01-A	5959 Santa Fe St San Diego
4	Ray Frey Auto Center	05	N	05-1115	01-A	7696 Vickers St San Diego
4	Precision Steel Rule Die Inc	05	N	05-1117	01-A	4887 Ronson Ct Suite E San Diego
4	David Freeman DDS	05	N	05-1118	01-A	3095 Clairemont Dr San Diego
4	Vinh Phat Auto Repair	05	N	05-1120	01-A	6625 Linda Vista Rd Suite C San Diego
4M	Linda Vista Dentistry	05	N	05-1128	02-A	7440 Beagle St San Diego
4M	Smile Creations Dental Practice	05	N	05-1129	02-A	8018 Clairemont Mesa Bl San Diego
4	Business Assessment	05	N	05-1130	01-A	7570 Clairemont Mesa Bl San Diego
4	Balboa Dental Care	05	N	05-1134	01-A	4223 Balboa Av Suite 109 San Diego

Active Permits Metrowide at Year End

Report run on: Monday, January, 3 2022 9:49 am

<i>Class</i>	<i>Name</i>	<i>Area</i>	<i>SIU</i>	<i>Facility</i>	<i>Permit</i>	<i>Address</i>
4	Lawrence Lotzor DDS	05	N	05-1135	01-A	4320 Genesee Av Suite 206 San Diego
5	Medical Office/Lab for Dr Walter K Nahn	05	N	05-1137	01-A	7695 Cardinal Ct Suite 200 San Diego
4	Sharp Rees-Stealy Medical Group - Radio	05	N	05-1138	01-A	2929 Health Center Dr San Diego
4	Target # 2465	05	N	05-1139	01-A	5454 Balboa Av San Diego
4	Target # 1410	05	N	05-1140	01-A	1288 Camino Del Rio North San Diego
4M	Christina A Bartsch DDS	05	N	05-1146	02-A	3737 Moraga Av Suite A306 San Diego
2F	Goodway Printing & Graphics	05	N	05-1148	01-A	7372 Convoy Ct San Diego
4M	Mesa Dental	05	N	05-1149	02-A	7625 Mesa College Dr Unit 100 San Diego
4	Imaging Healthcare Specialist	05	N	05-1150	01-A	7625 Mesa College Dr Suite 103 San Diego
4	Coast United Advertising	05	N	05-1154	01-A	5228 Cushman Pl San Diego
4	Siry Incorporated	05	N	05-1155	01-A	8085 Clairemont Mesa Bl San Diego
5	JW Stratton Specialty Coatings, Inc.	05	N	05-1160	01-A	5280 Riley St San Diego
5	Sunshine Supply Co., Inc.	05	N	05-1161	01-A	4946 Naples St San Diego
5	Sherwin Williams Paint	05	N	05-1163	01-A	4802 Convoy St San Diego
4M	Parvathi Pokala	05	N	05-1166	02-A	8031 Linda Vista Rd Unit 200 San Diego
4M	Xusheng Mu DDS Inc	05	N	05-1170	02-A	4716 Clairemont Mesa Bl San Diego
4	Anny's Alteration	05	N	05-1171	01-A	4592 Clairemont Dr Suite 120 San Diego
4	Mesa Family Dental	05	N	05-1172	01-A	5450 Clairemont Mesa Bl Suite C San Diego
4	Gilden Family Chiropractic	05	N	05-1173	01-A	5450 Clairemont Mesa Bl Suite F San Diego
4M	Denise Handler DDS	05	N	05-1174	02-A	7914 Ronson Rd Unit A San Diego
4M	David S Eshom DDS	05	N	05-1176	02-A	8899 University Center Ln Suite 245 San Diego
4M	Clairemont Dental Care	05	N	05-1179	02-A	5222 Balboa Av Suite 71 San Diego
4	First Transit Inc #55826	05	N	05-1180	01-A	7490 Copley Park Pl San Diego
4	VCA Animal Specialty Group	05	N	05-1181	01-A	5610 Kearny Mesa Rd Suite B San Diego
4	Thomas & Bros Auto Center	05	N	05-1182	01-A	3034 Clairemont Dr San Diego
2	Associated Microbreweries LTD aka Karl	05	N	05-1183	01-A	5985 Santa Fe St San Diego
5	Velocity Imaging Products	05	N	05-1187	01-A	1451 Morena Bl San Diego
2	UT; Thrifty Oil Company #405	05	N	05-1189	04-A	2505 Morena Bl San Diego
5	Advanced HPC	05	N	05-1193	02-A	4887 Ronson Ct San Diego
4	GT Pros Television Repair	05	N	05-1194	02-A	4650 Mercury St San Diego
5	Aps Electric	05	N	05-1195	01-A	8304 Clairemont Mesa Bl Unit 209 San Diego
5	Earle Associates Inc	05	N	05-1196	01-A	7585 Ronson Rd Suite 200 San Diego
5	Kennaret Enterprises	05	N	05-1203	02-A	8148 Ronson Rd Unit E San Diego
5	The Engraving Store	05	N	05-1205	01-A	4223 Genesee Av Suite 110 San Diego
4	5th Axis CNC	05	N	05-1211	01-A	7140 Engineer Rd San Diego
5	CAD Design	05	N	05-1216	01-A	4858 Mercury St Suite 103 San Diego
4	Fast Keys & Engraving	05	N	05-1222	01-A	8052 Clairemont Mesa Bl Space San Diego
5	Fast Keys & Engraving	05	N	05-1222	02-A	8052 Clairemont Mesa Bl Space San Diego
4	PSC Electronics	05	N	05-1224	01-A	7072 Convoy Ct San Diego
5	Sherwin-Williams Paint	05	N	05-1225	01-A	2231 Morena Bl San Diego
4	Vista Paint	05	N	05-1226	01-A	1103 Morena Bl San Diego
5	Barrios Distributing	05	N	05-1232	01-A	5265 Lovelock St San Diego
4	La Jolla Audio Inc	05	N	05-1234	01-A	5151 Santa Fe St Suite L San Diego
4	Deck Coating Specialist of San Diego	05	N	05-1235	01-A	6980 Convoy Ct San Diego
4	Rockler Woodworking	05	N	05-1236	01-A	8199 Clairemont Mesa Bl San Diego

Active Permits Metrowide at Year End

Report run on: Monday, January, 3 2022 9:49 am

<i>Class</i>	<i>Name</i>	<i>Area</i>	<i>SIU</i>	<i>Facility</i>	<i>Permit</i>	<i>Address</i>
4	PSC Electronics	05	N	05-1237	01-A	8245 Ronson Rd San Diego
4	Wesco Distribution Inc	05	N	05-1238	01-A	7790 Convoy Ct San Diego
5	Bearcom	05	N	05-1239	01-A	8290 Vickers St San Diego
4	Bejar Gate Company	05	N	05-1240	01-A	8016 Raytheon Rd San Diego
5	Future Active Industrial	05	N	05-1241	01-A	6256 Greenwich Dr San Diego
5	Tokyo Components USA Inc	05	N	05-1242	01-A	8322 Clairemont Mesa Bl San Diego
5	Teel Painting, Inc.	05	N	05-1244	01-A	4895 Savannah St San Diego
2	EM Lab P&K LLC	05	N	05-1246	01-A	8304 Clairemont Mesa Bl Unit 103 San Diego
4	EM Lab P&K LLC	05	N	05-1246	02-A	8304 Clairemont Mesa Bl Unit 103 San Diego
4	SDG&E - Miramar Energy Facility	05	N	05-1248	01-A	6897 Consolidated Wy San Diego
5	CoastView Veterinary Hospital	05	N	05-1249	01-A	3895 Clairemont Dr Suite 103 San Diego
3	UT; 7510 Hazard LLC	05	Y	05-1250	03-A	7400 Hazard Center Dr San Diego
3	UT; 7510 Hazard LLC	05	N	05-1250	04-A	7400 Hazard Center Dr San Diego
5	Tracon Pharmaceuticals	05	N	05-1251	01-A	8910 University Center Ln Suite 700 San Diego
4	Gentle Touch Car Wash	05	N	05-1253	01-A	7215 Clairemont Mesa Bl San Diego
4	Luv Car Wash	05	N	05-1256	02-A	7959 Balboa Av San Diego
4	Wash N' Go Express	05	N	05-1256	01-A	7959 Balboa Av San Diego
4	Hopnonymous Brewing	05	N	05-1258	02-A	7705 Convoy Ct San Diego
3	Societe Brewing	05	N	05-1259	01-A	8262 Clairemont Mesa Bl San Diego
4	Penske Automotive Facility	05	N	05-1264	01-A	7650 Convoy Ct San Diego
4	Bitter Brothers Brewing Company	05	N	05-1266	01-A	4170 Morena Bl San Diego
3	Coronado Brewing Company	05	N	05-1267	01-A	1205 Knoxville St San Diego
4	Kilowatt Brewing	05	N	05-1268	01-A	7576 Clairemont Mesa Bl San Diego
4	Quantum Brewery	05	N	05-1269	01-A	5375 Kearny Villa Rd Suite 116 San Diego
3	Balboa Express Carwash	05	N	05-1270	01-A	6066 Balboa Av San Diego
4	Deft Brewing	05	N	05-1271	01-A	5328 Banks St Suite A San Diego
5	Fresenius Kidney Care San Diego DS Hor	05	N	05-1276	01-A	7907 Ostrow St Suite D San Diego
4	Business Assessment	05	N	05-1277	01-A	7700 Ronson Rd Suite 100 San Diego
2	Sharp Pathology Laboratory	05	N	05-1279	01-A	5651 Copley Dr San Diego
2	Sharp Pathology Laboratory	05	N	05-1279	02-A	5651 Copley Dr San Diego
2	SDG&E Environmental Lab	05	N	05-1280	01-A	4949 Greencraig Ln San Diego
4	Lost Cause Meadery	05	N	05-1282	01-A	5328 Banks St Suite B San Diego
4M	Rossanne Sosa DDS	05	N	05-1285	01-A	7830 Clairemont Mesa Bl Suite 208 San Diego
4M	Thomas Acierno DDS	05	N	05-1286	01-A	2615 Clairemont Dr San Diego
4M	Kurt Hummeldorf and Eric Stalder	05	N	05-1287	01-A	2655 Camino Del Rio N Suite 140 San Diego
4M	Mission Valley Dental Arts	05	N	05-1288	01-A	2333 Camino Del Rio S Suite 140 San Diego
4M	Oasis Dentistry	05	N	05-1289	01-A	2020 Camino del Rio N Suite 108 San Diego
4M	New Smile Dentistry	05	N	05-1290	01-A	2780 Cardinal Rd Suite B San Diego
4M	Kazuhiro Kato	05	N	05-1291	01-A	3707 Convoy St San Diego
4	TLC Auto Repair Inc.	05	N	05-1293	01-A	7845 Raytheon Rd San Diego
4M	Yolanda Garcia Loret DDS	05	N	05-1294	01-A	3750 Convoy St Suite 307 San Diego
4M	South Clairemont Dentistry	05	N	05-1295	01-A	3796 Clairemont Dr San Diego
4M	Dr Russell McCalley	05	N	05-1296	01-A	4320 Genesee Av Suite 201 San Diego
4M	Balboa Dental Care	05	N	05-1297	01-A	4340 Genesee Av Suite 202 San Diego
4M	Jin Yang DDS	05	N	05-1298	01-A	4310 Genesee Av Suite 108B San Diego

Active Permits Metrowide at Year End

Report run on: Monday, January, 3 2022 9:49 am

<i>Class Name</i>	<i>Area</i>	<i>SIU</i>	<i>Facility</i>	<i>Permit</i>	<i>Address</i>
4M Bay View Dental	05	N	05-1299	01-A	3737 Moraga Av Suite 108 San Diego
4M Professional Dental Corp	05	N	05-1300	01-A	4320 Genesee Av Suite 203 San Diego
4M Albert Leung DDS	05	N	05-1301	01-A	6565 Balboa Av Suite B San Diego
4M San Diego Smile Dentistry	05	N	05-1302	01-A	7710 Balboa Av Suite 123 San Diego
4M Robert Jacob DDS	05	N	05-1303	01-A	4617 Ruffner St Suite 200 San Diego
4M Susan Chang DDS	05	N	05-1304	01-A	7380 Clairemont Mesa Bl Suite 100 San Diego
4M Maria Dulce	05	N	05-1305	01-A	7878 Clairemont Mesa Bl Suite E San Diego
4M Soloman Cantwell DDS	05	N	05-1306	01-A	7373 Clairemont Mesa Bl Suite 108F San Diego
4M New Image Dental	05	N	05-1307	01-A	8989 Rio San Diego Dr Suite 170 San Diego
4M All Smiles Pediatric Dentistry	05	N	05-1308	01-A	7695 Cardinal Ct Suite 250 San Diego
4M James Berry DDS	05	N	05-1310	01-A	4540 Kearny Villa Rd Suite 116 San Diego
4M Robert Takano DDS	05	N	05-1311	01-A	8910 University Center Ln Suite 670 San Diego
4M Hsieh Dental Office	05	N	05-1312	01-A	4620 Convoy St Suite H San Diego
4M Koshgeriam Surgical Dental Group	05	N	05-1313	01-A	3737 Moraga Av Suite B216 San Diego
4M Clairemont Pediatric Dental	05	N	05-1314	01-A	2780 Cardinal RD Suite A San Diego
4M William V Carlo DMD	05	N	05-1315	01-A	9040 Friars Rd Suite 535 San Diego
4M Clairemont smiles Dentistry & Ortho	05	N	05-1316	01-A	5675 Balboa Av San Diego
4M First Impressions Dental	05	N	05-1317	01-A	3805 Clairemont Dr San Diego
4M Governor Dental	05	N	05-1318	01-A	4001 Governor Dr San Diego
4M Truesmile Dental	05	N	05-1319	01-A	2171 Ulric St Suite 100 San Diego
4M Bay Park Smiles Dentistry	05	N	05-1320	01-A	2995 Clairemont Dr Suite A San Diego
4M Michael Carter DMD	05	N	05-1321	01-A	3737 Moraga Av Suite B220 San Diego
4M U Dream Dental San Diego	05	N	05-1322	01-A	7808 Clairemont Mesa Bl Suite 101 San Diego
4M Spectrum Dental	05	N	05-1323	01-A	5375 Kearny Villa Rd Suite 103 San Diego
4M Najwaa Barakat DDS	05	N	05-1324	01-A	7830 Clairemont Mesa Bl Suite 203 San Diego
4M Convoy Dental Arts	05	N	05-1325	02-A	4194 Convoy St San Diego
4M Dr Chengs Dental Office	05	N	05-1325	01-A	4194 Convoy St San Diego
4M Synergy Dental Group	05	N	05-1326	01-A	4428 Convoy St Suite 230 San Diego
4M Mark Bishop DDS	05	N	05-1327	01-A	7525 Linda Vista Rd Suite B San Diego
4M San Diego Dental Group, Inc	05	N	05-1328	01-A	7825 Engineer Rd Suite 111 San Diego
4M All Smiles Kids Dentistry	05	N	05-1331	01-A	3737 Moraga Av Suite B109 San Diego
4M Allegiance Dental, Inc	05	N	05-1332	01-A	4690 Genesee Av Suite B San Diego
4M Great Smile Dental	05	N	05-1333	01-A	5210 Balboa Av Suite A-2 San Diego
4M Edward Farajzadeh, DDS	05	N	05-1334	01-A	3867 Clairemont Dr San Diego
4M Tarabishi Dental Inc	05	N	05-1335	01-A	4223 Genesee Av Suite 109 San Diego
4M Dental Express	05	N	05-1337	01-A	4664 Clairemont Mesa Bl San Diego
4M Town Square Family Dentistry	05	N	05-1338	01-A	4731 Clairemont Dr Suite 101 San Diego
4M Cabrillo Dental	05	N	05-1339	01-A	7695 Cardinal Ct Suite 300 San Diego
4M New Smile Dental	05	N	05-1340	01-A	7450 Clairemont Mesa Bl Suite 201 San Diego
4M Mesa Dental	05	N	05-1341	01-A	7625 Mesa College San Diego
4M James F Misla DDS	05	N	05-1342	01-A	3737 Moraga Av Suite A208 San Diego
4M Dentistry At The Promenade	05	N	05-1343	01-A	8555 Station Village Wy Suite A San Diego
4M Garrett M Guess DDS, Inc	05	N	05-1344	01-A	8929 University Center Ln Suite 209 San Diego
4M South Coast Endodontics	05	N	05-1346	01-A	3760 Convoy St Suite 330 San Diego
4M MCAS Miramar, 13th Dental Company	05	N	05-1347	01-A	7224 Mitscher Wy Bldg 2495 San Diego

Active Permits Metrowide at Year End

Report run on: Monday, January, 3 2022 9:49 am

<i>Class</i>	<i>Name</i>	<i>Area</i>	<i>SIU</i>	<i>Facility</i>	<i>Permit</i>	<i>Address</i>
4	Planned Parenthood Kearny Mesa	05	N	05-1348	01-A	7035 Convoy Ct San Diego
2	Nanocomposix	05	N	05-1350	01-A	4878 Ronson Ct Suite J San Diego
3	UT; Flatiron West Inc	05	Y	05-1351	01-A	885 Sherman St San Diego
3	UT; Flatiron West Inc	05	Y	05-1352	01-A	887 Sherman St San Diego
3	UT; Flatiron West Inc	05	Y	05-1352	01-B	887 Sherman St San Diego
3	UT; Flatiron West Inc	05	Y	05-1353	01-A	5400 Friars Rd San Diego
2	City; Metro Biosolids Center	05	N	05-1354	01-A	5240 Convoy st San Diego
3	UT; Flatiron West Inc	05	Y	05-1357	01-A	4747 Friars Rd San Diego
3	UT; Fairfield Development LP	05	Y	05-1358	01-A	7050 Friars Rd San Diego
4	Business Assessment	05	N	05-1359	01-A	5040 Shoreham Pl San Diego
4M	Raymond E. Carpenter DDS Inc.	05	N	05-1361	01-A	4320 Genesee Av Suite 207 San Diego
4	Business Assessment	05	N	05-1362	01-A	6999 Clairemont Mesa Bl San Diego
4	USN;Naval Underseas Warfare	06	N	06-0007	00-A	9284 Balboa Av San Diego
2	Solar Turbines Inc	06	N	06-0013	04-A	4200 Ruffin Rd San Diego
4	Cubic Defense Applications Inc	06	N	06-0026	07-A	9233 Balboa Av San Diego
4	Schwerma's Carpet Cleaners	06	N	06-0042	00-A	4430 Vandever Av San Diego
4	Mechanical System Contractors, Inc.	06	N	06-0052	03-A	4444 Viewridge Av San Diego
1	Kyocera International Inc	06	Y	06-0058	07-A	8611 Balboa Av San Diego
3	City; Fire - Rescue Dept Repair Facility	06	N	06-0071	05-A	3870 Kearny Villa Rd San Diego
4	Business Assessment	06	N	06-0090	01-A	3738 Ruffin Rd San Diego
4	Century Design Inc	06	N	06-0107	01-A	3635 Afton Rd San Diego
4	County Burner and Machining	06	N	06-0159	01-A	6127 Fairmount Av San Diego
4	Automotive Fleet Service Inc	06	N	06-0187	01-A	6029 Fairmount Av San Diego
4C	Cobham Advanced Electronic Solutions Ir	06	N	06-0196	08-A	9404 Chesapeake Dr San Diego
4	Ryder Truck Rental	06	N	06-0223	02-A	5345 Overland Av San Diego
4	Spider's Aircraft Services	06	N	06-0226	00-A	3873 Kearny Villa Rd San Diego
5	Balboa Ambulance	06	N	06-0228	00-A	6342 Riverdale St San Diego
5	Aquatic Warehouse	06	N	06-0230	00-A	5466 Complex St Suite 204 San Diego
4	Saint Gobain Solar Gard LLC	06	N	06-0266	02-A	4540 Viewridge Av San Diego
2	San Diego Gas & Electric Company	06	N	06-0268	05-A	5488 Overland Av San Diego
4	Bussiness Assessment	06	N	06-0275	05-A	4340 Viewridge Av Suite A San Diego
4	Coastal Transportation	06	N	06-0277	01-A	2750 Murphy Canyon Rd San Diego
4	City; Police Dept Eastern Div	06	N	06-0279	01-A	9225 Aero Dr San Diego
4	San Diego County APCD	06	N	06-0302	01-A	9186 Chesapeake Dr San Diego
4	City; Qualcomm Stadium	06	N	06-0318	01-A	9449 Friars Rd San Diego
4	Body Beautiful Car Wash	06	N	06-0326	01-A	4282 Camino Del Rio N San Diego
4	Sterling Machine	06	N	06-0342	02-A	9424 Chesapeake Dr Suite 1304 San Diego
2	United Rentals	06	N	06-0344	02-A	5580 Kearny Villa Rd San Diego
2F	City; Print Shop	06	N	06-0350	01-A	8835 Balboa Av San Diego
4	Mipro Printing	06	N	06-0356	00-A	9178 Chesapeake Dr San Diego
5	Archer Corporation	06	N	06-0368	00-A	4247 Ponderosa Av Suite E San Diego
4	Gamma Scientific	06	N	06-0374	00-A	8581 Aero Dr San Diego
4	Owens & Minor	06	N	06-0377	01-A	4000 Ruffin Rd Suite H San Diego
4	Datel Systems Inc	06	N	06-0379	00-A	5636 Ruffin Rd San Diego
4	Tu's printing Graphics	06	N	06-0382	02-A	5980 Fairmount Av Suite 104 San Diego

Active Permits Metrowide at Year End

Report run on: Monday, January, 3 2022 9:49 am

<i>Class</i>	<i>Name</i>	<i>Area</i>	<i>SIU</i>	<i>Facility</i>	<i>Permit</i>	<i>Address</i>
4	USN;Admiral Baker Field	06	N	06-0384	02-A	Admiral Baker Rd San Diego
4	Trader Publishing Company	06	N	06-0389	01-A	3883 Ruffin Rd San Diego
4	Deepsea Power & Light	06	N	06-0391	02-A	3855 Ruffin Rd San Diego
4	FBI Vehicle Maintenance Facility	06	N	06-0393	00-A	9799 Aero Dr San Diego
5	Enecotech Southwest Inc	06	N	06-0406	00-A	6160 Fairmount Av Suite A San Diego
4	Four Point Sheraton Hotel	06	N	06-0410	01-A	8110 Aero Dr San Diego
4	Saturn of Kearny Mesa	06	N	06-0413	01-A	4595 Convoy St San Diego
2	UT; SDSU Mission Valley Site Developm	06	Y	06-0414	03-A	9449 Friars Rd San Diego
2	UT; SDSU Mission Valley Site Developm	06	Y	06-0414	03-B	9449 Friars Rd San Diego
5	Sys Technologies	06	N	06-0420	03-A	5050 Murphy Canyon Rd Suite 120 San Diego
5	Advanced Scientific Supply	06	N	06-0423	01-A	5474 Complex Dr Suite 501 San Diego
4	Ultramar Inc	06	N	06-0424	01-A	5970 Santo Rd San Diego
3	City Water Pipeline Flush Approvals	06	N	06-0433	01-A	9192 Topaz Wy San Diego
4	Caliber Body Works Inc	06	N	06-0435	02-A	4307 Vandever Av San Diego
4	L3 Communications Telemetry-West	06	N	06-0452	03-A	9020 Balboa Av San Diego
4	James Berry DDS	06	N	06-0462	02-A	4540 Kearny Villa Rd Suite 116 San Diego
4	Med Premises	06	N	06-0465	02-A	8705 Complex Dr San Diego
4	Vetsmart Pet Hospital	06	N	06-0467	02-A	3396 Murphy Canyon Rd San Diego
4M	Joseph S Sparrow DDS	06	N	06-0476	03-A	3292 Sandrock Rd San Diego
4M	Paul Koepke DDS	06	N	06-0477	02-A	4926 La Cuenta Dr Suite 100 San Diego
4	Pet Hospital of Tierra Santa	06	N	06-0479	02-A	6030 Santo Rd Suite A San Diego
4M	Lillian Liberto DDS	06	N	06-0480	02-A	10789 Tierrasanta Bl Suite 110 San Diego
4M	Tierrasanta Plaza Dental	06	N	06-0482	02-A	10715 Tierrasanta Bl Suite C San Diego
4M	Thomas Doleski DDS	06	N	06-0489	02-A	9340 Clairemont Mesa Bl Suite C San Diego
4	Stadium Blue Water Inc	06	N	06-0500	02-A	10383 Friars Rd San Diego
5	Fracture Investigations	06	N	06-0501	01-A	4718 Renovo Wy San Diego
4C	Senior Aerospace Jet Products	06	N	06-0502	05-A	9106 Balboa Av San Diego
4C	Senior Aerospace Jet Products	06	N	06-0502	06-A	9106 Balboa Av San Diego
5	Abingdon Circuits	06	N	06-0503	01-A	4550 Kearny Villa Rd Suite 208 San Diego
4	San Diego Power Clean	06	N	06-0504	01-A	3883 Ruffin Rd San Diego
4	Plavan Petroleum Inc	06	N	06-0505	02-A	6220 Fairmount Av San Diego
4	Cabrillo PWR II LLC Kearny GT	06	N	06-0506	01-A	5459 Complex St San Diego
4	SFPP Mission Valley Terminal	06	N	06-0507	02-A	9950 San Diego Mission Rd San Diego
5	Advanced Micro Devices Inc	06	N	06-0514	01-A	9619 Chesapeake Dr San Diego
4	144th Minimal Care Detachment	06	N	06-0515	03-A	2400 Admiral Baker Rd San Diego
4	One Earth Recycling	06	N	06-0518	03-A	5980 Fairmount Av Suite 106 San Diego
2	VAS Engineering	06	N	06-0519	04-A	4750 Viewridge Av San Diego
4	American Medical Response	06	N	06-0522	01-A	8808 Balboa Av San Diego
4C	Hi Tech Honeycomb	06	N	06-0533	02-A	9355 Ruffin Ct San Diego
4C	Hi Tech Honeycomb	06	N	06-0533	03-A	9355 Ruffin Ct San Diego
4	Tampoprint International Corporation	06	N	06-0537	01-A	4990 Greencraig Ln Suite C San Diego
5	Four Square Productions Inc	06	N	06-0538	01-A	5205 Kearny Villa Wy San Diego
4	Scandinavian Aviation Academy	06	N	06-0541	01-A	8622 Gibbs Dr San Diego
4	Tricare Outpatient Clinic/Clairemont	06	N	06-0542	02-A	8808 Balboa Av San Diego
4	San Diego Screen Printing	06	N	06-0543	01-A	9550 Ridgehaven Ct San Diego

Active Permits Metrowide at Year End

Report run on: Monday, January, 3 2022 9:49 am

<i>Class</i>	<i>Name</i>	<i>Area</i>	<i>SIU</i>	<i>Facility</i>	<i>Permit</i>	<i>Address</i>
4	Mission Village 76	06	N	06-0544	01-A	3310 Ruffin Rd San Diego
4	Lawson Stamp Company	06	N	06-0545	01-A	5256 Kearny Villa Wy San Diego
4	Raytheon	06	N	06-0546	01-A	8680 Balboa Av San Diego
4	San Diego Precision Machining	06	N	06-0549	01-A	9375 Ruffin Ct San Diego
4	Fast Radiator Warehouse	06	N	06-0550	01-A	9520 Chesapeake Dr Suite 606 San Diego
4	Mactec Engineering & Consultants	06	N	06-0553	01-A	9177 Sky Park Ct San Diego
4	City; Metro Operations Center III	06	N	06-0554	01-A	9191 Kearny Villa Ct San Diego
4	Jack in the Box	06	N	06-0555	01-A	9357 Spectrum Center Bl San Diego
4	Chem Pro Laboratory Inc	06	N	06-0556	01-A	5450 Complex St Suite 313 San Diego
4	John's Automotive Care	06	N	06-0557	02-A	6267 Riverdale St San Diego
4	Auto-Chlor System	06	N	06-0559	02-A	4388 Vandever Av San Diego
4	Alliant International University	06	N	06-0560	01-A	10455 Pomerado Rd San Diego
4	Analytical Chemists Inc	06	N	06-0561	02-A	7551 Convoy Ct San Diego
4	Cut N Core	06	N	06-0562	01-A	9194 Chesapeake Dr San Diego
4	D Lux Cleaners	06	N	06-0565	01-A	9211 Clairemont Mesa Bl Unit 105 San Diego
5	National University	06	N	06-0567	01-A	3580 Aero Ct San Diego
3	Water Works Inc	06	N	06-0569	02-A	5490 Complex St Suite 602 San Diego
5	Jobsite Supply Co	06	N	06-0571	01-A	4720 Mission Gorge Pl San Diego
4	R G Electronics	06	N	06-0580	01-A	6055 Fairmount Av San Diego
4	FritoLay Inc	06	N	06-0581	01-A	4953 Paramount Dr San Diego
5	Bumblebee Tuna and Tenants	06	N	06-0582	01-A	9655 Granite Ridge Dr San Diego
5	Granite Gold	06	N	06-0589	01-A	3914 Murphy Canyon Rd San Diego
3	Johnson's Catering	06	N	06-0592	02-A	9341 Ruffin Ct San Diego
2	County of San Diego Operations Center	06	N	06-0594	02-A	5560 Overland Av Suite 410 San Diego
2	Statewide Stripes Inc	06	N	06-0596	02-A	7320 Mission Gorge Rd San Diego
4	Statewide Stripes Inc	06	N	06-0596	03-A	7320 Mission Gorge Rd San Diego
5	Direct EDI Inc	06	N	06-0598	01-A	4669 Murphy Canyon Rd San Diego
4	Guy C Sutton	06	N	06-0602	01-A	5075 Ruffin Rd Suite C San Diego
4M	Sutton Advanced Dentistry	06	N	06-0602	02-A	5075 Ruffin Rd Suite C San Diego
4	WICR	06	N	06-0603	01-A	9424 Chesapeake Dr Suite 1303 San Diego
4	Bocks Awards	06	N	06-0604	01-A	9285 Chesapeake Dr San Diego
4	Satechi	06	N	06-0605	01-A	5482 Complex St Suite 110 San Diego
5	Sun Coast Remodelers	06	N	06-0606	01-A	9163 Chesapeake Dr San Diego
4	Titanium USA	06	N	06-0607	01-A	5450 Complex St Suite 309 San Diego
4	Metal Master Inc	06	N	06-0608	01-A	4611 Overland Avenue San Diego
5	HART Energy	06	N	06-0609	01-A	8745 Aero Dr Unit 305 San Diego
5	Eastman Enterprises	06	N	06-0611	01-A	11360 Portobelo Dr Unit 1 San Diego
5	Ista North america	06	N	06-0612	01-A	4715 Viewridge Av Suite 100 San Diego
5	Nu Horizons electronics Corp	06	N	06-0613	01-A	6050 Santo Rd Unit 175 San Diego
4	David Browne Metal Design	06	N	06-0620	01-A	5841 Mission Gorge Rd Unit F San Diego
4	Sheet Metal Joint Apprenticeship Training	06	N	06-0621	01-A	4596 Mission Gorge Pl San Diego
5	Omnitron Biosciences	06	N	06-0623	01-A	3090 Admiral Av San Diego
2	Basile Construction Inc	06	N	06-0624	01-A	7952 Armour St San Diego
4	SKF Condition Monitoring Inc	06	N	06-0627	01-A	5271 Viewridge Ct San Diego
5	Panasonic Industrial Devices Sales Compæ	06	N	06-0628	01-A	4995 Murphy Canyon Rd Suite 105 San Diego

Active Permits Metrowide at Year End

Report run on: Monday, January, 3 2022 9:49 am

<i>Class</i>	<i>Name</i>	<i>Area</i>	<i>SIU</i>	<i>Facility</i>	<i>Permit</i>	<i>Address</i>
4	Vista Paint	06	N	06-0629	01-A	5700 Kearny Villa Rd San Diego
5	Maxwell Technologies Inc	06	N	06-0630	01-A	5271 Viewridge Ct Suite 100 San Diego
2	Enthalpy Analytical	06	N	06-0637	01-A	4340 Vandever Av San Diego
4	Bill Howe Plumbing	06	N	06-0640	01-A	9085 Aero Dr Suite B San Diego
5	CED San Diego	06	N	06-0642	01-A	5457 Ruffin Rd San Diego
4	Beacon Electric Supply	06	N	06-0643	01-A	9630 Chesapeake Dr San Diego
4	Main Electric Supply Co	06	N	06-0644	01-A	9540 Chesapeake Dr San Diego
5	Kamita International	06	N	06-0645	01-A	8755 Aero Dr San Diego
5	Elmag Inc	06	N	06-0646	01-A	5466 Complex St Suite 208 San Diego
4	San Diego Brewing Company	06	N	06-0651	01-A	10450 Friars Rd Suite L San Diego
4	Groundswell Brewing	06	N	06-0652	01-A	6304 Riverdale St San Diego
2	Tesla Inc	06	N	06-0658	01-A	3888 Calle Fortunada San Diego
2	Kaiser Permanente San Diego Medical Ce	06	N	06-0659	01-A	9455 Clairemont Mesa Bl San Diego
4M	David Toppi DMD dba Lil' Smiles	06	N	06-0660	01-A	10415 San Diego Mission Rd Suite A San Diego
4M	Tierrasanta Plaza Dental	06	N	06-0661	01-A	10715 Tierrasanta Bl Suite C San Diego
3	Carrillo and Sons Collision Center	06	N	06-0662	01-A	4680 Old Cliffs Rd San Diego
4M	Joesph Maldonado DDS	06	N	06-0663	01-A	10471 San Diego Mission Rd San Diego
4M	Southern California Veterinary Specialties	06	N	06-0664	01-A	5775 Chesapeake Ct San Diego
4M	Meester & Olafsen DDS Inc	06	N	06-0667	01-A	3444 Kearny Villa Rd Suite 406 San Diego
4M	Dr Toma & Dr Peters DDS	06	N	06-0668	01-A	3530 Camino Del Rio N Suite 109 San Diego
4M	Evelyn Ascough DDS	06	N	06-0669	01-A	8953 Complex Dr San Diego
4M	William Larson DMD	06	N	06-0670	01-A	3755 Murphy Canyon Rd Suite D San Diego
2	EnviroMatrix Analytical Inc	06	N	06-0671	01-A	9590 Chesapeake Dr Ste 5 San Diego
5	Orkin Pest Control	06	N	06-0672	01-A	3944 Murphy Canyon Rd Ste C103 San Diego
4M	Greyling Dental	06	N	06-0673	01-A	3289 Greyling Dr San Diego
4M	Robert Bey DDS	06	N	06-0674	01-A	8787 Complex Dr Suite 100 San Diego
4M	Tony G Chammas DMD	06	N	06-0675	01-A	7910 Frost St Suite 160 San Diego
4M	Murphy Canyon Dental Group	06	N	06-0676	01-A	5250 Murphy Canyon Rd Suite 122 San Diego
4M	Adiina Manolescu DDS INC	06	N	06-0677	01-A	6529 Misssion Gorge Rd San Diego
4M	Aesthetic Dental Pactice	06	N	06-0678	01-A	4242 Camino Del Rio N Suite 24 San Diego
4M	Poiset and Associates	06	N	06-0679	01-A	7930 Frost St Suite 101 San Diego
4M	Tierrasanta Dental Group	06	N	06-0680	01-A	10405 Tierrasanta Bl San Diego
4M	Grant McGann DDS	06	N	06-0681	01-A	7910 Frost St Suite 310 San Diego
4M	Dr. Zak San Diego Dental Care & Orthodc	06	N	06-0682	02-A	5625 Ruffin Rd Suite 200 San Diego
4M	Brighton Dental	06	N	06-0683	01-A	10450 Friars Rd Suite G San Diego
4M	San Ysidro Health Children's Dental Cent	06	N	06-0684	01-A	8110 Birmingham Dr Bldg 28 San Diego
4M	Island in the Hills Dentistry	06	N	06-0685	01-A	10850 Baroque Ln Suite C San Diego
2	City; Public Utilities EMTS: Alvarado Joi	07	N	07-0001	04-A	5530 Kiowa Dr La Mesa
2	City; Public Utilities EMTS: Alvarado Joi	07	N	07-0001	05-A	5530 Kiowa Dr La Mesa
2	Kaiser Foundation Hospital	07	N	07-0011	05-A	4647 Zion Av San Diego
2	Kaiser Foundation Hospital	07	N	07-0011	06-A	4647 Zion Av San Diego
4	Adventure 16 Inc	07	N	07-0018	00-A	4620 Alvarado Canyon Rd San Diego
4	California Neon Products	07	N	07-0028	01-A	4530 Mission Gorge Pl San Diego
4	Superior Ready Mix	07	N	07-0033	01-A	7188 Mission Gorge Rd San Diego
4	Flame-Spray Inc	07	N	07-0036	00-A	4674 Alvarado Canyon Rd San Diego

Active Permits Metrowide at Year End

Report run on: Monday, January, 3 2022 9:49 am

<i>Class</i>	<i>Name</i>	<i>Area</i>	<i>SIU</i>	<i>Facility</i>	<i>Permit</i>	<i>Address</i>
4	5915 Steel Inc	07	N	07-0038	01-A	5915 Mission Gorge Rd San Diego
4	Precision Optical Products	07	N	07-0052	01-A	4950 Waring Rd Suite 4 San Diego
2F	Western Press	07	N	07-0071	00-A	4401 Twain Av Suite 20 San Diego
4	European & American Car Serv	07	N	07-0092	00-A	4546 Zion Av San Diego
3	G&M Oil Company #178	07	N	07-0094	03-A	8815 Lake Murray Bl San Diego
4	Mission Village Auto Care	07	N	07-0095	01-A	6008 Mission Gorge Rd San Diego
2	Wholesale Automotive Machine Inc	07	N	07-0104	02-A	6347 Mission Gorge Rd San Diego
4	Mission Gorge Auto Repair	07	N	07-0112	01-A	5909 Mission Gorge Rd San Diego
4	Radiator Shop	07	N	07-0114	01-A	4428 Glacier Av San Diego
5	Bestway Cleaners	07	N	07-0116	01-A	8792 Navajo Rd San Diego
4M	Tuan Le DDS Inc	07	N	07-0125	02-A	6280 Jackson Dr 3 San Diego
4M	James H Thompson Dmd	07	N	07-0126	02-A	7424 Jackson Dr 3 San Diego
4M	Donald R Fleming DDS Inc	07	N	07-0127	02-A	7676 Jackson Dr San Diego
4M	Brite Smile Dental	07	N	07-0129	03-A	6280 Jackson Dr Suite 2 San Diego
4	Tahmasebi & Tash Dental Group	07	N	07-0129	02-A	6280 Jackson Dr Suite 2 San Diego
4M	Guy Fox DDS & Amy Fox DDS	07	N	07-0130	02-A	8312 Lake Murray Bl Suite E San Diego
4	Rite Aid # 5656	07	N	07-0148	02-A	8702 Lake Murray Bl San Diego
2	BJ's Rentals Inc	07	N	07-0152	03-A	7585 Mission Gorge Rd San Diego
3	Sunbelt Rentals Inc	07	N	07-0152	04-A	7585 Mission Gorge Rd San Diego
5	Metallurgical Inspection Tech	07	N	07-0153	01-A	4678 Alvarado Canyon Rd San Diego
5	San Diego Boat Movers	07	N	07-0158	01-A	6996 Mission Gorge Rd Suite A San Diego
4	Qualtech Auto Collision & Repair Center	07	N	07-0159	01-A	5835 Mission Gorge Rd Suite A San Diego
4	Toyota San Diego	07	N	07-0161	01-A	5910 Mission Gorge Rd San Diego
4	Del Cerro Chevron	07	N	07-0164	01-A	6301 Del Cerro Bl San Diego
4	Ashley A Goodman DDS	07	N	07-0166	02-A	8736 Lake Murray Bl Suite 108 San Diego
4M	Navajo Estrella Dental	07	N	07-0166	03-A	8736 Lake Murray Bl Suite 108 San Diego
2	UT; Thrifty Oil Company # 419	07	N	07-0171	07-A	8787 Lake Murray Bl San Diego
4	Nicholas N Gadler DDS Inc	07	N	07-0176	01-A	6386 Alvarado Ct Suite 110 San Diego
4M	Mission Dental Center	07	N	07-0177	02-A	5995 Mission Gorge Rd Suite A San Diego
4	Borrego Chiropractic	07	N	07-0178	01-A	5995 Mission Gorge Suite B San Diego
4	Superior Pool Products LLC	07	N	07-0184	01-A	4737 Old Cliffs Rd San Diego
4	Oscar's Auto Services	07	N	07-0189	01-A	5837 Mission Gorge Rd Suite B San Diego
2	Biotone	07	N	07-0192	01-A	4757 Old Cliffs Rd San Diego
4	The Cider House dba Poochie's Hooch Url	07	N	07-0198	01-A	7559 Mission Gorge Rd San Diego
5	Lucent Hair Studio	07	N	07-0200	01-A	7403 Princess View Dr Suite A San Diego
4M	Alvarado Dental Group	07	N	07-0201	01-A	6475 Alvarado Rd Suite 205 San Diego
4M	Marcel Bougher DDS	07	N	07-0202	01-A	6280 Jackson Dr Suite 1 San Diego
4M	Jonathan Haynie DDS Inc	07	N	07-0203	01-A	6616 Mission Gorge Rd San Diego
4M	Douglas M Grosmark DMD Inc	07	N	07-0204	01-A	6398 Del Cerro Bl Suite 1 San Diego
4M	Dental Expressions	07	N	07-0205	01-A	8505 Navajo Rd San Diego
4M	Pokala Chawla Dental Partnership	07	N	07-0206	01-A	7189 Navajo Rd Suite A San Diego
4M	Mission Trails Dentistry	07	N	07-0207	01-A	6902 Navajo Rd San Diego
4M	Alex Corondoni DDS	07	N	07-0208	01-A	7424 Jackson Dr Suite 2 San Diego
4M	Hamid Kheradmand DDS	07	N	07-0209	01-A	7424 Jackson Dr Suite 9 San Diego
4M	Mission Gorge Family & Cosmetic Dentis	07	N	07-0210	01-A	7451 Mission Gorge Rd San Diego

Active Permits Metrowide at Year End

Report run on: Monday, January, 3 2022 9:49 am

<i>Class</i>	<i>Name</i>	<i>Area</i>	<i>SIU</i>	<i>Facility</i>	<i>Permit</i>	<i>Address</i>
4M	Dental Group San Diego	07	N	07-0211	01-A	7187 Navajo Rd Suite A San Diego
5	Carrillo and Sons Collision Center	07	N	07-0215	01-A	5805 Mission Gorge Rd Suite A San Diego
4	American Airlines	08	N	08-0004	04-A	2330 Stillwater Rd San Diego
2	UT; USN NBPL Defense Fuel Support Po	08	Y	08-0008	07-A	199 Rosecrans St San Diego
2	USN;Naval Base Point Loma	08	N	08-0009	07-A	140 Sylvester Rd San Diego
2C	USN;Naval Base Point Loma	08	N	08-0009	08-A	140 Sylvester Rd San Diego
4	The Auto Scrubber	08	N	08-0011	01-A	3405 Rosecrans St San Diego
4	USN;Fleet Anti-sub Warfare Training Cer	08	N	08-0014	01-A	32444 Echo Ln San Diego
4	USN;Third Fleet Complex	08	N	08-0015	01-A	200 Catalina Bl San Diego
2	USN;Marine Corps Recruit Depot	08	N	08-0016	05-A	4600 Belleau Av Bldg 224 San Diego
2	USN;Marine Corps Recruit Depot	08	N	08-0016	06-A	4600 Belleau Av Bldg 224 San Diego
2	USN;Marine Corps Recruit Depot	08	N	08-0016	06-B	4600 Belleau Av Bldg 224 San Diego
2C	USN;Naval Information Warfare Center P	08	N	08-0017	06-A	53560 Hull St San Diego
2	USN;Space & Naval Warfare Systems Cei	08	N	08-0017	05-A	53560 Hull St San Diego
1	USN;Naval Base Coronado - NASNI	08	Y	08-0018	07-A	NAS North Island San Diego
4C	USN; Naval Base Point Loma Old Town C	08	N	08-0019	07-A	4297 Pacific Hy San Diego
4C	USN;Naval Information Warfare Center P	08	N	08-0019	06-A	4297 Pacific Hy San Diego
4	Don's Speed Center Inc	08	N	08-0020	01-A	3303 Hancock St San Diego
4	Sunset Garage	08	N	08-0024	01-A	1946 Bacon St San Diego
4	Nations Rent	08	N	08-0035	02-A	3860 Sherman St San Diego
4	Point Loma Nazarene University	08	N	08-0042	02-A	3900 Lomaland Dr San Diego
2	Point Loma Nazarene University	08	N	08-0042	03-A	3900 Lomaland Dr San Diego
4	Sharp Cabrillo Hospital	08	N	08-0046	03-A	3475 Kenyon St San Diego
4	Neyenesch Printers Inc	08	N	08-0047	02-A	2750 Kettner Bl San Diego
3	Genie Car Wash	08	N	08-0059	03-A	3949 W Point Loma Bl San Diego
4	Belmont Laundry	08	N	08-0061	01-A	4955 Pacific Hy San Diego
4	DK Conde Wood	08	N	08-0080	01-A	3430 Hancock St San Diego
4	Old Town Trolley Tours	08	N	08-0124	00-A	2115 Kurtz St San Diego
4	North Sails	08	N	08-0145	00-A	1111 Anchorage Ln San Diego
4	Pearson's Marine Fuel	08	N	08-0148	01-A	2435 Shelter Island Dr San Diego
4	Cabrillo Enterprises Inc DBA RW Little C	08	N	08-0155	01-A	3923 Pacific Hy San Diego
4	West City Center	08	N	08-0207	01-A	3249 Fordham St San Diego
4	Stonehedge Leather Company	08	N	08-0212	00-A	1967 Abbott St San Diego
4	Sea World Graphic Arts Dept	08	N	08-0223	01-A	3505 Hancock St San Diego
4	Invensys	08	N	08-0228	01-A	2727 Kurtz St San Diego
4	United States Postal Service	08	N	08-0239	01-A	2535 Midway Dr San Diego
3	Safe Harbor Shelter Island	08	N	08-0247	02-B	2330 Shelter Island Dr Suite 1 San Diego
2	Shelter Island Boatyard	08	N	08-0247	01-A	2330 Shelter Island Dr Suite 1 San Diego
3	Shelter Island Boatyard	08	N	08-0247	02-A	2330 Shelter Island Dr Suite 1 San Diego
4	Best Western Posada Inn	08	N	08-0256	00-A	5005 N Harbor Dr San Diego
4	Viscount Hotel	08	N	08-0260	00-A	1960 Harbor Island Dr San Diego
4	Sunset Cliffs Animal Hospital	08	N	08-0262	01-A	4741 Point Loma Av San Diego
4	Red & Blue Inc	08	N	08-0283	01-A	2727 Kettner Bl San Diego
4	Alamo Rent A Car Inc	08	N	08-0284	02-A	2942 Kettner Bl San Diego
2	Nielsen Beaumont Marine	08	N	08-0290	00-A	2420 Shelter Island Dr San Diego

Active Permits Metrowide at Year End

Report run on: Monday, January, 3 2022 9:49 am

<i>Class</i>	<i>Name</i>	<i>Area</i>	<i>SIU</i>	<i>Facility</i>	<i>Permit</i>	<i>Address</i>
3	Nielsen Beaumont Marine	08	N	08-0290	01-A	2420 Shelter Island Dr San Diego
4	Holiday Inn / Mission Bay & Sea World	08	N	08-0293	01-A	3737 Sports Arena Bl San Diego
2Z	US Coast Guard	08	N	08-0304	04-A	2710 N Harbor Dr San Diego
2Z	US Coast Guard	08	N	08-0304	05-A	2710 N Harbor Dr San Diego
4	NRC Environmental Services Inc	08	N	08-0321	01-A	2950 Kurtz St San Diego
4	Hans Foreign Car Service	08	N	08-0322	01-A	4306 Pacific Hy San Diego
4	Midway Express Car Wash	08	N	08-0326	02-A	3460 Midway Dr San Diego
4	Holiday Inn / San Diego Bayside	08	N	08-0332	00-B	4875 N Harbor Dr San Diego
4	Gray Line San Diego	08	N	08-0336	01-A	3442 Sutherland St San Diego
4	James Gang Graphics Inc	08	N	08-0346	01-A	1931 Bacon St San Diego
4	City; Point Loma Chemistry Lab	08	N	08-0348	01-A	1902 Gatchell Rd San Diego
2	City; Point Loma Chemistry Lab	08	N	08-0348	02-A	1902 Gatchell Rd San Diego
2	County of San Diego Public Health Lab	08	N	08-0358	01-A	3851 Rosecrans St Suite 716 San Diego
2	County of San Diego Public Health Lab	08	N	08-0358	02-A	3851 Rosecrans St Suite 716 San Diego
4	In Design Inc	08	N	08-0362	01-A	2163 Hancock St San Diego
4	San Diego Transmission	08	N	08-0365	01-A	3777 Gaines St San Diego
4	Modern Printing & Mailing Inc	08	N	08-0367	02-A	3535 Enterprise St San Diego
4	Oil Max 10 Minute Oil Change	08	N	08-0371	00-A	3464 Midway Dr San Diego
4	City; Marine Biology Lab	08	N	08-0376	00-A	4918 N Harbor Dr San Diego
4	Chrome	08	N	08-0384	02-A	2345 Kettner Bl Suite B San Diego
2	San Diego County Regional Airport Authc	08	N	08-0385	01-A	3225 N Harbor Dr San Diego
2	San Diego County Regional Airport Authc	08	N	08-0385	02-A	3225 N Harbor Dr San Diego
2	Aircraft Service Internationl dba Menzies	08	N	08-0390	04-A	2340 Stillwater Rd San Diego
4	M & A Graphics	08	N	08-0397	01-A	3035 Moore St Suite B San Diego
3	The Hertz Corporation	08	N	08-0398	02-A	3202 N Harbor Dr San Diego
4	Jaguar Auto Repair	08	N	08-0400	01-A	3770 Hancock St San Diego
5	Brown Bag Deli	08	N	08-0401	01-A	1912 Rosecrans St San Diego
4	Sheraton San Diego Hotel & Marina	08	N	08-0402	01-A	1380 Harbor Island Dr San Diego
4	National Car Rental System	08	N	08-0412	02-A	3280 N Harbor Dr San Diego
2	Driscoll Boat Works	08	N	08-0414	01-A	2500 Shelter Island Dr San Diego
4	Two Men Will Move You	08	N	08-0417	01-A	3571 Pacific Hy San Diego
4	Avis Rent A Car System Inc	08	N	08-0418	01-A	3180 N Harbor Dr San Diego
4	Ewing & Holly DDS	08	N	08-0420	02-A	3340 Kemper St San Diego
4	Richard C Richley	08	N	08-0422	02-A	3434 Midway Dr 2007 San Diego
4	Sharp Rees Stealy Med Group	08	N	08-0423	02-A	3555 Kenyon St San Diego
4	Sea Breeze Cleaners	08	N	08-0424	01-A	3555 Rosecrans St San Diego
4	Palomar Cleaners	08	N	08-0426	03-A	4013 W Point Loma Bl San Diego
4	USN;Naval Exc Auto Service Center	08	N	08-0428	01-A	Rosecrans & Nimitz Av San Diego
4	Practical Cleaners	08	N	08-0431	02-A	3810 Rosecrans St San Diego
4	Carvana	08	N	08-0435	04-A	1691 Hancock St San Diego
4M	Pablo Liciaga DDS	08	N	08-0441	03-A	2115 Bacon St San Diego
4M	MICHELLE YAMADA DDS	08	N	08-0442	02-A	1802 Cable St San Diego
4M	Fleming S Lee DDS	08	N	08-0445	03-A	1857 Cable St San Diego
4	Philip Scott McMahan DDS Inc	08	N	08-0452	02-A	1829 Sunset Cliffs Bl Suite 3108 San Diego
4M	Mark A Kretz DDS	08	N	08-0456	02-A	1775 Locust St San Diego

Active Permits Metrowide at Year End

Report run on: Monday, January, 3 2022 9:49 am

<i>Class</i>	<i>Name</i>	<i>Area</i>	<i>SIU</i>	<i>Facility</i>	<i>Permit</i>	<i>Address</i>
4M	Ocean Beach Dental	08	N	08-0461	02-A	2176 Sunset Cliffs Bl San Diego
4M	Seaside Dentistry	08	N	08-0462	02-A	1499 Sunset Cliffs Bl San Diego
4M	Marc N Reis DDS	08	N	08-0466	02-A	4606 Voltaire St San Diego
4	Whitlock-Williams Med Group	08	N	08-0478	01-A	3405 Kenyon St Suite 210 San Diego
4	Richard Fassett & Joseph Allen MD Inc	08	N	08-0485	02-A	4116 Point Loma Bl San Diego
4	Allied Aviation	08	N	08-0489	02-A	3698 Pacific Highway St Unit C San Diego
2	USN;Naval Amphibious Base Coronado	08	N	08-0490	05-A	3420 Guadalcanal Rd Bldg 104 San Diego
4	Powerstride Battery	08	N	08-0491	02-A	3450 Kurtz St Suite B San Diego
4	Budget Rent-A-Car	08	N	08-0492	04-A	3125 Pacific Hy San Diego
2	BJ's Rentals Inc	08	N	08-0494	03-A	3959 Pacific Hy San Diego
3	Sunbelt Rentals Inc	08	N	08-0494	04-A	3959 Pacific Hy San Diego
4	Williams Form Engineering Corp	08	N	08-0498	03-A	3468 Hancock St San Diego
4	Caliber Collision Center	08	N	08-0500	03-A	1411 W Palm St San Diego
4	Sun Diego Charter Company	08	N	08-0501	01-A	3610 Hancock St Suite 205 San Diego
5	Chris Wimpey Studio	08	N	08-0502	01-A	1612 W Lewis St San Diego
4	Lockheed Martin Marine Systems	08	N	08-0506	01-A	1160 Harbor Island Dr San Diego
4	Harbor Aero Tech Center	08	N	08-0507	01-A	2701 N Harbor Dr San Diego
4	Sutherland Enterprises	08	N	08-0511	01-A	2175 Hancock St San Diego
4	Patina Finishes and Copper Coats	08	N	08-0512	01-A	2785 Kurtz St Suite 8 San Diego
4	Rush Press Inc	08	N	08-0513	02-A	3553 California St San Diego
4	Cement Cutting Inc	08	N	08-0514	01-A	3610 Hancock St San Diego
4M	David DeRosier DDS	08	N	08-0523	03-A	3019 Emerson St San Diego
2	City; Public Utilities EMTS Lab at NTC	08	N	08-0525	03-A	2392 Kincaid Rd San Diego
5	Cloud 9 Shuttle	08	N	08-0527	01-A	3520 Kurtz St San Diego
2	SDSU Research Foundation	08	N	08-0528	01-A	4165 Spruance Rd Suite 100 San Diego
5	Accurate Auto Body & Paint	08	N	08-0531	01-A	3571 Hancock St San Diego
4	Yellow Cab of San Diego Inc	08	N	08-0539	01-A	3473 Kurtz St San Diego
4M	Dr Scott Becker DDS	08	N	08-0543	02-A	3046 Avenida de Portugal San Diego
3	Rosecrans Car Wash	08	N	08-0554	01-A	3768 Rosecrans St San Diego
4	Target # 201	08	N	08-0557	01-A	3245 Sports Arena Bl San Diego
4	Cable Street Family Practice & Internal M	08	N	08-0569	01-A	1933 Cable St San Diego
4	Loma Laundryland	08	N	08-0570	01-A	3780 Voltaire St San Diego
4	Midway Coin Laundry	08	N	08-0572	01-A	3185 Midway Dr Suite B San Diego
4	Advanced Glass	08	N	08-0581	01-A	2183 Bacon St San Diego
3	Wash-N-Go Carwash	08	N	08-0593	01-A	3342 Rosecrans St San Diego
4	SeaBotix Inc	08	N	08-0597	01-A	2869 Historic Decatur rd San Diego
2	UT; Granite Construction Company	08	Y	08-0600	06-B	3225 N Harbor Dr San Diego
3	Modern Times Beer	08	N	08-0602	01-A	3725 Greenwood St San Diego
3	Conrac Managers SAN LLC	08	Y	08-0603	01-A	3355 Admiral Boland Wy San Diego
4	Stone Brewing Liberty Station	08	N	08-0610	01-A	2816 Historic Decatur Rd Suite 116 San Diego
5	Fix Auto Sports Arena	08	N	08-0612	01-A	3145 Moore St San Diego
5	Amazon Prime Now	08	N	08-0615	01-A	2727 Kurtz St San Diego
5	Chevron #92239	08	N	08-0616	01-A	2959 Midway Dr San Diego
4	Chevron #92239	08	N	08-0616	02-A	2959 Midway Dr San Diego
4M	Point Loma Dental Group	08	N	08-0619	01-A	1050 Rosecrans St Suite J San Diego

Active Permits Metrowide at Year End

Report run on: Monday, January, 3 2022 9:49 am

<i>Class</i>	<i>Name</i>	<i>Area</i>	<i>SIU</i>	<i>Facility</i>	<i>Permit</i>	<i>Address</i>
4	Fix Auto Sports Arena	08	N	08-0621	01-A	3101 Moore St San Diego
4M	Dr Edithann Graham DMD	08	N	08-0622	01-A	1806 Cable St San Diego
4M	ASW Dental	08	N	08-0623	01-A	32389 Echo Ln Bldg 10 San Diego
4M	Point Loma Children's Dentistry	08	N	08-0624	01-A	2445 Truxtun Rd Suite 106 San Diego
4M	Louis Paulerio DDS	08	N	08-0625	01-A	1635 Rosecrans St Suite A San Diego
4M	Sunset Cliffs Dental	08	N	08-0626	01-A	1829 Sunset Cliffs Bl San Diego
4M	Lighthouse Dental	08	N	08-0627	01-A	3625 Midway Dr Suite A San Diego
4M	McLaughlin & Upatham DDS	08	N	08-0628	01-A	2445 Truxtun Rd Suite 104 San Diego
4M	Xceptional Dental	08	N	08-0629	01-A	2044 Chatsworth Bl San Diego
4M	Omni Dental	08	N	08-0630	01-A	2535 Truxtun Rd Suite 200 San Diego
4M	Richard Dwing DDS	08	N	08-0631	01-A	3340 Kemper St Suite 201 San Diego
4M	Peninsala Dental	08	N	08-0633	01-A	1537 Rosecrans St Suite C San Diego
4M	Dental Express	08	N	08-0634	01-A	4110 W Point Loma Bl San Diego
4M	NMRTU MCRD San Diego Dental Clinic	08	N	08-0635	01-A	43000 Midway Av Bldg 595 San Diego
4M	Park Dental Arts	08	N	08-0636	01-A	2312 6th Av San Diego
4M	Downtown SD Modern Dentistry Dental C	08	N	08-0637	01-A	435 4th Av San Diego
4M	Keri Silva DDS, Inc.	08	N	08-0640	02-A	814 Morena Bl Suite 202 San Diego
4M	Michael G McMahon DDS PDC	08	N	08-0641	01-A	3405 Kenyon St Suite 510 San Diego
4	Business Assessment	08	N	08-0645	01-A	2955 N Harbor Dr Bldg 1302 San Diego
4M	USN; Naval Base Coronado - NASNI	08	N	08-0646	01-A	NAS North Island San Diego
3	UT; Burns & McDonnell	08	Y	08-0649	01-A	2246 W Washington St San Diego
4M	USN;Naval Amphibious Base Branch Der	08	N	08-0657	01-A	3538 Bougainville Rd Bldg 506 San Diego
2	UT; San Diego Int'l Airport Shuttle Lot	08	Y	08-0659	01-A	2535 Pacific Hy San Diego
3	AlSCO Inc	09	Y	09-0001	07-A	705 W Grape St San Diego
4	NRG Energy Center of San Diego	09	N	09-0007	01-A	901 Kettner Bl San Diego
2	USN;Naval Medical Center San Diego	09	N	09-0009	06-A	34800 Bob Wilson Dr San Diego
2	UC San Diego Health	09	N	09-0012	04-A	200 W Arbor Dr San Diego
2	UCSD Medical Center	09	N	09-0012	03-A	200 W Arbor Dr San Diego
4	Body Beautiful Car Wash	09	N	09-0016	02-A	2045 Pacific Hy San Diego
2Z	Solar Turbines Inc	09	N	09-0023	05-A	2200 Pacific Hy San Diego
5	The Link Apartments	09	N	09-0025	04-A	707 17th St San Diego
2F	Center City Printing	09	N	09-0028	02-A	1031 14th St San Diego
4	Unilab San Diego Laboratory	09	N	09-0029	00-A	550 Washington St Suite 101 San Diego
2	SDCCD; City College	09	N	09-0041	02-A	1313 Park Bl San Diego
2	SDCCD; City College	09	N	09-0041	03-A	1313 Park Bl San Diego
4	SDCCD; General Service/Maintenance	09	N	09-0043	00-A	1536 Murray Canyon Rd San Diego
4	San Diego Newslne	09	N	09-0046	01-A	3609 4th Av San Diego
2	Zoological Society of San Diego	09	N	09-0048	01-A	2920 Zoo Dr San Diego
2	Zoological Society of San Diego	09	Y	09-0048	02-A	2920 Zoo Dr San Diego
4	Rover Printers	09	N	09-0050	00-A	2135 Columbia St San Diego
4	Business Assessment	09	N	09-0052	02-A	2001 4th Av San Diego
4	Progressive Engravings Inc	09	N	09-0056	02-A	743 9th Av San Diego
4	City; Equipment Div - 20th & B	09	N	09-0107	01-A	1970 B St San Diego
4	Holiday Inn Harbor View	09	N	09-0121	00-A	1617 1st Av San Diego
4	Cal West Awards	09	N	09-0152	01-A	4451 30th St San Diego

Active Permits Metrowide at Year End

Report run on: Monday, January, 3 2022 9:49 am

<i>Class</i>	<i>Name</i>	<i>Area</i>	<i>SIU</i>	<i>Facility</i>	<i>Permit</i>	<i>Address</i>
4	Glenbar Lithographers	09	N	09-0186	02-A	3240 F St San Diego
4	Bayside Rehabilitation & Care	09	N	09-0194	01-A	3520 4th Av San Diego
4	Solunto Baking Company	09	N	09-0206	00-A	1643 India St San Diego
4	Mohr Manufacturing Inc	09	N	09-0231	01-A	3386 Sunrise St San Diego
5	Trang Sewing	09	N	09-0252	01-A	2935 El Cajon Bl San Diego
4	Westech Metal Fabrication Inc	09	N	09-0261	01-A	3420 E St San Diego
4	Cecil's House of Photography	09	N	09-0280	01-A	1337 India St San Diego
2F	George's Camera/Video Exchange	09	N	09-0282	01-A	3837 30th St San Diego
4	Brewery at the Top of the Mountain dba F	09	N	09-0324	01-A	4542 30th St San Diego
4	Best Western Columbia Hotel	09	N	09-0335	00-A	555 W Ash St San Diego
4	SBC Pacific Bell	09	N	09-0356	02-A	3855 Ash St San Diego
5	Casa de Martinez Mexican Restaurant	09	N	09-0388	01-A	3930 30th St San Diego
4	Sempre Energy Corporate Headquarters	09	N	09-0391	02-A	101 Ash St San Diego
4	City; Police Dept Auto Maintenace Facilit	09	N	09-0395	02-A	330 12th Av San Diego
4	Mayer Reprographics	09	N	09-0413	02-A	1065 University Av San Diego
4	Wetmores	09	N	09-0423	00-A	455 16th St San Diego
4	Quality Care Service Center	09	N	09-0425	01-A	1454 Union St San Diego
4	Thao's Auto Repair	09	N	09-0428	02-A	3752 Park Bl San Diego
4	San Diego Gas & Electric - Metro C & O	09	N	09-0431	05-A	701 33rd St San Diego
4	Mission Hills Automotive	09	N	09-0432	00-A	308 W Washington St San Diego
5	Tucker Sadler Noble Castro Architects	09	N	09-0434	00-A	2411 2nd Av San Diego
4	Fresenius Medical Care of Hillcrest	09	N	09-0441	00-A	3960 3rd Av San Diego
4	Thrifty Car Rental	09	N	09-0442	00-A	1600 Kettner Bl San Diego
4	West Coast Rent-A-Car	09	N	09-0456	00-A	834 W Grape St San Diego
4	Radio Cab Company	09	N	09-0458	02-A	2504 C St San Diego
4	Marvin K Brown Cadillac	09	N	09-0463	00-A	1441 Camino Del Rio S San Diego
4	InnSuites Hotels San Diego Balboa Park R	09	N	09-0470	01-A	2223 El Cajon Bl San Diego
4	Comfort Inn and Suites	09	N	09-0471	01-A	2201 Hotel Circle S San Diego
4	Days Inn	09	N	09-0472	01-A	543 Hotel Circle S San Diego
4	Clarke's Flamingo Lodge	09	N	09-0473	00-A	1765 Union St San Diego
4	Hotel San Diego	09	N	09-0474	00-A	339 W Broadway San Diego
4	Westin Hotel	09	N	09-0475	00-A	910 Broadway Cr San Diego
4	Padre Trails Inn	09	N	09-0476	00-A	4200 Taylor St San Diego
4	Regency Plaza Hotel	09	N	09-0477	00-A	1515 Hotel Circle S San Diego
4	Ramada Inn	09	N	09-0478	00-A	2151 Hotel Circle S San Diego
4	Vagabond Inn	09	N	09-0479	00-A	625 Hotel Circle S San Diego
4	Holiday Inn Mission Valley	09	N	09-0480	01-A	595 Hotel Circle S San Diego
4	Best Western Seven Seas Lodge	09	N	09-0482	00-A	411 Hotel Circle S San Diego
4	Radiology Medical Group	09	N	09-0497	02-A	2466 1st Av San Diego
4	Holiday Inn Embarcadero	09	N	09-0501	00-A	1355 N Harbor Dr San Diego
4	New Life Laundry	09	N	09-0512	00-A	3829 Granada Av San Diego
4	Darby's Paint & Auto Body	09	N	09-0513	01-A	2624 Adams Av San Diego
4	Loftin Business Forms Inc	09	N	09-0526	01-A	789 Gateway Center Wy San Diego
5	San Diego Blood Bank	09	N	09-0527	04-A	3636 Gateway Center Av San Diego
4	Caliber Collision Center	09	N	09-0546	02-A	2119 Kettner Bl San Diego

Active Permits Metrowide at Year End

Report run on: Monday, January, 3 2022 9:49 am

<i>Class</i>	<i>Name</i>	<i>Area</i>	<i>SIU</i>	<i>Facility</i>	<i>Permit</i>	<i>Address</i>
4	Pacific Inn Hotel and Suites	09	N	09-0550	01-A	1655 Pacific Hy San Diego
4	Howard Johnson	09	N	09-0566	00-A	1631 Hotel Circle S San Diego
4	Mr Fred's Car Care Center	09	N	09-0587	00-A	830 25th St San Diego
4	Guy Matthews Garage	09	N	09-0593	02-A	1011 Fort Stockton Dr San Diego
4	Old Columbia Brewery & Grill	09	N	09-0604	01-A	1157 Columbia St San Diego
4	Fumari, Inc.	09	N	09-0605	01-A	675 Gateway Center Dr San Diego
4	Mountain High Knitting	09	N	09-0605	00-A	675 Gateway Center Dr San Diego
2	City; Police Department Headquarters	09	N	09-0607	03-A	1401 Broadway San Diego
2Z	City; Police Department Headquarters	09	N	09-0607	04-A	1401 Broadway San Diego
4	Parking Company of America	09	N	09-0613	00-A	1300 State St San Diego
4	Uptown Car Wash	09	N	09-0615	00-A	4157 Normal St San Diego
3	Uptown Car Wash	09	N	09-0615	01-A	4157 Normal St San Diego
4	The Globe Theatres	09	N	09-0621	01-A	1363 Old Globe Wy San Diego
4	Pep Boys # 610	09	N	09-0624	02-A	1002 E Market St San Diego
4	Comfort Inn Airport Old Town	09	N	09-0626	00-A	1955 San Diego Av San Diego
4	West Park Inn	09	N	09-0627	01-A	1840 4th Av San Diego
4	Radisson Hotel San Diego	09	N	09-0628	00-A	1433 Camino Del Rio S San Diego
4	Sports & Classics	09	N	09-0634	02-A	2867 El Cajon Bl San Diego
4	Radisson Hotel Harbor View	09	N	09-0641	00-A	1646 Front St San Diego
4	A-1 Broadway Foto	09	N	09-0656	02-A	148 W Broadway San Diego
4	Pan Pacific Hotel	09	N	09-0667	00-A	400 W Broadway San Diego
4	1st Avenue European	09	N	09-0672	01-A	2210 1st Av San Diego
4	Britannia Motors Inc	09	N	09-0672	00-A	2210 1st Av San Diego
4	Pyramid Biological Corporation	09	N	09-0682	01-A	2850 6th Av Suite 111 San Diego
4	In House Photo	09	N	09-0683	03-A	2327 Kettner Bl San Diego
4	Kindred Hospital of San Diego	09	N	09-0688	03-A	1940 El Cajon Bl San Diego
4	Esc Reprographics	09	N	09-0700	02-A	1200 4th Av San Diego
5	Dawn Media	09	N	09-0706	01-A	2801 4th Av San Diego
4	Ladki Car Rental	09	N	09-0708	01-A	929 W Laurel St San Diego
4	Johanson Dielectric Inc	09	N	09-0710	03-A	823 Gateway Center Wy San Diego
4	Enterprise Rent A Car	09	N	09-0711	01-A	1465 C St San Diego
4	Prestige Motors	09	N	09-0714	01-A	3241 India St San Diego
4	Henry's Radiator and Auto Rep	09	N	09-0715	01-A	3035 El Cajon Bl San Diego
4	North Park Auto Repair and Rad	09	N	09-0716	01-A	4194 30th St San Diego
4M	Center for Dental Restorations	09	N	09-0720	02-A	4033 3rd Av Suite 300 San Diego
4M	Xuan Lan	09	N	09-0738	04-A	3823 8th Av San Diego
4	Dynobrand Custom Silkscreening	09	N	09-0740	02-A	3367 India St San Diego
4	UCSD Medical Group	09	N	09-0741	02-A	330 Lewis St San Diego
4	SDUSD; Print Services	09	N	09-0742	02-A	4100 Normal St San Diego
4M	Dr Jeffrey S Keeny DDS	09	N	09-0744	02-A	1807 Robinson Av Suite 101 San Diego
4M	Rancho Dental	09	N	09-0747	02-A	1442 University Av San Diego
4M	Park West Dental Group	09	N	09-0748	02-A	315 Walnut Av San Diego
4	Beauty & Body Lounge	09	N	09-0750	02-A	1450 Washington St San Diego
4M	Rober A Alder DDS	09	N	09-0752	02-A	920 Washington Av San Diego
4	Knightly Chiropractic Inc	09	N	09-0755	03-A	3627 30th St San Diego

Active Permits Metrowide at Year End

Report run on: Monday, January, 3 2022 9:49 am

<i>Class</i>	<i>Name</i>	<i>Area</i>	<i>SIU</i>	<i>Facility</i>	<i>Permit</i>	<i>Address</i>
4M	Dean Nguyen DDS	09	N	09-0756	03-A	4082 30th St San Diego
4	Print Systems Inc	09	N	09-0762	02-A	625 B St San Diego
4M	David Duguid DDS	09	N	09-0765	02-A	230 W G St Suite H San Diego
4	Ritz Camera and Image # 941	09	N	09-0766	02-A	27 Horton Plaza San Diego
4M	Dr David C Adams DDS	09	N	09-0768	02-A	239 Laurel St Suite 201 San Diego
2F	County Administration Center	09	N	09-0770	01-A	1600 Pacific Hy Room 402 San Diego
4	SDUSD; San Diego High School	09	N	09-0771	02-A	1405 Park Bl San Diego
4M	San Diego Childrens Dental Health Center	09	N	09-0772	02-A	1270 24th St San Diego
4	Internal Medicine Associates	09	N	09-0782	02-A	3260 3rd Av San Diego
4	Hillcrest Periodontal Health & Dental Imp	09	N	09-0788	02-A	3570 4th Av San Diego
4M	Demko Brockett Dental	09	N	09-0789	02-A	2654 4th Av San Diego
4M	Uptown Dental Office	09	N	09-0790	02-A	3315 4th Av San Diego
4	Uptown Dental Designs	09	N	09-0792	02-A	3703 4th Av San Diego
4	Russell Okihara DMD Inc	09	N	09-0793	03-A	3565 4th Av San Diego
4	MA Zirpolo Inc	09	N	09-0797	02-A	1855 1st Av Suite 102 San Diego
4M	David Donnelly DDS	09	N	09-0799	03-A	2445 2nd Av San Diego
4M	Cathleen A Silliman DDS	09	N	09-0805	03-A	2322 6th Av San Diego
4	Larry W Blenis DC	09	N	09-0816	02-A	3019 Polk Av San Diego
5	San Diego Hardware	09	N	09-0818	01-A	840 5th Av San Diego
2	Scripps Mercy Hospital	09	N	09-0825	02-A	4077 5th Av San Diego
2	Scripps Mercy Hospital	09	N	09-0825	03-A	4077 5th Av San Diego
4	Southern Auto Supply/Car Quest	09	N	09-0827	01-A	4575 30th St San Diego
4	Presidio Hills Golf Course	09	N	09-0831	01-A	4136 Wallace St San Diego
4	California Rent-A-Car	09	N	09-0836	01-A	2008 India St San Diego
4	California Rent-A-Car	09	N	09-0837	01-A	904 W Grape St San Diego
4	Jeffrey D Korn DPM	09	N	09-0839	01-A	4060 4 th Av Suite 100 San Diego
4M	Collins Dental Corp	09	N	09-0842	02-A	3808 Front St San Diego
4	Rite Aid # 5643	09	N	09-0843	02-A	427 C St San Diego
4	Greyhound Lines Inc	09	N	09-0844	01-A	120 W Broadway San Diego
4	Cliff Brown Automotive	09	N	09-0848	01-A	4491 Park Bl San Diego
4	Basile Studio Inc	09	N	09-0852	01-A	640 10th Av San Diego
4	Bayside Auto Inc	09	N	09-0854	01-A	1304 India St San Diego
4	Euro Service Specialists	09	N	09-0855	01-A	1330 India St San Diego
4M	Lawrence Addleson DDS	09	N	09-0858	02-A	2840 5th Av Suite 300 San Diego
4	Metro Imports	09	N	09-0859	01-A	1954 Kettner Bl San Diego
4	Lee Rollins Inc	09	N	09-0860	01-A	2008 Pacific Hy San Diego
4	Port of San Diego Cruise Ship Terminal	09	N	09-0861	01-A	1150 N Harbor Dr San Diego
4	Dieters Independent Porsche & BMW	09	N	09-0868	01-A	1633 Market St San Diego
4	Beck-n-Call	09	N	09-0869	01-A	3181 G St San Diego
4	Nicholas DeSantis	09	N	09-0871	01-A	2306 6th Av San Diego
4	Rite Aid # 6466	09	N	09-0874	02-A	1411 Kettner Bl San Diego
4M	Scott Rauvola DDS A Dental Corp	09	N	09-0882	02-A	2130 4th Av San Diego
4	Business Assessment	09	N	09-0884	03-A	2948 University Av San Diego
4	Drs Decker & McClanahan APC	09	N	09-0894	01-A	2533 El Cajon Bl San Diego
4	North Park Smiles	09	N	09-0895	01-A	3795 30th St San Diego

Active Permits Metrowide at Year End

Report run on: Monday, January, 3 2022 9:49 am

<i>Class</i>	<i>Name</i>	<i>Area</i>	<i>SIU</i>	<i>Facility</i>	<i>Permit</i>	<i>Address</i>
4	Evelyn G Ascough DDS Inc	09	N	09-0896	01-A	3333 5th Av Suite 100 San Diego
4	Claudio Zawitkowski MD	09	N	09-0897	01-A	3795 30th St Suite A San Diego
4	Laughter Chiropractic	09	N	09-0898	01-A	3596 30th St San Diego
4M	North Park Family Health Center Dental	09	N	09-0900	02-A	3544 30th St San Diego
4	Daisy Cleaners	09	N	09-0904	01-A	3994 30th St San Diego
4M	Ann Marie Zimmerman and David Rens E	09	N	09-0905	02-A	4103 Third Av Suite A San Diego
4M	Dental Implant Centers	09	N	09-0906	02-A	3969 4th Av San Diego
4M	Apple Dental	09	N	09-0908	02-A	1540 Fern St San Diego
4	Mark D Hendricks MD	09	N	09-0909	01-A	1835 El Cajon Bl Suite C San Diego
4M	Universal Dental Smiles	09	N	09-0910	02-A	1835 El Cajon Bl Suite E San Diego
4	M Dalia Strauser MD	09	N	09-0911	01-A	1835 El Cajon Bl San Diego
5	Flot Float Spa	09	N	09-0919	01-A	2859 El Cajon Bl San Diego
4	University Medical-Dental	09	N	09-0920	01-A	4844 University Av Suite A San Diego
4M	Dr Petros Toma and Putnes Corp	09	N	09-0921	02-A	4844 University Av Suite B San Diego
4M	Dr. Zak Northpark Dental Care	09	N	09-0922	03-A	4167 Ohio St San Diego
4M	Dr Mary O'Connor	09	N	09-0924	02-A	420 Spruce St Suite A San Diego
4M	Dentistry of Old Town	09	N	09-0926	02-A	3659 India St Suite 100 San Diego
4	Business Assessment	09	N	09-0927	02-A	1905 Broadway San Diego
3	Miller Machine Works LLC dba Miller C	09	N	09-0927	01-A	1905 Broadway San Diego
4	Dr Huong Nguyen	09	N	09-0928	01-A	4444 El Cajon Bl Suite 6 San Diego
4M	Kensington Heights Dental	09	N	09-0929	02-A	4444 El Cajon Bl Suite 4 San Diego
4	Market Street Vet Clinic	09	N	09-0932	01-A	1051 Market St San Diego
4	MAK Cleaners	09	N	09-0933	01-A	425 Laurel St San Diego
4	MAK Cleaners Inc	09	N	09-0934	01-A	1031 Market St San Diego
4	MAK Cleaners Inc	09	N	09-0935	01-A	703 Union St San Diego
4	Mak Cleaners Inc	09	N	09-0936	01-A	307 W Beech St San Diego
4	Julie's Cleaners	09	N	09-0937	01-A	1635 University Av San Diego
4	A & Z Coin Laundry	09	N	09-0938	01-A	2510 Uiversity Av San Diego
4	Printing on 5th	09	N	09-0939	01-A	3302 5th Av San Diego
4	George T Papas MD	09	N	09-0941	01-A	2883 Meade Av San Diego
4	Tan's Alterations & Dry Cleaning	09	N	09-0942	01-A	4598 30th St San Diego
5	Sherwin Williams	09	N	09-0945	01-A	1760 5th Av San Diego
2	UT; Arcadis US Inc	09	Y	09-0947	02-A	2200 Pacific Hy San Diego
4M	Hillcrest Dental Centre	09	N	09-0948	02-A	1060 University Av Unit A201 San Diego
4	An's Alteration & Dry Cleaning	09	N	09-0951	01-A	3017 Adams Av San Diego
4	San Diego Male Medical Clinic	09	N	09-0952	01-A	3033 5th Av Suite 105 San Diego
4	Cosmetic Dentistry Center of San Diego	09	N	09-0953	01-A	702 C St San Diego
4	Bodhi Veterinary Clinic and Animal Hosp	09	N	09-0955	01-A	2200 University Av San Diego
4M	Sunshine Dentistry	09	N	09-0959	02-A	4230 30th St San Diego
4	Park Blvd Oral Surgery	09	N	09-0961	01-A	4067 Park Bl San Diego
4	Perkins Wm Inc	09	N	09-0965	01-A	3148 Market St San Diego
5	Global Plastics Solutions	09	N	09-0972	01-A	4070 Goldfinch St San Diego
5	KSA Electronics	09	N	09-0973	01-A	1081 Camino Del Rio S Suite 205 San Diego
5	PCSD-Feighner Research	09	N	09-0974	01-A	1550 Hotel Circle N Suite 450 San Diego
3	CRH California Water Inc dba Culligan W	09	N	09-0975	02-A	885 Gateway Center Wy Suite 101 San Diego

Active Permits Metrowide at Year End

Report run on: Monday, January, 3 2022 9:49 am

<i>Class</i>	<i>Name</i>	<i>Area</i>	<i>SIU</i>	<i>Facility</i>	<i>Permit</i>	<i>Address</i>
4	Myriad Industries Inc	09	N	09-0976	01-A	3454 E St San Diego
5	MVP Services	09	N	09-0977	01-A	3990 Old Town Av Suite A115 San Diego
5	Tinsmith Old Town San Diego	09	N	09-0978	01-A	2613 San Diego Av San Diego
5	Painting Specialties	09	N	09-0979	01-A	2622 Covington Rd San Diego
3	Skubic Enterprises LLC dba Old Harbor E	09	N	09-0981	01-A	270 17th St San Diego
5	Foray Technologies	09	N	09-0989	01-A	3911 5th Av San Diego
4	Pacific Research Network	09	N	09-0993	01-A	3003 4th Av San Diego
4	K.A.McNair Brewing Company dba North	09	N	09-0994	01-A	3038 University Av San Diego
4	Big Hop LLC dba Thorn Street Brewery	09	N	09-0996	01-A	3176 Thorn St San Diego
4	Puesto	09	N	09-0997	01-A	5010 Mission Center Rd San Diego
4	Latchkey Brewing	09	N	09-0998	01-A	1795 Hancock St Suite P1 San Diego
3	Mike Hess Brewing Co LLC	09	N	09-1000	01-A	3812 Grim Av San Diego
4	Resident Brewing Co.	09	N	09-1001	01-A	1065 Fourth Av San Diego
4	CWF Holdings LLC dba Poor House Brew	09	N	09-1007	01-A	4494 30th St San Diego
4	B.Lloury LLC dba The Original 40 Brewin	09	N	09-1009	01-A	3117 University Av San Diego
2	UT; IQHQ RaDD I LLC	09	Y	09-1013	03-A	850 Pacific Hy San Diego
2	UT; IQHQ RaDD I LLC	09	N	09-1013	04-A	850 Pacific Hy San Diego
3	Hillcrest Shell	09	N	09-1014	01-A	330 Washington St San Diego
4M	Milberg Orthodontics	09	N	09-1015	01-A	306 Walnut Av Suite 33 San Diego
4	Business Assessment	09	N	09-1017	01-A	3433 Pickwick St San Diego
2	UT; Holland Partner Group	09	Y	09-1018	01-B	225 W B St San Diego
2	UT; SDCC Middle Block LLC	09	N	09-1018	02-A	225 W B St San Diego
4M	Hillcrest Periodontics	09	N	09-1019	01-A	1000 W Washington St Suite 1 San Diego
4M	Dr Vaheed Bayette DDS Dental Corp	09	N	09-1021	01-A	2221 Camino Del Rio South Suite 107 San Diego
4M	06th Ave Periodontics & Implant Dentistr	09	N	09-1022	01-A	1111 06th Av Suite 102 San Diego
4M	Byung Sun Yoo DDS	09	N	09-1023	01-A	2221 Camino Del Rio S Suite 102 San Diego
4M	Mziros Ortega DDS Inc	09	N	09-1024	01-A	3061 Wanut Av Suite 25 San Diego
4M	Dr Diana Kilokowsky	09	N	09-1025	01-A	2318 06th Av San Diego
4M	Walnut Ave Dentistry	09	N	09-1026	01-A	305 Walnut Av San Diego
4M	Timothy Thomas DDS	09	N	09-1027	01-A	306 Walnut Av Suite 38 San Diego
4M	A Professional Dental Corp	09	N	09-1028	01-A	3588 04th Av Suite 300 San Diego
4M	Natural Dental Arts	09	N	09-1029	01-A	3501 4th Av San Diego
4M	A Professional Dental Corp	09	N	09-1030	01-A	3945 01 St Av San Diego
4M	San Diego Periodontics & Implants Dentis	09	N	09-1031	01-A	4060 04th Av Suite 303 San Diego
4M	Evelyn Huaman DMD	09	N	09-1032	01-A	3330 03rd Av Suite 200 San Diego
4M	Affinity Dental Hillcrest	09	N	09-1033	01-A	3330 03rd Av Suite 400 San Diego
4M	Farakhian DDS Inc	09	N	09-1034	01-A	3500 05th St Suite 201 San Diego
4M	Richard Mercado DMD	09	N	09-1036	01-A	306 Walnut Av Suite 21 San Diego
4M	Henry Tran DDS Inc	09	N	09-1037	01-A	4002 Park Bl Suite D San Diego
4M	Donald Tran DDS	09	N	09-1038	01-A	4132 University Av San Diego
4M	A+ Family Dentistry	09	N	09-1039	01-A	3780 El Cajon Bl Unit 1 San Diego
4M	Sandra Chase DDS	09	N	09-1040	01-A	4410 30th St San Diego
4M	Leser Machado DDS	09	N	09-1041	01-A	501 Washington St Suite 710 San Diego
4M	Cosmetic Dentistry Center of San Diego	09	N	09-1042	01-A	940 B St San Diego
4M	Village Hillcrest Dental	09	N	09-1044	01-A	501 Washington St Suite 740 San Diego

Active Permits Metrowide at Year End

Report run on: Monday, January, 3 2022 9:49 am

<i>Class</i>	<i>Name</i>	<i>Area</i>	<i>SIU</i>	<i>Facility</i>	<i>Permit</i>	<i>Address</i>
4M	Padre Dental Group	09	N	09-1045	01-A	501 Washington St Suite 704 San Diego
4M	Randal Russ DDS	09	N	09-1046	01-A	3038 Meade Av San Diego
4M	Sabine Purps	09	N	09-1047	01-A	1764 San Diego Av Suite 130 San Diego
4M	Glenn J Hom DDS	09	N	09-1048	01-A	4410 30th St Suite B San Diego
4M	James Mebust DDS	09	N	09-1049	01-A	4367 30th St San Diego
4M	East Village Dental Goup	09	N	09-1050	01-A	1455 G St San Diego
4M	Dental Express	09	N	09-1051	02-A	210 Park Bl San Diego
4M	Urban Dental	09	N	09-1052	01-A	1111 06th Av Suite 510 San Diego
4M	Bankers Hill Dental	09	N	09-1053	01-A	2333 01 St Av Suite 207 San Diego
4M	Chapokas & Luczynski Dental Partnership	09	N	09-1054	01-A	3730 Third Av San Diego
4M	Million Hills Dental Group	09	N	09-1055	01-A	718 W Washington St San Diego
4M	Bella Vita Dental	09	N	09-1056	02-A	3900 05th Av Suite 270 San Diego
4M	MK Dental	09	N	09-1057	01-A	4365 Meade Av San Diego
4M	Thong Duong DDS	09	N	09-1058	01-A	4448 University Av Suite D San Diego
4M	Siuman Fan DDS	09	N	09-1059	01-A	2221 S Camino Del Rio Suite 208 San Diego
4	Business Assessment	09	N	09-1064	01-A	885 Gateway Center wy Suite 201 San Diego
4M	USN; Naval Medical Readiness and Train	09	N	09-1065	01-A	34800 Bob Wilson Dr Bldg 1 San Diego
4	Business Assessment	09	N	09-1068	01-A	3052 El Cajon Bl Suite A San Diego
4	Pariah Brewing Company	09	N	09-1069	01-A	3052 El Cajon Bl Suite B San Diego
4	Juneshine	09	N	09-1070	01-A	3052 El Cajon Bl Suite C San Diego
4M	Hillcrest Annex Family Health Center Der	09	N	09-1071	01-A	4065 3rd Av San Diego
4M	Family Health Center of San Diego Elm D	09	N	09-1072	01-A	140 Elm St San Diego
4	Business Assessment	09	N	09-1075	01-A	950 Waterfront Pl San Diego
4	Business Assessment	09	N	09-1076	01-A	925 Waterfront Pl San Diego
4	Business Assessment	09	N	09-1077	01-A	800 Pacific Coast Hy San Diego
4	Business Assessment	09	N	09-1079	01-A	1788 El Prado San Diego
2	Alvarado Hospital Medical Center	10	N	10-0002	02-A	6655 Alvarado Rd San Diego
2	Alvarado Hospital Medical Center	10	N	10-0002	03-A	6655 Alvarado Rd San Diego
4	Speed Specialties	10	N	10-0014	02-A	4781 El Cajon Bl San Diego
4	Coca-Cola Bottling Company of Southern	10	N	10-0018	05-A	1348 47th St San Diego
2C	San Diego State University	10	N	10-0023	04-B	5500 Campanile Dr San Diego
4	Reynolds Aluminum Recycling Co	10	N	10-0024	01-A	4460 University Av San Diego
4	Dynair Electronics	10	N	10-0033	00-A	5275 Market St San Diego
4	Haigs Complete Auto Repair	10	N	10-0036	00-A	3750 University Av San Diego
4	George's Garage	10	N	10-0041	01-A	3114 Fairmount Av San Diego
4	World Terminal Parking Inc	10	N	10-0045	00-A	5126 El Cajon Bl San Diego
2	City; Equipment Division - Chollas	10	N	10-0058	02-A	2740 Caminito Chollas San Diego
4	Cox Cable San Diego	10	N	10-0074	00-A	5159 Federal Bl San Diego
4	Discount Battery Company	10	N	10-0109	01-A	3203 Fairmount Av San Diego
4	Paris Bakery	10	N	10-0129	00-A	4481 El Cajon Bl San Diego
5	Lopez & Sons Inc	10	N	10-0146	01-A	6402 Akins Av San Diego
4	Aim 4 Health Center	10	N	10-0155	01-A	3924 El Cajon Bl San Diego
4	Your Valet Cleaners	10	N	10-0156	00-A	5065 Federal Bl San Diego
4	Stidum Detailing	10	N	10-0159	03-A	4275 44th St San Diego
4	Maytag Commercial	10	N	10-0221	00-A	6145 El Cajon Bl Suite E San Diego

Active Permits Metrowide at Year End

Report run on: Monday, January, 3 2022 9:49 am

<i>Class</i>	<i>Name</i>	<i>Area</i>	<i>SIU</i>	<i>Facility</i>	<i>Permit</i>	<i>Address</i>
4	Dion International Trucks Inc	10	N	10-0239	04-A	5255 Federal Bl San Diego
4	BJ's Rentals Inc	10	N	10-0253	02-A	3546 Euclid Av San Diego
4	San Diego's House of Motorcycles	10	N	10-0257	01-A	4904 El Cajon Bl San Diego
4	Stuart Terry Auto Repair	10	N	10-0261	01-A	4858 El Cajon Bl San Diego
4	Hopsing's Machine Inc	10	N	10-0271	01-A	5255 University Av San Diego
2	E & E Industries Inc	10	N	10-0272	05-A	4931 Market St San Diego
4	City; Police Dept SE Div	10	N	10-0276	01-A	7222 Skyline Dr San Diego
4	Pep Boys Manny Moe & Jack of Californi	10	N	10-0283	01-A	6714 El Cajon Bl San Diego
4	City; Water Utilities - Chollas	10	N	10-0286	00-A	2797 Caminito Chollas San Diego
4	Penske Truck Leasing	10	N	10-0289	01-A	4285 Camino Del Rio S San Diego
4	Howard Johnson	10	N	10-0293	01-A	6440 El Cajon Bl San Diego
4	Paradise Hills Convalescent Center	10	N	10-0295	00-A	6061 Banbury St San Diego
4	DV Honda Auto Repair	10	N	10-0297	01-A	5051 El Cajon Bl San Diego
4	University Cleaners	10	N	10-0307	01-A	3624 University Av San Diego
4	Screen Machine Inc	10	N	10-0312	01-A	3855 Wabash Av San Diego
5	Startline Auto Parts	10	N	10-0322	01-A	3821 32nd St San Diego
4	Cortez Auto Repair	10	N	10-0336	01-A	7075 El Cajon Bl San Diego
4	Floyd's Automotive Machine	10	N	10-0345	03-A	4603 El Cajon Bl San Diego
4	Dan's Auto Repair & Body	10	N	10-0346	01-A	4555 University Av San Diego
4	A + C Tire Service Auto Repair	10	N	10-0347	02-A	4260 El Cajon Bl San Diego
3	Apro LLC dba United Oil	10	N	10-0352	02-A	3927 El Cajon Bl San Diego
4	Brought Back Bugs	10	N	10-0355	01-A	4422 Euclid Av San Diego
4	Western Honda Specialist	10	N	10-0356	01-A	3669 University Av San Diego
4	Washington Inventory Service	10	N	10-0359	02-A	7150 El Cajon Bl San Diego
5	Globe Auto Tech	10	N	10-0375	01-A	3889 Euclid Av San Diego
4	BRU Auto	10	N	10-0376	03-A	5625 El Cajon Bl San Diego
4	Garland-Fields Glass Company	10	N	10-0379	01-A	7200 El Cajon Bl San Diego
4	Carl's Rentals	10	N	10-0380	00-A	3704 University Av San Diego
4	Bobby's Radiator Shop	10	N	10-0383	01-A	6521 Imperial Av San Diego
2Z	Decisive Testing Inc	10	N	10-0384	04-A	4735 Myrtle Av San Diego
4	T P Automotive Services	10	N	10-0385	01-A	2426 El Cajon Bl San Diego
3	Genie Car Wash and Oil Change	10	N	10-0386	03-A	5985 University Av San Diego
4	San Diego Auto Repair	10	N	10-0388	00-A	5255 University Av San Diego
4	City; Midcity Police Substation	10	N	10-0390	00-A	4310 Landis St San Diego
4	Lin's Auto Repair	10	N	10-0391	02-A	4765 Trojan Av San Diego
4	Lindy's Auto Upholstery	10	N	10-0394	03-A	7267 El Cajon Bl San Diego
4	The Gas Depot	10	N	10-0396	01-A	495 S Meadowbrook Dr San Diego
4	A & M Auto Repair	10	N	10-0398	01-A	3250 Adams Av San Diego
4	Palace Imports	10	N	10-0400	01-A	4802 El Cajon Bl San Diego
4	J & J Brake Parts	10	N	10-0401	01-A	3243 Euclid Av San Diego
4	Hub Cap Annie San Diego	10	N	10-0403	01-A	6211 University Av San Diego
4	Lomita Family Medical Group	10	N	10-0405	02-A	909 Cardiff St San Diego
4	University Cleaners	10	N	10-0411	02-A	6469 University Av San Diego
4M	Loc Bao DDS Inc	10	N	10-0417	03-A	4236 El Cajon Bl San Diego
4	Western Dental	10	N	10-0422	02-A	4123 University Av San Diego

Active Permits Metrowide at Year End

Report run on: Monday, January, 3 2022 9:49 am

<i>Class</i>	<i>Name</i>	<i>Area</i>	<i>SIU</i>	<i>Facility</i>	<i>Permit</i>	<i>Address</i>
4M	Western Dental	10	N	10-0422	03-A	4123 University Av San Diego
4M	South Bay Dental Center	10	N	10-0423	03-A	2939 Alta View Dr San Diego
4M	Gary L Mcclanahan DDS	10	N	10-0424	02-A	2449 E Plaza Bl Suite A San Diego
4M	Alpha Dental	10	N	10-0427	04-A	4276 54th Pl Suite D San Diego
4M	Center Point Dental Group	10	N	10-0432	03-A	6544 El Cajon Bl San Diego
4	R McCleave DDS & R Santoro DDS	10	N	10-0432	02-A	6544 El Cajon Bl San Diego
4M	Hung Khai Nguyen DDS	10	N	10-0437	02-A	4712 El Cajon Bl G San Diego
4M	Robert Gandola DDS	10	N	10-0438	03-A	7125 El Cajon Bl 2 San Diego
4M	Huan-Tony Bao Ngo DDS	10	N	10-0439	03-A	6663 El Cajon Bl C San Diego
4M	Patrycia Stewart	10	N	10-0440	02-A	6244 El Cajon Bl Suite 6 San Diego
4M	Campus Dentistry	10	N	10-0441	03-A	6244 El Cajon Bl Suite 8 San Diego
2F	Dung Ly General Dentistry	10	N	10-0445	01-A	4310 Euclid Av Suite A San Diego
4M	University Avenue Dental Group	10	N	10-0448	02-A	6324 University Av San Diego
4M	Dr Rodriguez Dental Corp	10	N	10-0450	03-A	3200 Adams Av Suite 202 San Diego
4M	Steven J Byers DDS	10	N	10-0452	03-A	4403 Marlborough Av San Diego
4M	Lynne A March DDS	10	N	10-0454	03-A	4685 Vista St San Diego
4	Ultramar	10	N	10-0455	01-A	4704 Imperial Av San Diego
2	SP+ Transportation	10	N	10-0456	03-A	4902 Market St San Diego
4	Water Technologies LLC	10	N	10-0457	01-A	3829 El Cajon Bl San Diego
4	555 AUTO REPAIR & BODY	10	N	10-0458	01-A	4150 University Av San Diego
4	Federal Express	10	N	10-0465	01-A	1650 47th St San Diego
4	Precision Radiators	10	N	10-0468	01-A	7066 El Cajon Bl Suite G San Diego
4	Hong's Radiator Shop	10	N	10-0470	01-A	5312 El Cajon Bl San Diego
4M	Orange Family Dental	10	N	10-0472	03-A	4205 Fairmount Av San Diego
4	Daniel's Radiator Shop	10	N	10-0475	01-A	6227 University Av San Diego
4	Robert J Santoro DDS Inc	10	N	10-0476	02-A	6244 El Cajon Bl Suite 1 San Diego
4	Environmental Grease Management	10	N	10-0482	01-A	4425 Federal Bl Unit 72 San Diego
4	Alpine Stained Glass	10	N	10-0483	02-A	6331 University Av San Diego
4	Squires-Belt Material Company	10	N	10-0484	01-A	4567 Federal Bl San Diego
4	Alvarado Breast Center	10	N	10-0485	02-A	6386 Alvarado Ct Suite 107 San Diego
4	Precision Auto Detail	10	N	10-0487	01-A	6233 University Av 1/2 San Diego
4	Wal-Mart Store # 2479	10	N	10-0491	02-A	3412 College Av San Diego
2F	Fromex Photo Systems	10	N	10-0494	01-A	6370 El Cajon Bl San Diego
4	Alse Auto	10	N	10-0496	01-A	4603 El Cajon Bl Suite B San Diego
4M	Beautiful Smile Dentistry	10	N	10-0498	02-A	6368 El Cajon Bl San Diego
2	UT; BBC Environmental Inc	10	N	10-0499	04-A	Various (Metro Area) San Diego
4M	Coast Dental Care	10	N	10-0506	02-A	6585 El Cajon Bl San Diego
4	U & R Affordable	10	N	10-0507	01-A	3877 42nd St San Diego
4	Dr Magat and Associates	10	N	10-0509	01-A	3811 El Cajon Bl San Diego
4M	Boulevard Dental Center	10	N	10-0512	02-A	3531 El Cajon Bl Suite A San Diego
4M	Robert S Cheung & Esther Ong DDS	10	N	10-0513	02-A	4546 College Av San Diego
4	Neelakantan Ramineni MD	10	N	10-0515	01-A	4537 College Av San Diego
4	Manorama M Reddy MD	10	N	10-0516	01-A	4533 College Av San Diego
4M	North Park Dental	10	N	10-0518	02-A	3426 University Av San Diego
4M	Victor X Crawford DDS	10	N	10-0520	02-A	5106 Federal Bl Suite 209 San Diego

Active Permits Metrowide at Year End

Report run on: Monday, January, 3 2022 9:49 am

<i>Class</i>	<i>Name</i>	<i>Area</i>	<i>SIU</i>	<i>Facility</i>	<i>Permit</i>	<i>Address</i>
4	Huong Nguyn MD	10	N	10-0523	01-A	4228 El Cajon Bl San Diego
4	Owens Chiropractic Center	10	N	10-0524	01-A	4527 College Av San Diego
4	More Life Chiropractic	10	N	10-0526	01-A	3655 Adams Av San Diego
4	Hanh My Truong MD	10	N	10-0535	01-A	5296 University Av Suite J San Diego
4	SD Dental Group	10	N	10-0536	02-A	4539 College Av San Diego
4	Target # 1846	10	N	10-0538	01-A	3424 College Av San Diego
4	California Womens Clinic	10	N	10-0539	01-A	4134 Fairmount Av San Diego
4	Tuan Nguyen MD	10	N	10-0540	01-A	4141 Fairmount Av San Diego
4M	FairEast Dental	10	N	10-0543	02-A	4170 Fairmount Av San Diego
4	Patricia Forg DPM	10	N	10-0544	01-A	3989 32nd St San Diego
4	Susie Thai Alterations 11	10	N	10-0545	01-A	6088 University Av San Diego
4	La Maestra Family Clinic Inc	10	N	10-0547	01-A	4060 Fairmount Av San Diego
4	Miguel Losada MD	10	N	10-0548	01-A	3250 El Cajon Bl San Diego
4M	Mid-City Dental	10	N	10-0549	02-A	4090 El Cajon Bl Suite F San Diego
4	Ann's Alteration & Dry Cleaning	10	N	10-0550	01-A	3435 University Av San Diego
4	Danh C Truong MD Inc	10	N	10-0551	01-A	4310 Euclid Av Suite D San Diego
4	Linhkieu T Nguyen MD Inc	10	N	10-0552	01-A	3375 Euclid Av Suite 100 San Diego
4	Euclid MMHS	10	N	10-0553	01-A	1733 Euclid Av San Diego
4	Progressive Medical Specialists Inc	10	N	10-0554	01-A	4974 El Cajon Bl Suite A San Diego
4	Prime Chiropractic Group	10	N	10-0555	01-A	6244 El Cajon Bl Suite 5 San Diego
4	Frazee Paint & Wallcovering	10	N	10-0558	01-A	3301 El Cajon Bl San Diego
4	SC Custom Metal Fabrication	10	N	10-0559	01-A	3141 Fairmount Av San Diego
4M	City Hts Family Health Centers of SD Der	10	N	10-0562	01-A	5454 El Cajon Bl San Diego
5	Gold Fever US	10	N	10-0565	01-A	5404 El Cajon Bl San Diego
5	Gold Fever US	10	N	10-0566	01-A	5071 Federal Bl San Diego
5	Innovative Solutions	10	N	10-0567	01-A	513 Kingswood St San Diego
4	Ameer Autos	10	N	10-0569	01-A	4930 El Cajon Bl San Diego
4M	Jeremy Factor DDS	10	N	10-0575	01-A	6719 Alvarado Rd Suite 301 San Diego
4M	Kensington Pediatric Dentistry	10	N	10-0578	01-A	4072 Adams Av San Diego
4M	North Park Smiles	10	N	10-0579	01-A	3638 El Cajon Bl San Diego
4M	Xiaochen Yin DDS	10	N	10-0580	01-A	5296 University Av Suite I San Diego
4M	Premier Dental	10	N	10-0582	01-A	4575 El Cajon Bl Suite A San Diego
4M	Henry Tran DDS	10	N	10-0583	01-A	4616 El Cajon Bl Suite 8 San Diego
4M	Family Dentistry	10	N	10-0584	01-A	5059 El Cajon Bl San Diego
4M	Dentist	10	N	10-0585	01-A	4703 University Av San Diego
4M	Neighborhood Dental Group	10	N	10-0588	01-A	4276 54th Pl Unit A San Diego
4M	Kensington Dental Group	10	N	10-0589	01-A	4142 Adams Av Suite 104 San Diego
4M	Dorman R Malone DDS	10	N	10-0592	01-A	6919 Paradise Valley Rd Suite 1A San Diego
4M	College Grove Dentistry	10	N	10-0593	01-A	3408 College Av San Diego
4M	Alex Reizhn	10	N	10-0594	01-A	4711 Monroe Av San Diego
3	UT; City; PUD Water Distribution Divisic	10	N	10-0597	02-A	6500 Imperial Av San Diego
3	UT; City; PUD Water Distribution Divisic	10	N	10-0597	02-B	6500 Imperial Av San Diego
3	UT; City; PUD Water Distribution Divisic	10	N	10-0597	02-C	6500 Imperial Av San Diego
3	UT; Orion Construction Corporation	10	Y	10-0597	01-A	6500 Imperial Av San Diego
4	Business Assessment	10	N	10-0598	01-A	8455 Jamacha Rd San Diego

Active Permits Metrowide at Year End

Report run on: Monday, January, 3 2022 9:49 am

<i>Class</i>	<i>Name</i>	<i>Area</i>	<i>SIU</i>	<i>Facility</i>	<i>Permit</i>	<i>Address</i>
4	Atlas Chemical	11	N	11-0012	01-A	2929 Commercial St San Diego
2	USN;Naval Base San Diego	11	Y	11-0016	06-B	32nd St @ Harbor Dr San Diego
4	Chevron USA Inc	11	N	11-0031	01-A	2351 Harbor Dr San Diego
4	Chevron USA Inc	11	N	11-0031	02-A	2351 Harbor Dr San Diego
4	Angelica Textile Services	11	N	11-0032	06-A	3939 Market St San Diego
4	Interstate Brands Corp	11	N	11-0033	01-A	1955 Julian Av San Diego
4C	San Diego Galvanizing Inc	11	N	11-0035	04-A	3586 Dalbergia St San Diego
4	SDG&E Silvergate Power Plant	11	N	11-0036	01-A	1348 Sampson St San Diego
2	San Diego Trolley Inc	11	N	11-0040	02-A	1535 Newton Av San Diego
2	San Diego Trolley Inc	11	N	11-0040	03-A	1535 Newton Av San Diego
3	San Diego Unified Port District	11	N	11-0041	03-A	1790 Water St San Diego
1	General Dynamics NASSCO	11	Y	11-0051	07-A	2798 Harbor Dr San Diego
5	Business Assessment	11	N	11-0057	02-A	2697 Main St San Diego
4	IMS Recycling Services	11	N	11-0057	01-A	2697 Main St San Diego
4	Pro-Line Paint Company	11	N	11-0084	00-A	2646 Main St San Diego
2	San Diego Transit Corporation	11	N	11-0086	03-B	100 16th St San Diego
2	San Diego Transit Corporation	11	N	11-0086	04-A	100 16th St San Diego
4	A & B Truck Recycling	11	N	11-0088	00-A	2863 Commercial St San Diego
2	A & B Truck Recycling	11	N	11-0088	01-A	2863 Commercial St San Diego
4	California Interior Services	11	N	11-0100	00-A	3356 National Av San Diego
4	ArcCastle Electrical Industries	11	N	11-0104	01-A	3106 Main St San Diego
4	Chicks Electric Motor	11	N	11-0107	01-A	3592 Main St San Diego
4	McCord's Bake Shop	11	N	11-0130	00-A	2985 National Av San Diego
4	San Diego Marriott	11	N	11-0133	01-C	333 W Harbor Dr San Diego
3	Moody's Lunch Service Inc	11	N	11-0147	03-A	4637 Market St San Diego
4	Pacific Marine Propellers Inc	11	N	11-0155	01-A	3781 Dalbergia St San Diego
2	Cool Way Radiator and Air Conditioning	11	N	11-0181	05-A	3362 National Av San Diego
2	Cintas Corporation	11	Y	11-0189	07-A	675 32nd St San Diego
5	Welders Supply & Equipment	11	N	11-0214	00-A	3091 Market St San Diego
2	BAE Systems San Diego Ship Repair	11	N	11-0217	04-A	2205 E Belt St San Diego
2	BAE Systems San Diego Ship Repair	11	N	11-0217	05-A	2205 E Belt St San Diego
2	BAE Systems San Diego Ship Repair	11	N	11-0217	05-B	2205 E Belt St San Diego
4	Carlson & Beauloye Machine Shop	11	N	11-0229	07-A	2141 Newton Av San Diego
4	National Brake Service Inc	11	N	11-0231	00-A	2040 Imperial Av San Diego
4	USA Cab Company	11	N	11-0235	02-A	2660 Imperial Av San Diego
4	Praxair	11	N	11-0239	00-A	2205 Newton Av San Diego
2	UT; St Vincent De Paul Village	11	N	11-0241	05-B	1501 Imperial Av San Diego
4	Propulsion Controls Engineering (PCE)	11	N	11-0249	01-A	1304 Sampson St San Diego
4	EDCO Disposal Corporation	11	N	11-0250	01-A	3660 Dalbergia St San Diego
3	Santa Monica Seafood dba Chesapeake Fi	11	N	11-0251	04-A	535 Harbor Ln San Diego
5	Aquamarine Seafood	11	N	11-0252	01-A	565 Harbor Ln San Diego
5	Aquamarine Seafood Brokerage	11	N	11-0253	01-A	565 Harbor Ln San Diego
2	Sundance Stage Lines	11	N	11-0261	04-A	3762 Main St San Diego
2	Sundance Stage Lines	11	N	11-0261	05-A	3762 Main St San Diego
4	Diego & Son Printing Inc	11	N	11-0263	03-A	2104 National Av San Diego

Active Permits Metrowide at Year End

Report run on: Monday, January, 3 2022 9:49 am

<i>Class</i>	<i>Name</i>	<i>Area</i>	<i>SIU</i>	<i>Facility</i>	<i>Permit</i>	<i>Address</i>
2	Pacific Ship Repair & Fabrication Inc	11	N	11-0269	03-A	1625 Rigel St San Diego
4	Marine and Restaurant Fabricators	11	N	11-0271	01-A	3763 Dalbergia St San Diego
4	Business Assessment	11	N	11-0272	07-A	3557 Dalbergia St San Diego
4	Food Palace Market	11	N	11-0276	01-A	3550 National Av San Diego
4	County; Dept of Health Services	11	N	11-0279	00-A	1175 Imperial Av San Diego
4	La Princesa Tortilleria	11	N	11-0283	01-A	3320 Broad Av San Diego
4	Arco San Diego Terminal	11	N	11-0284	05-A	2295 Harbor Dr San Diego
4	Linns Auto Service	11	N	11-0290	01-A	3601 Imperial Av San Diego
4	Hydro/Agri	11	N	11-0296	02-A	1770 Thor St San Diego
4	Penske Truck Leasing Company	11	N	11-0299	02-A	1402 Commercial St San Diego
4	Republic Services inc.	11	N	11-0301	03-A	2731 Newton Av San Diego
4	SDCCD; Educational Cutural Complex	11	N	11-0304	02-A	4343 Ocean View Bl San Diego
4	Cool Way Radiator & Air Cond	11	N	11-0311	03-A	999 S 43rd St San Diego
4	No Better Service	11	N	11-0317	01-A	1128 S 43rd St San Diego
4	RW Little Company	11	N	11-0318	01-A	3210 Commercial St San Diego
3	Star Laundry Services	11	Y	11-0321	04-A	3410 Main St San Diego
4	Motor Works Inc	11	N	11-0340	01-A	1490 Island Av San Diego
4	Denrich Press	11	N	11-0344	02-A	1701 Vesta St San Diego
4	Aguilar Inc	11	N	11-0346	01-A	2302 Newton Av San Diego
4	La Flor De Michoacan Tortilleria	11	N	11-0347	01-A	509 9th Av Unit B San Diego
4	RC Auto Repair & Transmissions	11	N	11-0348	01-A	2250 Logan Av San Diego
2	Ace Radiator	11	N	11-0352	05-A	1836 National Av San Diego
4	Fabrication Arts dba Graphic Solutions	11	N	11-0353	01-A	2926 Main St San Diego
4	West Marine Diesel	11	N	11-0359	00-A	1835 Newton Av San Diego
4	Kaman Industrial Technologies	11	N	11-0374	00-A	1675 Newton Av San Diego
4	Fraser's Boiler Service	11	N	11-0375	00-A	1746 Newton Av San Diego
2	The Jankovich Company	11	N	11-0379	04-A	961 E Harbor Dr San Diego
2	New Leaf Biofuel LLC	11	N	11-0380	02-A	2285 Newton Av San Diego
4	Hytech Metal Forming Inc	11	N	11-0382	01-A	2676 Newton Av San Diego
4	Stevedoring Service of America	11	N	11-0385	00-A	656 Switzer St San Diego
4	North American Terminals	11	N	11-0386	00-A	1090 Water St San Diego
4	Action Cleaning Corporation	11	N	11-0390	03-A	1620 Newton Av San Diego
2F	St Vincent De Paul Village	11	N	11-0394	01-A	1501 Imperial Av San Diego
2	Unifirst Corporation	11	Y	11-0398	07-A	4041 Market St San Diego
2	Unifirst Corporation	11	Y	11-0398	08-A	4041 Market St San Diego
4	Shell Etd Foodmart	11	N	11-0401	01-A	3890 Division St San Diego
4	National Avenue Used Car Sales	11	N	11-0402	01-A	1540 National Av San Diego
2	Burlington Northern & Santa Fe Railway	11	N	11-0404	04-A	1342 Cesar E Chavez Py San Diego
4	CT Services Inc	11	N	11-0408	02-A	1340 Cesar E. Chavez Py San Diego
4	Triple K Manufacturing	11	N	11-0410	02-B	2222 Commercial St San Diego
2	Sloan Electric Company	11	N	11-0412	04-A	3520 Main St San Diego
2	Sloan Electric Company	11	N	11-0412	05-A	3520 Main St San Diego
4	Hyatt Regency San Diego	11	N	11-0416	02-A	1 Market Pl San Diego
2	Continental Maritime of San Diego LLC	11	N	11-0417	06-A	1995 Bay Front St San Diego
4	Dimensional Silk Screen Inc	11	N	11-0418	03-A	3750 Dalbergia St San Diego

Active Permits Metrowide at Year End

Report run on: Monday, January, 3 2022 9:49 am

<i>Class</i>	<i>Name</i>	<i>Area</i>	<i>SIU</i>	<i>Facility</i>	<i>Permit</i>	<i>Address</i>
4M	San Diego Trolley Dental Group	11	N	11-0423	03-A	6571 Imperial Av San Diego
4	O'Farrell Community School	11	N	11-0425	02-A	6130 Skyline Dr San Diego
4	Gary's Auto Repair	11	N	11-0428	01-A	355 6th Av San Diego
4	El Dorado Sandblasting Company	11	N	11-0432	02-A	2694 Commercial St San Diego
4	Universal Radiator & Automotive Inc	11	N	11-0433	04-A	2005 Imperial Av San Diego
2	Deca Forklift Inc	11	N	11-0435	04-A	3596 Dalbergia St San Diego
2	Deca Forklift Inc	11	N	11-0435	05-A	3596 Dalbergia St San Diego
4	Trans Tech Transmissions	11	N	11-0438	01-A	3644 Main St San Diego
4	Hoffmeyer Company Inc	11	N	11-0439	01-A	1304 Imperial Av San Diego
4	FSE Inc	11	N	11-0443	01-A	1248 Market St San Diego
2	CP Kelco	11	Y	11-0444	06-A	2025 E Harbor Dr San Diego
4	Tinker's Alley	11	N	11-0445	01-A	3708 Ocean View Bl San Diego
3	Aqua Aire West LLC	11	N	11-0447	04-A	3561 Dalbergia St San Diego
4	The Home Depot	11	N	11-0450	01-A	355 Marketplace Av San Diego
5	Atlas Wood Products	11	N	11-0453	03-A	2966 Commercial St San Diego
4	CVS Pharmacy # 9193	11	N	11-0454	03-A	1380 43rd St San Diego
4	Advanced Metal Forming Inc	11	N	11-0460	01-A	2075 National Av San Diego
4	SA Hydraulics and Air Systems	11	N	11-0462	01-A	3120 Main St San Diego
4	Dole Fresh Fruit Company	11	N	11-0464	01-A	850 Water St San Diego
4	Absolute Perfection	11	N	11-0465	01-A	200 Harbor Dr San Diego
4	San Diego Collision Specialist	11	N	11-0467	02-A	3713 Dalbergia St San Diego
4	American & Foreign Auto Wreckers Inc	11	N	11-0468	01-A	1615 Logan Av San Diego
4	Wilson & Hampton Refinishing	11	N	11-0469	01-A	1835 Imperial Av San Diego
4	Berts Motor Werx Inc	11	N	11-0470	01-A	1476 Island Av San Diego
4	Dar Fryer Hydraulics	11	N	11-0471	01-A	3317 Logan Av San Diego
4	Cabrillo Enterprises Inc Db a RW Little Co	11	N	11-0472	02-A	3135 Commercial St San Diego
4	Union Electric Motor Service	11	N	11-0473	01-A	2777 Newton Av San Diego
3	Thomas Industrial Water	11	N	11-0475	02-A	3351 National Av San Diego
4	San Diego Truck Brake	11	N	11-0476	01-A	4001 Market St Suite C&D San Diego
4	Fleet Driveline Service	11	N	11-0477	01-A	4001 Market St Suite B San Diego
4	XXPress Auto II Transmission Specialist	11	N	11-0478	01-A	4001 Market St Suite A San Diego
4	Central Truck Repair	11	N	11-0479	01-A	4001 Market St Suite E San Diego
4	E & A Ornamental Iron	11	N	11-0480	01-A	1827 Logan Av Unit 1&5 San Diego
4	Maritime Solutions LLC	11	N	11-0481	01-A	1616 Newton Av San Diego
4	Arrow Market	11	N	11-0482	01-A	2638 Imperial Av San Diego
4	Sawaya Brothers Market	11	N	11-0483	01-A	425 S 30th St San Diego
4	La Palapa Market	11	N	11-0485	01-A	2483 Imperial Av San Diego
4	Sergios Auto Electrtic	11	N	11-0488	02-A	3746 Main St San Diego
5	Industrial Fire Sprinkler Company Inc	11	N	11-0489	01-A	3845 Imperial Av San Diego
4	Ricardo's Fleet Service	11	N	11-0490	01-A	1841 National Av San Diego
4	Central Marble Supply	11	N	11-0494	01-A	3754 Main St Suite B San Diego
4	Marine & Restaurant Fabricators Inc	11	N	11-0496	02-A	3768 Dalbergia St San Diego
4	Graphics Solutions	11	N	11-0501	01-A	2952 Main St San Diego
4C	California Marine Cleaning	11	N	11-0513	01-A	905 S 33rd St San Diego
4C	California Marine Cleaning	11	N	11-0513	02-A	905 S 33rd St San Diego

Active Permits Metrowide at Year End

Report run on: Monday, January, 3 2022 9:49 am

<i>Class</i>	<i>Name</i>	<i>Area</i>	<i>SIU</i>	<i>Facility</i>	<i>Permit</i>	<i>Address</i>
5	Ramada Limited	11	N	11-0525	01-A	3878 Dalbergia Ct San Diego
2	Propulsion Controls Engineering (PCE)	11	N	11-0527	04-A	1620 Rigel St San Diego
3	UT; City of San Diego - Storm Water Divi	11	Y	11-0534	04-A	111 W Harbor Dr San Diego
4	Work Shop For Warriors	11	N	11-0535	01-A	2970 Main St San Diego
5	Harborside Refrigerated Services	11	N	11-0540	01-A	802 Terminal St San Diego
5	Propulsion Controls Engineering (PCE)	11	N	11-0542	01-A	3376 Main St San Diego
4	IMS Recycling Service Inc	11	N	11-0544	01-A	2768 Boston Av San Diego
4	North Star Propellers	11	N	11-0546	01-A	2317 Newton Av San Diego
3	The San Diego Filter Company	11	N	11-0549	01-A	35 Hensley St San Diego
5	Barrio Logan College Institute	11	N	11-0560	01-A	1807 Main St San Diego
5	James Automotive Services	11	N	11-0562	01-A	2208 Imperial Av San Diego
2	UT; General Dynamics NASSCO	11	N	11-0563	03-A	2798 E Harbor Dr San Diego
4	San Diego Wheel Polishing	11	N	11-0568	01-A	2992 Commercial St San Diego
5	Riley Recycling	11	N	11-0570	01-A	15 28th st San Diego
4	Mujeres Brew House	11	N	11-0576	01-A	1983 Julian Av San Diego
4	Border X Brewing	11	N	11-0579	01-A	2181 Logan Av San Diego
4	Attitude Brewing Inc.	11	N	11-0582	02-A	1985 National Av Suite 1115 San Diego
4	Business Assessment	11	N	11-0582	01-A	1985 National Av Suite 1115 San Diego
4	Liberty Call Distilling	11	N	11-0588	01-A	1985 National Av Suite 1131 San Diego
3	Gabriel Tortilleria & Mexican Food	11	N	11-0589	01-A	2480 Imperial Av San Diego
2	UT; Apex Companies LLC	11	N	11-0592	02-A	3504 Main St San Diego
4M	USN;Naval Medical Readiness and Traini	11	N	11-0594	02-A	2310 Craven St Bldg 3230 San Diego
4M	Western Dental #578	11	N	11-0595	02-A	286 Euclid Av Suite 201 San Diego
4M	Crawford Dental Group	11	N	11-0596	01-A	5060 Logan Av San Diego
3	UT; Blue Pacific Engineering and Constr	11	Y	11-0609	01-A	10 Woodlawn Av Chula Vista
4	Business Assessment	11	N	11-0610	01-A	1155 Island Av Suite 500 San Diego
4	Business Assessment	11	N	11-0611	01-A	1155 Island Av Suite 600 San Diego
4	Business Assessment	11	N	11-0612	01-A	1155 Island Av Suite 700 San Diego
5	24th & Imperial Auto Repair	11	N	11-0614	01-A	2401 Imperial Av 1/2 San Diego
4	California Marine Cleaning	11	N	11-0615	01-A	2049 Main St San Diego
4	Business Assessment	11	N	11-0616	01-A	201 Park Bl Suite 101 San Diego
4	Business Assessment	11	N	11-0617	01-A	1155 Island Av Suite 100 San Diego
4	Business Assessment	11	N	11-0618	01-A	1155 Island Av Suite 200 San Diego
4	Business Assessment	11	N	11-0619	01-A	1155 Island Av Suite 300 San Diego
4	Business Assessment	11	N	11-0620	01-A	1155 Island Av Suite 400 San Diego
4	Business Assessment	11	N	11-0621	01-A	3279 National Av San Diego
4	Business Assessment	11	N	11-0624	01-A	1735 National Av San Diego
4M	Family Health Center of SD Logan Height	11	N	11-0625	01-A	1809 National Av San Diego
4M	Diamond Family Health Center Dental	11	N	11-0626	01-A	4725 Market St San Diego
5	Riley Recycling	11	N	11-0627	01-A	2812 Commercial St San Diego
5	El Guero Tire Shop	11	N	11-0628	01-A	2401 Imperial Av San Diego
2	UT; Michels Construction Inc	11	Y	11-0629	01-A	1709 Main St San Diego
4	Green Kars Auto Wrecking	12	N	12-0007	01-A	1510A Heritage Rd San Diego
3	US Border Patrol	12	N	12-0024	04-A	3752 Beyer Bl San Diego
3	LUV Car Wash Group LLC	12	N	12-0028	03-A	1835 Palm Av San Diego

Active Permits Metrowide at Year End

Report run on: Monday, January, 3 2022 9:49 am

<i>Class</i>	<i>Name</i>	<i>Area</i>	<i>SIU</i>	<i>Facility</i>	<i>Permit</i>	<i>Address</i>
3	Palm Ave LLC	12	N	12-0028	02-A	1835 Palm Av San Diego
3	RJ Donovan Correctional Facility	12	Y	12-0038	06-A	480 Alta Rd San Diego
4	Leo's Garage	12	N	12-0040	00-A	966 Hollister St San Diego
4	Tunes Lubes & Smogs	12	N	12-0040	01-A	966 Hollister St San Diego
5	Price Buster Wholsale	12	N	12-0049	01-A	424 W Calle Primera San Diego
5	Soto's Transmission	12	N	12-0051	01-A	2278 Palm Av San Diego
5	Sanyo E & E Corporation	12	N	12-0061	01-A	2001 Sanyo Av San Diego
4	PG Films Plastics & Solutions	12	N	12-0064	01-A	1840 Dornoch Ct San Diego
3	Emerald Textiles LLC	12	Y	12-0065	05-A	1725 Dornoch Ct San Diego
3	Emerald Textiles Services San Diego LLC	12	Y	12-0065	06-A	1725 Dornoch Ct San Diego
4C	Resideo Technologies Inc	12	N	12-0067	05-A	2055 Dublin Dr Suite 100 San Diego
4C	Resideo Technologies Inc.	12	N	12-0067	04-A	2055 Dublin Dr Suite 100 San Diego
4	Arc Products	12	N	12-0073	02-A	1245 30th St San Diego
4	Phase II	12	N	12-0082	01-A	9485 Customhouse Pz Suite D San Diego
4	County; East Mesa Detention Center	12	N	12-0085	01-A	446 Alta Rd San Diego
4	One Source Distributors	12	N	12-0087	01-A	8740 Avenida Costa Blanca San Diego
4	City; Police Dept Southern	12	N	12-0089	01-A	1120 27th St San Diego
4	Coronado Shell	12	N	12-0091	01-A	2485 Coronado (Sb) Av San Diego
4C	Parker Hannifin Corp CSS Division	12	N	12-0094	06-A	7664 Panasonic Wy San Diego
4C	Parker Hannifin Corporation	12	N	12-0094	07-A	7664 Panasonic Wy San Diego
4	Otay Shell	12	N	12-0095	01-A	2310 Roll Dr San Diego
4	Chula Vista Dialysis Center	12	N	12-0096	01-A	2252 Verus St Suite D San Diego
4	San Ysidro Dialysis Center	12	N	12-0097	01-A	3010 Del Sol Bl San Diego
4	Chevron Station # 203188	12	N	12-0098	01-A	604 Dennery Rd San Diego
4	TDK-Lambda Americas Inc	12	N	12-0101	03-A	3055 Del Sol Bl San Diego
4M	Dental Arts of Palm Ave	12	N	12-0103	03-A	3388 Palm Av Suite 101 San Diego
4	Vons # 2338	12	N	12-0109	02-A	665 Saturn Bl San Diego
4	Sperian Hearing Protection LLC	12	N	12-0111	03-A	7828 Waterville Rd San Diego
4M	Ismole Dental	12	N	12-0121	02-A	4370 Palm Av Suite C San Diego
4M	Carlos Garcia DDS	12	N	12-0122	03-A	1270 Picador Bl Suite L-M San Diego
4M	Southland Plaza Dental	12	N	12-0123	03-A	655 Saturn Bl Suite G San Diego
4M	San Ysidro Dental Care	12	N	12-0125	03-A	2004 Dairy Mart Rd San Diego
4	Wal-Mart # 2150	12	N	12-0126	02-A	710 Dennery Rd San Diego
4	Steris Isomedix Services	12	N	12-0131	02-A	7685 Saint Andrews Av San Diego
4	Chula Vista Tire Inc	12	N	12-0134	02-A	750 Dennery Rd San Diego
4C	General Dynamics Motion Control LLC	12	N	12-0137	05-A	7603 Saint Andrews Av Suite H San Diego
4C	General Dynamics Motion Control LLC	12	N	12-0137	06-A	7603 Saint Andrews Av Suite H San Diego
2	Kaiser Foundation Health Plan	12	N	12-0140	02-A	4652 Palm Av San Diego
5	Kaiser Foundation Health Plan	12	N	12-0140	03-A	4652 Palm Av San Diego
2	ADESA California LLC dba ADESA San	12	N	12-0143	04-A	2175 Cactus Rd San Diego
1	AP Precision Metals	12	Y	12-0144	06-A	1215 30th St San Diego
2	Larkspur Energy LLC	12	N	12-0145	06-A	9355 Otay Mesa Rd San Diego
4	CVS Pharmacy # 9115	12	N	12-0146	03-A	645 Saturn Bl San Diego
5	Industrial Polishing Services Inc	12	N	12-0148	02-A	9465 Customhouse Pz Suite H-1 San Diego
4C	Leidos Inc	12	N	12-0150	04-A	1330 30th St Suite A-C San Diego

Active Permits Metrowide at Year End

Report run on: Monday, January, 3 2022 9:49 am

<i>Class</i>	<i>Name</i>	<i>Area</i>	<i>SIU</i>	<i>Facility</i>	<i>Permit</i>	<i>Address</i>
4	Automated Customs Experts	12	N	12-0153	02-A	9163 Siempre Viva Rd Suite A-B San Diego
3	Kraft Heinz Foods Company	12	Y	12-0154	05-A	7878 Airway Rd San Diego
4	Longs Drug Stores	12	N	12-0155	02-A	444 E San Ysidro Bl San Diego
4	Silva Caseworks	12	N	12-0162	02-A	2212 Verus St San Diego
4	Mya International Inc	12	N	12-0164	01-A	1445 30th St Suite B San Diego
5	Compliance Customs Brokers and Logistic	12	N	12-0165	01-A	9651 Airway Rd Suite E San Diego
4C	Crower Cams & Equipment Co Inc	12	N	12-0167	05-A	6180 Business Center Ct San Diego
4C	Crower Cams & Equipment Co Inc	12	N	12-0167	06-A	6180 Business Center Ct San Diego
4	World Petrol II - Calimart II	12	N	12-0168	01-A	1605 Cactus Rd San Diego
4	Sanyo North American Corporation	12	N	12-0169	01-A	2055 Sanyo Av San Diego
4	McMahon Steel Company Inc	12	N	12-0170	01-A	6795 Calle De Linea San Diego
4	Lamkin Corporation	12	N	12-0172	01-A	6530 Gateway Park Dr San Diego
4	Otay Mesa Sales Inc	12	N	12-0176	02-A	1596 Radar Rd San Diego
2	Truck Net LLC	12	N	12-0177	02-A	8490 Avenida De La Fuente San Diego
2	Truck Net LLC	12	N	12-0177	03-A	8490 Avenida De La Fuente San Diego
4	Ron & Sons Trucking Inc	12	N	12-0179	01-A	1581 Radar Rd San Diego
4	Zavalza Trucking Company Inc	12	N	12-0181	01-A	1476 Radar Rd San Diego
4	Nushoe Incorporated	12	N	12-0183	01-A	1422 Radar Rd San Diego
4	Intransport Services Corporation	12	N	12-0184	01-A	1429 La Media Rd San Diego
5	California Industrial Fabrics	12	N	12-0189	01-A	2325 Marconi Ct San Diego
4	City; Brown Field Airport Operations Otay	12	N	12-0190	01-A	1424 Continental St San Diego
4	First Flight Corporation	12	N	12-0191	01-A	6810 Curran St San Diego
5	Grace Tabernacle	12	N	12-0198	02-A	7015 Alamitos Av San Diego
4	Caliber Collision	12	N	12-0200	01-A	7025 Many Cr San Diego
4C	Spec-Built Systems Inc	12	N	12-0202	05-A	2150 Michael Faraday Dr San Diego
4	California Splendor Inc	12	N	12-0206	01-A	7684 Saint Andrews Av Suite A San Diego
4	Power-Sonic Corporation	12	N	12-0207	01-A	7550 Panasonic Wy San Diego
4	CVS Pharmacy # 9524	12	N	12-0208	02-A	3320 Palm Av San Diego
4	Performance Plastics Inc	12	N	12-0210	01-A	7919 Saint Andrews Av San Diego
4	Kelcourt Plastics	12	N	12-0211	01-A	2189 Britannia Bl San Diego
3	Tarantino Wholesale Food Distributor	12	Y	12-0212	03-A	7651 Saint Andrews Av San Diego
4	Zebra Technologies Corporation	12	N	12-0213	01-A	1440 Innovative Dr Suite 100 San Diego
3	Ajinomoto Foods North America Inc	12	Y	12-0220	05-A	8411 Siempre Viva Rd San Diego
3	Ajinomoto Foods North America Inc	12	Y	12-0220	06-A	8411 Siempre Viva Rd San Diego
4	Chevron	12	N	12-0221	02-A	1599 La Media Rd San Diego
4M	Jose L Lopez DDS Inc	12	N	12-0222	02-A	3490 Palm Av Unit 1 San Diego
4	Marcos Borrero MD	12	N	12-0223	01-A	3490 Palm Av Unit 2 San Diego
5	Palm Nail	12	N	12-0224	03-A	3398 Palm Av Suite D San Diego
4	Dr Maria Rhi	12	N	12-0225	01-A	3327 Palm Av San Diego
4	Pinnacle Industrial Supply Inc	12	N	12-0230	01-A	6975 Camino Maquiladora San Diego
2F	Juvenile Detention Facility	12	N	12-0231	01-A	446 Alta Rd San Diego
4	Greenwald's Autobody & Frameworks Inc	12	N	12-0232	01-A	2285 Many St San Diego
4	US Border Patrol	12	N	12-0235	01-A	1802 Saturn Bl San Diego
4	Jose Guzman DDS	12	N	12-0236	01-A	1555 Palm Av Suite J1 San Diego
4	Palm Avenue Recycling LP	12	N	12-0237	01-A	1705 Palm Av San Diego

Active Permits Metrowide at Year End

Report run on: Monday, January, 3 2022 9:49 am

<i>Class</i>	<i>Name</i>	<i>Area</i>	<i>SIU</i>	<i>Facility</i>	<i>Permit</i>	<i>Address</i>
4	Aguilar Auto Sales	12	N	12-0238	01-A	2264 Palm Av San Diego
4	Advanced Mechatronics Solutions	12	N	12-0241	01-A	9163 Siempre Viva Rd Suite F San Diego
4	YRC Inc	12	N	12-0242	01-A	6930 Cactus Ct San Diego
4	San Diego Vista Steel Service Corp	12	N	12-0243	01-A	8753 Kerns St San Diego
1	Harcon Precision Metals Inc	12	Y	12-0244	03-A	1790 Dornoch Ct San Diego
4	Sharps Electronics Manufacturing	12	N	12-0247	01-A	9295 Siempre Viva Rd Suite J-2 San Diego
5	Richlong International (Sandberg Industries)	12	N	12-0248	01-A	9986 Via De La Amistad Suite D San Diego
5	PEC of America Corp	12	N	12-0250	01-A	2297 Niels Bohr Ct Suite 100 San Diego
4	Advanced Coating Solutions	12	N	12-0251	01-A	2295 Paseo De Las America Suite 20 San Diego
5	Schneider National Inc	12	N	12-0252	01-A	9093 Airway Rd San Diego
4	Dicopel	12	N	12-0253	01-A	8695 Avenida Costa Blanca San Diego
2	Northwest Circuits Corp	12	N	12-0254	01-A	8660 Avenida Costa Blanca San Diego
2	Northwest Circuits Corp	12	N	12-0254	02-A	8660 Avenida Costa Blanca San Diego
4	Samwha USA Inc	12	N	12-0255	01-A	2555 Melksee St San Diego
4	CMB Maquila/Baja-Mex EAS	12	N	12-0256	01-A	8580 Avenida De La Fuente Suite J San Diego
4	Sanritsu Chemicals America Inc	12	N	12-0257	01-A	9731 Siempre Viva Rd Suite San Diego
5	BCM Manufacturing (Vertek International)	12	N	12-0258	01-A	2297 Niels Bohr Ct Suite 207 San Diego
4	Suntron dba Brokerage & Logistic Solutions	12	N	12-0261	01-A	1659 Gales Bl San Diego
4	Coronado Electronics/JC Power	12	N	12-0262	01-A	464 Calle Primera Suite 800 San Ysidro
4	Rainbow Mart	12	N	12-0263	01-A	2344 Via Segundo San Ysidro
4	Unlimited Electro Automation	12	N	12-0265	01-A	8755 Mesa Point Tr San Diego
4	Rohm Semiconductor	12	N	12-0266	01-A	1424 Corporate Center Dr Suite 110 San Diego
4	DHL Global Forwarding	12	N	12-0267	01-A	2220 Niels Bohr Ct San Diego
4	Rohm Electronics	12	N	12-0267	02-A	2220 Niels Bohr Ct San Diego
4	St Clair Enterprises Inc	12	N	12-0268	01-A	301 E San Ysidro Bl San Ysidro
4	Cortes Towing Enterprises Inc	12	N	12-0270	01-A	919 Hollister St San Diego
4	Kieran Label Corporation	12	N	12-0271	01-A	2321 Siempre Viva Ct Suite 101 San Diego
4	Big Toy Depot	12	N	12-0272	01-A	7515 Britannia Ct San Diego
3	Jensen Meat Company Inc	12	Y	12-0275	03-A	2550 Britannia Bl Suite 101 San Diego
3	Jensen Meat Company Inc	12	Y	12-0275	04-A	2550 Britannia Bl Suite 101 San Diego
5	I G Electronics	12	N	12-0276	01-A	464 W Calle Primera San Ysidro
4	Rossin Steel	12	N	12-0277	01-A	2660 Cactus Rd San Diego
5	PEC of America Corp	12	N	12-0278	01-A	2320 Paseo De Las America Suite 107 San Diego
5	Vertek-BCM	12	N	12-0279	01-A	2320 Paseo De Las America Suite 110 San Diego
5	Dai Dong USA Inc	12	N	12-0280	01-A	2320 Paseo De Las America Suite 103 San Diego
3	Spectex Inc dba Specialty Textile Services	12	Y	12-0283	03-A	1333 30th St Suite A San Diego
3	US General Services Administration - SYL	12	Y	12-0285	03-A	720 E San Ysidro Bl San Diego
4	Affordable Grease	12	N	12-0286	01-A	5662 Otay Valley Rd San Diego
4	USN; Naval Outlying Land Field (NOLF)	12	N	12-0287	01-A	1500 13th St Imperial Beach
4	Pepito Outlets Furniture dba Rainbow Mart	12	N	12-0288	01-A	330 W Calle Primera San Ysidro
4	Miller Marine	12	N	12-0289	01-A	2275 Many St San Diego
4	Cross Steel	12	N	12-0290	01-A	1616 Precision Park Ln Suite C San Ysidro
5	Inzi Display America Inc	12	N	12-0291	01-A	7880 Airway Rd Suite B6E San Diego
5	Chiyoda Integre	12	N	12-0292	01-A	9335 Airway Rd Suite 106 San Diego
5	O & S California Inc	12	N	12-0293	01-A	9731 Siempre Viva Rd Suite E San Diego

Active Permits Metrowide at Year End

Report run on: Monday, January, 3 2022 9:49 am

<i>Class</i>	<i>Name</i>	<i>Area</i>	<i>SIU</i>	<i>Facility</i>	<i>Permit</i>	<i>Address</i>
5	Otay Electric Distribution Group	12	N	12-0294	01-A	9850 Via De La Amistad San Diego
5	Eurotec Engineering	12	N	12-0295	01-A	9765 Marconi Dr Suite 101 San Diego
4	Costco Wholesale Corporation #910	12	N	12-0296	01-A	2222 Enrico Fermi Dr San Diego
5	No Second Thoughts Inc	12	N	12-0297	01-A	1333 30th St Suite D San Diego
2	Advanced ElectroMagnetics Inc	12	N	12-0298	01-A	1320 Air Wing Rd Suite 101 San Diego
5	Fresh Tech USA	12	N	12-0299	01-A	9865 Marconi Dr Suite C San Diego
4	Universal Metal Products Inc	12	N	12-0300	01-A	10050 Via De La Amistad Suite 2482 San Diego
5	Verdict International	12	N	12-0301	01-A	2320 Paseo De Las America Suite 110 San Diego
5	IWAI Metal Company	12	N	12-0302	01-A	2320 Paseo De Las America Suite 202 San Diego
5	Mad Engine Inc	12	N	12-0303	01-A	8917 Kerns St Suite 100 San Diego
5	Napa Auto Parts	12	N	12-0307	01-A	8353 Otay Mesa Rd San Diego
4M	Bajars & Bajars, DDS INC	12	N	12-0314	01-A	2930 Coronado Av Suite C San Diego
4M	South Bay Family Dental	12	N	12-0315	01-A	1850 Coronado Av Suite 404 San Diego
4	Business Assessment	12	N	12-0316	01-A	9565 Heinrich Hertz Dr Suite 4 San Diego
4M	Cynthia Tuason DDS Inc	12	N	12-0317	01-A	1061 Saturn Bl Suite 103 San Diego
4M	RJ Donovan Correctional Facility Dental Clinic	12	N	12-0326	01-A	480 Alta Rd San Diego
4	City; Otay Water Treatment Plant Lab	12	N	12-0331	01-A	1500 Wueste Rd Chula Vista
5	City; South Bay Water Reclamation Plant	12	N	12-0332	01-A	2411 Dairy Mart Rd San Diego
3	UT; Dudek	12	Y	12-0333	01-A	302 Hollister St San Diego
2	Clarkson Laboratory & Supply Inc	13	N	13-0007	04-A	350 Trousdale Dr Chula Vista
2	Sharp Chula Vista Medical Center	13	N	13-0008	06-A	751 Medical Center Ct Chula Vista
4	Brenntag Pacific Inc	13	N	13-0009	02-A	1888 Nirvana Av Chula Vista
5	Castanedas Auto Repair	13	N	13-0010	04-A	44 Broadway Chula Vista
4	Medina's Transmissions	13	N	13-0013	01-A	140 Broadway Chula Vista
4	Pearl Car Wash	13	N	13-0014	01-A	298 Broadway Chula Vista
4	Prudential Overall Supply	13	N	13-0016	06-A	740 F St Chula Vista
4	Vista Palms Car Wash	13	N	13-0023	00-A	795 Broadway Bl Chula Vista
4	Palomar Shell	13	N	13-0027	01-A	1295 3rd Av Chula Vista
2	Southwestern Community College	13	N	13-0040	05-A	900 Otay Lakes Rd Chula Vista
5	Phoenix Towing	13	N	13-0047	02-A	3487 Main St Chula Vista
2	Hyspan Precision Products	13	N	13-0048	04-A	1685 Brandywine Av Chula Vista
4	Hyspan Precision Products	13	N	13-0048	05-A	1685 Brandywine Av Chula Vista
4	City of Chula Vista Public Works	13	N	13-0055	02-A	1800 Maxwell Rd Chula Vista
3	City of Chula Vista Public Works	13	N	13-0055	03-A	1800 Maxwell Rd Chula Vista
2	Scripps Memorial Hospital Chula Vista	13	N	13-0057	04-A	435 H St Chula Vista
2	Scripps Mercy Hospital Chula Vista	13	N	13-0057	05-A	435 H St Chula Vista
2	Network Industries Inc dba Quality Lift Trucks	13	N	13-0063	05-A	115 N Glover Av Suite A Chula Vista
2	Quality Lift Trucks	13	N	13-0063	04-A	115 N Glover Av Suite A Chula Vista
4	Annex Automotive and Industrial Finishes	13	N	13-0064	03-A	45 Broadway Chula Vista
4	Vital Carr	13	N	13-0065	01-A	1403 Broadway Suite 115 Chula Vista
4	Chula Vista Mobil	13	N	13-0070	01-A	902 3rd Av Chula Vista
4	Penske Truck Leasing	13	N	13-0071	01-A	910 Industrial Bl Chula Vista
4	Express Tire	13	N	13-0074	01-A	646 H St Chula Vista
4	Ledezma Automotive Center	13	N	13-0075	01-A	471 Broadway Chula Vista
4	Otay Valley Shell	13	N	13-0095	02-A	4555 Main St Chula Vista

Active Permits Metrowide at Year End

Report run on: Monday, January, 3 2022 9:49 am

<i>Class</i>	<i>Name</i>	<i>Area</i>	<i>SIU</i>	<i>Facility</i>	<i>Permit</i>	<i>Address</i>
4	Pauter Machine Company	13	N	13-0104	01-A	367 Zenith St Chula Vista
4	All American Car Wash	13	N	13-0112	01-A	1137 Broadway Suite A Chula Vista
3	Daiki Enterprise Corp DBA Eastlake Coui	13	N	13-0113	01-A	2375 Clubhouse Dr Chula Vista
4	Vacant	13	N	13-0117	03-A	645 Marsat St Suite D Chula Vista
4	Big O Tires	13	N	13-0124	01-A	399 Broadway Chula Vista
4	Cherniss Tire World	13	N	13-0127	00-A	101 Broadway Chula Vista
4	Butlers Auto Repair	13	N	13-0129	01-A	286 G St Chula Vista
4	MRI of Chula Vista	13	N	13-0131	01-A	755 Medical Center Ct Chula Vista
4	Hernandez Tires Sales	13	N	13-0134	01-A	3236 Main St Chula Vista
4	Plenums Plus	13	N	13-0136	01-A	67 Brisbane St Chula Vista
4	Sealed Air Corporation	13	N	13-0137	01-A	2311 Boswell Rd Suite 8 Chula Vista
3	Marine Group Boat Works	13	N	13-0147	02-A	997 G St Chula Vista
3	Marine Group Boat Works	13	N	13-0147	02-B	997 G St Chula Vista
3	Sunbelt Rentals Inc	13	N	13-0150	02-A	2665 Main St Chula Vista
4	Bowlin's Auto Service	13	N	13-0151	01-A	850 Broadway Chula Vista
4	Jaybright Company	13	N	13-0154	03-A	787 Energy Wy Chula Vista
5	United States Container	13	N	13-0155	01-A	1675 Brandywine Av Suite B Chula Vista
4	South Coast RV Service Center	13	N	13-0156	01-A	801 Broadway Chula Vista
4	Ace Industries Inc	13	N	13-0160	01-A	738 Design Ct Suite 302 Chula Vista
4	Rohr Inc A Collins Aerospace Company	13	N	13-0161	07-A	850 Lagoon Dr Chula Vista
5	Deseret Industries	13	N	13-0163	01-A	1773 Broadway Chula Vista
4	CVS Pharmacy # 9140	13	N	13-0179	03-A	555 Broadway Suite 1054 Chula Vista
4	Sharp Rees-Stealy	13	N	13-0182	02-A	525 3rd Av Chula Vista
4M	Yoshindo Shibuya DDS Inc	13	N	13-0184	02-A	468 3rd Av Chula Vista
4	Heather R Adams DDS	13	N	13-0186	02-A	613 3rd Av Chula Vista
4M	Pacific Dental Group	13	N	13-0188	03-A	310 3rd Av Suite C-1B Chula Vista
4	Clara Lucy Polak MD	13	N	13-0191	02-A	480 4th Av Chula Vista
4M	Gentle Care Family Dentistry	13	N	13-0192	04-A	340 4th Av Suite 16 Chula Vista
4	Bonita Pet Hospital	13	N	13-0195	02-A	3438 Bonita Rd Chula Vista
4	Wal-Mart # 2291	13	N	13-0196	02-A	75 N Broadway Chula Vista
4M	Chau Truong DDS	13	N	13-0198	03-A	713 Broadway Suite F Chula Vista
4M	Sonrisa Dental	13	N	13-0199	03-A	510 Broadway Suite 4 Chula Vista
4M	Tanaka Dental Corporation	13	N	13-0202	02-A	212 Church Av Chula Vista
4M	David A Hudson/John W Masters	13	N	13-0203	03-A	273 Church Av Chula Vista
4M	Twin Oaks Periodontics	13	N	13-0206	03-A	230 F St Suite C Chula Vista
4M	Chula Vista Periodontics	13	N	13-0207	04-A	345 F St Suite 240 Chula Vista
4M	Norma A Ramirez DDS	13	N	13-0209	03-A	230 F St Suite A Chula Vista
4M	Bill C Crafton DDS	13	N	13-0210	02-A	257 F St Chula Vista
4M	Dr Derek M Lichter	13	N	13-0212	02-A	247 F St Chula Vista
5	CVS Pharmacy # 9240	13	N	13-0213	04-A	380 H St Chula Vista
4	Nicholas M Gistaro DMD	13	N	13-0216	02-A	549 H St Suite A Chula Vista
4M	Nirmal Shah Dental Corp	13	N	13-0216	03-A	549 H St Suite A Chula Vista
4M	Woodside Dental Office	13	N	13-0220	02-A	498 Hale St Chula Vista
4	South Bay Family Dental Center	13	N	13-0222	02-A	290 Landis Av Chula Vista
4	Banfield	13	N	13-0226	02-A	820 Paseo Del Rey Chula Vista

Active Permits Metrowide at Year End

Report run on: Monday, January, 3 2022 9:49 am

<i>Class Name</i>	<i>Area</i>	<i>SIU</i>	<i>Facility</i>	<i>Permit</i>	<i>Address</i>
4M Center For Beautiful Smiles	13	N	13-0229	03-A	1415 Ridgeback Rd Suite 23 Chula Vista
4 Thomas E Heinrichs DDS	13	N	13-0229	02-A	1415 Ridgeback Rd Suite 23 Chula Vista
4 Rancho Del Ray Orthodontics	13	N	13-0232	01-A	1040 Tierra Del Rey St Suite 201 Chula Vista
4 Nita Hugo Largonza DMD	13	N	13-0233	02-A	1040 Tierra Del Rey Suite 207 Chula Vista
4M Meigs Family Dentistry	13	N	13-0234	03-A	1040 Tierra Del Rey Suite 209 Chula Vista
4 California Retina Associates	13	N	13-0236	02-A	865 3rd Av Chula Vista
4 Part Plus Car Care Center	13	N	13-0240	03-A	675 Anita St Suite 6 Chula Vista
4M Dental Checkup	13	N	13-0245	04-A	1010 Broadway Suite 5 Chula Vista
4 McCormack Dental Imaging	13	N	13-0247	02-A	285 K St Chula Vista
4 Joel S Berger DDS	13	N	13-0254	02-A	752 Medical Center Ct Suite 205 Chula Vista
4M Hilltop Dentistry	13	N	13-0255	02-A	11 Naples St Chula Vista
4 Vacant	13	N	13-0257	02-A	330 Oxford St Chula Vista
4 Vons # 71	13	N	13-0266	02-A	2250 Otay Lakes Rd Chula Vista
4 Eastlake Village Dental Center	13	N	13-0268	02-A	2260 Otay Lakes Rd Chula Vista
4 Rite Aid # 5615	13	N	13-0270	02-A	507 Telegraph Rd Chula Vista
4 Sweetwater Authority	13	N	13-0274	02-A	3066 N 2nd Av Chula Vista
4 Rent-X Industries Inc	13	N	13-0275	01-A	2665 Main St Chula Vista
4 Lyon Technologies Inc	13	N	13-0276	04-A	1690 Brandywine Av Chula Vista
2 Republic Services dba Allied Waste Service	13	N	13-0278	04-A	881 Energy Wy Chula Vista
2 Republic Services dba Allied Waste Service	13	N	13-0278	05-A	881 Energy Wy Chula Vista
4 Target # 203	13	N	13-0281	02-A	1240 Broadway Chula Vista
3 United Parcel Service Inc	13	N	13-0283	05-A	2300 Boswell Ct Chula Vista
4 Arya Cleaners	13	N	13-0284	01-A	2260 Otay Lakes Rd Suite 12 Chula Vista
4 Daily Fresh Cleaners	13	N	13-0285	01-A	202 Broadway Chula Vista
4 CVS Pharmacy # 9632	13	N	13-0289	03-A	880 Third Av Chula Vista
5 Southwest Boulder and Stone	13	N	13-0291	01-A	621 L St Chula Vista
4 Ortiz Corporation	13	N	13-0292	01-A	788 Energy Wy Chula Vista
4 Sunrise Jewelry Manufacturing	13	N	13-0293	02-A	2371 Fenton St Chula Vista
4 Flag Crafters	13	N	13-0294	01-A	1095 Bay Bl Chula Vista
4 Standard Auto Recycling	13	N	13-0295	02-A	150 Reed Ct Chula Vista
4 World Petrol I - Calimart I	13	N	13-0297	01-A	3733 Main St Chula Vista
2 Chula Vista Energy Center LLC	13	N	13-0298	05-A	3497 Main St Chula Vista
4 SBC Pacific Bell	13	N	13-0302	01-A	490 Main St Chula Vista
4M Elite Dental Care	13	N	13-0304	03-A	401 H St Suite 4 Chula Vista
4 CVS Pharmacy # 9113	13	N	13-0306	03-A	645 E Palomar St Chula Vista
4 The Star News	13	N	13-0307	01-A	321 E St Chula Vista
4 University Health Care Management	13	N	13-0308	01-A	1323 3rd Av Chula Vista
4M John D Dickie DMD	13	N	13-0309	02-A	345 F St Suite 180 Chula Vista
4 City of Chula Vista Police Department	13	N	13-0310	01-A	315 4th Av Chula Vista
4 Yuri Kaneda DDS	13	N	13-0311	02-A	1415 Ridgeback Rd Suite 24 Chula Vista
4 Mina A Mafi	13	N	13-0312	01-A	1040 Tierra del Rey Suite 211 Chula Vista
3 Chula Vista Ford and Kia	13	N	13-0316	04-A	560 Auto Park Dr Chula Vista
4 South Bay Pulmonary - Medical Group	13	N	13-0320	02-A	841 Kuhn Dr Suite 200 Chula Vista
4 AFS Industries	13	N	13-0322	01-A	520 Marina Parkway Chula Vista
2F Carl J Hemesath DDS Inc	13	N	13-0323	01-A	855 3rd Av Suite 3330 Chula Vista

Active Permits Metrowide at Year End

Report run on: Monday, January, 3 2022 9:49 am

<i>Class</i>	<i>Name</i>	<i>Area</i>	<i>SIU</i>	<i>Facility</i>	<i>Permit</i>	<i>Address</i>
4M	David Gonzalez, DDS, Dental Coproration	13	N	13-0323	02-A	855 3rd Av Suite 3330 Chula Vista
4	Tortilleria Santa Fe	13	N	13-0324	01-A	2765 Main St B Chula Vista
4	Self Health Resource Center	13	N	13-0325	01-A	1055 Bay Bl Suite A Chula Vista
4	Fuller Honda	13	N	13-0326	03-A	580 Auto Park Dr Chula Vista
2	Curtis-Wright	13	N	13-0327	04-A	1675 Brandywine Av Suite E&F Chula Vista
2	Dresser-Rand	13	N	13-0327	03-A	1675 Brandywine Av Suite E&F Chula Vista
4	Lamar Space	13	N	13-0328	01-A	3730 Main St Chula Vista
4	Arise Waco Scaffolding and Equipment	13	N	13-0330	02-A	676 Moss St Chula Vista
4	Knott's Soak City	13	N	13-0331	01-A	2052 Entertainment Cr Chula Vista
4	County; South Bay Detention Facility	13	N	13-0332	01-A	500 3rd Av Chula Vista
5	Sanyo Plastics Compound America Inc	13	N	13-0335	01-A	765 3rd Av Chula Vista
4	Tantus Inc	13	N	13-0336	01-A	1045 Bay Bl Suite H Chula Vista
4	Natural Essentials Handcrafted Soaps	13	N	13-0338	01-A	567 Douglas St Chula Vista
5	Advanced Products International LLC	13	N	13-0342	02-A	648 Marsat Ct Unit A Chula Vista
4	J & J Polishing	13	N	13-0343	01-A	2631 Faivre St Suite F Chula Vista
5	Bayview Cremation & Burial	13	N	13-0344	01-A	815 3rd Av Chula Vista
5	Amswede Corporation	13	N	13-0345	01-A	149 Reed Ct Chula Vista
4	Anthony's Auto Center	13	N	13-0346	01-A	305 E St Suite B Chula Vista
4	McMahon Steel Company Inc	13	N	13-0347	02-A	1880 Nirvana Av Chula Vista
4	Humphrey Mortuary	13	N	13-0350	01-A	753 Broadway Chula Vista
4M	Cluff Dental Co	13	N	13-0351	02-A	232 3rd Av Suite A Chula Vista
4	Press Plus	13	N	13-0352	01-A	870 Canarios Ct Chula Vista
4	Chevron Products Company SS# 30-1124	13	N	13-0353	01-A	2115 Olympic Py Chula Vista
4	CVS Pharmacy # 8859	13	N	13-0354	03-A	16 3rd Av Chula Vista
4	Heartland Meat Company Inc	13	N	13-0357	02-A	3461 Main St Chula Vista
4	Apollo Tire Company	13	N	13-0363	01-A	1421 Broadway Suite 119 Chula Vista
4	German Werks	13	N	13-0364	01-A	1409 Broadway Suite 101 Chula Vista
4	T & K Smog and Auto Repair	13	N	13-0365	01-A	1409 Broadway Suite 106 Chula Vista
4	Sparks Car Care	13	N	13-0367	01-A	1415 Broadway Suite 103 Chula Vista
4	Grelaz Complete Auto Repair	13	N	13-0368	01-A	107 Broadway Unit A Chula Vista
5	South Bay Leather	13	N	13-0371	02-A	3358 Main St Chula Vista
5	True Bar Machine Shop & Auto	13	N	13-0372	01-A	1403 Broadway Suite 107 Chula Vista
4	Four Wheel Parts Performance Centers	13	N	13-0375	01-A	1427 Broadway Suite 104 Chula Vista
4	Riviera Auto Sales Inc	13	N	13-0376	01-A	644 Broadway Chula Vista
4	Hotsy Pressure Washing Equipment of SD	13	N	13-0377	02-A	359 Trousdale Dr Unit B Chula Vista
4	Crown Dental Lab	13	N	13-0378	01-A	38 3rd Av Suite C Chula Vista
4	Pete's Precision Automotive	13	N	13-0381	01-A	310 Trousdale Dr Suite A Chula Vista
4M	Dental Arts of South Bay	13	N	13-0382	02-A	754 Medical Center Ct Unit 201 Chula Vista
4	PoCo Group Inc	13	N	13-0383	01-A	376 Trousdale Dr Chula Vista
4	United Rentals	13	N	13-0384	01-A	501 C St Chula Vista
4M	Perfecta Dental Group	13	N	13-0387	02-A	314 Palomar St Chula Vista
4M	Palomar Dental Group	13	N	13-0388	02-A	664 Palomar St Suite 1103 Chula Vista
4	Abbate Dental Clinic	13	N	13-0389	01-A	79 Minot Av Chula Vista
4	Inter Dental Ceramics	13	N	13-0390	01-A	1231 3rd Av Suite B Chula Vista
4	South Bay Autohaus	13	N	13-0391	01-A	310 Trousdale Dr Suite D Chula Vista

Active Permits Metrowide at Year End

Report run on: Monday, January, 3 2022 9:49 am

<i>Class</i>	<i>Name</i>	<i>Area</i>	<i>SIU</i>	<i>Facility</i>	<i>Permit</i>	<i>Address</i>
4	GI Trucking Company	13	N	13-0392	01-A	120 Press Ln Chula Vista
4	Chula Vista Electric	13	N	13-0393	01-A	127 Press Ln Chula Vista
4	G Scott Asphalt Inc	13	N	13-0394	01-A	358 Trousdale Dr Chula Vista
4	Healy Media Inc	13	N	13-0395	01-A	637 3rd Av Suite A-1 Chula Vista
4	Young Kim Dental Lab	13	N	13-0396	01-A	1815 Meeks Bay Dr Chula Vista
2	Transdev Services Inc	13	N	13-0399	03-A	3650 Main St Chula Vista
4	Christa Bates Dental Laboratory	13	N	13-0400	01-A	1086 Misty Creek St Chula Vista
4	Bonita Car Wash	13	N	13-0401	01-A	3048 Bonita Rd Chula Vista
4	Bonita Village Cleaners	13	N	13-0402	02-A	4054 Bonita Rd Chula Vista
4	Zepeda's Radiator Repair	13	N	13-0405	02-A	801 Broadway Suite C Chula Vista
4	Sam's Muffler	13	N	13-0407	01-A	225 Beyer Wy Chula Vista
4	Marco's Radiator Repair	13	N	13-0408	01-A	2530 Main St Suite H Chula Vista
4	Tony Radiators	13	N	13-0409	01-A	2827 Main St Unit A Chula Vista
4	Sirit Inc	13	N	13-0411	01-A	901 Lane Av Suite 100 Chula Vista
4	Wal-Mart Store # 5305	13	N	13-0412	02-A	1150 Broadway Chula Vista
3	Sunbelt Rentals Inc	13	N	13-0415	01-A	317 K St Chula Vista
4M	Suzanne Tulenko DMD	13	N	13-0416	02-A	235 F St Chula Vista
4	Vacant	13	N	13-0418	02-A	340 4th Av Suite 17 Chula Vista
4	CVS Pharmacy # 9196	13	N	13-0419	02-A	1376 Third Av Chula Vista
4M	Vicente Miramor DDS Inc	13	N	13-0421	02-A	276 Church Av Unit C Chula Vista
4	Chula Vista Animal Care Facility	13	N	13-0424	01-A	130 Beyer Wy Chula Vista
4	Ambart Inc	13	N	13-0428	01-A	652 H St Chula Vista
4	Smiles of Eastlake	13	N	13-0429	01-A	2127 Olympic Py Unit 1003 Chula Vista
4	Las Vegas Premium Water	13	N	13-0431	01-A	694 Moss St Chula Vista
4	Sundance Cleaning Services	13	N	13-0432	01-A	601 Westview Pl Chula Vista
4	Scripps Mercy Medical Group	13	N	13-0435	01-A	180 Otay Lakes Rd Suite 300 Chula Vista
4M	Children's Primary Dental Care & Adult C	13	N	13-0436	02-A	397 E St Suite A&B Chula Vista
4M	Berger Dental Corporation	13	N	13-0437	02-A	180 Otay Lakes Rd Suite 204 Chula Vista
4	South Bay Motor Sports	13	N	13-0438	01-A	1890 Auto Park Pl Chula Vista
3	Toyota Chula Vista	13	N	13-0439	02-A	650 Main St Chula Vista
4	McCune Chrysler Jeep & Dodge	13	N	13-0440	01-A	1885 Auto Park Pl Chula Vista
5	C Lloyd Johnson	13	N	13-0452	01-A	1690 Brandywine Av Chula Vista
4	Kleen Blast	13	N	13-0453	01-A	676 Moss St Suite B Chula Vista
2	UT; Innovative Environmental Solutions	13	Y	13-0454	07-C	1330 3rd Av Chula Vista
4	Eastlake Elite Dental	13	N	13-0455	01-A	2060 Otay Lakes Rd Suite 110 Chula Vista
4M	Otay Lakes Dental Group	13	N	13-0456	03-A	2060 Otay Lakes Rd Suite 230 Chula Vista
4	East Lake Medical Spa	13	N	13-0457	01-A	2060 Otay Lakes Rd Suite 220 Chula Vista
4M	Bonita Smiles Dentistry	13	N	13-0458	02-A	1558 E H St Suite B Chula Vista
4	California Hardcoating Company	13	N	13-0462	01-A	3517 Main St Unit 303 Chula Vista
4	JetCleanUSA Inc	13	N	13-0464	01-A	359 Trousdale Dr Suite B Chula Vista
4M	Victor H Carrillo Professional Dental Corj	13	N	13-0465	03-A	333 H St Suite 1015 Chula Vista
4	Mario's Auto Detail	13	N	13-0467	02-A	1409 Broadway Suite 102 Chula Vista
5	Hamilton Meat LLC	13	N	13-0468	01-A	3515 Main St Suite 208 Chula Vista
4	Pacific Pet Hospital	13	N	13-0471	01-A	1466 Melrose Av Chula Vista
4M	Melrose Dental Care	13	N	13-0472	02-A	1456 Melrose Av Chula Vista

Active Permits Metrowide at Year End

Report run on: Monday, January, 3 2022 9:49 am

<i>Class</i>	<i>Name</i>	<i>Area</i>	<i>SIU</i>	<i>Facility</i>	<i>Permit</i>	<i>Address</i>
4	DaVinci Metal Works	13	N	13-0474	01-A	3521 Main St Suite 506 Chula Vista
4	AT&T Services Inc	13	N	13-0475	01-A	1090 Apache Dr Chula Vista
4M	Twin Oaks Family Dentistry	13	N	13-0477	02-A	230 F St Suite D Chula Vista
3	Chula Vista Ice Cream and Commissary	13	N	13-0478	01-A	163 Mace St Chula Vista
4	Quality Powder Coating	13	N	13-0482	01-A	2605 Faivre St Suite A Chula Vista
4	Bradford Powder Coating	13	N	13-0483	01-A	739 Design Ct Suite 503 Chula Vista
4	CPM Electronics Inc	13	N	13-0484	01-A	3802 Main St Suite 9 Chula Vista
4	Bellama Custom Metal Fabricators Inc	13	N	13-0485	01-A	3129 Main St Chula Vista
4	Estrada Metals	13	N	13-0486	01-A	3261 Main St 1/2 Chula Vista
4	Hikam America	13	N	13-0488	01-A	3521 Main St Suite 501 Chula Vista
4	MH Electronics	13	N	13-0489	01-A	3639 Main St Chula Vista
4	Qual Chem	13	N	13-0490	01-A	1725 4th Av Chula Vista
4	MGP Caliper Covers	13	N	13-0491	01-A	616 Marsat Ct Chula Vista
4	Aker Leather Products	13	N	13-0492	01-A	2248 Main St Suite 4 Chula Vista
4	Sams Electronic Technologies Inc	13	N	13-0493	01-A	1040 Colorado Av Chula Vista
4	American Biologics	13	N	13-0495	01-A	1180 Walnut Av Chula Vista
4	Frazee Paint	13	N	13-0496	01-A	895 Third Av Chula Vista
4	DNP Electronics America LLC	13	N	13-0499	01-A	2391 Fenton St Chula Vista
4	Vesco Metal Craft	13	N	13-0500	01-A	2425 Fenton St Chula Vista
5	Salestronics	13	N	13-0503	02-A	861 Harold Pl Unit 307 Chula Vista
4	California Plating	13	N	13-0508	01-A	1550 W Frontage Rd Unit 2 Chula Vista
4	American Safety Technologies	13	N	13-0509	02-A	679 Anita St Suite A Chula Vista
4	Peter Parts Electronics	13	N	13-0510	01-A	679 Anita St Suite G Chula Vista
5	Espuma Distributing	13	N	13-0511	01-A	727 E J St Chula Vista
5	Action Trophies & Engraving	13	N	13-0512	01-A	1485 Country Vistas Ln Bonita
5	Schafer International	13	N	13-0513	01-A	220 Surrey Dr Chula Vista
5	JB General Distributions	13	N	13-0514	01-A	986 Paseo Del Paso Chula Vista
5	Marscot Marine and Industrial Supply	13	N	13-0517	01-A	2446 Main St Suite V Chula Vista
5	Baja Powder Coating and Iron Works	13	N	13-0518	01-A	444 Anita St Space 114 Chula Vista
4	Metcon Inc	13	N	13-0519	01-A	688 Marsat Ct Chula Vista
5	JFE Shoji Steel America Inc	13	N	13-0520	01-A	821 Kuhn Dr Suite 202 Chula Vista
5	Iwai Metal America Co LTD	13	N	13-0521	01-A	3130 Bonita Rd Suite 204 Chula Vista
5	Meiki	13	N	13-0522	01-A	3450 Bonita Rd Suite 107 Chula Vista
4	Pacific Tank Cleaning Services	13	N	13-0524	01-A	2387 Faivre St Chula Vista
4	Crystal Coatings	13	N	13-0527	01-A	1616 Industrial Bl Suite 102 Chula Vista
5	International Galvanizing Inc	13	N	13-0529	01-A	819 Anchorage Pl Chula Vista
2	UT; ETIC Engineering Inc	13	Y	13-0530	01-A	745 H St Chula Vista
2	UT; ExxonMobil Oil Corporation c/o ETI	13	Y	13-0530	02-A	745 H St Chula Vista
4	Palomar Valero	13	N	13-0532	01-A	873 Palomar St Suite 1 Chula Vista
2	Fleetwash Inc	13	N	13-0533	01-A	649 Anita St Suite 1A Chula Vista
5	Otay Hydraulics	13	N	13-0533	02-A	649 Anita St Suite 1A Chula Vista
4	Adept Process Services Inc	13	N	13-0534	02-A	609 Anita St Chula Vista
2	Super Welding of Southern California	13	N	13-0534	01-A	609 Anita St Chula Vista
5	California Electric Supply	13	N	13-0536	01-A	1011 Bay Bl Chula Vista
5	Hitachi Home Electronics	13	N	13-0537	01-A	2420 Fenton St Chula Vista

Active Permits Metrowide at Year End

Report run on: Monday, January, 3 2022 9:49 am

<i>Class</i>	<i>Name</i>	<i>Area</i>	<i>SIU</i>	<i>Facility</i>	<i>Permit</i>	<i>Address</i>
5	CMF Distribution	13	N	13-0538	01-A	2445 Fenton St Chula Vista
4	Videotel Inc	13	N	13-0539	01-A	681 Anita St Suite 104 Chula Vista
5	Euroart Frames	13	N	13-0540	01-A	790 Palomar St Suite D Chula Vista
5	JS Terminal Corp	13	N	13-0541	01-A	891 Kuhn Dr Chula Vista
5	Chula Vista Elementary School District	13	N	13-0543	01-A	1855 Maxwell Rd Chula Vista
4	US Renal Care Chula Vista Dialysis	13	N	13-0544	01-A	2084 Otay Lakes Rd Suite 101 Chula Vista
5	KGL America Inc	13	N	13-0546	01-A	660 Bay Bl Chula Vista
5	RapidBond	13	N	13-0547	01-A	1579 Jayken Wy A Chula Vista
5	Vape Up USA	13	N	13-0548	01-A	1079 3rd Av Chula Vista
2	UT; Brenntag Pacific Inc	13	Y	13-0549	03-A	1888 Nirvana Av Chula Vista
4	Bay Bridge Brewing	13	N	13-0550	01-A	688 Marsat Ct Suite B Chula Vista
3	AQX2 Inc DBA Aqua Clean Express	13	Y	13-0553	01-A	4290 Main St Chula Vista
4M	Western Dental	13	N	13-0556	01-A	1101 Broadway Chula Vista
4M	Dr Nita H Largoza, DMD	13	N	13-0557	01-A	1040 Tierra Del Rey Suite 207 Chula Vista
4M	Great Dental Group	13	N	13-0558	01-A	1310 3rd Av Suite A1 Chula Vista
4M	Sunbow Family Dentistry	13	N	13-0559	01-A	1351 Medical Center Dr Suite B Chula Vista
4M	Naples Plaza Dental Practice	13	N	13-0560	01-A	1072 3rd Av Suite A Chula Vista
3	Boochcraft	13	N	13-0562	01-A	692 Anita St Chula Vista
4M	Southwest Dental	13	N	13-0563	01-A	1660 Broadway Suite 4 Chula Vista
4M	Eastlake Dentistry	13	N	13-0564	01-A	2400 Fenton St Suite 100 Chula Vista
4M	G Marquez DDS dba Otay Lakes Smiles	13	N	13-0565	01-A	2452 Fenton St Suite 200 Chula Vista
4M	Salt Creek Dental	13	N	13-0566	01-A	2452 Fenton St Suite 304 Chula Vista
4M	Affinity Dental South Bay	13	N	13-0567	01-A	290 Landis Av Suite A&B Chula Vista
4M	Dr Marco Alegria Dental Office	13	N	13-0568	01-A	127 3rd Av Chula Vista
4M	Chula Vista Pediatric Dentistry	13	N	13-0569	01-A	1040 Tierra Del Rey Suite 103 Chula Vista
4M	Chula Vista Dental Arts/Mariflor Duhaylu	13	N	13-0570	01-A	340 4th Av Suite 15 Chula Vista
4M	Victor Chou, DDS	13	N	13-0571	01-A	394 Broadway Suite A Chula Vista
4M	Sasan K Parsi, DDS	13	N	13-0572	01-A	2452 Fenton St Suite 103 Chula Vista
4M	Brian T Tanaka	13	N	13-0573	01-A	2446 Fenton St Suite 101 Chula Vista
4M	Akhavan Orthodontics	13	N	13-0574	01-A	345 F St Suite 190 Chula Vista
4M	John Tillner Dental Corp	13	N	13-0575	01-A	769 Medical Center CT Suite 200 Chula Vista
4M	DR Delilah T Genido Dental Office	13	N	13-0576	01-A	219 Landis Av Chula Vista
4M	Rick Takahashi/Janet Yamate	13	N	13-0577	01-A	610 3rd Av Chula Vista
4M	Dental Art Designs at Eastlake	13	N	13-0578	01-A	860 Kuhn Dr Suite 203 Chula Vista
4M	Latino Family Dental	13	N	13-0579	01-A	1635 3rd Av Suite D Chula Vista
4M	Irene M Ting DMD, Inc	13	N	13-0580	01-A	2452 Fenton ST Suite 204 Chula Vista
4M	Estrella Dental	13	N	13-0581	01-A	2452 Fenton St Suite 100 Chula Vista
4M	Guzman Dental Office	13	N	13-0582	01-A	2638 Main St Suite J Chula Vista
4M	South Bay Dental	13	N	13-0583	01-A	345 F St Suite 290 Chula Vista
4M	Eastlake Periodontics & Implants	13	N	13-0584	01-A	2452 Fenton St Suite 302 Chula Vista
4M	South Bay Pediatric Dental Group	13	N	13-0585	01-A	2446 Fenton St Suite 102 Chula Vista
4M	Rancho Del Rey Center for Periodontics &	13	N	13-0586	01-A	885 Canarios Ct Suite 202 Chula Vista
4M	Bonnie M Badii, DDS, Dental Professiona	13	N	13-0587	01-A	480 4th Av Suite 314 Chula Vista
4M	Albert Broas DDS Inc	13	N	13-0588	01-A	1295 Broadway Suite 204 Chula Vista
4M	Federrco Dracenberg DDS Inc	13	N	13-0589	01-A	890 Eastlake Py Suite 101 Chula Vista

Active Permits Metrowide at Year End

Report run on: Monday, January, 3 2022 9:49 am

<i>Class</i>	<i>Name</i>	<i>Area</i>	<i>SIU</i>	<i>Facility</i>	<i>Permit</i>	<i>Address</i>
4M	Nazli Kei DDS dba The Super Dentist	13	N	13-0590	01-A	345 F St Suite 260 Chula Vista
4M	Life Smiles Dental Care	13	N	13-0591	01-A	2260 Otay Lakes Rd Suite 110 Chula Vista
4M	Manuel Arredondo Dental	13	N	13-0592	01-A	293 E Orange Av Chula Vista
4M	Vivencio Arante DDS Inc	13	N	13-0593	01-A	865 3rd Av Suite 120 Chula Vista
4M	Maria Luisa VAles DMD	13	N	13-0594	01-A	88 E Bonita Rd Suite F Chula Vista
4M	Deanna Risos DMD	13	N	13-0595	01-A	841 Kuhn DR Suite 102 Chula Vista
4M	Florencio Burquez DDS	13	N	13-0596	01-A	2452 Fenton St Suite 102 Chula Vista
4M	Terra Nova Family Dentistry	13	N	13-0597	01-A	374 E H St Suite 1710 Chula Vista
4M	Town Centre Dental	13	N	13-0598	01-A	234 3rd AV Suite A Chula Vista
4M	Mark Olson	13	N	13-0599	01-A	752 Medical Center Ct Suite 212 Chula Vista
4M	SoCal Perio Dental Office	13	N	13-0600	01-A	450 4th Av Suite 409 Chula Vista
4M	Maung Aye, DDS	13	N	13-0601	01-A	285 Quintard St Chula Vista
4M	Chula Vista Dental Care	13	N	13-0602	01-A	1177 Broadway Suite 19 Chula Vista
4M	Eric Barajas	13	N	13-0603	01-A	890 Eastlake Py Suite 304 Chula Vista
4M	Glenn E Gibson DDS	13	N	13-0604	01-A	885 Canarios Ct Suite 204 Chula Vista
4M	David B Littlefield DDS	13	N	13-0605	01-A	890 Eastlake Pk Suite 300 Chula Vista
4M	Eastlake Implants & Laser Dentistry	13	N	13-0606	01-A	890 Eastlake Py Suite 303 Chula Vista
4M	Manuel & Emily Lavarias DDS	13	N	13-0607	01-A	885 Canarios Ct Suite 206 Chula Vista
4M	Trilla R Cajuns DDS Inc	13	N	13-0608	01-A	890 Eastlake Py Suite 206 Chula Vista
4M	Shibuya Kint DDS	13	N	13-0609	01-A	2452 Fenton St Suite 300 Chula Vista
4M	Otay Lakes Dental Care	13	N	13-0610	01-A	945 Otay Lakes Rd Suite H Chula Vista
4M	Eastlake Elite Dental	13	N	13-0611	01-A	861 Harold Pl Suite 303 Chula Vista
4M	Paul A Martin DDS	13	N	13-0612	01-A	277 Church Av Suite A Chula Vista
4M	Olga Saiz Dental	13	N	13-0613	01-A	661 3rd Av Chula Vista
4M	Real Dental Care	13	N	13-0614	01-A	690 E St Chula Vista
4	Caliber Collision	13	N	13-0616	01-A	1421 Broadway Chula Vista
4M	Familiy First Dental Care	13	N	13-0617	01-A	1392 E Palomar St Suite 201 Chula Vista
4M	Canyon Vista Dental Group	13	N	13-0618	01-A	700 Otay Lakes Rd Chula Vista
4M	Naples Dental	13	N	13-0621	01-A	345 F St Suite 140 Chula Vista
4M	Maroon Lopez DDS, PC	13	N	13-0622	01-A	2648 Main St Suite A Chula Vista
4M	Happy Smiles Dental Center	13	N	13-0623	01-A	1750 E Palomar St Suite 3 Chula Vista
4M	Village Dental Group & Orthodontics	13	N	13-0624	01-A	878 Eastlake Py Suite 1511 Chula Vista
4M	Thompson Center for Dentistry	13	N	13-0626	01-A	688 Old Telegrpah Canyon Rd Chula Vista
4M	We Care Dentistry Inc.	13	N	13-0628	01-A	885 Canarios Ct Suite 212 Chula Vista
4M	Macatangay Dentistry	13	N	13-0629	01-A	890 Eastlake Wy Suite 201 Chula Vista
4M	Bonita Del Rey Dental Care	13	N	13-0631	01-A	690 Otay Lakes Rd Suite 260 Chula Vista
4M	San Ysidro Health Chula Vista Medical Pl	13	N	13-0632	01-A	678 3rd Av Chula Vista
4M	GIA Dental Group Inc.	13	N	13-0638	03-A	355 K st Unit A Chula Vista
4M	AM Dental	13	N	13-0641	01-A	3041 Bonita Rd Suite 101 Chula Vista
4	Business Assessment - Superstar Car Was	13	N	13-0643	01-A	2925 Main St Chula Vista
5	1st Stop Car Care	13	N	13-0657	01-A	3008 N 2nd Av Chula Vista
5	829 Auto	13	N	13-0658	01-A	1403 Broadway Suite 111 Chula Vista
4	Wartsila Defense, Inc.	13	N	13-0662	01-A	775 Anita St Suite G Chula Vista
5	SDG&E South Bay Power Plant	13	N	13-0663	01-A	1000 Bay Bl Chula Vista
4M	Orthodontics Unlimited	13	N	13-0664	01-A	3001 Bonita Rd Suite 400 Chula Vista

Active Permits Metrowide at Year End

Report run on: Monday, January, 3 2022 9:49 am

<i>Class</i>	<i>Name</i>	<i>Area</i>	<i>SIU</i>	<i>Facility</i>	<i>Permit</i>	<i>Address</i>
4	Enterprise Rent-A-Car #32F4	13	N	13-0665	01-A	1059 Broadway Chula Vista
5	San Diego County Mental Health Child &	13	N	13-0666	01-A	730 Medical Center Ct Chula Vista
5	Sharp Rees-Stealy Medical Group	13	N	13-0667	01-A	1400 E Palomar St Chula Vista
4M	Bonita Family Dentistry	13	N	13-0669	01-A	4424 Bonita Rd Chula Vista
4M	Bonita Dental Center	13	N	13-0670	01-A	5050 Bonita Rd Chula Vista
4M	Excellent Smile	13	N	13-0671	01-A	5080 Bonita Rd Suite N Chula Vista
4M	Bonita Point Dental Arts	13	N	13-0672	01-A	145 Willow St Suite 100 Chula Vista
4M	Chula Vista Smiles	13	N	13-0675	01-A	222 3rd Av Chula Vista
4M	Mustafa Khalid DDD Inc.	13	N	13-0676	01-A	309 3rd Av Chula Vista
4M	Kum S Hong DDS, Inc.	13	N	13-0677	01-A	624 3rd Av Chula Vista
4M	Massoumi Professional Dental dba Great I	13	N	13-0678	01-A	1310 3rd Av Suite A-1 Chula Vista
4M	Coastal Kids Dentistry & Orthodontics	13	N	13-0679	01-A	2015 Birch Rd Unit 103 Chula Vista
4M	Gentle Dental Chula Vista	13	N	13-0680	01-A	520 Broadway Suite 1 Chula Vista
5	Business Assessment	13	N	13-0681	01-A	57 N Broadway Chula Vista
4	BMW TECH INC.	13	N	13-0682	01-A	1403 Broadway Suite 110 Chula Vista
5	House of Leather & Fabrics Inc.	13	N	13-0684	01-A	280 Trousdale Dr D Chula Vista
5	Business Assessment	13	N	13-0685	01-A	750 Design Ct Suite 106 Chula Vista
5	Business Assessment	13	N	13-0686	01-A	505 Main St Chula Vista
2	Sharp Coronado Hospital	14	N	14-0002	04-A	250 Prospect Pl Coronado
4	Foto Image	14	N	14-0006	02-A	940 Orange Av Coronado
4	Carwash of Coronado	14	N	14-0014	00-A	150 C Av Coronado
4	Coronado Marriott Resort	14	N	14-0017	02-A	2000 2nd St Coronado
4	Michael Copp DDS	14	N	14-0020	02-A	1125 10th St Coronado
4M	Daryl Catherwood	14	N	14-0021	02-A	1001 B Av 105 Coronado
4	Coronado High School	14	N	14-0024	01-A	650 D Av Coronado
4	Caldwell Bankers	14	N	14-0025	02-A	501 Grand Caribe Cy Coronado
4M	Isabella Avenue Dentistry	14	N	14-0027	02-A	1012 Isabella Av Coronado
4M	A Professional Dental Corp	14	N	14-0032	03-A	1301 Ynez Pl Coronado
4	K Peter Chung DDS	14	N	14-0032	02-A	1301 Ynez Pl Coronado
4	Hotel Del Coronado	14	N	14-0034	06-A	1500 Orange Av Coronado
4	Department of Public Services City of Cor	14	N	14-0035	01-A	101 B Av Coronado
4M	Coronado Dentistry	14	N	14-0038	03-A	120 C Av Suite 100 Coronado
4	Genevieve Bloom MD	14	N	14-0039	01-A	1117 10th St Coronado
4M	David Warren DDS	14	N	14-0041	03-A	1317 Ynez Pl Coronado
4M	Coronado Classic Dentistry	14	N	14-0042	02-A	1315 Ynez Pl Coronado
4	Cabrillo Cleaners	14	N	14-0043	01-A	1110 10th St Coronado
4	Laura Norton Fagerlund MD	14	N	14-0044	01-A	1224 10th St Suite 200 Coronado
4M	Dr Margret Meadows, DDS	14	N	14-0049	01-A	1001 B St Suite 313 Coronado
4M	Coronado Pediatric Dentistry	14	N	14-0050	01-A	875 Orange AV Suite 210 Coronado
4M	Coronado Smiles Dental	14	N	14-0051	01-A	1111 9th ST Suite 203 Coronado
4M	Family & Cosmetic Dentistry	14	N	14-0052	01-A	1001 B Av Suite 111 Coronado
4M	Michael Copp DDS Inc	14	N	14-0053	01-A	120 C Av Suite 150 Coronado
4M	Milberg Orthodontics	14	N	14-0054	01-A	1001 B Av Unit 101 Coronado
4M	Advanced Dentistry	14	N	14-0057	01-A	1010 8th st Coronado
4	Intimate Images by Angela Lee Photograp	15	N	15-0002	02-A	1011 Camino Del Mar Suite 118 Del Mar

Active Permits Metrowide at Year End

Report run on: Monday, January, 3 2022 9:49 am

<i>Class</i>	<i>Name</i>	<i>Area</i>	<i>SIU</i>	<i>Facility</i>	<i>Permit</i>	<i>Address</i>
4	Del Mar Medical Clinic	15	N	15-0003	02-A	1335 Camino Del Mar Suite 134 Del Mar
4	Vacant	15	N	15-0004	02-A	1333 Camino Del Mar Del Mar
4M	Bylss Dental	15	N	15-0005	03-A	807 Camino Del Mar Del Mar
4	Lan T Tran DDS	15	N	15-0005	02-A	807 Camino Del Mar Del Mar
4	Animal and Bird Hospital of Del Mar	15	N	15-0009	02-A	2132 Jimmy Durante Bl Del Mar
4	Nolan Bellisario DMD	15	N	15-0012	02-A	13983 Mango Dr Suite 201 Del Mar
4M	Todd Pizzi DDS	15	N	15-0012	03-A	13983 Mango Dr Suite 201 Del Mar
4	Del Mar Aesthetics	15	N	15-0013	02-A	13983 Mango Dr Suite 102 Del Mar
2F	Del Mar Blue Print Company Inc	15	N	15-0015	01-A	2201 San Dieguito Dr Del Mar
4	Del Mar Family Dentistry	15	N	15-0016	02-A	2775 Via De La Valle Suite 103 Del Mar
4M	First Tooth Pediatric Dentistry	15	N	15-0016	03-A	2775 Via De La Valle Suite 103 Del Mar
4M	Michael J Miller DMD	15	N	15-0017	05-A	2775 Via De La Valle Suite 101 Del Mar
4	Del Mar Smiles	15	N	15-0019	03-A	817 Camino Del Mar Del Mar
4	Albertsons # 6702	15	N	15-0020	03-A	2707 Via de la Valle Del Mar
4	Patricia Murphy DDS	15	N	15-0021	01-A	1401 Camino Del Mar Suite 120 Del Mar
4M	Sarah Nabai DDS	15	N	15-0021	02-A	1401 Camino Del Mar Suite 120 Del Mar
4	Imaging Healthcare Specialists	15	N	15-0022	01-A	317 14th St Del Mar
4M	Curtis L Chan DDS	15	N	15-0024	01-A	12835 Pointe Del Mar Wy Suite 3 Del Mar
4M	Promenade Dentists	15	N	15-0025	01-A	2710 Via de la Valle Suite B250 Del Mar
4M	Kevin Fitzpatrick, DDS, Inc.	15	N	15-0027	01-A	1333 Camino Del Mar Del Mar
4	American Metal Processing	16	N	16-0007	03-A	390 Front St El Cajon
2F	Bowen Enterprises	16	N	16-0012	01-A	380 Coogan Wy El Cajon
2	Transdev Services Inc	16	N	16-0022	01-A	544 Vernon Wy El Cajon
2C	Decco Castings Inc	16	N	16-0024	06-A	1596 Pioneer Wy El Cajon
4	Atlas Radiator	16	N	16-0028	03-A	580 El Cajon Bl El Cajon
1	Garvin Industries	16	Y	16-0033	06-A	316 Millar Av El Cajon
1	Garvin Industries	16	Y	16-0033	07-A	316 Millar Av El Cajon
4	California Sheet Metal	16	N	16-0035	01-A	1020 N Marshall Av El Cajon
4	Chaparral High School	16	N	16-0036	00-A	1600 Cuyamaca St El Cajon
5	Chaparral High School	16	N	16-0036	01-A	1600 Cuyamaca St El Cajon
4C	Micro-Mode Products Inc	16	N	16-0048	03-A	1870 John Towers Av El Cajon
4	Oil Changers	16	N	16-0053	00-A	906 Fletcher Py El Cajon
4C	Precision Metal Products Inc	16	N	16-0054	06-A	850 W Bradley Av El Cajon
4	Romeo's Car Wash	16	N	16-0058	01-A	195 N 2nd St El Cajon
4	J&B Materials	16	N	16-0064	04-A	1155 N Johnson Av El Cajon
4	Weldmac Manufacturing Company	16	N	16-0065	00-A	1533 N Johnson Av El Cajon
4	Allure Windows and Doors	16	N	16-0099	02-A	1357 N Cuyamaca St El Cajon
4	World Terminal Parking Inc	16	N	16-0100	01-A	1111 Broadway El Cajon
4	Howard's Bakery	16	N	16-0109	01-A	1097 E Broadway El Cajon
4	Jiffy Lube	16	N	16-0203	01-A	539 N 2nd St El Cajon
4	San Diego Gas & Electric Company	16	N	16-0206	03-A	904 W Main St El Cajon
4	Shadow Mountain Community School	16	N	16-0208	01-A	2100 Greenfield Dr El Cajon
4	Russell's Metalfab Company	16	N	16-0216	01-A	549 Raleigh Av El Cajon
4	El Cajon Valley High School	16	N	16-0217	00-A	1035 E Madison Av El Cajon
5	El Cajon Valley High School	16	N	16-0217	01-A	1035 E Madison Av El Cajon

Active Permits Metrowide at Year End

Report run on: Monday, January, 3 2022 9:49 am

<i>Class</i>	<i>Name</i>	<i>Area</i>	<i>SIU</i>	<i>Facility</i>	<i>Permit</i>	<i>Address</i>
2F	Granite Hills High School	16	N	16-0218	01-A	1719 E Madison Av El Cajon
5	Granite Hills High School	16	N	16-0218	02-A	1719 E Madison Av El Cajon
4	Rock Automotive Group	16	N	16-0220	01-A	464 W Main St El Cajon
4	The Strip Shop	16	N	16-0223	02-A	1050 Pioneer Wy Suite I El Cajon
4	Rays Fabrication & Development	16	N	16-0232	00-A	1987 Friendship Dr Suite I El Cajon
4	Murphy's Auto Repair	16	N	16-0260	01-A	935 N 2nd St El Cajon
4	Certified Tire & Service Centers Inc	16	N	16-0261	01-A	790 N Johnson Av El Cajon
2	Grossmont-Cuyamaca Community College	16	N	16-0270	04-A	8800 Grossmont College Dr El Cajon
2C	Grossmont-Cuyamaca Community College	16	N	16-0270	05-A	8800 Grossmont College Dr El Cajon
4	Body Beautiful Car Wash	16	N	16-0278	01-A	690 El Cajon Bl El Cajon
4	Sunshine Auto Repair	16	N	16-0281	03-A	151 S Sunshine Av El Cajon
5	Boyd Anderson Photography	16	N	16-0283	00-A	500 Broadway Suite D El Cajon
4	Abcana Industries	16	N	16-0293	01-A	545 W Bradley Av El Cajon
4	BMW of El Cajon	16	N	16-0304	02-A	720 El Cajon Bl El Cajon
4	Aero Paint	16	N	16-0307	00-A	1780 Joe Crosson Dr Suite G El Cajon
4	Cajon Valley Union School District	16	N	16-0320	01-A	777 E Park Av El Cajon
2	Autohaus Stebel Inc	16	N	16-0335	02-A	885 E Washington Av El Cajon
2	Autohaus Stebel Inc	16	N	16-0335	03-A	885 E Washington Av El Cajon
4	CVS/Pharmacy #9818	16	N	16-0341	05-A	572 Fletcher Py El Cajon
1	Veridiam Inc	16	Y	16-0348	05-A	1717 Cuyamaca St El Cajon
4	All American Car Wash	16	N	16-0354	01-A	111 S 1st St El Cajon
4	BJ's Rentals	16	N	16-0369	02-A	1717 E Main St El Cajon
4	McIntyre Tool and Machine	16	N	16-0376	01-A	1250 Pioneer Wy Suite H El Cajon
5	His Business Mfg Co	16	N	16-0379	00-A	1180 N Johnson Av El Cajon
2	Cummins Pacific LLC	16	N	16-0382	02-A	310 N Johnson Av El Cajon
2	Cummins Sales and Service	16	N	16-0382	03-A	310 N Johnson Av El Cajon
4	Probe Master	16	N	16-0390	00-A	215 Denny Wy Suite A El Cajon
4	Air Exhaust Corporation	16	N	16-0394	01-A	1937 Friendship Dr Suite E El Cajon
4Z	Certified Metal Craft	16	N	16-0396	04-A	877 Vernon Wy El Cajon
4C	Certified Metal Craft	16	N	16-0396	05-A	877 Vernon Wy El Cajon
4	Vacant	16	N	16-0399	03-A	1339 Broadway El Cajon
4	El Cajon Ford	16	N	16-0400	02-A	1595 E Main St El Cajon
4	AJM Packaging Corporation	16	N	16-0403	06-A	1160 Vernon Wy El Cajon
2	Waste Management	16	N	16-0405	02-A	1001 W Bradley Av El Cajon
2	Waste Management	16	N	16-0405	03-A	1001 W Bradley Av El Cajon
4	Arcadia Architectural Coatings	16	N	16-0406	02-A	1899 Gillespie Wy El Cajon
4	Vacant	16	N	16-0411	04-A	1654 Pioneer Wy El Cajon
4C	Senior Aerospace Ketema	16	N	16-0413	06-A	790 Greenfield Dr El Cajon
4C	Senior Aerospace Ketema	16	N	16-0413	07-A	790 Greenfield Dr El Cajon
4	Aerowind Corporation	16	N	16-0414	02-A	1959 John Towers Av El Cajon
4	Cal Dor Specialties	16	N	16-0418	01-A	244 Millar Av El Cajon
4	Vons # 333	16	N	16-0420	02-A	13439 Camino Canada El Cajon
4	City of El Cajon Public Works	16	N	16-0423	02-A	1050 Vernon Wy El Cajon
4D	Crystal Cleaners	16	N	16-0428	01-A	360 Magnolia Av Suite N El Cajon
4	Star Cleaners	16	N	16-0431	01-A	1246 Main St El Cajon

Active Permits Metrowide at Year End

Report run on: Monday, January, 3 2022 9:49 am

<i>Class</i>	<i>Name</i>	<i>Area</i>	<i>SIU</i>	<i>Facility</i>	<i>Permit</i>	<i>Address</i>
4M	Jamacha Dental	16	N	16-0441	04-A	767 Jamacha Rd El Cajon
4M	Dental Arts San Diego	16	N	16-0451	03-A	707 Arnele Av El Cajon
4M	J Andrew Hunter DDS	16	N	16-0452	03-A	242 Avocado Av El Cajon
4M	S David Rahnejat Dental Corp	16	N	16-0454	02-A	254 Avocado Av El Cajon
4M	Dr Richard S Prouse	16	N	16-0455	03-A	292 Avocado Av El Cajon
4M	John Joe Bacino DDS	16	N	16-0456	03-A	560 Brockton St El Cajon
4M	Jean Chan DDS	16	N	16-0457	03-A	260 E Chase Av Suite 101 El Cajon
4M	El Cajon Family Dental	16	N	16-0462	02-A	2720 Fletcher Py El Cajon
4M	V & S Dentistry	16	N	16-0463	02-A	2526 Fletcher Py El Cajon
4M	H Jay Jacobson & Erick Sato DDS	16	N	16-0465	02-A	360 Highland Av El Cajon
4	Banfield Pet Hospital	16	N	16-0466	03-A	865 Jackman St El Cajon
4M	East County Dental Group	16	N	16-0470	03-A	337 W Madison Av El Cajon
4	East County Endodontics	16	N	16-0475	02-A	506 Magnolia Av El Cajon
4M	Jim Stewart DDS, MD	16	N	16-0477	03-A	406 S Magnolia Av El Cajon
4M	Ali Haeri DMD MHS	16	N	16-0480	03-A	1297 W Main St Suite A El Cajon
4M	Fletcher Hills Dental Arts	16	N	16-0486	02-A	595 N Westwind Dr El Cajon
4M	Western Dental Services	16	N	16-0487	02-A	583 2nd St El Cajon
4	John James MD	16	N	16-0488	02-A	1580 2nd St El Cajon
4	Vacant	16	N	16-0489	03-A	9303 Bond Av Suite A El Cajon
4	AAA Printing Company Inc	16	N	16-0490	01-A	1315 Broadway El Cajon
4M	Horizon Dental Group	16	N	16-0491	02-A	742 Broadway El Cajon
4M	Samar Atto DDS	16	N	16-0492	03-A	1252 Broadway Suite B El Cajon
4M	Gary V Parcel DDS	16	N	16-0494	02-A	941 Broadway Suite A El Cajon
2F	Gary A Olen DDS	16	N	16-0495	01-A	773 Broadway El Cajon
4M	Michael Maurer DDS, Inc	16	N	16-0495	02-A	773 Broadway El Cajon
4	Sharp Rees-Stealy	16	N	16-0497	02-A	1240 Broadway El Cajon
4	Wal-Mart Photo Center	16	N	16-0498	02-A	13487 Camino Canada El Cajon
4M	East County Dental Center	16	N	16-0499	02-A	13465 Camino Canada Suite 110A El Cajon
4M	Family Dentistry	16	N	16-0503	03-A	1782 Main St El Cajon
4	CVS Pharmacy # 9173	16	N	16-0510	03-A	2760 Fletcher Py El Cajon
4	Toro Agriculture & Irrigation	16	N	16-0511	02-A	1588 N Marshall Av El Cajon
4	Cal Metal Manufacturing	16	N	16-0512	01-A	395 Vernon Wy El Cajon
4	Dose Inc	16	N	16-0518	02-A	215 Denny Wy F El Cajon
4	C F Miller Company	16	N	16-0519	01-A	215 Denny Wy Suite B El Cajon
1	GKN Aerospace Chem-tronics Inc	16	Y	16-0520	06-A	1150 W Bradley Av El Cajon
1	GKN Aerospace Chem-tronics Inc	16	Y	16-0520	06-B	1150 W Bradley Av El Cajon
4	Gardner Pool Plastering	16	N	16-0523	02-A	801 Gable Wy El Cajon
4M	Granite Hills Dental Team	16	N	16-0526	02-A	810 Jamacha Rd Suite 104 El Cajon
4	Diversified Technology Developers	16	N	16-0527	01-A	215 Denny Wy Suite C El Cajon
4	CVS/Pharmacy #9167	16	N	16-0528	04-A	790 Jamacha Rd El Cajon
4C	Radius Aerospace - San Diego Inc	16	N	16-0529	06-A	203 N Johnson Av El Cajon
4	East County Dental Associates	16	N	16-0533	02-A	700 N Johnson Av Suite P El Cajon
4	Albertsons # 6771	16	N	16-0534	03-A	1608 Broadway El Cajon
4	Express Auto Repair & Tires	16	N	16-0536	02-A	1316 Broadway El Cajon
4	Champion Collision and Repair	16	N	16-0544	01-A	187 N Marshall Av El Cajon

Active Permits Metrowide at Year End

Report run on: Monday, January, 3 2022 9:49 am

<i>Class Name</i>	<i>Area</i>	<i>SIU</i>	<i>Facility</i>	<i>Permit</i>	<i>Address</i>
4M General Family Dentistry	16	N	16-0546	02-A	711 Avocado Av El Cajon
5 Inflatable Market Place	16	N	16-0548	01-A	1810 Gillespie Wy Suite 202 El Cajon
4 Pool & Electrical Products Inc	16	N	16-0549	01-A	1908 Friendship Dr El Cajon
4 Business Assessment	16	N	16-0550	03-A	1954 Friendship Dr Suite 101 El Cajon
5 Business Assessment	16	N	16-0553	02-A	435 N Johnson Av El Cajon
4 Pacific Bell	16	N	16-0553	01-A	435 N Johnson Av El Cajon
4 Prime Heat Inc	16	N	16-0554	02-A	1844 Friendship Dr El Cajon
4 El Cajon Sheet Metal	16	N	16-0556	01-A	1954 Friendship Dr Suite 102 El Cajon
5 La Jolla Electric Inc	16	N	16-0557	01-A	449 Vernon Wy El Cajon
4 Tube Service Company	16	N	16-0563	01-A	1571 N Johnson Av El Cajon
4 ECP Powder Coating	16	N	16-0564	02-A	1835 John Towers Av Suite A El Cajon
5 ECP Powder Coating	16	N	16-0564	03-A	1835 John Towers Av Suite A El Cajon
2 UT; Thrifty Oil Company # 043	16	Y	16-0565	12-A	1092 E Washington Av El Cajon
4 A & J Metal Finishing	16	N	16-0566	02-A	1080 W Bradley Av Suite D El Cajon
4 Rick's RV Center	16	N	16-0567	02-A	1546 E Main St El Cajon
5 El Cajon Auto Repair 4 Less	16	N	16-0569	02-A	1313 N 2nd St El Cajon
4 CVS Pharmacy # 9114	16	N	16-0571	03-A	1299 Broadway El Cajon
4 Precision Tune Auto Care	16	N	16-0573	01-A	1191 E Main St Suite 1 El Cajon
5 Safety-Kleen Systems Inc	16	N	16-0575	01-A	197 Vernon Wy El Cajon
4 Kaelins Touchless Car Wash	16	N	16-0577	01-A	1437 E Main St El Cajon
4 El Cajon Mitsubishi	16	N	16-0579	01-A	247 El Cajon Bl El Cajon
4 Riley Automotive	16	N	16-0580	01-A	1665 E Main St El Cajon
4 Mission Dialysis Center of El Cajon	16	N	16-0581	01-A	858 Fletcher Py El Cajon
4 El Cajon Auto Electric	16	N	16-0582	01-A	317 N 2nd St El Cajon
4 Earl Scheib Paint & Auto Body	16	N	16-0587	01-A	1002 W Main St El Cajon
4 MIT	16	N	16-0588	01-A	1112 Pioneer Wy El Cajon
4 Airgas West Inc	16	N	16-0591	01-A	1192 Pioneer Wy El Cajon
4 World Terminal Parking Inc	16	N	16-0592	01-A	329 N 2nd St El Cajon
4 Trick Trucks	16	N	16-0593	02-A	777 N 2nd St El Cajon
4 Valley Automotive	16	N	16-0594	01-A	813 N 2nd St El Cajon
4 DeVore Automotive	16	N	16-0595	01-A	1253 N 2nd St El Cajon
4 Griffiths Machining	16	N	16-0599	01-A	465 Vernon Wy El Cajon
4 Intermarket Manufacturing Service	16	N	16-0600	01-A	1504 Fayette St El Cajon
4 New West Petroleum / Exxon	16	N	16-0601	01-A	1699 E Main St El Cajon
4 De La Fuente Cadillac	16	N	16-0602	01-A	1385 E Main St El Cajon
4 Caliber Collision Center	16	N	16-0603	01-A	332 N Johnson Av El Cajon
4 Caliber Collision Center	16	N	16-0604	01-A	375 N 2nd St El Cajon
4 Harley-Davidson of El Cajon	16	N	16-0606	01-A	621 El Cajon Bl El Cajon
4 East County Auto Center	16	N	16-0607	01-A	1375 E Main St El Cajon
4 Myers Transmission Repair Inc dba AAM	16	N	16-0608	02-A	355 N Johnson Av El Cajon
4 Al Archard Inc	16	N	16-0609	01-A	661 El Cajon Bl El Cajon
4 Business Assessment	16	N	16-0610	04-A	1215 Pioneer Wy El Cajon
4 Big O Tires & Service Center	16	N	16-0612	01-A	844 N Johnson Av El Cajon
4 Auto Tech	16	N	16-0614	01-A	910 El Cajon Bl El Cajon
4 Sid's Auto Body Inc	16	N	16-0615	01-A	1129 Broadway El Cajon

Active Permits Metrowide at Year End

Report run on: Monday, January, 3 2022 9:49 am

<i>Class</i>	<i>Name</i>	<i>Area</i>	<i>SIU</i>	<i>Facility</i>	<i>Permit</i>	<i>Address</i>
4	Golden Hammer Auto Body	16	N	16-0616	01-A	631 W Lexington Av El Cajon
4	Honda of El Cajon	16	N	16-0617	02-A	889 Arnele Av El Cajon
4	DelStar Technologies Inc	16	N	16-0619	02-A	1306 Fayette St El Cajon
4	Mustang Auto & Classic Cars	16	N	16-0620	01-A	727 El Cajon Bl El Cajon
4	Vacant	16	N	16-0621	02-A	875 El Cajon Bl El Cajon
4	National Label and Screenprint	16	N	16-0623	01-A	1254 Pierre Wy El Cajon
4	Quality RV Inc	16	N	16-0626	01-A	1062 N 2nd St El Cajon
4	Leonard Engineering Inc	16	N	16-0627	01-A	412 Front St El Cajon
4	Banny Hom Enterprises	16	N	16-0629	01-A	1240 W Main St El Cajon
4	Consolidated Motors	16	N	16-0630	01-A	410 El Cajon Bl El Cajon
4	Auto Finance Specialists Inc	16	N	16-0633	01-A	327 El Cajon Bl El Cajon
4	AZ Auto Service	16	N	16-0637	01-A	953 Broadway El Cajon
4	Heartland Cleaners	16	N	16-0639	02-A	999 E Washington Av El Cajon
4	G Marble & Granite Company	16	N	16-0642	01-A	1820 John Towers Av Suite A El Cajon
4	Omega Fuel Injectors	16	N	16-0643	01-A	1934 John Towers Av Suite B El Cajon
4	Taylor Guitars	16	N	16-0644	01-A	1980 Gillespie Wy El Cajon
4	CP Richards Signs Inc	16	N	16-0646	01-A	1200 Billy Mitchell Dr Suite B El Cajon
4	Hi Tech Welding and Forming Inc	16	N	16-0647	01-A	1375 Fayette St El Cajon
4	LED Works Inc	16	N	16-0648	01-A	926 Fesler St El Cajon
4	Sentrec Electronics Inc	16	N	16-0649	01-A	1943 Friendship Dr Unit E El Cajon
5	Kifer Hydraulics Company Inc	16	N	16-0651	03-A	1148 N Marshall Av El Cajon
2	Thunderbird Products Inc	16	N	16-0651	02-A	1148 N Marshall Av El Cajon
4	Super-Krete International Inc	16	N	16-0652	01-A	1290 N Johnson Av Suite 101 El Cajon
4M	Brian Y Suzuki DMD Inc	16	N	16-0654	02-A	2592 Fletcher Py El Cajon
4M	Michael Miroue Ds MSD Inc	16	N	16-0655	02-A	2752 Navajo Rd El Cajon
4M	Instant Dental Care	16	N	16-0657	02-A	407 W Madison Av El Cajon
4M	Laurel M Morello DDS	16	N	16-0658	03-A	226 Avocado Av El Cajon
4M	Stephen D White DDS Inc	16	N	16-0659	02-A	266 Avocado Av Suite B El Cajon
4	John C Thompson MD	16	N	16-0660	01-A	1625 E Main St Suite 201 El Cajon
4	Peter H Belott MD	16	N	16-0661	01-A	1625 E Main St Suite 202 El Cajon
4	Laurence R Saben MD A Professional Co	16	N	16-0662	01-A	615 E Lexington Av El Cajon
4	Dr Graham Treer DDS Inc	16	N	16-0663	02-A	321 E Main St El Cajon
4M	Cajon Dental Group	16	N	16-0665	02-A	359 W Madison Av El Cajon
4	East County Dermatology	16	N	16-0668	01-A	514 S Magnolia Av El Cajon
4M	Washington Dentistry	16	N	16-0669	02-A	1008 E Washington Av El Cajon
4	New Beginnings Healthcare	16	N	16-0670	01-A	1328 E Madison Av El Cajon
4	Top Notch Manufacturing Inc	16	N	16-0671	01-A	1488 Pioneer Wy Suite 17 El Cajon
4M	Gary J Wokuluk DDS	16	N	16-0672	02-A	119 W Lexington Av El Cajon
4	Fast Forward	16	N	16-0674	02-A	1399 N Cuyamaca St El Cajon
4	Master Halco Incorporated	16	N	16-0677	02-A	485 Raleigh Av El Cajon
4	Business Assessment	16	N	16-0690	01-A	535 Floyd Smith Dr El Cajon
4	Business Assessment	16	N	16-0695	02-A	1280 N Johnson Av Suite 100 El Cajon
4	Mike & Diane's Gourmet Kitchen Inc	16	N	16-0703	01-A	1444 Pioneer Wy Suite 9 El Cajon
4	Tube Lighting Products	16	N	16-0705	01-A	1346 Pioneer Wy El Cajon
4M	Blake N Synowski DMD Inc	16	N	16-0706	03-A	266 Avocado Av Suite A El Cajon

Active Permits Metrowide at Year End

Report run on: Monday, January, 3 2022 9:49 am

<i>Class</i>	<i>Name</i>	<i>Area</i>	<i>SIU</i>	<i>Facility</i>	<i>Permit</i>	<i>Address</i>
4	Doetsch Enterprises	16	N	16-0709	01-A	515 Raleigh Av El Cajon
4	Omni Pacific	16	N	16-0710	01-A	505 Raleigh Av El Cajon
4	Mossy Nissan Recon Center El Cajon	16	N	16-0716	01-A	396 Raleigh St El Cajon
4C	Chidgey & Son LLC	16	N	16-0718	04-A	1099 W Palm Av El Cajon
4C	Chidgey & Son LLC	16	N	16-0718	05-A	1099 W Palm Av El Cajon
4	Animal Medical Center	16	N	16-0724	01-A	600 Broadway El Cajon
4	East County Metal Supply	16	N	16-0728	01-A	755 Vernon Wy El Cajon
5	Industrial Rubber Supply	16	N	16-0729	01-A	1099 N Cuyamaca St El Cajon
4M	San Diego Smiles	16	N	16-0730	02-A	895 Jackman St El Cajon
4	New Brunswick Industries Inc	16	N	16-0733	01-A	1850 Gillespie Wy El Cajon
4	National Public Safety	16	N	16-0734	01-A	892 E Madison Av El Cajon
4C	Premier Metal Processing Inc	16	N	16-0738	03-A	971 Vernon Wy El Cajon
4C	Premier Metal Processing Inc	16	N	16-0738	04-A	971 Vernon Wy El Cajon
4M	Fletcher Hills Dental Implant & Oral Surge	16	N	16-0739	02-A	366 S Pierce St El Cajon
4	Vacant	16	N	16-0741	01-A	1485 N Magnolia El Cajon
4M	Professional Family Dental	16	N	16-0745	02-A	1106 N 2nd St El Cajon
4M	Fenn Orthodontics	16	N	16-0746	02-A	1136 N Second St El Cajon
4M	Tower Dentistry	16	N	16-0747	02-A	2397 Fletcher Py El Cajon
4	El Cajon Energy Center LLC	16	N	16-0748	01-A	222 N Johnson Av El Cajon
4	Gilden Family Chiropractic	16	N	16-0749	01-A	1208 N 2nd St El Cajon
4	Dave Whipple Sheet Metal Inc	16	N	16-0751	02-A	1077 N Cuyamaca St El Cajon
4	Fabcom	16	N	16-0752	01-A	781 Vernon Wy El Cajon
4	Direct Sheet Metal	16	N	16-0753	01-A	1423 Pioneer Wy El Cajon
4	Davis Gregg Enterprises Inc	16	N	16-0754	01-A	1488 Pioneer Wy Suite 12 El Cajon
4	Polishing Proz	16	N	16-0755	01-A	1987 Friendship Dr Suite C El Cajon
4	Bay Sheet Metal	16	N	16-0757	01-A	1263 Greenfield Dr Space A El Cajon
4	Frazee Paint & Wallcovering	16	N	16-0758	01-A	1154 E Main St Unit 108 El Cajon
4	Things Remembered	16	N	16-0762	01-A	407 Parkway Pz El Cajon
4	TCP Global	16	N	16-0766	01-A	1000 W Bradley Av Suite A El Cajon
4	Kropf Custom Sheet Metal	16	N	16-0768	01-A	1408 Pioneer Wy El Cajon
5	Mouser Corp	16	N	16-0769	01-A	1810 Gillespie Way Suite 101 El Cajon
4	Via Sat Inc	16	N	16-0770	01-A	1935 Cordell Ct El Cajon
4	Targeting Systems	16	N	16-0771	01-A	1453 N Cuyamaca St El Cajon
4Z	Brantner & Associates Inc	16	N	16-0774	03-A	1700 Gillespie Wy El Cajon
4C	Brantner & Associates Inc	16	N	16-0774	04-A	1700 Gillespie Wy El Cajon
2	Campbell Membrane Technologies Inc	16	N	16-0775	02-A	1168 N Johnson Av El Cajon
2	California Filtration Services Inc	16	N	16-0776	02-A	1168 N Johnson Av El Cajon
2	California Filtration Services Inc	16	N	16-0776	03-A	1168 N Johnson Av El Cajon
4	Can-Am Coatings	16	N	16-0781	02-A	466 Vernon Wy El Cajon
4	Alpha Powder Coating	16	N	16-0783	01-A	440 Front St El Cajon
2	UT; Ametek Inc	16	Y	16-0785	06-A	790 Greenfield Dr El Cajon
3	Toyota of El Cajon	16	N	16-0786	02-A	965 Arnele Av El Cajon
4	Inflatable Design Group	16	N	16-0787	01-A	1080 W Bradley Av Suite B El Cajon
4	Ponderosa Roasting Maintenance & Manu	16	N	16-0788	01-A	1466 Pioneer Wy Suite 8 El Cajon
2	Medical Environmental Technologies	16	N	16-0789	02-A	1463 Fayette St El Cajon

Active Permits Metrowide at Year End

Report run on: Monday, January, 3 2022 9:49 am

<i>Class</i>	<i>Name</i>	<i>Area</i>	<i>SIU</i>	<i>Facility</i>	<i>Permit</i>	<i>Address</i>
4	Circlemaster Inc	16	N	16-0790	01-A	495 Raleigh Av El Cajon
4	REM Machine	16	N	16-0795	01-A	1488 Pioneer Wy Suite 11 El Cajon
4	Cutting Edge Supply	16	N	16-0796	01-A	1675 N Johnson Av El Cajon
4	Ishtar Wheat Products	16	N	16-0798	01-A	954 Industrial Pl El Cajon
5	Dark Prince Studios	16	N	16-0799	01-A	852 De Ann Ln El Cajon
4	DN Tanks	16	N	16-0804	01-A	351 Cypress Dr El Cajon
4	Artflor Inc	16	N	16-0808	01-A	535 Vernon Wy El Cajon
5	California Electric Supply	16	N	16-0812	01-A	1080 N Johnson Av El Cajon
5	IDL Corporation	16	N	16-0814	01-A	1941 Friendship Dr Suite A El Cajon
4	Burning Beard Brewing Company	16	N	16-0816	01-A	785 Vernon Wy El Cajon
4M	Bright Smile Dental Care	16	N	16-0818	01-A	1183 E Main St Suite G El Cajon
4M	Dr Maribel A Celebrado	16	N	16-0819	01-A	1571 N Magnolia Av Suite 205 El Cajon
4M	Life Smiles Dental Care	16	N	16-0820	01-A	1530 Hilton Head Rd Suite 111 El Cajon
4M	Renae L Wilson DDS	16	N	16-0821	01-A	275 W Madison Suite B El Cajon
4M	Korel Family Dentistry	16	N	16-0822	01-A	1265 Avocado Av Suite 102 El Cajon
4M	RSD Dental Group & Orthodontics	16	N	16-0823	01-A	2907 Jamacha Rd Suite B El Cajon
4M	H H Hermes, DDS	16	N	16-0824	01-A	1530 Jamacha Rd Suite L El Cajon
4M	Sahawneh Dental Corp dba Bright Now!	16	N	16-0825	01-A	2502 Jamacha Rd El Cajon
4M	Singing Hills Destistry	16	N	16-0826	01-A	2990 Jamacha Rd Suite 140 El Cajon
4M	Stephan Family Dental	16	N	16-0827	01-A	860 Jamacha Rd Suite 201 El Cajon
4M	CitiDental Rancho	16	N	16-0828	01-A	2451 Jamacha Rd Suite 104 El Cajon
4M	Professional Dental Corp	16	N	16-0829	01-A	343 E Lexington Av Suite 102 El Cajon
4M	Rancho San Diego Dental Group	16	N	16-0830	01-A	2648 Jamacha Rd Suite 166 El Cajon
4M	Michael Maude DDS	16	N	16-0831	01-A	2638 Navajo Rd El Cajon
4M	CitiDental El Cajon	16	N	16-0832	01-A	290 E Douglas Av El Cajon
2	Calbiotech Inc	16	N	16-0835	01-A	1935 Cordell Ct El Cajon
4M	Sun Valley Dental Care	16	N	16-0836	01-A	1209 E Main St El Cajon
4M	Orthodontics Unlimited	16	N	16-0838	01-A	810 Jamacha Rd Suite 205 El Cajon
4M	La Maestra Family Clinic, Inc	16	N	16-0840	01-A	165 S First St El Cajon
4M	Family Dentistry	16	N	16-0842	01-A	312 Highland Av Suite 102 El Cajon
4M	Dr Prouse Dentistry, DDS	16	N	16-0843	01-A	260 E Chase Av Suite 201 El Cajon
4M	WD Nordquist DMD Inc.	16	N	16-0845	01-A	236 Jamacha Rd Suite 101 El Cajon
4	Fox Factory	16	N	16-0846	01-A	750 Vernon Wy El Cajon
4M	El Cajon Family Health Center Dental	16	N	16-0847	01-A	525 E Main St El Cajon
3	iWash Express	16	N	16-0852	01-A	760 E Main St El Cajon
4M	4030 Dental	16	N	16-0853	01-A	1166 E Main St El Cajon
5	Jerames Manufacturing & Tools	16	N	16-0854	01-A	460 Cypress Ln Suite F El Cajon
5	Grossmont High School	16	N	16-0855	01-A	1100 Murray Dr El Cajon
4	All American Car Wash	17	N	17-0003	00-A	1158 Palm Av Imperial Beach
5	Tijuana National Wildlife Preserve	17	N	17-0015	02-A	301 Caspian Wy Suite A Imperial Beach
4	A B Brite Cleaners	17	N	17-0016	02-A	674 Palm Av Imperial Beach
4	We Care Cleaners	17	N	17-0017	02-A	762 13th St Imperial Beach
4	CVS Pharmacy # 9120	17	N	17-0028	02-A	800 Palm Av Imperial Beach
4	Luis A Contreras DDS	17	N	17-0029	01-A	1340 Imperial Beach Bl Suite 101 Imperial Beac
4M	Imperial Beach Family Dentistry	17	N	17-0030	01-A	629 09th St Imperial Beach

Active Permits Metrowide at Year End

Report run on: Monday, January, 3 2022 9:49 am

<i>Class</i>	<i>Name</i>	<i>Area</i>	<i>SIU</i>	<i>Facility</i>	<i>Permit</i>	<i>Address</i>
4M	Special Smiles	17	N	17-0031	01-A	600 Palm Av Suite 116 Imperial Beach
4	Alvarado Parkway Institute	18	N	18-0003	00-A	7050 Parkway Dr La Mesa
4	La Mesa Car Wash	18	N	18-0004	01-A	5322 Jackson Dr La Mesa
2	Sharp Grossmont Hospital	18	N	18-0010	04-A	5555 Grossmont Center Dr La Mesa
4	Broding's Battery Wholesale	18	N	18-0016	00-A	8188 Commercial St La Mesa
4	A A Printing Inc	18	N	18-0024	00-A	7323 El Cajon Bl La Mesa
2	Grossmont Union High School District	18	N	18-0040	02-A	1100 Murray Dr El Cajon
2	Grossmont Union High School District	18	N	18-0040	03-A	1100 Murray Dr El Cajon
4	Dieter Fischer's Star Car Inc	18	N	18-0049	01-A	8699 La Mesa Bl La Mesa
4	Community Convalescent Hospital	18	N	18-0051	00-A	8665 La Mesa Bl La Mesa
4	Tune Craft Auto Centers	18	N	18-0052	00-A	8802 La Mesa Bl La Mesa
5	California Pipeline Technology	18	N	18-0053	00-B	8418 La Mesa Bl La Mesa
4	La Mesa Auto Care	18	N	18-0054	00-A	8692 La Mesa Bl La Mesa
4	McClellan Buick	18	N	18-0061	01-A	7675 University Av La Mesa
4	Kaiser Foundation Health Plan	18	N	18-0066	03-A	8010 Parkway Dr La Mesa
4	Classic Screen Print	18	N	18-0067	02-A	8176 Center St Suite C La Mesa
4	Sid's Auto Body	18	N	18-0068	01-A	7473 El Cajon Bl La Mesa
4	Drew Ford	18	N	18-0070	01-A	8970 La Mesa Bl La Mesa
4	Texaco Car Wash	18	N	18-0075	00-A	9090 Dallas St La Mesa
4	Express Auto Service	18	N	18-0078	01-A	7633 El Cajon Bl 300 La Mesa
4	Neil's Auto Center	18	N	18-0079	01-A	7633 El Cajon Bl Suite 100 La Mesa
4	Mobil Station - Car Wash	18	N	18-0090	00-A	5450 Jackson Dr La Mesa
4	Thrifty Transmission	18	N	18-0092	02-A	7633 El Cajon Bl La Mesa
4	Shell Oil Products Company	18	N	18-0093	01-A	4200 Spring St La Mesa
4	Bob Stall Chevrolet	18	N	18-0094	01-A	7601 Alvarado Rd La Mesa
4	Prestigious Automotive	18	N	18-0095	01-A	5301 Lake Murray Bl La Mesa
4	Bob Bowen's Auto Service	18	N	18-0096	03-A	7191 Alvarado Rd La Mesa
4	Kleen Rite Cleaners	18	N	18-0099	03-A	8755 La Mesa Bl La Mesa
4	Heritage Cleaners	18	N	18-0101	02-A	9122 Fletcher Py La Mesa
4M	La Mesa Village Dental	18	N	18-0109	03-A	4730 3rd St Suite C La Mesa
4M	Hornbrook Center for Dentistry	18	N	18-0110	03-A	7777 Alvarado Rd Suite 210 La Mesa
4	Sharp Rees-Stealy	18	N	18-0119	02-A	7862 El Cajon Bl La Mesa
4	La Mesa Internal Medicine Medical Group	18	N	18-0120	02-A	5111 Garfield St La Mesa
4	Pet Emergency Clinic of E Cnty	18	N	18-0123	02-A	5232 Jackson Dr Suite 105 La Mesa
4M	Thomas K Brassington DDS	18	N	18-0125	02-A	8442 La Mesa Bl La Mesa
4M	Robert Hagstrom DDS Inc	18	N	18-0129	03-A	8923 La Mesa Bl La Mesa
4	George J Chionis	18	N	18-0130	03-A	7811 La Mesa Bl Suite C La Mesa
4M	Catherine Schlaht & Marey Stone	18	N	18-0131	03-A	8077 La Mesa Bl La Mesa
4	Richard Roberts & Catherine Schlaht DDS	18	N	18-0131	02-A	8077 La Mesa Bl La Mesa
4	McCormack Dental Imaging Inc	18	N	18-0133	02-A	4333 Palm Av Suite A La Mesa
4M	Love Your Smile Dentistry	18	N	18-0134	02-A	4333 Palm Av Suite B La Mesa
4M	Stormberg Orthodontics	18	N	18-0136	04-A	4333 Palm Av Suite C La Mesa
4M	La Mesa Hills Dentistry	18	N	18-0138	03-A	8375 University Av La Mesa
4	Encompass Family Medicine	18	N	18-0139	02-A	7043 University Av La Mesa
4	Vacant	18	N	18-0145	02-A	5268 Baltimore Dr La Mesa

Active Permits Metrowide at Year End

Report run on: Monday, January, 3 2022 9:49 am

<i>Class</i>	<i>Name</i>	<i>Area</i>	<i>SIU</i>	<i>Facility</i>	<i>Permit</i>	<i>Address</i>
4	Vacant	18	N	18-0146	02-A	8881 Fletcher Py Suite 108 La Mesa
4	Parkway Dental Group	18	N	18-0147	02-A	8881 Fletcher Py Suite 265 La Mesa
4	Sharp Rees-Stealy	18	N	18-0150	02-A	5525 Grossmont Center Dr La Mesa
4	Varboncoeur Caldemeyer & Hiser DDS	18	N	18-0151	02-A	5565 Grossmont Center Dr Suite 129 La Mesa
4M	Vernon T K Au DDS	18	N	18-0157	02-A	5340 Jackson Dr La Mesa
4	EDCO Station	18	N	18-0165	01-A	8184 Commercial St La Mesa
4	Vons # 2093	18	N	18-0166	02-A	8011 University Av La Mesa
4	Albertsons # 6710	18	N	18-0167	03-A	8920 Fletcher Py La Mesa
4M	Dinkha Dental, Inc	18	N	18-0168	02-A	4323 Palm Av Suite C La Mesa
4	Target # 997	18	N	18-0169	02-A	5500 Grossmont Center Dr La Mesa
4	Lakeside Motors	18	N	18-0171	01-A	8090 University Av La Mesa
5	Magic Carpet	18	N	18-0172	01-A	7232 University Av La Mesa
4M	Larry R Pawl DMD	18	N	18-0173	03-A	7339 El Cajon Bl Suite F La Mesa
4	Elite Auto Collision Repair Center	18	N	18-0174	01-A	4949 Baltimore Dr La Mesa
4	Village Studio	18	N	18-0176	01-A	8806 La Mesa Bl La Mesa
4	Bruces's Auto Repair	18	N	18-0178	01-A	7633 El Cajon Bl Suite 217 La Mesa
5	Rush Motorsport	18	N	18-0179	01-A	7633 El Cajon Bl Suite 210 La Mesa
5	Senti-Metal	18	N	18-0181	01-A	4636 Parks Av La Mesa
2	City of La Mesa Operations Center	18	N	18-0184	03-A	8152 Commercial St La Mesa
2	City of La Mesa Operations Center	18	N	18-0184	04-A	8152 Commercial St La Mesa
4	Wal-Mart # 5140	18	N	18-0185	02-A	5500 Grossmont Center Dr La Mesa
4	Robert W Foster MD	18	N	18-0189	01-A	5565 Grossmont Center Dr Suite 105 La Mesa
4M	Frederick W Lindblam DDS	18	N	18-0192	02-A	5153 Jackson Dr La Mesa
4	Fitness Chiropractic	18	N	18-0194	01-A	7760 University Av La Mesa
4	G David Gibson MD	18	N	18-0196	01-A	8875 La Mesa Bl Suite C La Mesa
4	Albert Nottali DDS	18	N	18-0199	01-A	4990 70th St Space B La Mesa
4M	La Mesa Family Dental Group	18	N	18-0201	02-A	5680 Lake Murray Bl Suite B La Mesa
4M	Sutra Dental Spa	18	N	18-0202	02-A	7851 University Av Suite 206 La Mesa
4M	Dr Federico J Tiznado DDS	18	N	18-0203	02-A	7877 Parkway Dr Suite 2B La Mesa
4	Aliya I Khan MD	18	N	18-0205	01-A	5360 Jackson Dr Suite 100 La Mesa
4M	John C Pawlak	18	N	18-0206	02-A	7900 El Cajon Av Suite F La Mesa
4M	Jassamine T Sunglao	18	N	18-0207	02-A	7900 El Cajon Av Suite D La Mesa
5	Harolds Automotive	18	N	18-0208	01-A	7860 El Cajon Bl La Mesa
4M	Dr Allen Wei DDS	18	N	18-0211	03-A	5308 Lake Murray Bl Suite A La Mesa
2F	Jerry T Herring DDS	18	N	18-0214	01-A	5308 Lake Murray Bl Suite D La Mesa
4	Dunn Edwards Paint	18	N	18-0219	01-A	5250 Jackson Dr La Mesa
4	Engraving Pros	18	N	18-0220	01-A	5500 Grossmont Center Dr La Mesa
5	MGH Granite Works	18	N	18-0223	01-A	8332 Case St La Mesa
4M	Lyudvig Vaniyants DDS	18	N	18-0236	01-A	6062 Lake Murraray Bl Suite 106 La Mesa
4M	Kurt Stormberg DDS	18	N	18-0237	01-A	4333 Palm Av Suite C La Mesa
4M	Ben Mandel DDS	18	N	18-0238	01-A	3835 Avocado Bl Suite 220 La Mesa
4M	Trinity Family Dental	18	N	18-0239	01-A	7557 El Cajon Bl Suite A La Mesa
4M	Michael Buskirk DDS	18	N	18-0240	01-A	3855 Avocado Bl Suite 260 La Mesa
4M	Emily Bland DDS Inc	18	N	18-0241	01-A	6080 Lake Murraray Bl Suite B La Mesa
4M	La Mesa Smiles & Family Detristry	18	N	18-0243	01-A	8419 La Mesa Bl Suite A La Mesa

Active Permits Metrowide at Year End

Report run on: Monday, January, 3 2022 9:49 am

<i>Class</i>	<i>Name</i>	<i>Area</i>	<i>SIU</i>	<i>Facility</i>	<i>Permit</i>	<i>Address</i>
4M	Paul H Van Horne DDS	18	N	18-0244	01-A	7200 Parkway Dr Suite 115 La Mesa
4M	Smile Haven Dental Center	18	N	18-0245	01-A	4700 Spring St Suite 210 La Mesa
4M	Sergio Berkstein DDS	18	N	18-0246	01-A	8860 Center Dr Suite 440 La Mesa
4M	Karl Wehrle DDS	18	N	18-0247	01-A	8425 Grant Av La Mesa
4M	Craig Kubina DDS	18	N	18-0248	01-A	5565 Grossmont Center Dr Suite 107 La Mesa
4M	Edward Rabinovich	18	N	18-0249	01-A	3855 Avocado Bl Suite 250 La Mesa
4M	Authentic Dental Designs	18	N	18-0250	01-A	8029 La Mesa Bl La Mesa
4M	La Perle Dental	18	N	18-0251	01-A	7557 El Cajon Bl Suite B La Mesa
4M	New Day Smile	18	N	18-0252	01-A	8881 Fletcher Py Suite 220 La Mesa
4M	La Mesa Dental	18	N	18-0253	01-A	7872 La Mesa Bl La Mesa
4M	Dr Surillo's Children's Braces & Dentistry	18	N	18-0254	01-A	4700 Spring St Suite 104 La Mesa
4M	Allison Avenue Dental	18	N	18-0255	01-A	8131 Allison Av La Mesa
4M	Dr Harold Gulbransen	18	N	18-0256	01-A	8860 Center Dr Suite 460 La Mesa
4M	Sophia Kalami DDS Inc	18	N	18-0257	01-A	8366 University AV La Mesa
4M	SD Endodontics	18	N	18-0258	01-A	8860 Center Dr Suite 430 La Mesa
4M	Matosian Dental Corp aka Matosian Dental	18	N	18-0259	01-A	8851 Center Dr Suite 301 La Mesa
4M	Kenny Williams DDS	18	N	18-0260	01-A	5565 Grossmont Center Dr Suite 220 La Mesa
4M	R Scott Herrod DDS	18	N	18-0261	01-A	8600 La Mesa Bl Suite A La Mesa
4M	Jeramel Jardin DDS	18	N	18-0262	01-A	8805 La Mesa Bl La Mesa
4M	Jeff Gray, DDS	18	N	18-0263	01-A	8555 Fletcher Py Suite 102 La Mesa
4M	La Mesa Dental Artistry	18	N	18-0264	01-A	8430 Lemon Av La Mesa
4M	Richard D Steinberg DDS	18	N	18-0265	01-A	9131 Fletcher Py Suite 112 La Mesa
4M	Fletcher Family Dental	18	N	18-0266	01-A	2694 Navajo Rd Suite 100 La Mesa
4M	San Diego Dental Group	18	N	18-0267	01-A	7557 El Cajon Bl Suite C La Mesa
4M	Bella Smiles Dental Care	18	N	18-0269	01-A	5555 Jackson Dr Suite 210 La Mesa
4M	La Mesa Dental Center	18	N	18-0270	01-A	8334 University Av La Mesa
4M	M&M Dentalare	18	N	18-0272	01-A	4990 70th St La Mesa
4M	La Mesa Modern Dental Group	18	N	18-0273	01-A	5620 Lake Murray Bl La Mesa
4M	Kotha Flamenco Dental Corp	18	N	18-0275	01-A	8860 Center Dr Suite 410 La Mesa
4M	Yo Imai-Marshall DDS	18	N	18-0276	01-A	3855 Avocado Bl Suite 200 La Mesa
4M	McCormack Dental Imaging	18	N	18-0277	01-A	8860 Center Dr Suite 340 La Mesa
4M	Judmar S dimapilis DMD	18	N	18-0278	01-A	5565 Grossmont Center DR Suite 1209 La Mesa
4M	Richard Feinberg DDS	18	N	18-0279	01-A	5565 Grossmont Center Dr Suite 3257 La Mesa
4M	Gentle Dental Grossmont	18	N	18-0280	01-A	5565 Grossmont Center Dr #459 354 La Mesa
4M	Summit Dental of La Mesa	18	N	18-0281	01-A	8530 La Mesa Bl Suite 204 La Mesa
4M	Affinity Dental of La Mesa	18	N	18-0282	01-A	8881 Fletcher Py Suite 325 La Mesa
4M	Cardinal Dental	18	N	18-0285	01-A	8960 Fletcher Py Suite D La Mesa
5	Grossmont Sharp Hospital	18	N	18-0286	01-A	8881 Fletcher Py Suite 310 La Mesa
5	Quest Diagnostics	18	N	18-0287	01-A	5103 Garfield St La Mesa
4	Enterprise Rent-A-Car #3241	18	N	18-0288	01-A	8323 Hercules St La Mesa
4	Cumming Chevrolet	19	N	19-0001	04-A	2301 National City Bl National City
2	Ron Baker Chevrolet Isuzu	19	N	19-0001	03-A	2301 National City Bl National City
4	Crest Offset Printing	19	N	19-0010	02-A	921 Collidge Av National City
2	Prime Healthcare Paradise Valley Hospita	19	N	19-0024	05-A	2400 E 4th St National City
2	Prime Healthcare Paradise Valley Hospita	19	N	19-0024	06-A	2400 E 4th St National City

Active Permits Metrowide at Year End

Report run on: Monday, January, 3 2022 9:49 am

<i>Class</i>	<i>Name</i>	<i>Area</i>	<i>SIU</i>	<i>Facility</i>	<i>Permit</i>	<i>Address</i>
4	Univar USA Inc	19	N	19-0028	02-A	2100 Haffley Av National City
2	Pepper Oil Company Inc	19	N	19-0032	05-A	2300 Tidelands Av National City
2	Pepper Oil Company Inc	19	N	19-0032	06-A	2300 Tidelands Av National City
4	Shell Oil Company	19	N	19-0039	01-A	1601 E 8th St National City
4	Motivational Systems Inc	19	N	19-0046	02-A	2200 Cleveland Av National City
4	Kay Automotive Distributors	19	N	19-0049	03-A	2121 Hoover Av National City
4	Precision Lenscrafters	19	N	19-0054	00-A	3030 Plaza Bonita Rd Suite 2270 National City
4	National City Auto Body	19	N	19-0067	01-A	24 E 4th St National City
4	Microwave Solutions Inc	19	N	19-0074	00-A	3200 Highland Av National City
5	JTW Motor Sports	19	N	19-0078	01-A	415 National City Bl National City
4	California State Military Department	19	N	19-0098	02-A	303 Palm Av Suite 17A National City
4	Old School House Square	19	N	19-0102	01-A	600 8th St National City
4	Southland Clutch Inc	19	N	19-0110	04-A	101 E 18th St National City
4	Inspec Testing	19	N	19-0111	02-A	1413 Wilson Av National City
3	Mossy Inc	19	N	19-0115	05-A	2700 National City Bl National City
4	Friendship Homes	19	N	19-0135	00-A	2300 E 7th St National City
4	San Diego Cold Storage	19	N	19-0139	01-A	2809 Quay Av National City
4	Express Tire	19	N	19-0142	01-A	820 Highland Av National City
4	Costco Wholesale Industries	19	N	19-0143	03-A	1001 W 19th St National City
2	Costco Wholesale Optical Lab #908	19	N	19-0143	04-A	1001 W 19th St National City
4	Caliber Collision Centers	19	N	19-0148	02-A	3131 National City Bl National City
5	Framing Associated	19	N	19-0150	02-A	1316 Coolidge Av National City
4	Jocson's Autobody Paint & Repair	19	N	19-0150	01-A	1316 Coolidge Av National City
4	National City Detail Shop Inc	19	N	19-0152	01-A	108 W 18th St National City
5	AMCE Safety & Supply Corp	19	N	19-0154	01-A	1616 West Av National City
4	Jack Harrison Buick-Pontiac-Suzuki	19	N	19-0157	01-A	2601 National City Bl National City
5	Mossy Nissan	19	N	19-0157	02-A	2601 National City Bl National City
4	Frank Subaru	19	N	19-0159	03-A	2940 National City Bl National City
4	Crown Trucks	19	N	19-0162	00-A	220 W 14th St National City
4	McCune Chrysler/Plymouth	19	N	19-0163	01-A	2340 National City Bl National City
5	Western Hose & Gasket Company	19	N	19-0171	03-A	325 W 30th St National City
4	Westflex Industrial	19	N	19-0171	02-A	325 W 30th St National City
4	Fabrication Technologies Industries Inc	19	N	19-0174	03-A	2200 Haffley Av National City
5	Silva Case Works	19	N	19-0175	01-A	105 W 35th St Suite M National City
4	San Diego Unified Port District	19	N	19-0176	01-A	1400 W 24th St National City
4	Universal Steel Fabrication Inc	19	N	19-0178	01-A	1702 Harding Av National City
3	Pasha Automotive Services	19	N	19-0180	04-A	2500 Terminal Av National City
4	Pasha Services	19	N	19-0180	03-A	2500 Terminal Av National City
4	H M Pitt Labs Inc	19	N	19-0184	02-A	2434 Southport Wy Suite L National City
4	Bear's VW Machine	19	N	19-0185	01-A	337 W 35th St National City
4	South Bay Volkswagen - Suzuki	19	N	19-0202	00-A	3131 National City Bl National City
4C	L3 Unidyne Inc DBA L3Harris Maritime S	19	N	19-0205	04-A	240 W 30th St National City
4C	L3Harris Maritime Services Inc	19	N	19-0205	05-A	240 W 30th St National City
2	Frank Toyota	19	N	19-0206	03-A	2400 National City Bl National City
4	Frank Toyota	19	N	19-0206	04-A	2400 National City Bl National City

Active Permits Metrowide at Year End

Report run on: Monday, January, 3 2022 9:49 am

<i>Class</i>	<i>Name</i>	<i>Area</i>	<i>SIU</i>	<i>Facility</i>	<i>Permit</i>	<i>Address</i>
5	JW Metals	19	N	19-0208	01-A	1401 Cleveland Av National City
4	Door-Man	19	N	19-0213	01-A	910 Hoover Av National City
4	San Diego Auto Detail	19	N	19-0214	04-A	110 W 11th St National City
4	Powers & Hunt	19	N	19-0215	02-A	1703 Hoover Av National City
4	Ehmcke Sheet Metal Corporation	19	N	19-0216	04-A	840 W 19th St National City
4	Manila Motorworks	19	N	19-0217	01-A	25 E 18th St National City
4	JC Environmental Company	19	N	19-0223	02-A	2504 Transportation Av Suite C National City
4	H2O Life Aquarium Foods	19	N	19-0224	03-A	1014 Coolidge Av National City
4	Enterprise Rent A Car	19	N	19-0226	01-A	1145 National City Bl National City
4	Enterprise Rent A Car	19	N	19-0226	02-A	1145 National City Bl National City
4	Mr Best Cleaners	19	N	19-0229	02-A	1210 Plaza Bl National City
4	Foremost Cleaners	19	N	19-0232	01-A	2928 E 8th St National City
4	El Dorado Cleaners & Laundry	19	N	19-0233	02-A	4 N Euclid Av Suite E National City
4M	A Avenue Dental	19	N	19-0244	02-A	705 A Av National City
4	Ira R Braverman MD	19	N	19-0245	03-A	610 Euclid Av Suite 201 National City
4M	Raul Arrechea DDS dba Smart Dental Car	19	N	19-0247	03-A	2016 Highland Av National City
4	Woodside Dental	19	N	19-0247	02-A	2016 Highland Av National City
4M	Rodolfo H Picazo DDS	19	N	19-0248	02-A	1436 Highland Av National City
4M	Waiel Y Putrus DDS	19	N	19-0249	02-A	2004 Highland Av National City
4M	Sevilla Dental Care	19	N	19-0253	02-A	1919 Highland Av National City
4M	Family Dentistry	19	N	19-0254	03-A	1127 Highland Av National City
4M	Town & Country Dental	19	N	19-0261	03-A	1536 Sweetwater Rd Suite E National City
4M	Renato David Reyes DDS	19	N	19-0263	03-A	1625 Sweetwater Rd Suite G1 National City
4	Hertz Equipment Rental Inc	19	N	19-0266	01-A	415 W 30th St National City
4	Frank Hyundai	19	N	19-0267	01-A	3150 National City Bl National City
4	Double J Auto Repair	19	N	19-0270	01-A	29 E 17th St National City
4	National Auto Repair	19	N	19-0271	01-A	2125 Roosevelt Av Suite C National City
4	Southland Transmission	19	N	19-0272	01-A	1339 Hoover Av National City
4	CVS Pharmacy #9783	19	N	19-0274	03-A	1730 Sweetwater Rd National City
5	Pacific Magnetics Inc	19	N	19-0275	01-A	2602 Transportation Av National City
4	Highland Service Station	19	N	19-0277	01-A	1803 Highland Av National City
4	McCune Collision Center	19	N	19-0278	01-A	3000 National City Bl National City
4	Auto Access	19	N	19-0280	01-A	1609 National City Bl National City
4	Nikasil USA Inc	19	N	19-0281	02-A	1212 McKinley Av National City
4C	Prochem Specialty Products	19	N	19-0282	04-A	115 E 18th St National City
4C	Prochem Specialty Products	19	N	19-0282	05-A	115 E 18th St National City
4	Rentx Equipment Rentals	19	N	19-0284	01-A	1936 Mckinley Av National City
5	Son Zee Inc	19	N	19-0285	01-A	1445 Tidelands Av National City
4	National Iron Works	19	N	19-0286	01-A	832 Hoover Av National City
4	Super Shrimp Inc	19	N	19-0287	01-A	1545 Tidelands Av Suite C National City
4	National City Trophy	19	N	19-0288	01-A	21 N Euclid Av National City
4	Miller Marine	19	N	19-0289	01-A	1430 Hoover Av National City
4	Southland Auto Body & Painting	19	N	19-0290	01-A	141 W 18th St National City
4	Alpha Therapeutic Corporation	19	N	19-0291	01-A	2720 Hoover Av National City
4	Senior Flexonics Inc	19	N	19-0293	01-A	326 W 30th St National City

Active Permits Metrowide at Year End

Report run on: Monday, January, 3 2022 9:49 am

<i>Class</i>	<i>Name</i>	<i>Area</i>	<i>SIU</i>	<i>Facility</i>	<i>Permit</i>	<i>Address</i>
4	Southbay Sandblasting & Tank Cleaning	19	N	19-0293	02-A	326 W 30th St National City
4	Custom Lights & Iron	19	N	19-0295	01-A	3101 Hoover Av National City
4	San Diego Cold Storage	19	N	19-0296	01-A	1240 W 28th St National City
4	Walmart # 5023	19	N	19-0297	02-A	1200 Highlands Av National City
4	So-Cal Truck Stop	19	N	19-0298	01-A	2250 Tidelands Av National City
4	Bob's National City Auto Repair	19	N	19-0301	01-A	1504 National City Bl National City
3	National City Car Wash	19	N	19-0302	02-A	2550 E Plaza Bl National City
4	National City Car Wash Inc	19	N	19-0302	01-A	2550 E Plaza Bl National City
4	Perry Ford National City	19	N	19-0303	01-A	2050 E National City Bl National City
4	Advance Plastics	19	N	19-0306	02-A	225 W 30th St National City
4	Business Assessment	19	N	19-0308	01-A	1532 National City Bl National City
5	TNH Auto Repair	19	N	19-0308	02-A	1532 National City Bl National City
4	Megla Manufacturing	19	N	19-0309	02-A	2105 Cleveland Av National City
4	Bay Plaza Cleaners	19	N	19-0312	01-A	1430 E Plaza Bl Suite E3 National City
4M	Marilyn Agbuya DDS	19	N	19-0314	02-A	1430 E Plaza Bl Suite E9 National City
4	CVS Pharmacy # 9138	19	N	19-0315	02-A	1201 E Plaza Bl National City
4M	Emilia Hernandez Dental Office	19	N	19-0316	02-A	1483 E Plaza Bl National City
2	ICD Waterjet Inc	19	N	19-0318	03-A	1805 Cleveland Av National City
4M	Western Dental	19	N	19-0319	02-A	1539 E Plaza Bl National City
4	Galleria Medical Clinic Inc	19	N	19-0322	01-A	2720 E Plaza Bl Suite K National City
4	Maria Flora G Trimor-Tamoria Med Clini	19	N	19-0323	01-A	2240 E Plaza Bl Suite A National City
4	Western Lift Inc	19	N	19-0326	01-A	1839 Cleveland Av National City
4	William T Chapman MD Inc	19	N	19-0328	01-A	2340 E 8th St Suite G National City
4	South Bay OB/Gyn Medical Group Inc	19	N	19-0329	01-A	2340 E 8th St Suite E National City
4	California Family Care Medical Clinic	19	N	19-0330	01-A	2340 E 8th St Suite D National City
4	Dr Shin Office	19	N	19-0332	01-A	2340 E 8th St Suite A National City
4M	Highland Dental	19	N	19-0335	02-A	51 N Highland Av Suite F National City
4	Target # 2232	19	N	19-0336	01-A	3060 Plaza Bonita Rd National City
4	Albert J Sharf MD Inc	19	N	19-0338	01-A	655 Euclid Av Unit 304 National City
4	Paradise Family Health Center	19	N	19-0339	01-A	655 Euclid Av Unit 207 National City
4	Griselda E Tiu MD	19	N	19-0341	01-A	655 S Euclid Av Unit 210 National City
4	Chris Clark DC	19	N	19-0343	01-A	3142 E Plaza Bl Suite T National City
4M	Ferdinand Tuazon DDS	19	N	19-0344	02-A	1235 E 8th St National City
4M	Aurea B & Arleen Crisostomo DDS	19	N	19-0345	02-A	905 E 8th St National City
4M	Jane S Galang	19	N	19-0347	02-A	1415 E 8th St Suite 2 National City
4	Crash & Fix Auto Body	19	N	19-0349	01-A	202 W 11th St National City
4M	Dr Frank Ceja	19	N	19-0350	02-A	3007 Highland Av Suite 3 National City
2	Jacobs Engine Rebuilding	19	N	19-0351	01-A	938 Coolidge Av National City
2	Jacobs Engine Rebuilding	19	N	19-0351	02-A	938 Coolidge Av National City
4M	Bernardita N Lizan DMD Inc	19	N	19-0353	02-A	550 E 8th St Suite 12 National City
4	Mabuhay Tailoring Cleaner	19	N	19-0354	01-A	550 E 8th St Suite 16 National City
4	National City Family Medical Center	19	N	19-0355	01-A	340 E 8th St Unit B National City
4	San Antonio Family Medical Clinic	19	N	19-0358	01-A	36 Euclid Av National City
4	The Saints Sinphony Clothing Company	19	N	19-0359	01-A	199 E 27th St National City
4	Commercial Fleet Service	19	N	19-0360	01-A	1521 Coolidge Av National City

Active Permits Metrowide at Year End

Report run on: Monday, January, 3 2022 9:49 am

<i>Class</i>	<i>Name</i>	<i>Area</i>	<i>SIU</i>	<i>Facility</i>	<i>Permit</i>	<i>Address</i>
4	Patrick Shaw's Letter Works	19	N	19-0361	01-A	1535 Tideland Av Suite J National City
4	Dan Fab	19	N	19-0362	01-A	1110 Harding Av National City
4	E-Z Spring & Stamping	19	N	19-0363	01-A	231 W 11th St National City
4	JB Bradford Metals	19	N	19-0364	01-A	221 W 16th St National City
4	FinishMaster	19	N	19-0365	01-A	110 E 16th St National City
4	Pioneer Speakers Inc	19	N	19-0366	01-A	2427 Hoover Av National City
4	RTM International	19	N	19-0367	01-A	301 W 28th St Suite V National City
4	Horn's Welding	19	N	19-0368	01-A	1840 Wilson Av National City
4	Carroll Metal Works Inc	19	N	19-0369	01-A	740 W 16th St National City
5	Universal Steel Fabrication	19	N	19-0372	01-A	135 Civic Center Dr Suite 101 National City
4	Things Remembered	19	N	19-0373	01-A	3030 Plaza Bonita Rd Space 2460 National City
5	Potter Electric	19	N	19-0377	01-A	1343 Wilson Av National City
5	Seacoast Electric Co	19	N	19-0378	01-A	2702 Southport Wy Suite D National City
5	Jaann	19	N	19-0379	01-A	2602 Transportation Av Suite F National City
5	National City Library	19	N	19-0380	01-A	1401 National City Bl National City
5	L-3/Titan Corporation Unidyne	19	N	19-0381	01-A	202 Mile of Cars Wy National City
4M	South Coast Dental	19	N	19-0381	02-A	202 Mile of Cars Wy National City
3	Austal USA LLC	19	N	19-0384	02-A	1313 Bay Marina Dr National City
3	Marine Group Boat Works	19	N	19-0384	01-A	1313 Bay Marina Dr National City
2	Metropolitan Solutions	19	N	19-0386	01-A	2403 Hoover Av National City
4M	M Hirota DMD	19	N	19-0387	01-A	135 Civic Center Dr Suite 102 National City
4M	Albert Pascual DDS	19	N	19-0388	01-A	2240 E Plaza Bl Suite M National City
4M	Miriam Tamoria Dental Clinic	19	N	19-0389	01-A	1132 E Plaza Bl Suite 202 National City
4M	Ness Dental Corp dba Crown Dental Grou	19	N	19-0390	01-A	2405 Transportation Av National City
4M	Rexie M Oliveria DDS	19	N	19-0391	01-A	2220 E Plaza Bl Suite B National City
4M	New Image Dentistry	19	N	19-0392	01-A	819 D Av Suite 101 National City
4M	Beautiful Smiles Dental	19	N	19-0393	01-A	3403 E Plaza Bl Suite G National City
4M	Chona M Austria Sagana DMD Inc	19	N	19-0394	01-A	2720 E Plaza Bl Suite V National City
4M	Dr Riza Dela Fuente-Lewis DMD	19	N	19-0395	01-A	3400 E 08th St Suite 214 National City
4M	Dr Moore's Dental Office	19	N	19-0396	01-A	3110 E Plaza Bl National City
4M	Maritessa Masangya DDS	19	N	19-0397	01-A	2207 Highland Av Suite 102 National City
4M	Bayview Family Dental Care	19	N	19-0398	01-A	801 National City Bl Suite 106 National City
3	Sureride Charter Inc DBA Sun Diego Cha	19	N	19-0399	01-A	522 W 8th St National City
2	Vees Transmissions Plus	19	N	19-0400	01-A	1400 Hoover Av National City
5	National City Trophy	19	N	19-0401	01-A	337 W 35th St Ste F National City
4M	South Bay Plaza Dental	19	N	19-0402	01-A	1210 E Plaza Bl Suite 405 National City
4M	Healthy Smile Dental Office	19	N	19-0403	01-A	1035 Highland Av National City
4M	Julita G Trimor	19	N	19-0404	01-A	2240 E 2240 Bl Suite O National City
4M	Family Dentistry of San Diego	19	N	19-0405	01-A	1400 E 1400 E Suite A National City
4M	Western Dental 249	19	N	19-0406	01-A	1540 E Plaza Bl National City
4M	Sweetwater Dental Corporation	19	N	19-0407	02-A	1727 Sweetwater Rd Suite 110 National City
4M	Family Dentistry of San Diego	19	N	19-0408	01-A	1400 E Plaza Bl Suite A National City
4M	Family Dentistry	19	N	19-0409	01-A	914 E 8th St National City
4M	Silvia S. Toma, DMD	19	N	19-0418	01-A	3460 Highland Av Suite D National City
5	Avalon Rafts South LLC	19	N	19-0420	01-A	1725 Harding Av Unit B National City

Active Permits Metrowide at Year End

Report run on: Monday, January, 3 2022 9:49 am

<i>Class</i>	<i>Name</i>	<i>Area</i>	<i>SIU</i>	<i>Facility</i>	<i>Permit</i>	<i>Address</i>
2	Palomar Medical Center Poway	20	N	20-0002	04-A	15615 Pomerado Rd Poway
4	Pomerado Publishing	20	N	20-0004	00-A	13247 Poway Rd Poway
4	Intermountain Radiator & A/C	20	N	20-0005	02-A	13945 Poway Rd Suite C Poway
5	Business Assessment	20	N	20-0013	02-A	12255 Poway Rd Poway
3	Poway Unified School District	20	N	20-0020	02-A	13626 Twin Peaks Rd Poway
4	Richardson Pontiac Buick GMC	20	N	20-0025	02-A	13811 Poway Rd Poway
4C	General Atomics Aeronautical Systems In	20	N	20-0026	04-A	12365 Crosthwaite Cr Poway
4	Poway Chevrolet	20	N	20-0030	01-A	13742 Poway Rd Poway
2	Toray Membranes USA Inc	20	N	20-0033	03-A	13435 Danielson St Poway
4	Mission Valley Cabinets/Counter Tech	20	N	20-0036	01-A	12254 Iavelli Wy Poway
4	Body Beautiful Car Wash of Poway	20	N	20-0039	01-A	13236 Poway Rd Poway
4	Micron Machine	20	N	20-0040	01-A	12530 Stowe Dr Poway
4	Poway Toyota Isuzu	20	N	20-0042	01-A	13760 Poway Rd Poway
1	Somacis Inc	20	Y	20-0043	07-A	13500 Danielson St Poway
4	Single Eagle	20	N	20-0044	01-A	12599 Stotler Ct Poway
4	SKS Inc	20	N	20-0045	01-A	13910 Danielson St Poway
4	Alba Action Sports	20	N	20-0046	02-A	12160 Community Rd Poway
4	Pad Print USA	20	N	20-0049	02-A	12528 Kirkham Ct Suite 9 Poway
4	Medical Device Group Inc	20	N	20-0050	01-A	12675 Stowe Dr Suite B Poway
4	Hunter Douglas Fabrication	20	N	20-0051	01-A	12400 Stowe Dr Poway
4	JV Tomahawk Inc	20	N	20-0052	01-A	12255 Kirkham Rd Suite 100 Poway
4	Montgomery Elevator Company	20	N	20-0054	01-A	12150 Tech Center Dr Poway
4	Olhausen Billiards	20	N	20-0056	01-A	12460 Kirkham Ct Poway
4	Orkin Pest Control	20	N	20-0057	01-A	12175 Flint Pl Poway
4	Production Tooling Systems	20	N	20-0058	01-A	12675 Danielson Ct Ste 408 Poway
4	R&D Machine Inc	20	N	20-0060	01-A	12528 Kirkham Ct Suite 1 Poway
5	West Coast Installers	20	N	20-0062	02-A	12170 Tech Center Dr Poway
4	Wassco	20	N	20-0063	01-A	12778 Brookprinter Pl Poway
4	Conco Pumping	20	N	20-0065	01-A	12599 Stotler Ct Poway
4	Target # 296	20	N	20-0066	02-A	14823 Pomerado Rd Poway
4	Royal Dry Cleaning	20	N	20-0072	02-A	14149 Twin Peaks Rd Poway
4	Retina Consultants	20	N	20-0078	02-A	12630 Monte Vista Rd Suite 104 Poway
4M	Ham Sang Wong DDS	20	N	20-0079	03-A	12855 Pomerado Rd Suite A Poway
4	Mark Mikulics MD	20	N	20-0080	02-A	15644 Pomerado Rd Suite F Poway
4M	Bernadette Tyler DDS	20	N	20-0082	05-A	15835 Pomerado Rd Suite 102 Poway
4M	Nicol R Cook	20	N	20-0083	02-A	15835 Pomerado Rd Suite 202 Poway
4M	Roxana Mashoon DDS	20	N	20-0084	03-A	15835 Pomerado Rd Suite 201 Poway
4	Steven Schneider DDS	20	N	20-0089	02-A	15725 Pomerado Rd Suite 212 Poway
4M	Juergen Langenbach DMD	20	N	20-0090	04-A	15725 Pomerado Rd Suite 104 Poway
4	Poway Animal Hospital	20	N	20-0095	02-A	12219 Poway Rd Poway
4M	Joe Noto Nguyen DDS	20	N	20-0096	03-A	12511 Poway Rd Suite B Poway

CHAPTER 4 - ENFORCEMENT

4.1 INTRODUCTION

The IWCP has the primary objectives of bringing permittees into compliance with applicable Federal Pretreatment Standards and requirements and controlling and reducing mass emissions of industrial pollutants to the sewer. As provided in its Enforcement Response Plan and the City of San Diego Municipal Code, the IWCP has a broad range of enforcement mechanisms available, including the recovery of administrative and supplemental monitoring costs related to violation identification and processing; Notices of Violation; Compliance or Penalty Orders; publication of the annual List of Facilities in Significant Non-Compliance (SNC); and permit revocations and suspensions.

IWCP follows the approved Enforcement Response Plan for violations identified through monitoring at designated sample points. When a permittee violates a discharge limit, enforcement actions are initiated, including issuance of a NOV and scheduling of additional sampling. The industry is billed to recover violation sampling and NOV administrative costs. Subsequent non-compliance results in escalating enforcement, which may include issuance of a Compliance Order requiring corrective measures and compliance by a prescribed date. Following a Compliance Order, the IWCP will issue an Administrative Penalty Order to recover, at a minimum, any economic benefit accrued to the violator because of non-compliance; the economic benefit is calculated using EPA's BEN model. Additionally, the IWCP is authorized to seek administrative civil penalties. All compliance schedules resulting from violations of pretreatment standards are issued in Administrative Compliance Orders. Violators that do not achieve and maintain compliance through the Administrative Notice and Order procedure are referred to the court system for civil or criminal prosecution. Enforcement procedures are detailed in the IWCP's Enforcement Response Plan, available on the City's website: <https://www.sandiego.gov/public-utilities/permits-construction/industrial-user-permits>

4.2 ANNUAL SIU COMPLIANCE STATISTICS

The IWCP assesses the compliance status of its inventory of SIUs according to the criteria set forth in NPDES Permit Nos. CA0107409 and CA0109045. These criteria include identification of all SIUs in SNC, as defined in the federal regulations at 40 CFR 403.8(f)(2)(viii). Table 4.2-1 presents a summary of annual SIU compliance status determinations. The IWCP is required to meet a minimum standard of no more than 15% of SIUs in SNC for the calendar year. As provided in the NPDES permits, SIUs who have been issued Administrative Penalty Orders are not included in determining compliance with the 15% SNC standard.

Table 4.2-1 COMPLIANCE STATUS SUMMARY FOR SIGNIFICANT INDUSTRIAL USERS										
Status	NUMBER OF PERMITTED OUTFALLS									
	2013	2014	2015	2016	2017	2018	2019	2020	2021	2022
Consistent Compliance	99	102	103	101	96	102	101	100	97	95
Inconsistent Compliance	11	13	15	13	13	10	14	11	8	13
Significant Non-Compliance	8	4	7	4	6	11	12	18	8	10
Total	118	119	125	118	114	123	127	129	113	118

For the period covered in this report a total of 95 SIUs were monitored at 151 sampling locations constituting 118 outfalls. Ten (10) outfalls at ten (10) SIU facilities were found to be in SNC, and no Administrative Penalty Orders were issued. **The resulting non-compliance rate is 8% (10 of 118 outfalls).** For the year, SIUs were in full compliance (no pollutant violations) with discharge standards and requirements at 80% of the permitted outfalls.

Included in the system wide counts above, the 13 SIUs discharging to the SBWRP were monitored at 16 sampling locations constituting 14 outfalls. Of the ten (10) outfalls found to be in SNC, two (2) were dischargers to the SBWRP.

4.3 ANNUAL SIU COMPLIANCE STATUS REPORT

The Annual SIU Compliance Status Report is presented on page 4-10 at the end of this section. The report lists the industry name, address, permit number, permit class; industrial flow by Connection; violation dates and descriptions, if applicable; discharge standard and period, and actual value resulting in the violation; whether the violation exceeded the Technical Review Committee (TRC); and whether the industry has been in SNC at any time during the year.

4.4 PUBLICATION OF INDUSTRIES IN SNC

Public participation provisions of the Federal Pretreatment Regulations require that industries found to be in Significant Non-Compliance at any time during the previous calendar year be published in a newspaper of general circulation that provides meaningful public notice within the jurisdiction(s) served by the POTW. Each spring, the IWCP publishes the annual Notice of Significant Non-Compliance in the San Diego edition of the Union Tribune. The notice for this year follows:

Table 4.4-1
**NOTICE OF SIGNIFICANT NON-COMPLIANCE
 WITH SEWER DISCHARGE REQUIREMENTS**

NOTICE is hereby given by the City of San Diego that in 2022, the following industries discharging to the Metropolitan Sewerage System were found to be in Significant Non-Compliance (SNC) for exceeding applicable discharge limits or failing to meet reporting requirements, based on statistical criteria established by the US EPA and set forth at 40 CFR 403.8(f)(2)(viii). For additional information contact John Steger, Pretreatment Program Manager, Industrial Wastewater Control Program, (858) 654-4103.

Industrial User	Address	Pollutant/Other
Anocote Metal Finishing Inc	7550 Trade St, San Diego	Cadmium ¹ , Copper ¹ , Nickel ¹ , Zinc ¹
Ballast Point Brewery Miramar	9045 Carroll Wy, San Diego	SMR Late > 45 days
CP Kelco	2025 E Harbor Dr, San Diego	Dissolved sulfides
Conrac Managers SAN LLC	3355 Admiral Boland Wy, San Diego	SMR Late > 45 days
JDZ Inc DBA AleSmith Brewing Company	9990 AleSmith Ct, San Diego	pH lowest
Jensen Meat Company Inc	2550 Britannia Bl, San Diego	Dissolved sulfides
Kraft Heinz Foods Company	7878 Airway Rd, San Diego	Dissolved sulfides
K-Tube Corporation	13400 Kirkham Wy, Poway	Chromium ¹ , Nickel ¹
Otay Landfill Inc	1700 Maxwell Rd, Chula Vista	Oil/grease
Veridiam Inc	1717 Cuyamaca St, El Cajon	Chromium ¹ , Fluoride

¹ SNC due to a single sample in violation for the pollutant listed

4.5 NON-COMPLIANCE FEES / PENALTIES

Non-compliance fees and administrative penalties issued during the past ten years are summarized in Table 4.5-1 below.

Table 4.5-1 NON-COMPLIANCE FEES AND PENALTIES SUMMARY										
Action	2013 SIU/ non-SIU	2014 SIU/ non-SIU	2015 SIU/ non-SIU	2016 SIU/ non-SIU	2017 SIU/ non-SIU	2018 SIU/ non-SIU	2019 SIU/ non-SIU	2020 SIU/ non-SIU	2021 SIU/ non-SIU	2022 SIU/ non-SIU
NOV Fees (\$)	12,402/ 6,125	10,503/ 6,074	10,028/ 6,675	9,720/ 10,550	12,120/ 12,750	15,670/ 14,300	16,875/ 10,500	18,074/ 16,225	15,055/ 10,050	13,109/ 8,550
Civil (\$) Penalties Collected	0	0	0	0	0	0	0	0	0	0
Civil (\$) Penalties Assessed	0	0	0	0	0	0	0	0	0	0
Civil (\$) Penalties Offset	0	0	0	0	0	0	0	0	0	0

4.6 ENFORCEMENT ACTIONS BY TYPE

Compliance Inspections: To investigate non-compliance, determine required or recommended corrective actions, and/or evaluate the progress of permittees operating under Compliance Orders or specific permit requirements or schedules, inspectors conduct non-routine compliance inspections. The IWCP did not conduct any non-routine compliance inspections this year.

Notices of Violation - Administrative Fees: An NOV is a written notification from the IWCP of specific violations of discharge limits or requirements that have occurred. Simultaneously, the discharger is invoiced for fees to cover costs associated with administering the NOV. The NOV requires the permittee to take corrective actions. Supplemental violation monitoring is performed by the IWCP's analytical laboratory within 30 days of becoming aware of the violation, and the cost of the extra sampling and analyses is billed to the violator. This year a total of 261 NOV's were issued to categorical and non-categorical permittees, and \$21,659 in related administrative fees was billed.

Compliance Orders: Compliance Orders are issued to permit violators for the purpose of imposing schedules, requiring pretreatment installation, or mandating other measures needed to achieve and maintain permit compliance. The IWCP issued one Compliance Order this year.

Administrative Penalties and Other Fees: Pursuant to the authority of Municipal Code Chapter I, Article 2, Sections 12.0801 - 12.0810, the IWCP may issue Administrative Orders and Penalties. The IWCP did not issue any Administrative Penalty Orders this year.

Civil / Criminal Referral to Prosecuting Agencies: When a permittee intentionally or negligently violates any provision of the Municipal Code, permit conditions, or discharge limits, the IWCP may refer the matter to the City or District Attorneys for investigation and possible action. The IWCP did not make any civil or criminal referrals this year.

4.7 ENFORCEMENT SUMMARIES

4.7-1: Summary of IWCP Enforcement Actions

Table 4.7-1 ENFORCEMENT ACTIONS SUMMARY										
Action	2013 SIU / non-SIU	2014 SIU / non-SIU	2015 SIU / non-SIU	2016 SIU / non-SIU	2017 SIU / non-SIU	2018 SIU / non-SIU	2019 SIU / non-SIU	2020 SIU / non-SIU	2021 SIU / non-SIU	2022 SIU / non-SIU
NOV	159/ 81	125/ 78	119/ 85	109/ 138	152/ 163	193/ 192	228/ 147	221/ 225	170/ 137	139/ 122
Supplemental Monitoring	29 / 31	33 / 9	14 / 18	28 / 13	34/31	16/17	5/0	11/2	7/7	40/18
Compliance Order	2	0	0	0	0	0	0	0	0	0
Administrative Penalty Order	0	0	0	0	0	0	0	0	0	0
Permit Revocation	0	0	0	0	0	0	0	0	0	0
Civil/Criminal Referral	0	0	0	0	0	0	0	0	0	0
Published for SNC	8	4	6	4	6	11	12	18	8	10

4.7-2: SIU Enforcement Actions Initiated, Continued, or Finalized

Anocote Metal Finishing Inc; IU # 03-1017

This job shop is regulated as a metal finisher and discharges about 110 gpd through their pretreatment system. The IU met the criteria for SNC status for cadmium, copper, nickel, and zinc for the six-month periods ending in the 2nd and 3rd quarters of 2022, when an April sample in 1 of the 3 months exceeded the monthly averages by more than the TRC. NOV's were issued and the IU found and fixed a leak in a rinse tank and also installed a liner as extra protection against any future leaks. As 4 of the 5 monitoring events conducted in the 4th quarter demonstrated that compliance has been re-established the IU avoided SNC status in the 4th quarter. However, the last IWCP monitoring event of the year exceeded both the daily maximum and monthly average limits for nickel and NOV's were issued. Extra IWCP monitoring will continue into the first half of 2023 and unless there are additional violations no further enforcement actions are planned.

Ballast Point Brewery Miramar; IU # 03-0270

This large brewery discharges about 47,000 gpd from its brew house and has the potential for low and high pH and/or high strength slug discharges. The IU has not submitted its SMR due December 15, 2022 and thus was in SNC for late reporting in the fourth quarter. An NOV was

issued requiring submission of the SMR in early 2023. Unless there are additional violations no further enforcement actions are planned.

Cintas Corporation; IU # 11-0189

This industrial laundry discharges about 32,000 gpd after pretreatment including heat reclamation, lint screening, and oil and sediment separation with a three-chambered clarifier. The IU met the criteria for SNC status for oil and grease for the six-month period ending in the 3rd quarter of 2021, as 2 of the 6 samples collected exceeded the daily maximum by more than the TRC. NOVs were issued for the violations and additional IWCP monitoring was scheduled. In response the IU pumped its wastewater pits, removed the accumulated sludge, and retrained their operators on the necessary balance for product processing to ensure consistent discharge strength of the wastewater. The IU avoided SNC status in the 4th quarter, and the monitoring in the first half of 2022 established compliance has been restored.

Conrac Managers SAN LLC; IU # 08-0603

This large rental car center discharges about 48,000 gpd from exterior car washing operations. The IU submitted its SMR due October 15, 2022 on January 1, 2023 (80 days late) and thus was in SNC for late reporting in the fourth quarter. An NOV was issued, and no further enforcement actions are planned.

CP Kelco; IU # 11-0444

This biogum manufacturing facility discharges about 44,000 gpd after pretreatment from its R&D pilot plant production operations and associated equipment cleaning to Connection 430. The IU met the SNC criteria for the six-month periods ending in the 2nd, 3rd, and 4th quarters of 2022, when 2 of the 4 samples collected in the 3rd quarter exceeded the daily maximum for dissolved sulfide by more than the TRC. NOVs were issued, and the IU response stated, "the water and subsequent sewer usage (from the) pilot plant should have been minimal leading to stagnant water in the system which would have potentially caused the high dissolved sulfides issue at Connection 430." Subsequently, the IU modified this connection to comply with flow proportioned sampling requirements and prevent stagnant water from accumulating in the sampling point. The last 2 monitoring events (1 in August by the IU and 1 in November by the IWCP) demonstrated that compliance has been re-established, therefore, no further enforcement actions are planned.

General Dynamics NASSCO; IU # 11-0051

This ship building and repair facility is regulated as a metal finisher and discharges about 40,000 gpd from their wastewater treatment facility to Connection 310. A single sample at Connection 310 in December exceeded the daily maximum and monthly average for zinc and resulted in SNC status for the 4th quarter of 2021. NOVs were issued and the IU responded by conducting a full inspection of the plant and reviewing its daily records for the period preceding the discharge. This confirmed that the plant was operating normally, all plant equipment was functioning properly, and that adequate supplies of treatment chemicals were confirmed prior to startup. Although the underlying cause of the violation has not yet been identified, the IU has taken steps to help prevent recurrence including conducting a comprehensive walkthrough with the wastewater treatment operators to verify that the plant continues to be operated in accordance with manufacturer's specifications and conducting refresher training for all plant operators. Subsequent IWCP (5 events) and IU (7 events) monitoring in 2022 demonstrated that compliance has been re-established, therefore, no further enforcement actions are planned.

JDZ Inc DBA AleSmith Brewing Company; IU # 03-1300

This medium sized brewery is currently discharging about 10,000 gpd after pretreatment including flow equalization, screening, and pH neutralization as it has the potential for low pH and/or high strength slug discharges. The IU met the criteria for SNC status for the six-month period ending in the 4th quarter of 2020, when in 5 of the 6 sampling periods the pH was out of range for both the lower and higher limits. NOV's were issued for the violations and the IU attributed the low values to "u-trap fermentation." The IU explained it is brewing sour beer more often, so the lactic bacteria in the wastewater thrived at the warmer temperatures that started in July. Once flow was restored, the pH in the u-trap went back to being within specification.

In 2021, the IU continued to meet the criteria for SNC status for all 4 quarters – in all 12 monthly sampling periods the pH was out of range on one or more days for the lower limit. NOV's were issued for the violations and in subsequent discussions the IU continued to attribute the low values at least in part to "u-trap fermentation."

The IU continued to meet the criteria for SNC status for the all four quarters of 2022 – in all 12 monthly sampling periods the pH was out of range on one or more days. NOV's were issued for the violations and in subsequent discussions the IU continued to attribute the low and high values at least in part to "u-trap fermentation" or user error. The renewal permit effective March 1, 2022 required that upgrades to the pretreatment system be implemented by June 1, 2022. The plan submitted by the IU indicated they can complete the upgrades by November 1, 2022. The IU did not meet the completion deadline due to supply chain shortages and the system is now anticipated to be completed in February 2023. Extra IWCP monitoring is planned to determine whether these new actions are sufficient to achieve consistent compliance.

Jensen Meat Company Inc; IU # 12-0275

Tributary to the SBWRP, this meat processing facility discharges about 32,000 gpd after pretreatment from cleaning and sanitizing operations. The IU met the SNC criteria for the six-month period ending in the 3rd quarter of 2019, when 5 of the 6 samples collected exceeded the daily maximum for dissolved sulfide by more than the TRC. NOV's were issued and the IU responded that "we have too much decomposing or too much organic matter in our grease trap" and that they are taking several steps to improve their cleaning procedures including: jet-cleaning the drainpipes 3 times a year instead of 2, cleaning the grease trap once a month and deep cleaning it twice a year, and implementing a new cleaning procedure to reduce the solids into the drains.

The IU was not in SNC for the first half of 2020; however, no monitoring for dissolved sulfides was conducted. The IU met the SNC criteria for the six-month periods ending in the 3rd and 4th quarters of 2020, when 4 of the 6 samples collected exceeded the daily maximum for dissolved sulfide by more than the TRC. NOV's were issued for the violations and the IU responded that it will further improve its cleaning steps by increasing the jet-cleaning of the drainpipes to 4 times a year instead of 3 and by increasing the grease trap cleaning frequency to every 3 weeks instead of every 4.

In 2021, the IU met the criteria for SNC status for the six-month periods ending in the 2nd, 3rd, and 4th quarters, when 4 of the 6 samples exceeded the 1.0 mg/L limit for dissolved sulfides. NOV's were issued for the violations and the IU began the permitting process for the construction of a wastewater treatment plant while the equipment has been ordered and is under fabrication.

The IU met the SNC criteria for the six-month periods ending in the 2nd, 3rd, and 4th quarters of 2022, when 3 of the 5 samples collected exceeded the daily maximum for dissolved sulfide by

more than the TRC. The IU anticipated installing extraction equipment to intercept primary food waste before its introduction to the existing grease interceptor in March 2023. Extra IWCP monitoring is planned once the new system is installed to determine whether these new actions are sufficient to achieve consistent compliance.

Kraft Heinz Foods Company; IU # 12-0154

Tributary to the SBWRP, this food manufacturer of frozen foods discharges about 102,000 gpd after pretreatment from cleaning and sanitizing operations. The IU met the SNC criteria for the six-month period ending in the 4th quarter of 2022, when 1 of the 3 samples collected exceeded the daily maximum for dissolved sulfide by more than the TRC. An NOV was issued, and the IU is required to respond by February 15, 2023. Extra IWCP monitoring is planned for early 2023 to determine that compliance has been re-established.

K-Tube Corporation; IU # 20-0122

This specialty metal (needle) tubing manufacturer discharges about 700 gpd from stainless steel tube manufacturing, cleaning, tumbling, and area clean-up operations and is regulated under the metal finishing categorical standards. The IU met the SNC criteria for the six-month period ending in the 3rd and 4th quarter, as 1 of the 3 samples collected for chromium and nickel exceeded the daily max and monthly average by more than the TRC. NOV's were issued, and the IU responded stating the CAST pretreatment system had issues. The system was fixed, and parts were replaced as needed. The subsequent 2 monitoring events (IU samples collected in September and December) demonstrated that compliance has been re-established, therefore, no further enforcement actions are planned.

Otay Landfill Inc; IU # 25-0105

This Trucked Waste generator of landfill leachate had approximately 45,000 gpd hauled for discharge to the receiving/disposal site at Pump Station 1. The IU met the criteria for SNC status for oil and grease for the six-month periods ending in the 2nd, 3rd, and 4th quarters of 2020, as 8 of the 17 samples collected exceeded the daily maximum by more than the TRC. NOV's were issued for the violations. The IU responded the leachate storage system will undergo an annual cleaning, and the leachate conveyance system has been jetted and will be jetted again and more frequently in the future to prevent any potential build-up of oil and grease. While all monitoring in 2021 demonstrated compliance and the IU avoided SNC, only 1 IWCP monitoring event was able to quantify the oil and grease as the 4 others were "unreportable" due to matrix issues. In contrast the IU reported its 12 monthly self-monitoring results demonstrating compliance.

In 2022 the IU met the criteria for SNC status for oil and grease for the six-month periods ending in the 1st and 2nd quarters, as 7 of the 15 samples collected exceeded the daily maximum by more than the TRC. A compliance order was issued on July 28, 2022 and required the IU submit a plan and implementation schedule for installing pretreatment. The IU's submissions to date identify saponification for oil and grease removal as its preferred pretreatment approach, but the implementation schedule is unclear or doesn't meet the requirement timeframes. Also, the last discharge of this leachate wastestream occurred in June 2022 and the IU states it "will continue to not discharge until agreement to resume discharge from the City is obtained." Therefore, authorization to discharge has been suspended until the IU complies with the requirement to effectively pretreat the oil and grease in its leachate wastestream.

Veridiam Inc; IU # 16-0348

This specialty metal tubing manufacturer discharges about 2,300 gpd from surface treatment, etching, passivation, and cleaning operations and is regulated under metal forming (production-based) and metal finishing categorical standards. In January and November 2019 there were daily maximum and monthly average violations for fluoride that resulted in SNC status for the 1st and 4th quarters. NOV's were issued and in response, the IU indicated that 1) no anomalies that support a fluoride result of this magnitude were found, 2) there have been no changes in existing coatings, chemicals or processes, and 3) by contract with existing customers they do not allow changes in processes or coatings and chemicals used.

In February, March, and December 2020 there were daily maximum and/or monthly average violations for fluoride that resulted in SNC status for the 1st, 2nd, and 4th quarters. NOV's were issued and the IU indicated the incoming water supply has fluoride levels exceeding its monthly average limit and its initial rinse was performed with city water, while the second rinse used RO/DI water. To eliminate this source of fluoride, all rinses were switched to RO/DI water in October, but the only subsequent result in December was also above the limits.

In 2021, a single sample in May exceeded the monthly average for fluoride and resulted in SNC status for the 3rd quarter. In response to the NOV, the IU reiterated it has discontinued rinsing with incoming city water and continued to only use RO/DI water. The subsequent 3 IU monitoring events in 2021 demonstrated that compliance had been re-established, but then in 2022, the IU met the SNC criteria for fluoride in the six-month periods ending in the 2nd, 3rd, and 4th quarters, as all 4 of the months sampled exceeded the monthly average, and for chromium an August sample resulted in daily maximum and monthly average violations and SNC status for the 3rd and 4th quarter. NOV's were issued, and the IU responded with an action plan to investigate the accuracy of production/flow reporting from the forming operations that affect the fluoride limit. Water meters will be installed to ensure more accurate flow data is available when the limit for fluoride is reevaluated. The IU plans to install pretreatment for fluoride if the limit is not met after the investigation. The IU attributed the chromium violation to an anomaly since their investigation did not yield any sources. The 3 subsequent monitoring events (1 by the IU and 2 by the IWCP in the 4th quarter) in 2022 demonstrated that for chromium compliance has been re-established. For fluoride, once the annual production/flow reevaluation and any resulting amendments to limits are implemented, extra IWCP monitoring is planned for 2023 to determine whether this is sufficient to achieve consistent compliance.

4.8 POLLUTION PREVENTION PLANS

During this calendar year, no industries were required to prepare and / or implement pollution prevention plans under the provisions of CA SB709 and SB2165.

Annual SIU Compliance Status Report

01-Jan-2022 through 31-Dec-2022

Page 1

SIU Name	IU#	Class	IW Disch	SNC?	[If Yes, Why]	Conn	Violation Date	Description/Parameter	Value	Limit	Period	Cat	TRC
AP Precision Metals 1215 30th St, San Diego	12-0144	1	100	No		NA							
AQX2 Inc DBA Aqua Clean Express 4290 Main St, Chula Vista	13-0553	3	28900	No		NA							
ATK Space Systems Inc 9603 Distribution Av, San Diego	03-0115	1	190	No		NA							
Action Powder Coating LLC 7949 Stromesa Ct Suite D, San Diego	03-0717	1	1500	No		110	01-Apr-22	Zinc, Total	2.5	1.48	MO	F	Y
							06-Apr-22	Zinc, Total	4.68	2.61	DM	F	Y
							01-Jul-22	Zinc, Total	1.5	1.48	MO	F	N
Ajinomoto Althea Inc 6175 Lusk Bl, San Diego	02-0722	1	1694	No		NA							
Ajinomoto Foods North America Inc 8411 Siempre Viva Rd, San Diego	12-0220	3	83300	No		110	09-May-22	pH-lowest value	3	5	DM	L	N
						110	15-Jun-22	Solids, Total Dissolved	2500	1300	DM	L	N
						110	28-Jun-22	Solids, Total Dissolved	1900	1300	DM	L	N
						110	25-Jul-22	SMR Incomplete - failed notify in 24 hrs					
						110	21-Nov-22	SMR Incomplete					
						110	22-Nov-22	Solids, Total Dissolved	1440	1300	DM	L	N
						110	08-Dec-22	Solids, Total Dissolved	1830	1300	DM	L	N
							06-Oct-22	Delinquent Requirement					

Annual SIU Compliance Status Report

01-Jan-2022 through 31-Dec-2022

Page 2

SIU Name	IU#	Class	IW Disch	SNC?	[If Yes, Why]	Conn	Violation Date	Description/Parameter	Value	Limit	Period	Cat	TRC
Alphacoat Finishing LLC 9352 Cabot Dr, San Diego	03-0920	1	375	No		110	18-Apr-22	SMR Incomplete					
						110	20-Jun-22	pH-Instantaneous	7.3				
						110	01-Aug-22	SMR Incomplete					
						120	21-Apr-22	SMR Late - written notice					
						120	16-May-22	SMR Incomplete					
						120	20-Jun-22	pH-Instantaneous	7.9				
						120	01-Aug-22	SMR Incomplete					
AlSCO Inc 705 W Grape St, San Diego	09-0001	3	37334	No		100	24-Jan-22	Oil and grease, Total-Instantaneous	568	500	DM	L	N
						100	01-Mar-22	Oil and grease, Total-Instantaneous	630	500	DM	L	N
						100	25-Apr-22	SMR Incomplete - failed notify in 24 hrs					
						100	01-Nov-22	SMR Incomplete					
Anocote Metal Finishing Inc 7550 Trade St, San Diego	03-1017	1	110	Yes	SNC2 - TRC (MO): Cd 1/3,Cu 1/3,Ni 1/3,Zn 1/3	110	01-Apr-22	Cadmium, Total	.167	.07	MO	F	Y
						110	01-Apr-22	Chromium, Total	1.83	1.71	MO	F	N
						110	01-Apr-22	Copper, Total	3.36	2.07	MO	F	Y
						110	01-Apr-22	Nickel, Total	7.29	2.38	MO	F	Y
						110	01-Apr-22	Zinc, Total	6.26	1.48	MO	F	Y
						110	15-Apr-22	Cadmium, Total	.167	.11	DM	F	Y
						110	15-Apr-22	Nickel, Total	7.29	3.98	DM	F	Y
						110	15-Apr-22	Zinc, Total	6.26	2.61	DM	F	Y
						110	04-May-22	Zinc, Total	2.83	2.61	DM	F	N
						110	07-Jul-22	SMR Incomplete					
						110	01-Dec-22	Nickel, Total	5.28	2.38	MO	F	Y
						110	23-Dec-22	Nickel, Total	10.3	3.98	DM	F	Y
Ballast Point Brewery Miramar 9045 Carroll Wy, San Diego	03-0270	3	46600	Yes	SNC6 - Report Late > 45 days	100	31-Jul-22	Number pH Violation Days in period	8	0	DM	L	N
						100	21-Dec-22	SMR Late - written notice					
							06-Oct-22	Delinquent Requirement					
Business Assessment 6550 Mira Mesa Bl, San Diego	03-0966	4		No		NA							

Annual SIU Compliance Status Report

01-Jan-2022 through 31-Dec-2022

Page 3

SIU Name	IU#	Class	IW Disch	SNC?	[If Yes, Why]	Conn	Violation Date	Description/Parameter	Value	Limit	Period	Cat	TRC
CP Kelco 2025 E Harbor Dr, San Diego	11-0444	2	452488	Yes	SNC2 - TRC (DM): SulfD 1/3,SulfD 2/4	430	29-Jun-22	Sulfides, Dissolved-Instantaneous	4.2	1	DM	L	Y
						430	31-Jul-22	Sulfides, Dissolved-Instantaneous	4.83	1	DM	L	Y
						430	03-Oct-22	SMR Incomplete					
						800	03-Oct-22	SMR Incomplete					
Chromalloy San Diego 7007 Consolidated Wy, San Diego	05-0985	1	130	No		130	01-Nov-22	SMR Incomplete					
Cintas Corporation 675 32nd St, San Diego	11-0189	2	32286	No		110	25-Apr-22	SMR Incomplete					
Coating Services Group LLC 11649 Riverside Dr Suite 139, Lakeside	21-0331	2	20	No		NA							
Compucraft Industries Inc 8787 Olive Ln, Santee	21-0252	1	340	No		NA							
Conrac Managers SAN LLC 3355 Admiral Boland Wy, San Diego	08-0603	3	48120	Yes	SNC6 - Report Late > 45 days	110	03-Nov-22	SMR Late - written notice					
						110	09-Jan-23	SMR Incomplete					
Creative Metal Industries 10039 Prospect Av Suite E, Santee	21-0248	1	90	No		110	01-Aug-22	Copper, Total	2.39	2.07	MO	F	N
						110	29-Aug-22	pH-Instantaneous	1.5	5-12.5	DM	L	N
						110	01-Nov-22	SMR Incomplete					
Cue Health Inc 9877 Waples St, San Diego	03-0801	1	125	No		110	19-Aug-22	SMR Incomplete					
						110	01-Nov-22	SMR Incomplete					

Annual SIU Compliance Status Report

01-Jan-2022 through 31-Dec-2022

Page 4

SIU Name	IU#	Class	IW Disch	SNC?	[If Yes, Why]	Conn	Violation Date	Description/Parameter	Value	Limit	Period	Cat	TRC
Defender SD Manufacturing LLC 3443 Tripp Ct, San Diego	02-0439	1	254	No		100	01-Sep-22	Acetone - 40CFR136.3 Table 1F	2590	1820	MO	F	Y
						100	10-Oct-22	SMR Incomplete					
						100	01-Nov-22	SMR Incomplete					
							06-Oct-22	Delinquent Requirement					
Emerald Textiles Services San Diego LLC 1725 Dornoch Ct, San Diego	12-0065	3	100390	No		110	31-Oct-22	Maximum gals/min thru meter	133	98	DM	L	N
						110	15-Nov-22	SMR Incomplete - monitor outside period					
						110	30-Nov-22	Maximum gals/min thru meter	134	98	DM	L	N
						110	01-Dec-22	SMR Late - written notice					
						110	31-Dec-22	Maximum gals/min thru meter	111	98	DM	L	N
GKN Aerospace Chem-tronics Inc 1150 W Bradley Av, El Cajon	16-0520	1	36230	No		210	03-Oct-22	pH-lowest value	3.8	5	DM	L	N
Garvin Industries 316 Millar Av, El Cajon	16-0033	1	75	No		NA							
General Dynamics NASSCO 2798 Harbor Dr, San Diego	11-0051	1	73101	No		200	21-Apr-22	SMR Late - written notice					
						300	21-Apr-22	SMR Late - written notice					
						310	21-Apr-22	SMR Late - written notice					
						600	21-Apr-22	SMR Late - written notice					
						620	21-Apr-22	SMR Late - written notice					
						798	21-Apr-22	SMR Late - written notice					
						799	21-Apr-22	SMR Late - written notice					
Golden State Metal Finishing 2737 Via Orange Wy Suite 104, Spring Valley	34-0070	1	171	No		NA							
Harcon Precision Metals Inc 1790 Dornoch Ct, San Diego	12-0244	1	70	No		NA							

Annual SIU Compliance Status Report

01-Jan-2022 through 31-Dec-2022

Page 5

SIU Name	IU#	Class	IW Disch	SNC?	[If Yes, Why]	Conn	Violation Date	Description/Parameter	Value	Limit	Period	Cat	TRC
IriSys LLC 6828 Nancy Ridge Dr Suite 100, San Diego	03-0779	1	285	No		110	01-Aug-22	SMR Incomplete					
JDZ Inc DBA AleSmith Brewing Company 9990 AleSmith Ct, San Diego	03-1300	3	10200	Yes	SNC1 - Chronic (DM): pHVDs 2/2,pHVDs 4/4,pHVDs 6/6	110	28-Jan-22	pH-highest value	13.1	12.5	DM	L	N
						110	28-Jan-22	pH-lowest value	4.4	5	DM	L	N
						110	31-Jan-22	Number pH Violation Days in period	4	0	DM	L	N
						110	28-Feb-22	Number pH Violation Days in period	3	0	DM	L	N
						110	28-Feb-22	pH-lowest value	3.9	5	DM	L	N
						110	31-Mar-22	Number pH Violation Days in period	4	0	DM	L	N
						110	30-Jun-22	Number pH Violation Days in period	10	0	DM	L	N
						110	30-Sep-22	Number pH Violation Days in period	12	0	DM	L	N
						110	15-Dec-22	Delinquent Requirement					
						110	31-Dec-22	Number pH Violation Days in period	15	0	DM	L	N
Jensen Meat Company Inc 2550 Britannia Bl Suite 101, San Diego	12-0275	3	32300	Yes	SNC1 - Chronic (DM): SulfD 2/3,SulfD 4/6; SNC2 - TRC (DM): SulfD 1/3,SulfD 3/5,SulfD 3/6	110	18-Apr-22	SMR Incomplete					
						110	09-May-22	Sulfides, Dissolved-Instantaneous	1.3	1	DM	L	Y
						110	10-May-22	Sulfides, Dissolved-Instantaneous	1.1	1	DM	L	N
						110	27-Jun-22	Sulfides, Dissolved-Instantaneous	3.8	1	DM	L	Y
						110	27-Jun-22	pH-Instantaneous	4.7	5-12.5	DM	L	N
						110	28-Jun-22	Sulfides, Dissolved-Instantaneous	2.8	1	DM	L	Y
						110	28-Jun-22	Sulfides, Dissolved-Instantaneous	2.2	1	DM	L	Y
						110	21-Nov-22	Sulfides, Dissolved-Instantaneous	1.5	1	DM	L	Y
						110	21-Nov-22	Sulfides, Dissolved-Instantaneous	1.6	1	DM	L	Y
						110	21-Nov-22	Sulfides, Dissolved-Instantaneous	2	1	DM	L	Y
						110	07-Dec-22	Sulfides, Dissolved-Instantaneous	2.3	1	DM	L	Y
						110	08-Dec-22	Sulfides, Dissolved-Instantaneous	2.5	1	DM	L	Y
						110	08-Dec-22	Sulfides, Dissolved-Instantaneous	2.8	1	DM	L	Y
Johnson Matthey Medical Products 12205 World Trade Dr, San Diego	03-1070	1	245	No		NA							

Annual SIU Compliance Status Report

01-Jan-2022 through 31-Dec-2022

Page 6

SIU Name	IU#	Class	IW Disch	SNC?	[If Yes, Why]	Conn	Violation Date	Description/Parameter	Value	Limit	Period	Cat	TRC
K-Tube Corporation 13400 Kirkham Wy, Poway	20-0122	1	1080	Yes	SNC2 - TRC (DM): Cr 1/3,Ni 1/3 (MO): Cr 1/3,Ni 1/3	120	01-Jul-22	Chromium, Total	11	1.71	MO	F	Y
						120	01-Jul-22	Nickel, Total	6.28	2.38	MO	F	Y
						120	19-Jul-22	Chromium, Total	11	2.77	DM	F	Y
						120	19-Jul-22	Nickel, Total	6.28	3.98	DM	F	Y
Kraft Heinz Foods Company 7878 Airway Rd, San Diego	12-0154	3	102142	Yes	SNC2 - TRC (DM): SulfD 1/3	110	25-Apr-22	SMR Incomplete					
						110	09-May-22	Sulfides, Dissolved-Instantaneous	1.1	1	DM	L	N
						110	09-May-22	Sulfides, Dissolved-Instantaneous	1.1	1			N
						110	28-Jun-22	Oil and grease, Total-Instantaneous	770	500	DM	L	N
						110	24-Oct-22	SMR Incomplete					
						110	25-Oct-22	Oil and grease, Total-Instantaneous	710	500	DM	L	Y
						110	28-Nov-22	SMR Incomplete - failed notify in 24 hrs					
Kyocera International Inc 8611 Balboa Av, San Diego	06-0058	1	23650	No		130	26-Sep-22	SMR Incomplete					
						130	28-Nov-22	SMR Incomplete					
L & T Precision Corporation 12105 Kirkham Rd, Poway	20-0109	1	35	No		NA							
Otay Landfill Inc 1700 Maxwell Rd, Chula Vista	25-0105	9	1000	Yes	SNC2 - TRC (DM): O/G 4/10,O/G 6/14	100	27-Jan-22	Oil and grease, Total-Instantaneous	1000	500	DM	L	Y
						100	11-Feb-22	Oil and grease, Total-Instantaneous	1000	500	DM	L	Y
						100	28-Feb-22	Oil and grease, Total-Instantaneous	1000	500	DM	L	Y
						100	08-Mar-22	Oil and grease, Total-Instantaneous	1000	500	DM	L	Y
						100	02-Apr-22	Oil and grease, Total-Instantaneous	1000	500	DM	L	Y
						100	09-Apr-22	Oil and grease, Total-Instantaneous	1000	500	DM	L	Y
Otay Landfill Inc 1700 Maxwell Rd, Chula Vista	36-0012	2	9070	No		100	08-Jun-22	Compliance Order					

Annual SIU Compliance Status Report

01-Jan-2022 through 31-Dec-2022

Page 7

SIU Name	IU#	Class	IW Disch	SNC?	[If Yes, Why]	Conn	Violation Date	Description/Parameter	Value	Limit	Period	Cat	TRC
Otay Mesa Energy Center LLC 606 De La Fuente Ct, San Diego	36-0001	1	46616	No		NA							
Pacira Pharmaceuticals Inc 10450 Science Center Dr, San Diego	02-0762	1	32690	No		NA							
Pall Filtration & Separations Group Inc 4116 Sorrento Valley Bl, San Diego	02-0332	2	50550	No		NA							
Pio Pico Energy Center 7363 Calzada de la Fuente, San Diego	25-0379	9	13700	No		NA							
Pio Pico Energy Center 7363 Calzada de la Fuente, San Diego	36-0009	3	750	No		NA							
PolyPeptide Laboratories San Diego 9395 Cabot Dr, San Diego	03-1024	1	800	No		NA							
RJ Donovan Correctional Facility 480 Alta Rd, San Diego	12-0038	3	13700	No		NA							
Saint Archer Brewing Company 9550 Distribution Av, San Diego	03-1338	3	14000	No		NA							

Annual SIU Compliance Status Report

01-Jan-2022 through 31-Dec-2022

Page 8

SIU Name	IU#	Class	IW Disch	SNC?	[If Yes, Why]	Conn	Violation Date	Description/Parameter	Value	Limit	Period	Cat	TRC
Santier Inc 10103 Carroll Canyon Rd, San Diego	03-1380	1	138.638	No		110	01-Feb-22	Fluoride, Total	115	68.96	MO	F	Y
							10-Feb-22	Fluoride, Total	230	106.9	DM	F	Y
							01-Sep-22	Nickel, Total	2.72	1.85	MO	F	Y
Somacis Inc 13500 Danielson St, Poway	20-0043	1	32108	No		NA							
Spectex Inc dba Specialty Textile Services 1333 30th St Suite A, San Diego	12-0283	3	47853	No		NA							
Stallergenes Greer dba Allermed Laboratories Inc 7203 Convoy Ct, San Diego	05-0684	1	60	No		150	01-Nov-22	SMR Incomplete					
Star Laundry Services 3410 Main St, San Diego	11-0321	3	38970	No		NA							
Suneva Medical Inc 5870 Pacific Center Bl, San Diego	02-0518	1	979	No		110	06-Jun-22	pH-Instantaneous	4.2	5-12.5	DM	L	N
Sungear 8535 Arjons Dr Suite G, San Diego	03-0347	1	20	No		110	01-Nov-22	SMR Incomplete					
						110	03-Jan-23	SMR Incomplete					
TTM Technologies Inc - San Diego Division 5037 Ruffner St, San Diego	05-0997	1	10100	No		220	14-Feb-22	SMR Incomplete					

Annual SIU Compliance Status Report

01-Jan-2022 through 31-Dec-2022

Page 9

SIU Name	IU#	Class	IW Disch	SNC?	[If Yes, Why]	Conn	Violation Date	Description/Parameter	Value	Limit	Period	Cat	TRC
Tarantino Wholesale Food Distributor 7651 Saint Andrews Av, San Diego	12-0212	3	14565	No			09-May-22	Oil and grease, Total-Instantaneous	510	500	DM	L	N
							25-Jul-22	SMR Incomplete					
							25-Jul-22	SMR Incomplete					
							12-Dec-22	Delinquent Requirement					
The Argen Corporation 5855 Oberlin Dr, San Diego	02-0582	1	110	No			NA						
US General Services Administration - SYLPOE 720 E San Ysidro Bl, San Diego	12-0285	3	50	No			NA						
USN;Marine Corps Air Station Miramar 45249 Miramar Wy, San Diego	05-1019	2Z	22400	No			NA						
USN;Naval Base Coronado - NASNI NAS North Island, San Diego	08-0018	1	156585	No		150	01-Nov-22	Cadmium, Total	.0919	.07	MO	F	Y
USN;Naval Base San Diego 32nd St @ Harbor Dr, San Diego	11-0016	2	14587	No			NA						
UT; 7510 Hazard LLC 7400 Hazard Center Dr, San Diego	05-1250	3	21000	No			NA						
UT; Ametek Inc 790 Greenfield Dr, El Cajon	16-0785	2	29100	No			07-Mar-22	SMR Incomplete					
							28-Mar-22	SMR Incomplete					

Annual SIU Compliance Status Report

01-Jan-2022 through 31-Dec-2022

Page 10

SIU Name	IU#	Class	IW Disch	SNC?	[If Yes, Why]	Conn	Violation Date	Description/Parameter	Value	Limit	Period	Cat	TRC
UT; Arcadis US Inc 2200 Pacific Hy, San Diego	09-0947	2	22000	No		100	31-Jan-22	Minimum gals/min thru meter when discharging	.1	.4	DM	L	N
						100	31-Jan-22	Submit Report for Auto Shutdown Mechanism					
						100	15-Feb-22	SMR Incomplete - missing parameter					
UT; Blue Pacific Engineering and Construction 10 Woodlawn Av, Chula Vista	11-0609	3	1440000	No		NA							
UT; Blue Pacific Engineering and Construction 16711 Martincoit Rd, Poway	20-0304	3	144000	No		NA							
UT; Brenntag Pacific Inc 1888 Nirvana Av, Chula Vista	13-0549	2	10080	No		NA							
UT; Burns & McDonnell 2246 W Washington St, San Diego	08-0649	3	360000	No		NA							
UT; City of San Diego - Storm Water Division 111 W Harbor Dr, San Diego	11-0534	3	400960	No		NA							
UT; City; PUD Water Distribution Division 6500 Imperial Av, San Diego	10-0597	3	23000	No		NA							
UT; Dudek 302 Hollister St, San Diego	12-0333	3	810000	No		NA							

Annual SIU Compliance Status Report

01-Jan-2022 through 31-Dec-2022

Page 11

SIU Name	IU#	Class	IW Disch	SNC?	[If Yes, Why]	Conn	Violation Date	Description/Parameter	Value	Limit	Period	Cat	TRC
UT; ExxonMobil Oil Corporation c/o ETIC 745 H St, Chula Vista	13-0530	2	14400	No		NA							
UT; Fairfield Development LP 7050 Friars Rd, San Diego	05-1358	3	43200	No		NA							
UT; Flatiron West Inc 4747 Friars Rd, San Diego	05-1357	3	216000	No		NA							
UT; Flatiron West Inc 5400 Friars Rd, San Diego	05-1353	3	216000	No		100	03-Oct-22	SMR Incomplete					
						100	30-Nov-22	Maximum gals/min thru meter	500	150	DM	L	N
						100	30-Nov-22	Minimum gals/min thru meter when discharging	15	40	DM	L	N
UT; Flatiron West Inc 885 Sherman St, San Diego	05-1351	3	576000	No		100	07-Jul-22	SMR Incomplete					
UT; Flatiron West Inc 887 Sherman St, San Diego	05-1352	3	2500000	No		NA							
UT; Granite Construction - Lindo Lake Project 12660 Lindo Ln, Lakeside	33-0077	3	108000	No		100	24-Jan-22	SMR Late - written notice					
UT; Granite Construction Company 3225 N Harbor Dr, San Diego	08-0600	2	216000	No		NA							

Annual SIU Compliance Status Report

01-Jan-2022 through 31-Dec-2022

Page 12

SIU Name	IU#	Class	IW Disch	SNC?	[If Yes, Why]	Conn	Violation Date	Description/Parameter	Value	Limit	Period	Cat	TRC
UT; IQHQ RaDD I LLC 850 Pacific Hy, San Diego	09-1013	2	24000	No		NA							
UT; Innovative Environmental Solutions 1330 3rd Av, Chula Vista	13-0454	2	14710	No		NA							
UT; Lennar 9245 Camino Santa Fe, San Diego	03-1537	3	144000	No		100	24-Jan-22	SMR Late - written notice					
UT; Michels Construction Inc 1709 Main St, San Diego	11-0629	2	662400	No		NA							
UT; SC Valley Engineering Inc 717 Pacific Beach Dr, San Diego	04-0569	2	720000	No		200	14-Mar-22	SMR Incomplete					
UT; SDCC Middle Block LLC 225 W B St, San Diego	09-1018	2	22500	No		NA							
UT; SDG&E L1600 Replacement 14401 Pomerado Rd, Poway	20-0306	2	432000	No		NA							
UT; SDSU Mission Valley Site Development 9449 Friars Rd, San Diego	06-0414	2	864000	No		NA							

Annual SIU Compliance Status Report

01-Jan-2022 through 31-Dec-2022

Page 13

SIU Name	IU#	Class	IW Disch	SNC?	[If Yes, Why]	Conn	Violation Date	Description/Parameter	Value	Limit	Period	Cat	TRC
UT; San Diego Int'l Airport Shuttle Lot 2535 Pacific Hy, San Diego	08-0659	2	144000	No		NA							
UT; Thrifty Oil Company # 043 1092 E Washington Av, El Cajon	16-0565	2	15	No		NA							
UT; USN NBPL Defense Fuel Support Point 199 Rosecrans St, San Diego	08-0008	2	54000	No		NA							
Unifirst Corporation 4041 Market St, San Diego	11-0398	2	25535	No		110	28-Mar-22	Oil and grease, Total-Instantaneous	596	500	DM	L	N
University of California San Diego 9500 Gilman Dr 0089, La Jolla	02-0112	2	174800	No		NA							
Valley Metals 13125 Gregg St, Poway	20-0108	1	897.26	No		NA							
Valley Powder Coating Inc 6530 Federal Bl, Lemon Grove	22-0092	1	20	No		110	09-Feb-22	SMR Incomplete					
						110	14-Feb-22	SMR Incomplete					

Annual SIU Compliance Status Report

01-Jan-2022 through 31-Dec-2022

Page 14

SIU Name	IU#	Class	IW Disch	SNC?	[If Yes, Why]	Conn	Violation Date	Description/Parameter	Value	Limit	Period	Cat	TRC
Veridiam Inc 1717 Cuyamaca St, El Cajon	16-0348	1	2378	Yes	SNC1 - Chronic (MO): F 2/2,F 3/3; SNC2 - TRC (MO): Cr 1/2,Cr 1/3,F 1/2,F 2/2,F 3/3 (DM): Cr 1/3,F 2/4	110	01-Feb-22	Fluoride, Total	.687	.58	MO	F	N
						110	01-May-22	Fluoride, Total	.94	.58	MO	F	Y
						110	01-Aug-22	Chromium, Total	2.5	.86	MO	F	Y
						110	01-Aug-22	Fluoride, Total	1.1	.58	MO	F	Y
						110	23-Aug-22	Chromium, Total	2.5	1.4	DM	F	Y
						110	01-Oct-22	Fluoride, Total	1.57	.58	MO	F	Y
						110	26-Oct-22	Fluoride, Total	2.4	1.31	DM	F	Y
						110	01-Nov-22	Fluoride, Total	1.9	.58	MO	F	Y
						110	15-Nov-22	Fluoride, Total	1.9	1.31	DM	F	Y
Vision Systems Inc 11322 N Woodside Av, Santee	21-0288	1	520	No		120	01-Feb-22	Chromium, Total	1.83	1.71	MO	F	N
						120	09-Feb-22	Chromium, Total	5.14	2.77	DM	F	Y
Zoological Society of San Diego 2920 Zoo Dr, San Diego	09-0048	2	302030	No		100	01-Nov-22	SMR Incomplete					
						100	11-Nov-22	Maximum gals/min during restricted hours	999	292	DM	L	N
						100	11-Nov-22	Maximum gals/min during unrestricted hours	1720	500	DM	L	N
						100	15-Nov-22	SMR Incomplete - monitor outside period					
						100	30-Nov-22	Maximum gals/min during restricted hours	894	292	DM	L	N
						100	30-Nov-22	Maximum gals/min during unrestricted hours	1530	500	DM	L	N
						100	31-Dec-22	Maximum gals/min during restricted hours	563	292	DM	L	N
						100	31-Dec-22	Maximum gals/min during unrestricted hours	964	500	DM	L	N
						200	01-Nov-22	SMR Incomplete					
nVent - Schroff Inc 7328 Trade St, San Diego	03-1203	1	352	No		110	18-May-22	SMR Incomplete					

NOVs Issued in 2022 for SIUs Discharging to Treatment Plant

Report run on: Thursday, February 9, 2023 12:36 pm

Page 1

<i>Name</i>	<i>Facility</i>	<i>Conn</i>	<i>NOV</i>	<i>Identified</i>	<i>Action</i>	<i>Viol Date</i>	<i>Fee</i>	<i>Level</i>
Action Powder Coating LLC	03-0717	110	102464	16-May-2022	16-May-2022	06-Apr-2022	100	Initial notice
			103091	03-Aug-2022	04-Aug-2022	19-Apr-2022	50	Notice only
			103812	09-Nov-2022	09-Nov-2022	28-Jul-2022	100	Initial notice
Ajinomoto Foods North America Inc	12-0220	110	101289	19-Jan-2022	19-Jan-2022	04-Nov-2021	100	Initial notice
			102862	06-Jul-2022	05-Jul-2022	09-May-2022	100	Initial notice
			102998	25-Jul-2022	25-Jul-2022	15-Jun-2022	100	Initial notice
			103079	03-Aug-2022	03-Aug-2022	28-Jun-2022	100	Initial notice
			104095	21-Nov-2022	21-Nov-2022	12-Oct-2022	50	Notice only
Alphacoat Finishing LLC	03-0920	110	102210	18-Apr-2022	18-Apr-2022		50	Notice only
			103004	01-Aug-2022	01-Aug-2022	20-Jun-2022	50	Notice only
Alphacoat Finishing LLC	03-0920	120	102235	21-Apr-2022	21-Apr-2022		100	Initial notice
			102444	16-May-2022	16-May-2022	31-Mar-2022	50	Notice only
			103007	01-Aug-2022	01-Aug-2022	20-Jun-2022	50	Notice only
Alsco Inc	09-0001	100	101405	27-Jan-2022	27-Jan-2022	07-Dec-2021	100	Initial notice
			101553	02-Feb-2022	02-Feb-2022	23-Nov-2021	50	Notice only
			101991	07-Mar-2022	07-Mar-2022	25-Jan-2022	100	Initial notice
			102278	25-Apr-2022	25-Apr-2022	01-Mar-2022	100	Initial notice
			103713	01-Nov-2022	01-Nov-2022	30-Sep-2022	50	Notice only
Anocote Metal Finishing Inc	03-1017	110	102533	23-May-2022	23-May-2022	15-Apr-2022	100	Initial notice
			102824	20-Jun-2022	20-Jun-2022	04-May-2022	100	Initial notice
			102890	07-Jul-2022	07-Jul-2022	30-Sep-2021	50	Notice only
			103111	03-Aug-2022	03-Aug-2022	15-Apr-2022	100	Initial notice
Ballast Point Brewery Miramar	03-0270	100	101292	20-Jan-2022	20-Jan-2022	30-Nov-2021	100	Notice only
			103429	06-Sep-2022	05-Oct-2022	31-Jul-2022	100	Initial notice
			103429	06-Sep-2022	19-Dec-2022	31-Jul-2022	75	Second notice
			104191	21-Dec-2022	21-Dec-2022		100	Initial notice
Ballast Point Brewery Miramar	03-0270		103568	06-Oct-2022	06-Oct-2022		50	Notice only
CP Kelco	11-0444	430	103066	03-Aug-2022	03-Aug-2022	30-Jun-2022	100	Initial notice
			103329	22-Aug-2022	22-Aug-2022	31-Jul-2022	50	Notice only
			103563	03-Oct-2022	03-Oct-2022	18-Aug-2022	50	Notice only
CP Kelco	11-0444	800	103562	03-Oct-2022	03-Oct-2022	18-Aug-2022	50	Notice only
Chromalloy San Diego	05-0985	130	103711	01-Nov-2022	01-Nov-2022	13-Sep-2022	100	Initial notice
Cintas Corporation	11-0189	110	101099	30-Sep-2021	18-Mar-2022	30-Sep-2021	348	Final notice
			101150	29-Nov-2021	09-Feb-2022	21-Oct-2021	75	Second notice
			102263	25-Apr-2022	10-May-2022	31-Mar-2022	50	Notice only
Coating Services Group LLC	21-0331	110	103093	03-Aug-2022	03-Aug-2022	13-Apr-2022	0	Initial notice

NOVs Issued in 2022 for SIUs Discharging to Treatment Plant

Report run on: Thursday, February 9, 2023 12:36 pm

Page 2

<i>Name</i>	<i>Facility</i>	<i>Conn</i>	<i>NOV</i>	<i>Identified</i>	<i>Action</i>	<i>Viol Date</i>	<i>Fee</i>	<i>Level</i>
Conrac Managers SAN LLC	08-0603	110	103760	03-Nov-2022	03-Nov-2022		100	Initial notice
			103760	03-Nov-2022	19-Dec-2022		75	Second notice
Creative Metal Industries	21-0248	110	103507	26-Sep-2022	26-Sep-2022	30-Aug-2022	100	Initial notice
			103714	01-Nov-2022	01-Nov-2022	15-Sep-2022	100	Initial notice
			103884	09-Nov-2022	09-Nov-2022	30-Aug-2022	100	Initial notice
Cue Health Inc	03-0801	110	101221	19-Aug-2022	05-Oct-2022		50	Notice only
			101853	31-Dec-2021	03-Mar-2022		348	Final notice
			103707	01-Nov-2022	20-Dec-2022	27-Sep-2022	50	Notice only
Defender SD Manufacturing LLC	02-0439	100	103575	10-Oct-2022	10-Oct-2022	06-Jul-2022	50	Notice only
			103709	01-Nov-2022	01-Nov-2022	07-Sep-2022	50	Notice only
			103955	09-Nov-2022	09-Nov-2022	07-Sep-2022	100	Initial notice
			103955	09-Nov-2022	20-Dec-2022	07-Sep-2022	75	Second notice
Defender SD Manufacturing LLC	02-0439		103569	06-Oct-2022	06-Oct-2022		50	Notice only
			103570	06-Oct-2022	06-Oct-2022		100	Initial notice
Emerald Textiles Services San Diego LLC	12-0065	110	104143	01-Dec-2022	01-Dec-2022		100	Initial notice
GKN Aerospace Chem-tronics Inc	16-0520	110	101331	31-Jan-2022	24-Jan-2022	30-Nov-2021	100	Initial notice
GKN Aerospace Chem-tronics Inc	16-0520	210	103686	24-Oct-2022	24-Oct-2022	04-Oct-2022	100	Initial notice
General Dynamics NASSCO	11-0051	200	102243	21-Apr-2022	21-Apr-2022		50	Notice only
General Dynamics NASSCO	11-0051	300	102238	21-Apr-2022	21-Apr-2022		50	Notice only
General Dynamics NASSCO	11-0051	310	101374	19-Jan-2022	19-Jan-2022	02-Dec-2021	100	Initial notice
			101781	03-Feb-2022	03-Feb-2022	02-Dec-2021	50	Notice only
			101859	31-Dec-2021	21-Mar-2022	31-Dec-2021	348	Final notice
			102244	21-Apr-2022	21-Apr-2022		50	Notice only
General Dynamics NASSCO	11-0051	600	102240	21-Apr-2022	21-Apr-2022		50	Notice only
General Dynamics NASSCO	11-0051	620	102241	21-Apr-2022	21-Apr-2022		50	Notice only
General Dynamics NASSCO	11-0051	798	102242	21-Apr-2022	21-Apr-2022		50	Notice only
General Dynamics NASSCO	11-0051	799	102239	21-Apr-2022	21-Apr-2022		50	Notice only
IriSys LLC	03-0779	110	103005	01-Aug-2022	03-Aug-2022		100	Initial notice
			103005	01-Aug-2022	19-Aug-2022		75	Second notice
JDZ Inc DBA AleSmith Brewing Company	03-1300	110	101307	20-Jan-2022	20-Jan-2022	30-Nov-2021	100	Notice only
			101521	20-Jan-2022	31-Jan-2022	31-Dec-2021	100	Notice only
			101857	31-Dec-2021	21-Mar-2022	31-Dec-2021	348	Final notice
			101937	01-Mar-2022	28-Feb-2022	31-Jan-2022	50	Notice only
			102157	29-Mar-2022	28-Mar-2022	28-Feb-2022	50	Notice only
			102338	03-May-2022	02-May-2022	31-Mar-2022	100	Notice only
			102956	26-Jul-2022	25-Jul-2022	30-Jun-2022	50	Notice only

NOVs Issued in 2022 for SIUs Discharging to Treatment Plant

Report run on: Thursday, February 9, 2023 12:36 pm

Page 3

<i>Name</i>	<i>Facility</i>	<i>Conn</i>	<i>NOV</i>	<i>Identified</i>	<i>Action</i>	<i>Viol Date</i>	<i>Fee</i>	<i>Level</i>
JDZ Inc DBA AleSmith Brewing Company	03-1300	110	103769	07-Nov-2022	07-Nov-2022	30-Sep-2022	50	Notice only
			104169	15-Dec-2022	15-Dec-2022		100	Initial notice
Jensen Meat Company Inc	12-0275	110	100592	30-Jun-2021	18-Mar-2022	30-Jun-2021	348	Final notice
			101280	19-Jan-2022	19-Jan-2022	04-Nov-2021	100	Initial notice
			102211	18-Apr-2022	18-Apr-2022	02-Mar-2022	50	Notice only
			102872	05-Jul-2022	05-Jul-2022	10-May-2022	100	Initial notice
			103072	03-Aug-2022	03-Aug-2022	28-Jun-2022	100	Initial notice
Johnson Matthey Medical Products	03-1070	110	100588	30-Jun-2021	18-Mar-2022	30-Jun-2021	348	Final notice
K-Tube Corporation	20-0122	120	103304	15-Aug-2022	15-Aug-2022	19-Jul-2022	100	Initial notice
			103809	09-Nov-2022	09-Nov-2022	19-Jul-2022	50	Notice only
Kraft Heinz Foods Company	12-0154	110	102267	25-Apr-2022	25-Apr-2022		50	Notice only
			102876	05-Jul-2022	05-Jul-2022	10-May-2022	100	Initial notice
			103073	03-Aug-2022	03-Aug-2022	28-Jun-2022	100	Initial notice
			103639	24-Oct-2022	24-Oct-2022	21-Sep-2022	50	Notice only
			104134	28-Nov-2022	28-Nov-2022	25-Oct-2022	100	Initial notice
Kyocera International Inc	06-0058	130	103461	26-Sep-2022	26-Sep-2022	15-Jul-2022	50	Notice only
			104121	28-Nov-2022	28-Nov-2022	09-Sep-2022	50	Notice only
Kyocera International Inc	06-0058	131	101622	03-Feb-2022	03-Feb-2022	13-Oct-2021	100	Initial notice
Otay Landfill Inc	25-0105	100	101981	07-Mar-2022	07-Mar-2022	27-Jan-2022	100	Initial notice
			102051	21-Mar-2022	21-Mar-2022	11-Feb-2022	100	Initial notice
			102052	21-Mar-2022	21-Mar-2022	28-Feb-2022	100	Initial notice
			102422	09-May-2022	09-May-2022	08-Mar-2022	100	Initial notice
			102452	16-May-2022	18-May-2022	09-Apr-2022	300	Prelim Conf
Santier Inc	03-1380	110	102453	16-May-2022	16-May-2022	02-Apr-2022	100	Initial notice
			102136	28-Mar-2022	28-Mar-2022	10-Feb-2022	100	Initial notice
			102571	23-May-2022	25-May-2022	10-Feb-2022	50	Notice only
			103908	09-Nov-2022	25-Nov-2022	26-Sep-2022	100	Initial notice
			103708	01-Nov-2022	01-Nov-2022	30-Sep-2022	50	Notice only
Stallergenes Greer dba Allermed Laboratories Inc	05-0684	150	102895	11-Jul-2022	11-Jul-2022	06-Jun-2022	100	Initial notice
Suneva Medical Inc	02-0518	110	103712	01-Nov-2022	01-Nov-2022	30-Sep-2022	100	Initial notice
Sungear	03-0347	110	101443	14-Feb-2022	31-Jan-2022	19-Oct-2021	50	Notice only
TTM Technologies Inc - San Diego Division	05-0997	220	101316	19-Jan-2022	19-Jan-2022	04-Nov-2021	100	Initial notice
Tarantino Wholesale Food Distributor	12-0212	100	101316	19-Jan-2022	30-Mar-2022	04-Nov-2021	75	Second notice
			102886	05-Jul-2022	05-Jul-2022	09-May-2022	100	Initial notice
			102886	05-Jul-2022	03-Aug-2022	09-May-2022	75	Second notice
			102936	25-Jul-2022	03-Aug-2022	29-Jun-2022	100	Initial notice

NOVs Issued in 2022 for SIUs Discharging to Treatment Plant

Report run on: Thursday, February 9, 2023 12:36 pm

Page 4

Name	Facility	Conn	NOV	Identified	Action	Viol Date	Fee	Level
Tarantino Wholesale Food Distributor	12-0212	100	102936	25-Jul-2022	12-Oct-2022	29-Jun-2022	75	Second notice
Tarantino Wholesale Food Distributor	12-0212	210	101301	19-Jan-2022	19-Jan-2022	04-Nov-2021	100	Initial notice
			101301	19-Jan-2022	30-Mar-2022	04-Nov-2021	75	Second notice
			102937	25-Jul-2022	03-Aug-2022	29-Jun-2022	100	Initial notice
			102937	25-Jul-2022	12-Oct-2022	29-Jun-2022	75	Second notice
			104157	12-Dec-2022	13-Dec-2022		100	Initial notice
USN;Naval Base Coronado - NASNI	08-0018	140	101098	30-Sep-2021	18-Mar-2022	30-Sep-2021	348	Final notice
UT; Ametek Inc	16-0785	100	101970	07-Mar-2022	07-Mar-2022		50	Notice only
			102129	28-Mar-2022	28-Mar-2022		50	Notice only
UT; Arcadis US Inc	09-0947	100	101913	28-Feb-2022	28-Feb-2022	31-Jan-2022	100	Initial notice
UT; Flatiron West Inc	05-1351	100	102888	07-Jul-2022	07-Jul-2022	31-Dec-2021	50	Notice only
UT; Flatiron West Inc	05-1353	100	103564	03-Oct-2022	03-Oct-2022	19-Aug-2022	50	Notice only
UT; Granite Construction - Lindo Lake Project	33-0077	100	101442	24-Jan-2022	25-Jan-2022		50	Notice only
UT; Lennar	03-1537	100	101435	24-Jan-2022	25-Jan-2022		50	Notice only
UT; SC Valley Engineering Inc	04-0569	200	102025	14-Mar-2022	14-Mar-2022		50	Notice only
Unifirst Corporation	11-0398	110	102447	16-May-2022	16-May-2022	29-Mar-2022	100	Initial notice
Valley Powder Coating Inc	22-0092	110	101241	14-Feb-2022	07-Jul-2022	30-Nov-2022	100	Initial notice
			101241	14-Feb-2022	19-Aug-2022	30-Nov-2022	75	Second notice
			101447	09-Feb-2022	31-Jan-2022		50	Notice only
Veridiam Inc	16-0348	110	100594	30-Jun-2021	18-Mar-2022	30-Jun-2021	348	Final notice
			102601	23-May-2022	23-May-2022	24-Feb-2022	100	Initial notice
			103134	03-Aug-2022	03-Aug-2022	24-May-2022	100	Initial notice
			103796	07-Nov-2022	07-Nov-2022	23-Aug-2022	100	Initial notice
			103796	07-Nov-2022	25-Nov-2022	23-Aug-2022	100	Initial notice
			103868	09-Nov-2022	09-Nov-2022	23-Aug-2022	100	Initial notice
Vision Systems Inc	21-0288	120	102152	28-Mar-2022	28-Mar-2022	09-Feb-2022	100	Initial notice
			102586	23-May-2022	25-May-2022	22-Feb-2022	50	Notice only
Zoological Society of San Diego	09-0048	100	103710	01-Nov-2022	01-Nov-2022	30-Sep-2022	50	Notice only
			104122	28-Nov-2022	28-Nov-2022	11-Nov-2022	100	Initial notice
Zoological Society of San Diego	09-0048	200	103706	01-Nov-2022	01-Nov-2022	30-Sep-2022	50	Notice only
nVent - Schroff Inc	03-1203	110	102483	18-May-2022	18-May-2022	21-Feb-2022	50	Notice only
Total fees:							\$13,109	
NOV count:			139					

NOVs Issued in 2022 for SIUs Discharging to SBWRP

Report run on: Tuesday, February 7, 2023 11:38 am

Page 1

<i>Name</i>	<i>Facility</i>	<i>Conn</i>	<i>NOV</i>	<i>Identified</i>	<i>Action</i>	<i>Viol Date</i>	<i>Fee</i>	<i>Level</i>
Ajinomoto Foods North America Inc	12-0220	110	101289	19-Jan-2022	19-Jan-2022	04-Nov-2021	100	Initial notice
			102862	06-Jul-2022	05-Jul-2022	09-May-2022	100	Initial notice
			102998	25-Jul-2022	25-Jul-2022	15-Jun-2022	100	Initial notice
			103079	03-Aug-2022	03-Aug-2022	28-Jun-2022	100	Initial notice
			104095	21-Nov-2022	21-Nov-2022	12-Oct-2022	50	Notice only
Emerald Textiles Services San Diego LLC	12-0065	110	104143	01-Dec-2022	01-Dec-2022		100	Initial notice
Jensen Meat Company Inc	12-0275	110	100592	30-Jun-2021	18-Mar-2022	30-Jun-2021	348	Final notice
			101280	19-Jan-2022	19-Jan-2022	04-Nov-2021	100	Initial notice
			102211	18-Apr-2022	18-Apr-2022	02-Mar-2022	50	Notice only
			102872	05-Jul-2022	05-Jul-2022	10-May-2022	100	Initial notice
			103072	03-Aug-2022	03-Aug-2022	28-Jun-2022	100	Initial notice
Kraft Heinz Foods Company	12-0154	110	102267	25-Apr-2022	25-Apr-2022		50	Notice only
			102876	05-Jul-2022	05-Jul-2022	10-May-2022	100	Initial notice
			103073	03-Aug-2022	03-Aug-2022	28-Jun-2022	100	Initial notice
			103639	24-Oct-2022	24-Oct-2022	21-Sep-2022	50	Notice only
			104134	28-Nov-2022	28-Nov-2022	25-Oct-2022	100	Initial notice
Tarantino Wholesale Food Distributor	12-0212	100	101316	19-Jan-2022	19-Jan-2022	04-Nov-2021	100	Initial notice
			101316	19-Jan-2022	30-Mar-2022	04-Nov-2021	75	Second notice
			102886	05-Jul-2022	05-Jul-2022	09-May-2022	100	Initial notice
			102886	05-Jul-2022	03-Aug-2022	09-May-2022	75	Second notice
			102936	25-Jul-2022	03-Aug-2022	29-Jun-2022	100	Initial notice
Tarantino Wholesale Food Distributor	12-0212	210	102936	25-Jul-2022	12-Oct-2022	29-Jun-2022	75	Second notice
			101301	19-Jan-2022	19-Jan-2022	04-Nov-2021	100	Initial notice
			101301	19-Jan-2022	30-Mar-2022	04-Nov-2021	75	Second notice
			102937	25-Jul-2022	03-Aug-2022	29-Jun-2022	100	Initial notice
			102937	25-Jul-2022	12-Oct-2022	29-Jun-2022	75	Second notice
			104157	12-Dec-2022	13-Dec-2022		100	Initial notice
Total fees:								\$2,623
NOV count:			27					

NOVs Issued in 2022 for nonSIUs Discharging to Treatment Plant

Report run on: Tuesday, February 7, 2023 11:25 am

Page 1

<i>Name</i>	<i>Facility</i>	<i>Conn</i>	<i>NOV</i>	<i>Identified</i>	<i>Action</i>	<i>Viol Date</i>	<i>Fee</i>	<i>Level</i>
Affordable Grease Pumping	25-0432	100	101979	07-Mar-2022	07-Mar-2022	20-Jan-2022	100	Initial notice
			101980	07-Mar-2022	07-Mar-2022	17-Jan-2022	100	Initial notice
			103800	07-Nov-2022	07-Nov-2022	06-Oct-2022	100	Initial notice
Alvarado Hospital Medical Center	10-0002	100	103554	29-Sep-2022	29-Sep-2022		100	Initial notice
Aqua Aire West LLC	11-0447	110	101914	29-Apr-2022	28-Feb-2022	01-Feb-2022	50	Notice only
			101968	03-Mar-2022	03-Mar-2022		50	Notice only
			102887	07-Jul-2022	07-Jul-2022	31-Oct-2021	50	Notice only
Associated Microbreweries LTD aka Karl Strauss	05-1183	100	101317	09-Feb-2022	19-Jan-2022		50	Notice only
			104123	28-Nov-2022	28-Nov-2022	11-Nov-2022	50	Notice only
Athletic Brewing Company LLC	03-1504	100	103585	13-Oct-2022	13-Oct-2022		100	Initial notice
			103585	13-Oct-2022	25-Nov-2022		75	Second notice
			104144	05-Dec-2022	06-Dec-2022	21-Oct-2022	50	Notice only
Barona Resort and Casino	25-0589	100	101242	29-Apr-2022	19-Jan-2022	10-Nov-2021	50	Notice only
Boochcraft	13-0562	110	102802	30-May-2022	20-Jun-2022		50	Notice only
			102902	11-Jul-2022	11-Jul-2022	08-Jun-2022	100	Initial notice
			103599	17-Oct-2022	17-Oct-2022	12-Sep-2022	50	Notice only
			104127	28-Nov-2022	28-Nov-2022	23-Sep-2022	100	Initial notice
			104127	28-Nov-2022	02-Dec-2022	23-Sep-2022	100	Initial notice
CALTRANS - Kearny Mesa	05-0467	140	103552	29-Sep-2022	05-Oct-2022		50	Notice only
CALTRANS - Kearny Mesa	05-0467	240	100300	11-Oct-2021	11-Jul-2022	31-Aug-2021	100	Initial notice
			103553	29-Sep-2022	05-Oct-2022		50	Notice only
California Filtration Services Inc	16-0776	110	101969	03-Mar-2022	03-Mar-2022		100	Initial notice
			101969	03-Mar-2022	30-Mar-2022		75	Second notice
			103415	30-Aug-2022	30-Aug-2022		100	Initial notice
Campbell Membrane Technologies Inc	16-0775	110	102124	23-Mar-2022	23-Mar-2022		100	Initial notice
			102261	25-Apr-2022	25-Apr-2022		50	Notice only
			102836	22-Jun-2022	22-Jun-2022		100	Initial notice
			102836	22-Jun-2022	19-Aug-2022		75	Second notice
			103559	29-Sep-2022	29-Sep-2022		100	Initial notice
			103559	29-Sep-2022	25-Nov-2022		75	Second notice
			104197	21-Dec-2022	21-Dec-2022		100	Initial notice
City; Environmental Svcs - Miramar Landfill	25-0557	100	103376	29-Aug-2022	29-Aug-2022		50	Notice only
Coronado Brewing Company	05-1267	110	103509	26-Sep-2022	26-Sep-2022	07-Sep-2022	50	Notice only
County of San Diego DPW Julian WWTP	25-0325	100	103462	26-Sep-2022	26-Sep-2022		50	Notice only
County of San Diego DPW Rancho Del Campo WWTP	25-0244	100	101245	14-Feb-2022	12-Jul-2022	30-Nov-2021	50	Notice only
			103703	24-Oct-2022	24-Oct-2022	30-Sep-2022	50	Notice only

NOVs Issued in 2022 for nonSIUs Discharging to Treatment Plant

Report run on: Tuesday, February 7, 2023 11:25 am

Page 2

<i>Name</i>	<i>Facility</i>	<i>Conn</i>	<i>NOV</i>	<i>Identified</i>	<i>Action</i>	<i>Viol Date</i>	<i>Fee</i>	<i>Level</i>
Cutwater Spirits	03-0351	110	104158	12-Dec-2022	12-Dec-2022	16-Sep-2022	50	Notice only
DARPRO Solutions Division of Darling International	03-0332	120	102882	05-Jul-2022	06-Jul-2022	24-May-2022	50	Notice only
			102883	05-Jul-2022	05-Jul-2022	16-May-2022	100	Initial notice
			102930	21-Jul-2022	28-Jul-2022		50	Notice only
Decco Castings Inc	16-0024	100	102933	21-Jul-2022	28-Jul-2022		50	Notice only
Decco Castings Inc	16-0024	130	102934	21-Jul-2022	28-Jul-2022		50	Notice only
Gabriel Tortilleria & Mexican Food	11-0589	110	98526	26-Jan-2021	03-Aug-2022		100	Final notice
			99249	22-Apr-2021	03-Aug-2022		75	Second notice
			101545	19-Jul-2022	19-Jul-2022		100	Initial notice
			101545	19-Jul-2022	20-Sep-2022		75	Second notice
			102932	21-Jul-2022	21-Jul-2022		100	Initial notice
			102932	21-Jul-2022	20-Sep-2022		300	Prelim Conf
Grossmont-Cuyamaca Community College District	16-0270	100	104156	09-Dec-2022	09-Dec-2022		50	Notice only
Jamul Indian Village Development Corp	25-0491	100	101243	29-Apr-2022	19-Jan-2022	02-Nov-2021	50	Notice only
			104096	21-Nov-2022	21-Nov-2022	04-Oct-2022	50	Notice only
Jamul Indian Village Development Corp	25-0495	100	104172	19-Dec-2022	19-Dec-2022	09-Nov-2022	50	Notice only
Juice Delivery LLC dba Solti	03-1381	120	101278	27-Jan-2022	27-Jan-2022	12-Nov-2021	0	Final notice
			101278	27-Jan-2022	27-Jan-2022	12-Nov-2021	100	Initial notice
			102049	21-Mar-2022	21-Mar-2022	24-Feb-2022	100	Initial notice
			102128	28-Mar-2022	28-Mar-2022		50	Notice only
			103510	26-Sep-2022	26-Sep-2022	30-Aug-2022	50	Notice only
Kaiser Permanente San Diego Medical Center	06-0659	100	101912	29-Apr-2022	28-Feb-2022		50	Notice only
Lilac Enterprises - Hideaway Lake Mobile Estates	25-0142	100	104159	12-Dec-2022	12-Dec-2022	09-Nov-2022	50	Notice only
Liquid Environmental Solutions	33-0069	100	104094	21-Nov-2022	21-Nov-2022	13-Oct-2022	50	Notice only
Marine Group Boat Works	13-0147	110	101546	31-Jan-2022	31-Jan-2022		50	Notice only
			101555	29-Apr-2022	03-Feb-2022	14-Dec-2021	50	Notice only
			102401	29-Apr-2022	04-May-2022	17-Jan-2022	50	Notice only
Marine Group Boat Works	19-0384	110	102484	30-May-2022	23-May-2022	01-Apr-2022	0	Notice only
Mike Hess Brewing Co LLC	09-1000	110	102755	31-May-2022	31-May-2022		100	Initial notice
			102853	05-Jul-2022	05-Jul-2022		50	Notice only
			104141	01-Dec-2022	01-Dec-2022		100	Initial notice
Moody's Lunch Service Inc	11-0147	120	103779	07-Nov-2022	07-Nov-2022	29-Sep-2022	100	Initial notice
Moody's Lunch Service Inc	11-0147	140	102775	13-Jun-2022	13-Jun-2022	06-Jun-2022	50	Initial notice
			103594	17-Oct-2022	21-Oct-2022	29-Sep-2022	100	Initial notice
Moody's Lunch Service Inc	11-0147	150	101933	28-Feb-2022	28-Feb-2022	13-Jan-2022	100	Initial notice
			102014	07-Mar-2022	07-Mar-2022	31-Jan-2022	100	Initial notice

NOVs Issued in 2022 for nonSIUs Discharging to Treatment Plant

Report run on: Tuesday, February 7, 2023 11:25 am

Page 3

<i>Name</i>	<i>Facility</i>	<i>Conn</i>	<i>NOV</i>	<i>Identified</i>	<i>Action</i>	<i>Viol Date</i>	<i>Fee</i>	<i>Level</i>
Moody's Lunch Service Inc	11-0147	150	103799	07-Nov-2022	07-Nov-2022	29-Sep-2022	100	Initial notice
New Leaf Biofuel LLC	11-0380	110	103348	22-Aug-2022	22-Aug-2022		50	Notice only
			103348	22-Aug-2022	20-Sep-2022		100	Initial notice
Oak Tree Ranch Inc	25-0157	100	101548	31-Jan-2022	01-Feb-2022		50	Notice only
			104155	05-Dec-2022	05-Dec-2022		100	Initial notice
			104189	21-Dec-2022	21-Dec-2022	31-Oct-2022	50	Notice only
			104190	21-Dec-2022	21-Dec-2022	02-Nov-2022	50	Notice only
Penhall Company	02-0527	110	102206	12-Apr-2022	12-Apr-2022	30-Mar-2022	50	Initial notice
			102511	23-May-2022	23-May-2022	17-May-2022	50	Initial notice
Point Loma Nazarene University	08-0042	100	104194	21-Dec-2022	21-Dec-2022		100	Initial notice
Poway Unified School District	20-0020		101909	25-Feb-2022	25-Feb-2022		100	Initial notice
			101910	25-Feb-2022	25-Feb-2022		100	Initial notice
Rady Children's Hospital San Diego	05-0035	100	103411	30-Aug-2022	30-Aug-2022		50	Notice only
			103417	06-Sep-2022	06-Sep-2022		50	Notice only
Rady Children's Hospital San Diego	05-0035	200	102742	30-May-2022	31-May-2022		50	Notice only
			103412	30-Aug-2022	30-Aug-2022		50	Notice only
			103418	06-Sep-2022	06-Sep-2022		50	Notice only
San Diego State University	10-0023	100	101554	02-Feb-2022	02-Feb-2022		100	Initial notice
San Marcos Energy LLC	25-0343	100	103375	29-Aug-2022	29-Aug-2022	26-Jul-2022	50	Notice only
Skyline Ranch Country Club	25-0246	100	104098	21-Nov-2022	21-Nov-2022	03-Oct-2022	50	Notice only
Societe Brewing	05-1259	110	104140	01-Dec-2022	01-Dec-2022		100	Initial notice
Solar Turbines Inc	09-0023	110	102852	30-Jun-2022	30-Jun-2022		100	Initial notice
Stella Polly Inc dba Mikkeller San Diego	03-1194	110	102054	21-Mar-2022	21-Mar-2022	15-Feb-2022	100	Initial notice
			102118	23-Mar-2022	29-Mar-2022		50	Notice only
			102181	04-Apr-2022	04-Apr-2022	28-Feb-2022	50	Notice only
			102854	05-Jul-2022	05-Jul-2022	19-May-2022	50	Notice only
			103512	26-Sep-2022	26-Sep-2022	31-Aug-2022	50	Notice only
Stone Brewing Company	25-0411	100	101244	29-Apr-2022	19-Jan-2022	09-Nov-2021	50	Notice only
Stone Brewing Company	25-0412	100	101551	31-Jan-2022	31-Jan-2022		50	Notice only
Suez Water Technologies & Solutions	25-0319	100	102527	23-May-2022	23-May-2022	21-Apr-2022	50	Notice only
Sycamore Energy LLC	25-0344	100	102482	18-May-2022	18-May-2022		50	Notice only
Sycuan Casino	25-0358	100	101558	09-Feb-2022	11-Feb-2022	31-Dec-2021	50	Notice only
			103640	24-Oct-2022	24-Oct-2022	30-Sep-2022	50	Notice only
			104097	21-Nov-2022	21-Nov-2022	01-Oct-2022	50	Notice only
			104173	19-Dec-2022	19-Dec-2022	01-Nov-2022	50	Notice only
Toray Membranes USA Inc	20-0033	110	103561	03-Oct-2022	03-Oct-2022		50	Notice only

NOVs Issued in 2022 for nonSIUs Discharging to Treatment Plant

Report run on: Tuesday, February 7, 2023 11:25 am

Page 4

Name	Facility	Conn	NOV	Identified	Action	Viol Date	Fee	Level
TriLink Biotechnologies LLC	02-1416	100	102113	23-Mar-2022	23-Mar-2022		100	Initial notice
			102751	31-May-2022	31-May-2022		50	Notice only
USN;Naval Amphibious Base Coronado	08-0490	600	103068	03-Aug-2022	03-Aug-2022	21-Jun-2022	100	Initial notice
USN;Naval Base Point Loma	08-0009	100	101426	27-Jan-2022	27-Jan-2022	09-Dec-2021	100	Initial notice
USN;Remote Training Site Warner Springs (RTSWS)	25-0265	100	101549	31-Jan-2022	01-Feb-2022		50	Notice only
UT; Bert W Salas Inc	32-0028	100	102486	30-May-2022	23-May-2022		50	Notice only
UT; General Dynamics NASSCO	11-0563	100	102245	21-Apr-2022	21-Apr-2022		50	Notice only
UT; Shimmick Construction	02-1553	100	101394	09-Feb-2022	24-Jan-2022		50	Notice only
UT; St Vincent De Paul Village	11-0241	110	102835	22-Jun-2022	22-Jun-2022		50	Notice only
			103555	29-Sep-2022	29-Sep-2022		100	Initial notice
			103567	05-Oct-2022	05-Oct-2022		100	Initial notice
			104196	21-Dec-2022	21-Dec-2022		100	Initial notice
White Labs Inc	03-1369	110	103008	01-Aug-2022	01-Aug-2022	11-May-2022	50	Notice only
			103641	24-Oct-2022	24-Oct-2022	16-Sep-2022	50	Notice only
Total fees:							\$8,550	
NOV count:			122					

Sampling in 2022 at SIUs discharging to Treatment Plant

Report run on: Friday, February 10, 2023 3:05 pm

Page 1

<i>Facility</i>	<i>Pmt</i>	<i>Name</i>	<i>Conn</i>	<i>Principle Process</i>	<i>Pmt</i> <i>Include</i>	<i>Parmcode</i>	<i>City</i> <i>Samples</i>	<i>Self</i> <i>Samples</i>
02-0112	07-A	University of California San Diego	100	Overview - Muir & Revelle colleges	L	SILVER CERT		2
						RAIN DIVERT CERT		1
						SOLVENT CERT		2
						SULFIDE DISSOLVD		
						COD	3	4
						COPPER	3	4
						PHARMA MFR CERT		1
						R&D CERT		1
						FLOW		12
						PH	3	4
						PH LOWEST	3	
						BIOHAZARD CERT		2
						PH HIGHEST	3	
						TSS	3	4
			200	Overview - medical school	L	COD	3	4
						COPPER	3	4
						PH LOWEST	3	
						FLOW		12
						PH HIGHEST	3	
						TSS	3	4
						PH	3	4
						SULFIDE DISSOLVD		
			300	Overview - northeast campus	L	PH	3	4
						PH HIGHEST	3	
						COD	3	4
						COPPER	3	4
						PH LOWEST	3	
						TSS	3	4
						SULFIDE DISSOLVD		
						FLOW		12
			500	Stein clinical sciences	L	COPPER	3	4
						FLOW		12
						PH HIGHEST	3	
						SULFIDE DISSOLVD		
						PH LOWEST	3	
						COD	3	4
						PH	2	4
						TSS	3	4
			600	Overview - northwest campus	L	COPPER	3	4
						PH HIGHEST	3	
						TSS	3	4
						FLOW		12
						COD	3	4

Sampling in 2022 at SIUs discharging to Treatment Plant

Report run on: Friday, February 10, 2023 3:05 pm

Page 2

Facility	Pmt	Name	Conn	Principle Process	Pmt Include	Parmcode	City Samples	Self Samples
02-0112	07-A	University of California San Diego	600			PH LOWEST	3	
						PH	3	4
02-0332	07-A	Pall Filtration & Separations Group Inc	100	Lateral	L	SULFIDE DISSOLVD		2
			110	Membrane mfg	L	SOLVENT CERT		2
						TSS	2	6
						PH	4	6
						COD	4	6
						FLASH	4	6
						FLOW		6
02-0439	04-A	Defender SD Manufacturing LLC	100	Industrial and sanitary	F	ISOP ACETATE:P-O	1	2
						PHARMA MFR CERT		2
						FLOW MAX		3
						N-AMYL ACET:P-O	1	2
						90 DAY COMP CERT		1
						ETHYL ACET:P-O	1	2
						SOLVENT CERT		2
						ACETONE:P-O	1	3
						BIOHAZARD CERT		2
						METHYLE CL:P-O	1	2
						PH	1	1
						COD	1	3
						FLOW		3
						ANNUAL SCAN CERT		2
02-0518	07-A	Suneva Medical Inc	100	Lateral	L	TSS	1	3
						SOLVENT CERT		2
						PHARMA MFR CERT		2
			110	Pharmaceutical manufacturing	F	BIOHAZARD CERT		2
						FLOW		4
						TSS	6	4
						COD	6	4
						PH	6	4
						FLOW MAX		4
						ISOP ACETATE:P-O	3	4
						ANNUAL SCAN CERT		4
						N-AMYL ACET:P-O	3	4
						ACETONE:P-O	3	4
						ETHYL ACET:P-O	3	4
						METHYLE CL:P-O	3	4
02-0582	07-A	The Argen Corporation	100	Sewer Lateral	L	SOLVENT CERT		2
			110	Precious Metals Forming	F	COPPER	2	22
						FLOW		2
						SILVER	2	22
						CYANIDE(T)	2	22

Sampling in 2022 at SIUs discharging to Treatment Plant

Report run on: Friday, February 10, 2023 3:05 pm

Page 3

<i>Facility</i>	<i>Pmt</i>	<i>Name</i>	<i>Conn</i>	<i>Principle Process</i>	<i>Pmt</i> <i>Include</i>	<i>Parmcode</i>	<i>City</i> <i>Samples</i>	<i>Self</i> <i>Samples</i>
02-0582	07-A	The Argen Corporation	110			FLOW MAX		2
						COD	2	22
						PRODUCTION RPT		2
						ZEROUNAUTHZ CERT		4
						CADMIUM	2	22
						TSS	1	22
			130	Ti anodizing - Zero generation	L	ZEROGENERTN CERT		4
02-0722	09-A	Ajinomoto Althea Inc	100	Industrial and sanitary	L	PHARMA MFR CERT		2
						BIOHAZARD CERT		2
						SOLVENT CERT		2
			110	Botox mixing/compounding and formulation	F	N-AMYL ACET:P-O		
						COD		
						FLOW MAX		
						TSS		
						FLOW		
						PH		
						ANNUAL SCAN CERT		
						ACETONE:P-O		
						ETHYL ACET:P-O		
						ISOP ACETATE:P-O		
						METHYLE CL:P-O		
02-0762	06-A	Pacira Pharmaceuticals Inc	100	Building 1 lateral	L	BIOHAZARD CERT		4
						PHARMA MFR CERT		4
						SOLVENT CERT		4
			110	Pharmaceutical mfg	F	COD	2	4
						PH LOWEST		
						ANNUAL SCAN CERT		4
						ACETONE:P-O	2	4
						ETHYL ACET:P-O	2	4
						FLOW MAX		4
						ISOP ACETATE:P-O	2	4
						N-AMYL ACET:P-O	2	4
						PH HIGHEST		
						TSS	2	4
						FLOW		4
						METHYLE CL:P-O	2	4
						PH	2	4
03-0270	05-A	Ballast Point Brewery Miramar	100	Brewery	L	PH VIOL DAYS		7
						FLOW RATE MAX		2
						COD	6	8
						FLOWMETER READ 2		7
						PH MIN/MAX RPT		7
						TSS	6	8

Sampling in 2022 at SIUs discharging to Treatment Plant

Report run on: Friday, February 10, 2023 3:05 pm

Page 4

<i>Facility</i>	<i>Pmt</i>	<i>Name</i>	<i>Conn</i>	<i>Principle Process</i>	<i>Pmt</i> <i>Include</i>	<i>Parmcode</i>	<i>City</i> <i>Samples</i>	<i>Self</i> <i>Samples</i>
03-0270	05-A	Ballast Point Brewery Miramar	100			PH HIGHEST	5	5
						PH MAINT&CAL RPT		7
						FLOWMETER READ 1		7
						PH LOWEST	5	5
						FLOW		7
						FLOW RATE MIN		7
						PH	6	2
03-0347	05-B	Sungear	100	Sanitary and industrial	L	SOLVENT CERT		2
			110	Etching rinses	F	CHROMIUM	4	5
						CADMIUM	4	5
						COPPER	4	5
						FLOW		4
						ZINC	4	5
						PH	4	5
						90 DAY COMP CERT		
						CYANIDE(T)	4	5
						LEAD	4	5
						SILVER	4	5
						TTO(413+433)-P	1	
						FLOW MAX		4
						NICKEL	4	5
						TTO CERT		4
03-0717	09-A	Action Powder Coating LLC	110	Coating / cleaning	F	CYANIDE(T)	5	3
						PH LOWEST	4	
						TTO CERT		3
						CHROMIUM	5	3
						FLOW		3
						FLOW MAX		3
						TTO(413+433)-P	1	
						ZINC	5	3
						SILVER	5	3
						PH	5	3
						NICKEL	5	3
						PH HIGHEST	4	
						COPPER	5	3
						LEAD	5	3
						CADMIUM	5	3
03-0779	05-A	IriSys LLC	100	Sanitary & industrial WW	L	SOLVENT CERT		2
						BIOHAZARD CERT		2
			110	Elixir tank cleaning	F	FLOW		1
						FLOW MAX		1
						PH	1	1
						ETHYL ACET:P-O	1	1

Sampling in 2022 at SIUs discharging to Treatment Plant

Report run on: Friday, February 10, 2023 3:05 pm

Page 5

Facility	Pmt	Name	Conn	Principle Process	Pmt Include	Parmcode	City Samples	Self Samples
03-0779	05-A	IriSys LLC	110			METHYLE CL:P-O	1	1
						TSS	1	1
						ACETONE:P-O	1	1
						COD	1	1
						ISOP ACETATE:P-O	1	1
						N-AMYL ACET:P-O	1	1
			120	CIP of the tablet formulation equipment	F	ANNUAL SCAN CERT		
						ISOP ACETATE:P-O		
						PH		
						ANNUAL SCAN CERT		
						ETHYL ACET:P-O		
						N-AMYL ACET:P-O		
						FLOW MAX		
						METHYLE CL:P-O		
						TSS		
						COD		
						ACETONE:P-O		
						FLOW		
						ZERODISCHRG CERT		2
						130	Small scale manufacturing	L
			METHYLE CL:P-O					
			140	Compounding/mixing and formulation	F	N-AMYL ACET:P-O		
						TSS		
						PH		
						FLOW		
						ISOP ACETATE:P-O		
						ETHYL ACET:P-O		
ACETONE:P-O								
ANNUAL SCAN CERT								
FLOW MAX								
BIOHAZARD CERT		4						
03-0801	04-A	Cue Health Inc	100	Industrial & sanitary	L	SOLVENT CERT		4
						NICKEL	1	3
			110	Automation cell sanitation	F	PH	1	4
						TSS	1	3
						COPPER	1	3
						SILVER	1	3
						CADMIUM	1	3
						TTO CERT		4
						COD	1	3
						FLOW MAX		4
						TTO(413+433)-P	1	
						90 DAY COMP CERT		

Sampling in 2022 at SIUs discharging to Treatment Plant

Report run on: Friday, February 10, 2023 3:05 pm

Page 6

<i>Facility</i>	<i>Pmt</i>	<i>Name</i>	<i>Conn</i>	<i>Principle Process</i>	<i>Pmt Include</i>	<i>Parmcode</i>	<i>City Samples</i>	<i>Self Samples</i>
03-0801	04-A	Cue Health Inc	110			CYANIDE(T) FLOW ZINC CHROMIUM LEAD	1 1 1 1 1	3 4 3 3 3
03-0920	07-A	Alphacoat Finishing LLC	110	Anodize, etch, and passivation	F	LEAD COPPER CYANIDE(T) PH TTO CERT ZINC CHROMIUM CADMIUM FLOW MAX TTO(413+433)-P FLOW NICKEL SILVER	3 3 3 3 1 3 3 3 1 3 3 3	4 4 4 4 4 4 4 4 4 4 4 4
			120	Chemfilm, dichromate seal, passivation	F	CYANIDE(T) NICKEL PH FLOW MAX TTO CERT TTO(413+433)-P ZINC FLOW LEAD CADMIUM COPPER CHROMIUM SILVER	3 3 3 1 1 3 3 3 3 3 3 3	4 4 4 4 4 4 4 4 4 4 4 4
03-1017	04-A	Anocote Metal Finishing Inc	110	Etch, anodize, and cleaning rinses	F	COPPER LEAD TTO CERT TTO(413+433)-P ZINC CYANIDE(T) SILVER PH CADMIUM CHROMIUM FLOW FLOW MAX	6 6 1 1 6 6 6 6 6 6 4 4	4 4 4 4 4 4 4 4 4 4 4 4

Sampling in 2022 at SIUs discharging to Treatment Plant

Report run on: Friday, February 10, 2023 3:05 pm

Page 7

<i>Facility</i>	<i>Pmt</i>	<i>Name</i>	<i>Conn</i>	<i>Principle Process</i>	<i>Pmt</i> <i>Include</i>	<i>Parmcode</i>	<i>City</i> <i>Samples</i>	<i>Self</i> <i>Samples</i>
03-1017	04-A	Anocote Metal Finishing Inc	110			NICKEL	6	4
03-1024	02-A	PolyPeptide Laboratories San Diego	100	Industrial and sanitary	L	SOLVENT CERT		4
						PHARMA MFR CERT		4
						BIOHAZARD CERT		4
			110	Labware cleaning - Angiotensin II mfrg	F	CYANIDE(T)	1	4
						CYANIDE CERT		4
03-1070	05-A	Johnson Matthey Medical Products	100	Building 1 sewer lateral	L	SOLVENT CERT		2
			110	Parts cleaning, tumbling	F	FLOW		4
						FLOW MAX		4
						90 DAY COMP CERT		
						CADMIUM	4	4
						NICKEL	4	4
						SILVER	4	4
						CHROMIUM	4	4
						COD	4	4
						PH	4	4
						TSS	4	4
						TTO CERT		4
						CYANIDE(T)	4	4
						COPPER	4	4
						LEAD	4	4
						TTO(413+433)-P	1	
						ZINC	4	4
03-1203	03-A	nVent - Schroff Inc	200	Building 2 sewer lateral	L			
			100	Industrial and sanitary	L	SOLVENT CERT		2
			110	Passivation, silkscreening, tumbling	F	COD	2	4
						FLOW		4
						CYANIDE(T)	5	4
						PH	5	4
						SILVER	5	4
						CADMIUM	5	4
						COPPER	5	4
						TTO(413+433)-P	1	
						ZINC	5	4
						FLOW MAX		4
						NICKEL	5	4
						TSS	2	4
						TTO CERT		4
						CHROMIUM	5	4
						LEAD	5	4
03-1300	03-A	JDZ Inc DBA AleSmith Brewing Company	110	Brewery	L	PH VIOL DAYS		6
						FLOW RATE MIN		6

Sampling in 2022 at SIUs discharging to Treatment Plant

Report run on: Friday, February 10, 2023 3:05 pm

Page 8

<i>Facility</i>	<i>Pmt</i>	<i>Name</i>	<i>Conn</i>	<i>Principle Process</i>	<i>Pmt Include</i>	<i>Parmcode</i>	<i>City Samples</i>	<i>Self Samples</i>
03-1300	03-A	JDZ Inc DBA AleSmith Brewing Company	110			FLOWMETER READ 2		6
						PH HIGHEST	5	2
						PH LOWEST	5	2
						FLOWMETER READ 1		6
						PH	5	6
						TSS	5	6
						FLOW RATE MAX		6
						FLOW		6
						PH MIN/MAX RPT		6
						COD	5	6
						PH MAINT&CAL RPT		6
						FLOW R MAX WET		4
03-1338	03-A	Saint Archer Brewing Company	110	Brewery	L	PH MIN/MAX RPT		3
						FLOW		3
						PH VIOL DAYS		3
						COD	3	9
						FLOWMETER READ 2		3
						PH HIGHEST	3	
						TSS	3	9
						FLOW RATE MIN		3
						PH	3	9
						FLOW RATE MAX		3
						PH LOWEST	3	
						PH MAINT&CAL RPT		3
						FLOWMETER READ 1		3
03-1380	02-A	Santier Inc	110	Metal Finishing / Surface Treatment	F	CADMIUM	5	8
						COD	5	9
						MOLYBDENUM	5	9
						PH	5	
						FLOW		4
						ZINC	5	8
						PRODUCTION RPT		4
						TTO(413+433)-P	1	
						COPPER	5	8
						CYANIDE(T)	5	9
						FLOW MAX		4
						TSS	5	9
						TTO CERT		4
						SILVER	5	8
						CHROMIUM	5	8
						FLUORIDE	5	9
						LEAD	5	8
						NICKEL	5	8

Sampling in 2022 at SIUs discharging to Treatment Plant

Report run on: Friday, February 10, 2023 3:05 pm

Page 9

<i>Facility</i>	<i>Pmt</i>	<i>Name</i>	<i>Conn</i>	<i>Principle Process</i>	<i>Pmt</i> <i>Include</i>	<i>Parmcode</i>	<i>City</i> <i>Samples</i>	<i>Self</i> <i>Samples</i>
05-0684	07-A	Stallergenes Greer dba Allermed Laboratories Inc	130	Wash/sterilize glassware	F	FLOW		4
						FLOW MAX		4
						N-AMYL ACET:P-O	2	1
						ETHYL ACET:P-O	2	1
						ANNUAL SCAN CERT		4
						ISOP ACETATE:P-O	2	1
						METHYLE CL:P-O	2	1
						ACETONE:P-O	2	4
			140	Glassware/equip wash	F	ANNUAL SCAN CERT		4
						ACETONE:P-O	2	4
						N-AMYL ACET:P-O	2	1
						FLOW		4
						ISOP ACETATE:P-O	2	1
						METHYLE CL:P-O	2	1
						ETHYL ACET:P-O	2	1
						FLOW MAX		4
			150	Media prep/tube wash	F	N-AMYL ACET:P-O	2	1
						METHYLE CL:P-O	2	1
						ANNUAL SCAN CERT		4
						FLOW		4
						FLOW MAX		4
						ACETONE:P-O	2	3
						ETHYL ACET:P-O	2	1
						ISOP ACETATE:P-O	2	1
05-0985	06-A	Chromalloy San Diego	130	Fluorescent penetrant inspection (FPI)	F	ZINC	2	3
						TSS	2	3
						CYANIDE(T)	2	4
						NICKEL	2	3
						TTO(413+433)-P	1	
						CHROMIUM	2	3
						COD	2	3
						FLOW		4
						PH		2
						FLOW MAX		4
						LEAD	2	3
						SILVER	2	3
						CADMIUM	2	3
						COPPER	2	3
						TTO CERT		4
05-0997	06-A	TTM Technologies Inc - San Diego Division	220	PCB Manufacturing	F	CADMIUM	3	10
						PH LOWEST	3	
						FLOW		4
						CHROMIUM	3	9

Sampling in 2022 at SIUs discharging to Treatment Plant

Report run on: Friday, February 10, 2023 3:05 pm

Page 10

<i>Facility</i>	<i>Pmt</i>	<i>Name</i>	<i>Conn</i>	<i>Principle Process</i>	<i>Pmt</i> <i>Include</i>	<i>Parmcode</i>	<i>City</i> <i>Samples</i>	<i>Self</i> <i>Samples</i>
05-0997	06-A	TTM Technologies Inc - San Diego Division	220			NICKEL	3	10
						SILVER	3	10
						TSS	3	4
						ZINC	3	10
						COD	3	4
						PH	3	11
						LEAD	3	10
						TTO CERT		4
						PH HIGHEST	3	
						TTO(413+433)-P	1	
						COPPER	3	14
						CYANIDE(T)	3	10
						FLOW		3
						FLOW		4
05-1019	06-B	USN;Marine Corps Air Station Miramar	221	Gold Electro Plating	F	CYANIDE(T)	3	11
			222	Immersion Gold	F	FLOW		2
			230	Film Developing	L	SILVER CERT		2
			100	Sanitary & Aircraft maintenance	L	BIOHAZARD CERT		2
						PH	2	4
						ZEROGENERTN CERT		1
						OIL/GREASE	2	4
						RAIN DIVERT CERT		1
						TSS	2	4
						FLOW RATE MAX		
						REPORT RPT		1
						SOLVENT CERT		2
						COD	2	4
						FLOW MAX		
05-1353	01-B	UT; Flatiron West Inc	100	Construction dewatering	L	BTEX	2	5
						FLOW TOTIMPORTED		5
						FLOW R MAX WET		5
						FLOW RATE MAX		5
						PETROLEUM HC		5
						TPH		5
						COD	2	5
						FLASH	2	4
						FLOWMETER READ 1		5
						TSS	2	5
						BNZ(W/OAGG)	2	5
						FLOW RATE MIN		5
						FLOWMETER READ 2		5
						FLOW RATE MAX		3
05-1357	01-A	UT; Flatiron West Inc	100	Construction dewatering	L	FLOW RATE MIN		3
						FLOW R MAX WET		3

Sampling in 2022 at SIUs discharging to Treatment Plant

Report run on: Friday, February 10, 2023 3:05 pm

Page 11

<i>Facility</i>	<i>Pmt</i>	<i>Name</i>	<i>Conn</i>	<i>Principle Process</i>	<i>Pmt</i> <i>Include</i>	<i>Parmcode</i>	<i>City</i> <i>Samples</i>	<i>Self</i> <i>Samples</i>
05-1357	01-A	UT; Flatiron West Inc	100			FLOWMETER READ 2		3
						COD	2	3
						FLOW TOTIMPORTED		5
						FLOWMETER READ 1		3
						TSS	2	3
05-1358	01-A	UT; Fairfield Development LP	100	Construction dewatering	L	FLOW TOTIMPORTED		5
						FLOWMETER READ 2		5
						TSS	3	5
						FLOW R MAX WET		5
						FLOWMETER READ 1		5
						COD	3	5
						FLOW RATE MAX		5
						FLOW RATE MIN		5
06-0058	07-A	Kyocera International Inc	130	Ni plating, cleaning	F	COPPER	2	6
						TTO CERT		6
						FLOW MAX		6
						CHROMIUM	2	6
						SILVER	2	6
						FLOW		6
						NICKEL	2	6
						TTO(413+433)-P	1	
						CADMIUM	2	6
						COD	2	6
						PH HIGHEST	2	
						TSS	2	5
						ZINC	2	6
						LEAD	2	6
						PH	2	5
						PH LOWEST	2	
			131	Au plating	F	CYANIDE(T)	2	6
						FLOW		6
						CYANIDE(A)	1	6
						FLOW MAX		6
06-0414	03-B	UT; SDSU Mission Valley Site Development	100	Construction dewatering	L	PETROLEUM HC		1
						TSS	1	2
						BTEX	1	1
						COD	1	2
						BNZ(W/OAGG)	1	1
						FLOW RATE MAX		2
						TPH		1
						FLOW RATE MIN		2
						FLOW TOTIMPORTED		11
						FLOWMETER READ 1		2

Sampling in 2022 at SIUs discharging to Treatment Plant

Report run on: Friday, February 10, 2023 3:05 pm

Page 12

<i>Facility</i>	<i>Pmt</i>	<i>Name</i>	<i>Conn</i>	<i>Principle Process</i>	<i>Pmt</i> <i>Include</i>	<i>Parmcode</i>	<i>City</i> <i>Samples</i>	<i>Self</i> <i>Samples</i>
06-0414	03-B	UT; SDSU Mission Valley Site Development	100			FLOWMETER READ 2		2
						AUTOSHUTDOWN RPT		2
						FLOW R MAX WET		2
			200	Construction dewatering	L	FLASH	1	1
						BNZ(W/OAGG)	1	1
						FLOW RATE MIN		2
						FLOW R MAX WET		2
						FLOW TOTIMPORTED		11
						FLOWMETER READ 1		2
						PETROLEUM HC		1
						AUTOSHUTDOWN RPT		2
						FLASH	1	1
						FLOW RATE MAX		2
						TSS	1	2
						BTEX	1	1
						COD	1	2
						FLOWMETER READ 2		2
						TPH		1
08-0008	07-A	UT; USN NBPL Defense Fuel Support Point	210	Fuel recovery	L	FLOW R MAX WET		4
						PETROLEUM HC	1	
						FLOWMETER READ 1		4
						FLASH	1	4
						FLOW TOTIMPORTED		4
						FLOW R MAX DRY		4
						TPH		4
			220	Groundwater remediation	L	FLOWMETER READ 2		4
						FLOW R MAX WET		4
						FLOW TOTIMPORTED		4
						PETROLEUM HC	1	
						FLASH	1	4
						FLOW R MAX DRY		4
						FLOWMETER READ 2		4
						TPH		4
						FLOWMETER READ 1		4
08-0018	07-A	USN;Naval Base Coronado - NASNI	100	NASNI pump station	L	BIOHAZARD CERT		2
						OIL/GREASE	4	4
						PHARMA HC CERT		2
						CHT CERT		2
						SILVER CERT		2
						SOLVENT CERT		2
						SULFIDE DISSOLVD	10	4
						PH	5	4
			120	IWTP	F	FLOW MAX		8

Sampling in 2022 at SIUs discharging to Treatment Plant

Report run on: Friday, February 10, 2023 3:05 pm

Page 13

<i>Facility</i>	<i>Pmt</i>	<i>Name</i>	<i>Conn</i>	<i>Principle Process</i>	<i>Pmt</i> <i>Include</i>	<i>Parmcode</i>	<i>City</i> <i>Samples</i>	<i>Self</i> <i>Samples</i>
08-0018	07-A	USN;Naval Base Coronado - NASNI	120			TTO(413+433)-P	1	3
						ZINC	4	3
						CHROMIUM	4	3
						COPPER	4	3
						LEAD	4	3
						NICKEL	4	3
						CADMIUM	4	3
						FLOW		8
						SILVER	4	3
			123	IWTP CN treatment	F	FLOW MAX		2
						CYANIDE(A)	2	
						FLOW		2
			140	Engine test cell cleaning	F	CADMIUM	3	4
						CHROMIUM	3	4
						ZINC	3	4
						LEAD	3	4
						SILVER	3	4
						COPPER	3	4
						TTO(413+433)-P	1	
						FLOW		4
						FLOW MAX		4
						NICKEL	3	4
						CYANIDE(T)	3	4
						TTO CERT		4
			150	Oil recovery plant	F	CYANIDE(T)	2	11
						FLOW		12
						NICKEL	2	11
						TTO(413+433)-P	1	11
						LEAD	2	11
						SILVER	2	11
						CADMIUM	2	11
						COPPER	2	11
						CHROMIUM	2	11
						FLOW MAX		12
						ZINC	2	11
			160	Hydrostatic testing	F	CHROMIUM	1	4
						FLOW MAX		4
						TTO CERT		4
						SILVER	1	4
						TTO(413+433)-P	1	
						CYANIDE(T)	1	4
						FLOW		4
						LEAD	1	4

Sampling in 2022 at SIUs discharging to Treatment Plant

Report run on: Friday, February 10, 2023 3:05 pm

Page 14

<i>Facility</i>	<i>Pmt</i>	<i>Name</i>	<i>Conn</i>	<i>Principle Process</i>	<i>Pmt</i> <i>Include</i>	<i>Parmcode</i>	<i>City</i> <i>Samples</i>	<i>Self</i> <i>Samples</i>
08-0018	07-A	USN;Naval Base Coronado - NASNI	160			CADMIUM	1	4
						COPPER	1	4
						NICKEL	1	4
						ZINC	1	4
			180	Pump/valve/hose testing	F	FLOW		
						CYANIDE(T)		
						CHROMIUM		
						SILVER		
						TTO(413+433)-P		
						ZINC		
						FLOW MAX		
						CADMIUM		
						LEAD		
						NICKEL		
						TTO CERT		
						COPPER		
			190	Aircraft test pad cleaning	F	CADMIUM	2	4
						CYANIDE(T)	2	4
						FLOW MAX		4
						SILVER	2	4
						FLOW		4
						TTO CERT		4
						COPPER	2	4
						NICKEL	2	4
						ZINC	2	4
						TTO(413+433)-P	1	
						CHROMIUM	2	4
						LEAD	2	4
			799	Contaminated stormwater	L	BNZ(W/OAGG)	2	12
						FLOW TOTIMPORTED		12
08-0603	01-A	Conrac Managers SAN LLC	110	Car washing	L	OIL/GREASE	1	2
						FLOW		2
						CLARIFIER RPT		1
						PH	1	
						TSS	1	2
						COD	1	2
09-0001	07-A	Alsco Inc	100	Commercial Laundry	L	COD	7	5
						OIL/GREASE	5	5
						TSS	7	4
						ZINC	4	5
						CLARIFIER RPT		1
						COPPER	4	5
						PH	5	4

Sampling in 2022 at SIUs discharging to Treatment Plant

Report run on: Friday, February 10, 2023 3:05 pm

Page 15

<i>Facility</i>	<i>Pmt</i>	<i>Name</i>	<i>Conn</i>	<i>Principle Process</i>	<i>Pmt Include</i>	<i>Parmcode</i>	<i>City Samples</i>	<i>Self Samples</i>
09-0001	07-A	Alsco Inc	100			FLOW		4
						FLOW MAX		4
09-0048	02-A	Zoological Society of San Diego	100	Zoo main section	L	FLOW		3
						PH	1	
						TSS	6	12
						FLOW R MAX UNRES		3
						COD	6	12
						FLOW R MAX RESTR		3
			200	Hospital	L	PH	1	
						TSS	4	10
						PHARMA HC CERT		1
						COD	4	10
						FLOW		1
						SOLVENT CERT		2
						BIOHAZARD CERT		1
09-0947	02-A	UT; Arcadis US Inc	100	GW construction w/contamination	L	AUTOSHUTDOWN RPT		11
						BNZ(W/OAGG)	2	12
						CHROMIUM	3	12
						COPPER	3	12
						FLOW RATE MAX		12
						FLOW TOTIMPORTED		12
						MERCURY	3	12
						TSS	3	12
						BTEX	2	12
						COD	3	12
						FLOW RATE MIN		12
						LEAD	3	12
						VINYL CL	2	12
						3CLETHE	2	12
						FLOWMETER READ 1		12
						FLOWMETER READ 2		12
						FLOW R MAX WET		12
						PETROLEUM HC	3	12
						TPH	1	12
						FLASH	2	12
						NICKEL	3	12
						PCBS	2	12
						ZINC	3	12
						12-2CLETHA	2	12
			110	Opt/Amb regeneration	L	3CLETHE	2	2
						PETROLEUM HC	3	2
						VINYL CL	2	2
						TPH	1	2

Sampling in 2022 at SIUs discharging to Treatment Plant

Report run on: Friday, February 10, 2023 3:05 pm

Page 16

Facility	Pmt	Name	Conn	Principle Process	Pmt Include	Parmcode	City Samples	Self Samples
09-0947	02-A	UT; Arcadis US Inc	110			CHROMIUM	3	2
						NICKEL	3	2
						12-2CLETHA	2	2
						LEAD	3	2
						BNZ(W/OAGG)	2	2
						FLASH	3	2
						PCBS	2	2
						BTEX	2	2
						FLOW RATE MAX		2
						MERCURY	3	2
						COPPER	3	2
						ZINC	3	2
11-0016	06-B	USN;Naval Base San Diego	100	USN8 SWW: Piers 6, 7, 8 & Mole Pier	L	CHT CERT		2
						COPPER	3	12
			200	Medical/Dental Clinics, Gym	L			
			300	Auto Hobby Shop	L			
			400	Vehicle Maint	L			
			500	Steam Clean, Hydrotest, Hydroblast	L			
			600	NEX Car Wash; Engine cleaning	L			
			799	Vault dewatering	L	FLOW TOTIMPORTED		1
			810	USN6 SWW: Piers 1 & 2, Quay Wall	L	CHT CERT		2
			820	USN7 SWW: Piers 3, 4, 5, Graving Dock	L	CHT CERT		2
						FLOW R MAX DRY		2
						FLOW R MAX WET		2
						FLOW R MAX RESTR		2
						REPORT RPT		2
			830	NC4M SWW: Piers 10, 12, 13	L	OIL/GREASE	3	
						PH	3	
						COPPER	3	12
						CHT CERT		2
			850	Bilge and Oily Waste Treatment	L	COPPER	3	4
						CHROMIUM	3	4
						ZINC	3	4
						CADMIUM	3	4
						LEAD	3	4
						FLOW		4
						NICKEL	3	4
			900	Fire Fighting School	L			

Sampling in 2022 at SIUs discharging to Treatment Plant

Report run on: Friday, February 10, 2023 3:05 pm

Page 17

<i>Facility</i>	<i>Pmt</i>	<i>Name</i>	<i>Conn</i>	<i>Principle Process</i>	<i>Pmt</i> <i>Include</i>	<i>Parmcode</i>	<i>City</i> <i>Samples</i>	<i>Self</i> <i>Samples</i>
11-0051 07-A	General Dynamics NASSCO	200	Bilge/Ballast/New Construction	L		OIL/GREASE	2	4
						PH	3	4
						ZINC	3	4
						FLOW		4
						CHROMIUM	3	4
						LEAD	3	4
						CADMIUM	3	4
						COPPER	3	4
						NICKEL	3	4
		300	Overview - West End of Yard	L		PH	2	4
						COD	2	4
						FLOW		4
		310	WWTF Effluent	F		OIL/GREASE	1	4
						TSS	2	4
						COPPER	5	7
						LEAD	5	7
						SILVER	5	7
						TTO(413+433)-P	1	
						FLOW		4
						TTO CERT		4
						NICKEL	5	7
						CADMIUM	5	7
						CHROMIUM	5	7
						FLOW MAX		4
						CYANIDE(T)	5	7
						ZINC	5	7
		600	Overview - East End of Yard	L		FLOW		4
						COD	2	4
						FLOW R MAX DRY		
						PH	2	4
						OIL/GREASE	1	4
11-0189 08-A	Cintas Corporation	110	Industrial laundering	L		TSS	2	4
						FLOW R MAX WET		
						FLOW		4
						FLOW TOTSTORM		11
						FLOW TOTIMPORTED		12
						FLOW IWIMPORTED		12
						WW INVENTORY RPT		12
						NICKEL	6	3
						COD	6	3
						CADMIUM	6	3
						TSS	6	3
						CHROMIUM	6	3

Sampling in 2022 at SIUs discharging to Treatment Plant

Report run on: Friday, February 10, 2023 3:05 pm

Page 18

<i>Facility</i>	<i>Pmt</i>	<i>Name</i>	<i>Conn</i>	<i>Principle Process</i>	<i>Pmt</i> <i>Include</i>	<i>Parmcode</i>	<i>City</i> <i>Samples</i>	<i>Self</i> <i>Samples</i>
11-0189	08-A	Cintas Corporation	110			COPPER	6	3
						LEAD	6	3
						OIL/GREASE	11	3
						ZINC	6	3
						FLOW		2
						PH	12	3
11-0321	04-A	Star Laundry Services	100	Commercial Laundry	L	COD	4	4
						FLOW		4
						TSS	4	4
						PH	4	4
11-0398	08-A	Unifirst Corporation	110	Industrial laundry	L	OIL/GREASE	4	4
						COPPER	5	4
						FLOW		4
						TSS	5	4
						PH LOWEST	4	
						LEAD	5	4
						PH	5	4
						ZINC	5	4
						OIL/GREASE	4	4
						CADMIUM	5	4
						CHROMIUM	5	4
						PH HIGHEST	4	
						COD	5	4
						NICKEL	5	4
11-0444	06-A	CP Kelco	430	R&D Pilot Plant	L	FLOW		12
						SULFIDE DISSOLVD	2	4
						COD	2	14
						TSS 1/10 DIL	2	13
						ZINC	2	5
						REPORT RPT		4
						PH	2	12
			799	Storm Water	L	WW INVENTORY RPT		1
			800	Kelco SBP & Cogen Plant processe	L	TSS 1/10 DIL	4	14
						COD	4	15
						PH	4	11
						REPORT RPT		4
						FLOW		12
						SULFIDE DISSOLVD	4	3
						ZINC	4	5
11-0534	04-A	UT; City of San Diego - Storm Water Division	100	western lateral	L	FLOWMETER READ 1		12
						FLOW RATE MIN		12
						FLOW R MAX COMB		12
						FLOW TOTIMPORTED		12

Sampling in 2022 at SIUs discharging to Treatment Plant

Report run on: Friday, February 10, 2023 3:05 pm

Page 19

Facility	Pmt	Name	Conn	Principle Process	Pmt Include	Parmcode	City Samples	Self Samples
11-0534	04-A	UT; City of San Diego - Storm Water Division	100	eastern lateral	L	FLOWMETER READ 2		12
			200			FLOW RATE MIN		12
						FLOWMETER READ 1		12
						FLOW TOTIMPORTED		12
						FLOWMETER READ 2		12
11-0629	01-B	UT; Michels Construction Inc	100	Construction dewatering	L	BTEX		1
						COD		1
						FLOW R MAX WET		1
						FLOW RATE MAX		1
						FLOWMETER READ 1		1
						FLOW RATE MIN		1
						TSS		1
						FLOW TOTIMPORTED		1
						TPH		1
						LEAD		1
						BNZ(W/OAGG)		1
						FLASH		1
						FLOWMETER READ 2		1
						PETROLEUM HC		1
		200	Construction dewatering	L	FLASH			
					FLOW RATE MAX			
					FLOW RATE MIN			
					FLOW TOTIMPORTED		1	
					BNZ(W/OAGG)			
					BTEX			
					COD			
					LEAD			
					TSS			
					FLOW R MAX WET			
					TPH			
					FLOWMETER READ 1			
					FLOWMETER READ 2			
					PETROLEUM HC			
300	Construction dewatering	L	FLOW TOTIMPORTED		1			
			PETROLEUM HC					
			FLOW RATE MAX					
			FLASH					
			FLOW RATE MIN					
			FLOWMETER READ 2					
			TPH					
			TSS					
			BNZ(W/OAGG)					
			COD					

Sampling in 2022 at SIUs discharging to Treatment Plant

Report run on: Friday, February 10, 2023 3:05 pm

Page 20

Facility	Pmt	Name	Conn	Principle Process	Pmt Include	Parmcode	City Samples	Self Samples
11-0629	01-B	UT; Michels Construction Inc	300			FLOWMETER READ 1 LEAD BTEX FLOW R MAX WET SOLVENT CERT		
12-0038	06-A	RJ Donovan Correctional Facility	100	Prison Sewer Main	L	COD PH PHARMA HC CERT BIOHAZARD CERT OIL/GREASE TSS	1 1	2 4 2 2 4 4
12-0065	06-A	Emerald Textiles Services San Diego LLC	110	Commercial laundry	L	FLOW COD FLOW RATE MAX PH HIGHEST ZINC CHLORIDE OIL/GREASE TSS COPPER PH LOWEST SULFIDE DISSOLVD TDS	1 4 4 4 4 4 2 4 4 4 8 4	12 6 3 3 3 6 6 6 3 6 6 6
12-0144	06-A	AP Precision Metals	110	Metal coating (iron phosphating)	F	PH CHROMIUM CYANIDE(T) SILVER FLOW MAX NICKEL PH TTO CERT TTO(413+433)-P CADMIUM FLOW ZINC LEAD COPPER	4 4 4 4 4 4 4 1 4 4 4 4 4 4 4	6 3 3 3 3 3 3 3 3 3 3 3 3 3 3
12-0154	05-A	Kraft Heinz Foods Company	110	Food Manufacturing	L	FLOWMETER READ 1 FLOWMETER READ 2 TEMP FLOW FLOW TOTIMPORTED PH	3 3 12 12 12 12	12 12 12 12 12 12

Sampling in 2022 at SIUs discharging to Treatment Plant

Report run on: Friday, February 10, 2023 3:05 pm

Page 21

<i>Facility</i>	<i>Pmt</i>	<i>Name</i>	<i>Conn</i>	<i>Principle Process</i>	<i>Pmt</i> <i>Include</i>	<i>Parmcode</i>	<i>City</i> <i>Samples</i>	<i>Self</i> <i>Samples</i>
12-0154	05-A	Kraft Heinz Foods Company	110			PH HIGHEST	7	
						TSS	7	12
						OIL/GREASE	12	12
						COD	7	12
						SULFIDE DISSOLVD	12	2
						PH LOWEST	7	
12-0212	03-A	Tarantino Wholesale Food Distributor	100	Lateral	L	SULFIDE DISSOLVD	2	4
						TSS	2	4
						COD	2	4
						TDS	2	4
						CHLORIDE	2	4
						FLOW		4
						PH	2	4
						OIL/GREASE	6	4
			210	Sausage manufacturing	L	PH	1	4
						TSS	1	4
						SULFIDE DISSOLVD	1	4
						CLARIFIER RPT		4
						COD	1	4
						OIL/GREASE	3	4
						CHLORIDE	1	4
						FLOW		4
						TDS	1	4
12-0220	06-A	Ajinomoto Foods North America Inc	110	Food manufacturing	L	PH LOWEST	7	
						TSS	7	12
						FLOWMETER READ 1		12
						PH HIGHEST	7	
						TDS	7	12
						PH	11	12
						SULFIDE DISSOLVD	11	6
						CHLORIDE	7	12
						FLOW		12
						OIL/GREASE	11	12
						TEMP	11	12
						COD	7	12
						FLOWMETER READ 2		12
12-0244	04-A	Harcon Precision Metals Inc	110	Conversion coating & assoc processes	F	TSS	2	2
						COD	2	2
						NICKEL	2	2
						TTO CERT		2
						CYANIDE(T)	2	2
						PH	2	2
						CADMIUM	2	2

Sampling in 2022 at SIUs discharging to Treatment Plant

Report run on: Friday, February 10, 2023 3:05 pm

Page 22

<i>Facility</i>	<i>Pmt</i>	<i>Name</i>	<i>Conn</i>	<i>Principle Process</i>	<i>Pmt</i> <i>Include</i>	<i>Parmcode</i>	<i>City</i> <i>Samples</i>	<i>Self</i> <i>Samples</i>
12-0244	04-A	Harcon Precision Metals Inc	110			COPPER	2	2
						FLOW MAX		2
						CHROMIUM	2	2
						LEAD	2	2
						SILVER	2	2
						FLOW		2
						OIL/GREASE	1	2
						TTO(413+433)-P	1	
						ZINC	2	2
12-0275	04-A	Jensen Meat Company Inc	110	Meat processing, cleaning/sanitizing	L	RAIN DIVERT CERT		1
						COD	4	4
						COPPER	4	4
						FLOW		4
						PH LOWEST	3	
						PH HIGHEST	3	
						CLARIFIER RPT		4
						TDS	4	3
						TSS	4	4
						PH	12	4
						CHLORIDE	4	4
						OIL/GREASE	12	3
						SULFIDE DISSOLVD	12	4
12-0283	03-A	Spectex Inc dba Specialty Textile Services	110	Commerical Laundry	L	SULFIDE DISSOLVD	8	3
						TSS	4	3
						OIL/GREASE	4	3
						PH LOWEST	4	
						PH	4	3
						COD	4	3
						FLOW		12
						PH HIGHEST	4	
12-0285	03-A	US General Services Administration - SYLPOE	110	Waste activated sludge	L	FLOW		1
						FLOW MAX		1
						FLOW TOTIMPORTED		12
						TDS	2	
						TSS	2	
						COD	2	
						SULFIDE DISSOLVD	2	
			120	Untreated wastewater	L	FLOW TOTIMPORTED		12
			130	Treated wastewater	L	FLOW TOTIMPORTED		12
12-0312	02-A	ImageFIRST	110	Commercial laundry	L	COD		
						OIL/GREASE		
						TSS		
						FLOW		

Sampling in 2022 at SIUs discharging to Treatment Plant

Report run on: Friday, February 10, 2023 3:05 pm

Page 23

[illegible]

Sampling in 2022 at SIUs discharging to Treatment Plant

Report run on: Friday, February 10, 2023 3:05 pm

Page 24

<i>Facility</i>	<i>Pmt</i>	<i>Name</i>	<i>Conn</i>	<i>Principle Process</i>	<i>Pmt</i> <i>Include</i>	<i>Parmcode</i>	<i>City</i> <i>Samples</i>	<i>Self</i> <i>Samples</i>
16-0033	07-A	Garvin Industries	110			CADMIUM	1	4
						CYANIDE(T)	1	4
						NICKEL	1	4
						SILVER	1	4
						COPPER	1	4
						TTO CERT		4
						TTO(413+433)-P	1	
						PH	1	4
						ZINC	1	4
						FLOW		4
16-0348	05-A	Veridiam Inc	110	Metal Forming/Cleaning	F	CHROMIUM	1	4
						AMMONIA	4	4
						LEAD	5	4
						PRODUCTION RPT		4
						NICKEL	5	4
						ZEROUNAUTHZ CERT		4
						COPPER	5	4
						PH	5	4
						CADMIUM	5	4
						CHROMIUM	5	4
						FLUORIDE	5	4
						ZINC	5	4
						FLOW		4
						SILVER	5	4
						TTO CERT		4
						CYANIDE(T)	5	4
						TTO(413+433)-P	1	
						FLOW MAX		4
						SILVER CERT		2
16-0520	06-B	GKN Aerospace Chem-tronics Inc	120	X-ray Processing	L			
			110	MF and associated operations	F	CADMIUM	2	4
						COPPER	2	4
						LEAD	2	4
						PH	2	4
						PH HIGHEST	2	
						TTO(413+433)-P	1	
						ZINC	2	4
						CHROMIUM	2	4
						PH LOWEST	2	
						CYANIDE(T)	2	4
						FLOW MAX		4
						NICKEL	2	4
						SILVER	2	4
						TTO CERT		4

Sampling in 2022 at SIUs discharging to Treatment Plant

Report run on: Friday, February 10, 2023 3:05 pm

Page 25

Facility	Pmt	Name	Conn	Principle Process	Pmt Include	Parmcode	City Samples	Self Samples
16-0520 06-B	06-B	GKN Aerospace Chem-tronics Inc	110 210	MF and associated operations	F	FLOW		4
						FLOW		4
						CADMIUM	2	4
						CHROMIUM	2	4
						CYANIDE(T)	2	4
						SILVER	2	4
						LEAD	2	4
						PH HIGHEST	2	
						TTO CERT		4
						FLOW MAX		4
						PH LOWEST	2	
						COPPER	2	4
						NICKEL	2	4
						ZINC	2	4
						PH	2	4
						TTO(413+433)-P	1	
			410	Chembrite rinses & labs	F	COPPER	2	4
						CHROMIUM	2	4
						ZINC	2	4
						FLOW		4
						TTO CERT		4
						FLOW MAX		4
						LEAD	2	4
						CADMIUM	2	4
						TTO(413+433)-P	1	
						PH	2	4
						SILVER	2	4
						CYANIDE(T)	2	4
						NICKEL	2	4
			420	Steam cleaning and hydrotesting	F	TTO CERT		4
						TTO(413+433)-P	1	
						ZINC	3	4
						COPPER	3	4
						SILVER	3	4
						CHROMIUM	3	4
						CYANIDE(T)	3	4
						FLOW MAX		4
						LEAD	3	4
						NICKEL	3	4
						CADMIUM	3	4
						FLOW		4
						SILVER CERT		2
			430	X-ray processing	L			
			450	Steam clean, dye pen testing	F	FLOW MAX		4

Sampling in 2022 at SIUs discharging to Treatment Plant

Report run on: Friday, February 10, 2023 3:05 pm

Page 26

<i>Facility</i>	<i>Pmt</i>	<i>Name</i>	<i>Conn</i>	<i>Principle Process</i>	<i>Pmt</i> <i>Include</i>	<i>Parmcode</i>	<i>City</i> <i>Samples</i>	<i>Self</i> <i>Samples</i>
16-0520	06-B	GKN Aerospace Chem-tronics Inc	450			CHROMIUM	3	4
						TTO(413+433)-P	1	
						CYANIDE(T)	3	4
						SILVER	3	4
						FLOW		4
						LEAD	3	4
						NICKEL	3	4
						TTO CERT		4
						ZINC	3	4
						CADMIUM	3	4
						COPPER	3	4
			460	Dye penetrant testing	F	NICKEL	3	4
						CADMIUM	3	4
						FLOW		4
						LEAD	3	4
						CYANIDE(T)	3	4
						SILVER	3	4
						COPPER	3	4
						CHROMIUM	3	4
						FLOW MAX		4
						TTO(413+433)-P	1	
						ZINC	3	4
						TTO CERT		4
			510	Dye penetrant testing	F	COPPER	3	4
						TTO(413+433)-P	1	
						NICKEL	3	4
						CADMIUM	3	4
						CYANIDE(T)	3	4
						LEAD	3	4
						ZINC	3	4
						FLOW		4
						CHROMIUM	3	4
						FLOW MAX		4
						TTO CERT		4
						SILVER	3	4
			610	Dye penetrant testing	F	COPPER		
						CYANIDE(T)		
						NICKEL		
						TTO CERT		
						ZINC		
						CHROMIUM		
						FLOW MAX		
						LEAD		

Sampling in 2022 at SIUs discharging to Treatment Plant

Report run on: Friday, February 10, 2023 3:05 pm

Page 27

<i>Facility</i>	<i>Pmt</i>	<i>Name</i>	<i>Conn</i>	<i>Principle Process</i>	<i>Pmt</i> <i>Include</i>	<i>Parmcode</i>	<i>City</i> <i>Samples</i>	<i>Self</i> <i>Samples</i>
16-0520	06-B	GKN Aerospace Chem-tronics Inc	610			TTO(413+433)-P FLOW CADMIUM SILVER		
16-0785	06-A	UT; Ametek Inc	100	Groundwater remediation	L	3CLETHE FLOW R MAX RESTR FLOW TOTIMPORTED COD 14DIOXANE 4CLETHE FLOW RATE MIN FLOW R MAX DRY FLOW R MAX WET FLOWMETER READ 1 TSS FLOWMETER READ 2 REPORT RPT	1 1 1 1 1	4 11 12 10 4 4 11 11 11 12 10 12 11
20-0026	05-A	General Atomics Aeronautical Systems Inc	100 110	Industrial and sanitary Water jet and pressure testing (A14)	L F	SOLVENT CERT CADMIUM CHROMIUM SILVER ZINC COPPER CYANIDE(T) PH TTO CERT TTO(413+433)-P FLOW FLOW MAX LEAD NICKEL		
20-0043	07-A	Somacis Inc	110	PCB mfg	F	PH HIGHEST TTO(413+433)-P ZINC SILVER TTO CERT FLOW MAX COPPER PH CADMIUM LEAD FLOW CHROMIUM	2 1 4 4 4 4 4 4 4 4	4 4 4 4 4 4 4

Sampling in 2022 at SIUs discharging to Treatment Plant

Report run on: Friday, February 10, 2023 3:05 pm

Page 28

<i>Facility</i>	<i>Pmt</i>	<i>Name</i>	<i>Conn</i>	<i>Principle Process</i>	<i>Pmt</i> <i>Include</i>	<i>Parmcode</i>	<i>City</i> <i>Samples</i>	<i>Self</i> <i>Samples</i>
20-0043	07-A	Somacis Inc	110			NICKEL	4	4
						PH LOWEST	2	
			111	immersion gold plating	F	CYANIDE(A)	2	4
						FLOW		4
						FLOW MAX		4
						CYANIDE(T)	2	
			112	immersion gold plating final rinse	F	CYANIDE(T)	4	4
						FLOW MAX		4
						FLOW		4
20-0108	06-A	Valley Metals	110	Metal forming/finishing	F	TTO CERT		3
						CADMIUM	2	3
						CHROMIUM	2	3
						COPPER	2	3
						FLOW MAX		3
						PH	2	3
						PH HIGHEST	2	
						ZINC	2	3
						SILVER	2	3
						AMMONIA	2	3
						LEAD	2	3
						PH LOWEST	2	
						TTO(413+433)-P	1	
						FLOW		3
						FLUORIDE	2	3
						NICKEL	2	3
						CYANIDE(T)	2	3
						PRODUCTION RPT		3
			120	X-ray processing	L	SILVER CERT		3
20-0109	07-A	L & T Precision Corporation	120	Silkscreen Cleaning	F	TTO CERT		4
						CHROMIUM	3	4
						PH	3	4
						CYANIDE(T)	3	4
						FLOW		4
						FLOW MAX		4
						LEAD	3	4
						ZINC	3	4
						CADMIUM	3	4
						COPPER	3	4
						NICKEL	3	4
						SILVER	3	4
						TTO(413+433)-P	1	
20-0122	05-B	K-Tube Corporation	100	Industrial and sanitary	L	ZERODISCHRG CERT		1
			110	Power washing	F	LEAD	2	4

Sampling in 2022 at SIUs discharging to Treatment Plant

Report run on: Friday, February 10, 2023 3:05 pm

Page 29

<i>Facility</i>	<i>Pmt</i>	<i>Name</i>	<i>Conn</i>	<i>Principle Process</i>	<i>Pmt</i> <i>Include</i>	<i>Parmcode</i>	<i>City</i> <i>Samples</i>	<i>Self</i> <i>Samples</i>
20-0122	05-B	K-Tube Corporation	110			COPPER	2	4
						PH HIGHEST	2	
						CYANIDE(T)	2	4
						CADMIUM	2	4
						PH	2	4
						PH LOWEST	2	
						SILVER	2	4
						TTO CERT		4
						NICKEL	2	4
						ZINC	2	4
						CHROMIUM	2	4
						FLOW		4
						FLOW MAX		4
			120	Tube manufacturing	F	TTO(413+433)-P	1	
						PH HIGHEST	2	
						CADMIUM	2	4
						CYANIDE(T)	2	4
						SILVER	2	4
						TTO(413+433)-P	1	
						CHROMIUM	2	4
						TTO CERT		4
						LEAD	2	4
						PH	2	3
						PH LOWEST	2	
						FLOW		4
						NICKEL	2	4
						ZINC	2	4
						COPPER	2	4
						FLOW MAX		4
21-0248	06-A	Creative Metal Industries	110	Silkscreen Cleaning	F	CADMIUM	4	5
						CHROMIUM	4	5
						LEAD	4	5
						SILVER	4	5
						PH	4	5
						TTO CERT		4
						FLOW		4
						FLOW MAX		4
						COPPER	4	5
						CYANIDE(T)	4	3
						ZINC	4	5
						NICKEL	4	5
						TTO(413+433)-P	1	
21-0252	06-A	Compucraft Industries Inc	110	Metal finishing	F	CADMIUM	2	4

Sampling in 2022 at SIUs discharging to Treatment Plant

Report run on: Friday, February 10, 2023 3:05 pm

Page 30

<i>Facility</i>	<i>Pmt</i>	<i>Name</i>	<i>Conn</i>	<i>Principle Process</i>	<i>Pmt</i> <i>Include</i>	<i>Parmcode</i>	<i>City</i> <i>Samples</i>	<i>Self</i> <i>Samples</i>
21-0252	06-A	Compucraft Industries Inc	110			CYANIDE(T)	2	4
						FLOW		4
						NICKEL	2	4
						OIL/GREASE	2	4
						ZINC	2	4
						CHROMIUM	2	4
						COPPER	2	4
						LEAD	2	4
						PH	2	4
						PH LOWEST	1	
						TTO CERT		4
						SILVER	2	4
						FLOW MAX		4
						PH HIGHEST	1	
						TTO(413+433)-P	1	
			120	Fabrication/machining	F	FLOW MAX		4
						LEAD	2	4
						SILVER	2	4
						PH	2	4
						PH HIGHEST	1	
						CHROMIUM	2	4
						COPPER	2	4
						PH LOWEST	1	
						NICKEL	2	4
						ZINC	2	4
						TTO CERT		4
						TTO(413+433)-P	1	
						CYANIDE(T)	2	4
						FLOW		4
						CADMIUM	2	4
						OIL/GREASE	2	4
21-0288	02-A	Vision Systems Inc	110	Etch	F	SILVER	4	15
						CADMIUM	4	15
						NICKEL	4	15
						COPPER	4	15
						CYANIDE(T)	4	15
						FLOW		4
						PH	4	13
						FLOW MAX		4
						LEAD	4	15
						TTO CERT		4
						CHROMIUM	4	15
						TTO(413+433)-P	2	

Sampling in 2022 at SIUs discharging to Treatment Plant

Report run on: Friday, February 10, 2023 3:05 pm

Page 31

<i>Facility</i>	<i>Pmt</i>	<i>Name</i>	<i>Conn</i>	<i>Principle Process</i>	<i>Pmt</i> <i>Include</i>	<i>Parmcode</i>	<i>City</i> <i>Samples</i>	<i>Self</i> <i>Samples</i>
21-0288	02-A	Vision Systems Inc	110			ZINC	4	15
			120	Chemfilm	F	PH	7	15
						TTO CERT		5
						CYANIDE(A)	5	19
						FLOW MAX		5
						ZINC	7	19
						COPPER	7	19
						FLOW		5
						CADMIUM	7	19
						CHROMIUM	7	19
						TTO(413+433)-P	2	
						LEAD	7	19
						NICKEL	7	19
						SILVER	7	19
22-0092	01-A	Valley Powder Coating Inc	110	Industrial	F	FLOW		4
						SILVER	4	5
						CADMIUM	4	5
						FLOW MAX		4
						PH	4	5
						CYANIDE(T)	4	5
						LEAD	4	5
						NICKEL	4	5
						TTO CERT		4
						COPPER	4	5
						90 DAY COMP CERT		
						CHROMIUM	4	5
						TTO(413+433)-P	2	1
25-0105	37-A	Otay Landfill Inc	100	landfill leachate	L	ZINC	4	5
						DISCHARGE DATE		6
						COPPER	9	6
						CHROMIUM	9	6
						TSS	9	6
						ZINC	9	6
						CADMIUM	9	6
						PH	9	6
						LEAD	9	6
						OIL/GREASE	9	6
						COD	9	6
						NICKEL	9	6
38-A		Otay Landfill Inc	100	landfill leachate	L	CADMIUM	9	6
						CHROMIUM	9	6
						COPPER	9	6
						NICKEL	9	6

Sampling in 2022 at SIUs discharging to Treatment Plant

Report run on: Friday, February 10, 2023 3:05 pm

Page 32

<i>Facility</i>	<i>Pmt</i>	<i>Name</i>	<i>Conn</i>	<i>Principle Process</i>	<i>Pmt</i> <i>Include</i>	<i>Parmcode</i>	<i>City</i> <i>Samples</i>	<i>Self</i> <i>Samples</i>
25-0105	38-A	Otay Landfill Inc	100			OIL/GREASE	9	6
						TSS	9	6
						LEAD	9	6
						ZINC	9	6
						COD	9	6
						DISCHARGE DATE		6
						PH	9	6
25-0379	07-A	Pio Pico Energy Center	100	Gas Turbine Power Plant	L	COD	2	8
						PH	2	8
						TSS	2	7
						DISCHARGE DATE		8
						TDS	3	7
						CHLORIDE	3	8
34-0070	05-A	Golden State Metal Finishing	110	Treated MF Rinses	F	CHROMIUM	2	4
						PH	2	4
						ZINC	2	4
						NICKEL	2	4
						SILVER	2	4
						CADMIUM	2	4
						COPPER	2	4
						CYANIDE(T)	2	4
						FLOW		4
						FLOW MAX		4
						LEAD	2	4
						TTO CERT		4
						TTO(413+433)-P	1	
36-0001	04-B	Otay Mesa Energy Center LLC	100	Industrial and sanitary	F	PH HIGHEST		
						FLOW MAX		3
						ZEROUNAUTHZ CERT		2
						SULFIDE DISSOLVD		3
						TDS		2
						FLOW		3
						ZINC		3
						CHROMIUM		3
						OIL/GREASE		3
						PH LOWEST		
						SOLVENT CERT		2
						PH		3
			140	Turbine washing	F	COPPER		
						FLOW		
						FLOW MAX		
36-0009	02-A	Pio Pico Energy Center	800	Power plant	L			

TTO Sampling in 2022 at SIUs discharging to Treatment Plant

Report run on: Friday, February 10, 2023 3:11 pm

Page 1

<i>Facility</i>	<i>Pmt</i>	<i>Name</i>	<i>Conn</i>	<i>Principle Process</i>	<i>Batch</i>	<i>City TTO Samples</i>	<i>Self TTO Samples</i>	<i>Self Cert</i>
03-0115	07-A	ATK Space Systems Inc	410	Abrasive Jet Machining				
03-0347	05-B	Sungear	110	Etching rinses	N	1		4
03-0717	09-A	Action Powder Coating LLC	110	Coating / cleaning		1		3
03-0801	04-A	Cue Health Inc	110	Automation cell sanitation	N	1		4
03-0920	07-A	Alphacoat Finishing LLC	110	Anodize, etch, and passivation	N	1		4
			120	Chemfilm, dichromate seal, passivation	Y	1		4
03-1017	04-A	Anocote Metal Finishing Inc	110	Etch, anodize, and cleaning rinses	Y	1		4
03-1070	05-A	Johnson Matthey Medical Products	110	Parts cleaning, tumbling	N	1		4
03-1203	02-A	nVent - Schroff Inc	110	Tumble deburring	N	1		4
03-1380	02-A	Santier Inc	110	Metal Finishing / Surface Treatment	N	1		4
05-0985	06-A	Chromalloy San Diego	130	Fluorescent penetrant inspection (FPI)	N	1		4
05-0997	06-A	TTM Technologies Inc - San Diego Division	220	PCB Manufacturing		1		4
06-0058	07-A	Kyocera International Inc	130	Ni plating, cleaning		1		6
08-0018	07-A	USN;Naval Base Coronado - NASNI	120	IWTP	Y	1	3	
			190	Aircraft test pad cleaning	N	1		4
			180	Pump/valve/hose testing	Y			
			160	Hydrostatic testing		1		4
			140	Engine test cell cleaning		1		4
			150	Oil recovery plant		1	3	
11-0051	07-A	General Dynamics NASSCO	310	WWTF Effluent	N	1		4
12-0144	06-A	AP Precision Metals	110	Metal coating (iron phosphating)	N	1		3
12-0244	03-A	Harcon Precision Metals Inc	110	Conversion coating & assoc processes	N	1		2
16-0033	07-A	Garvin Industries	110	Cleaning / iron phosphating / sealing	Y	1		4
16-0348	05-A	Veridium Inc	110	Metal Forming/Cleaning		1		4
16-0520	06-B	GKN Aerospace Chem-tronics Inc	110	MF and associated operations	N	1		4
			210	MF and associated operations		1		4
			510	Dye penetrant testing		1		4
			420	Steam cleaning and hydrotesting		1		4
			610	Dye penetrant testing				
			460	Dye penetrant testing		1		4
			410	Chembrite rinses & labs		1		4
			450	Steam clean, dye pen testing	N	1		4
20-0043	07-A	Somacis Inc	110	PCB mfg		1		4
20-0108	06-A	Valley Metals	110	Metal forming/finishing		1		3
20-0109	07-A	L & T Precision Corporation	120	Silkscreen Cleaning	N	1		4
20-0122	05-B	K-Tube Corporation	120	Tube manufacturing	N	1		4

TTO Sampling in 2022 at SIUs discharging to Treatment Plant

Report run on: Friday, February 10, 2023 3:11 pm

Page 2

<i>Facility</i>	<i>Pmt</i>	<i>Name</i>	<i>Conn</i>	<i>Principle Process</i>	<i>Batch</i>	<i>City TTO Samples</i>	<i>Self TTO Samples</i>	<i>Self Cert</i>
20-0122	05-B	K-Tube Corporation	110	Power washing	N	1		4
21-0248	06-A	Creative Metal Industries	110	Silkscreen Cleaning	N	1		4
21-0252	06-A	Compucraft Industries Inc	110	Metal finishing	N	1		4
			120	Fabrication/machining	N	1		4
21-0288	02-A	Vision Systems Inc	120	Chemfilm	Y	2		5
			110	Etch	Y	2		4
21-0331	03-A	Coating Services Group LLC	110	Metal Parts Cleaning	Y			1
22-0092	01-A	Valley Powder Coating Inc	110	Industrial	N	2		4
34-0070	05-A	Golden State Metal Finishing	110	Treated MF Rinses	N	1		4

Analytical Methods Used by the IWLab in 2022

Report run on: Friday, February 10, 2023 3:14 pm

Page 1

<i>Parmname</i>	<i>Parmcode</i>	<i>Protocol</i>	<i>Mdl</i>	<i>Units</i>
1,1,1-Trichloroethane	111-3CLETH	EPA624.1	.32	ug/L
1,1,1-Trichloroethane	111-3CLETH	EPA624.1	.547	ug/L
1,1,2,2-Tetrachloroethane	1122-4CLET	EPA624.1	.349	ug/L
1,1,2,2-Tetrachloroethane	1122-4CLET	EPA624.1	.412	ug/L
1,1,2-Trichloroethane	112-3CLETH	EPA624.1	.363	ug/L
1,1,2-Trichloroethane	112-3CLETH	EPA624.1	.504	ug/L
1,1-Dichloroethane	11-2CLETH	EPA624.1	.278	ug/L
1,1-Dichloroethane	11-2CLETH	EPA624.1	.568	ug/L
1,1-Dichloroethene	11-2CLETHE	EPA624.1	.253	ug/L
1,1-Dichloroethene	11-2CLETHE	EPA624.1	.58	ug/L
1,12-Benzoperylene (benzo(ghi)perylene)	BGHIP	EPA625.1	.541	ug/L
1,12-Benzoperylene (benzo(ghi)perylene)	BGHIP	EPA625.1	.544	ug/L
1,12-Benzoperylene (benzo(ghi)perylene)	BGHIP	EPA625.1	.546	ug/L
1,12-Benzoperylene (benzo(ghi)perylene)	BGHIP	EPA625.1	.549	ug/L
1,12-Benzoperylene (benzo(ghi)perylene)	BGHIP	EPA625.1	.552	ug/L
1,12-Benzoperylene (benzo(ghi)perylene)	BGHIP	EPA625.1	.554	ug/L
1,12-Benzoperylene (benzo(ghi)perylene)	BGHIP	EPA625.1	.557	ug/L
1,12-Benzoperylene (benzo(ghi)perylene)	BGHIP	EPA625.1	.56	ug/L
1,12-Benzoperylene (benzo(ghi)perylene)	BGHIP	EPA625.1	.563	ug/L
1,2,4-Trichlorobenzene	124-3CLBNZ	EPA625.1	.378	ug/L
1,2,4-Trichlorobenzene	124-3CLBNZ	EPA625.1	.38	ug/L
1,2,4-Trichlorobenzene	124-3CLBNZ	EPA625.1	.383	ug/L
1,2,4-Trichlorobenzene	124-3CLBNZ	EPA625.1	.385	ug/L
1,2,4-Trichlorobenzene	124-3CLBNZ	EPA625.1	.387	ug/L
1,2,4-Trichlorobenzene	124-3CLBNZ	EPA625.1	.389	ug/L
1,2,4-Trichlorobenzene	124-3CLBNZ	EPA625.1	.391	ug/L
1,2,5,6-Dibenzanthracene (dibenzo(a,h)anthrac	2BANTH	EPA625.1	.56	ug/L
1,2,5,6-Dibenzanthracene (dibenzo(a,h)anthrac	2BANTH	EPA625.1	.563	ug/L
1,2,5,6-Dibenzanthracene (dibenzo(a,h)anthrac	2BANTH	EPA625.1	.566	ug/L
1,2,5,6-Dibenzanthracene (dibenzo(a,h)anthrac	2BANTH	EPA625.1	.569	ug/L
1,2,5,6-Dibenzanthracene (dibenzo(a,h)anthrac	2BANTH	EPA625.1	.571	ug/L
1,2,5,6-Dibenzanthracene (dibenzo(a,h)anthrac	2BANTH	EPA625.1	.574	ug/L
1,2,5,6-Dibenzanthracene (dibenzo(a,h)anthrac	2BANTH	EPA625.1	.577	ug/L
1,2,5,6-Dibenzanthracene (dibenzo(a,h)anthrac	2BANTH	EPA625.1	.58	ug/L
1,2,5,6-Dibenzanthracene (dibenzo(a,h)anthrac	2BANTH	EPA625.1	.583	ug/L
1,2-Benzanthracene (benzo(a)anthracene)	BAA	EPA625.1	.498	ug/L
1,2-Benzanthracene (benzo(a)anthracene)	BAA	EPA625.1	.5	ug/L
1,2-Benzanthracene (benzo(a)anthracene)	BAA	EPA625.1	.502	ug/L
1,2-Benzanthracene (benzo(a)anthracene)	BAA	EPA625.1	.505	ug/L
1,2-Benzanthracene (benzo(a)anthracene)	BAA	EPA625.1	.507	ug/L
1,2-Benzanthracene (benzo(a)anthracene)	BAA	EPA625.1	.51	ug/L
1,2-Benzanthracene (benzo(a)anthracene)	BAA	EPA625.1	.512	ug/L
1,2-Benzanthracene (benzo(a)anthracene)	BAA	EPA625.1	.515	ug/L
1,2-Benzanthracene (benzo(a)anthracene)	BAA	EPA625.1	.518	ug/L
1,2-Dichloroethane	12-2CLETHA	EPA624.1	.236	ug/L
1,2-Dichloroethane	12-2CLETHA	EPA624.1	.611	ug/L
1,2-Dichloropropane	12-2CLPROP	EPA624.1	.392	ug/L
1,2-Dichloropropane	12-2CLPROP	EPA624.1	.459	ug/L
1,2-Diphenylhydrazine	12-2PHENHYDRA	EPA625.1	1.31	ug/L
1,2-Diphenylhydrazine	12-2PHENHYDRA	EPA625.1	1.32	ug/L
1,2-Diphenylhydrazine	12-2PHENHYDRA	EPA625.1	1.33	ug/L
1,2-Diphenylhydrazine	12-2PHENHYDRA	EPA625.1	1.34	ug/L

Analytical Methods Used by the IWLab in 2022

Report run on: Friday, February 10, 2023 3:14 pm

Page 2

<i>Parmname</i>	<i>Parmcode</i>	<i>Protocol</i>	<i>Mdl</i>	<i>Units</i>
1,2-Diphenylhydrazine	12-2PHENHYDRA	EPA625.1	1.35	ug/L
1,2-Diphenylhydrazine	12-2PHENHYDRA	EPA625.1	1.36	ug/L
1,2-Trans-dichloroethene	T12-2CLETHE	EPA624.1	.287	ug/L
1,2-Trans-dichloroethene	T12-2CLETHE	EPA624.1	.529	ug/L
1,3-Dichlorobenzene	13-2CLBNZ	EPA624.1	.318	ug/L
1,3-Dichlorobenzene	13-2CLBNZ	EPA624.1	.427	ug/L
1,4-Dichlorobenzene	14-2CLBNZ	EPA624.1	.319	ug/L
1,4-Dichlorobenzene	14-2CLBNZ	EPA624.1	.439	ug/L
1,4-Dioxane (PW)	14DIOXANE	EPA624.1	23	ug/L
11,12-Benzofluoranthene (benzo(k)fluoranthene BKF		EPA625.1	.599	ug/L
11,12-Benzofluoranthene (benzo(k)fluoranthene BKF		EPA625.1	.602	ug/L
11,12-Benzofluoranthene (benzo(k)fluoranthene BKF		EPA625.1	.605	ug/L
11,12-Benzofluoranthene (benzo(k)fluoranthene BKF		EPA625.1	.608	ug/L
11,12-Benzofluoranthene (benzo(k)fluoranthene BKF		EPA625.1	.611	ug/L
11,12-Benzofluoranthene (benzo(k)fluoranthene BKF		EPA625.1	.614	ug/L
11,12-Benzofluoranthene (benzo(k)fluoranthene BKF		EPA625.1	.617	ug/L
11,12-Benzofluoranthene (benzo(k)fluoranthene BKF		EPA625.1	.62	ug/L
11,12-Benzofluoranthene (benzo(k)fluoranthene BKF		EPA625.1	.623	ug/L
2,4,6-Trichlorophenol	246-3CLPHENOL	EPA625.1/3510C	.251	ug/L
2,4,6-Trichlorophenol	246-3CLPHENOL	EPA625.1/3510C	.252	ug/L
2,4,6-Trichlorophenol	246-3CLPHENOL	EPA625.1/3510C	.254	ug/L
2,4,6-Trichlorophenol	246-3CLPHENOL	EPA625.1/3510C	.255	ug/L
2,4,6-Trichlorophenol	246-3CLPHENOL	EPA625.1/3510C	.256	ug/L
2,4,6-Trichlorophenol	246-3CLPHENOL	EPA625.1/3510C	.257	ug/L
2,4,6-Trichlorophenol	246-3CLPHENOL	EPA625.1/3510C	.259	ug/L
2,4,6-Trichlorophenol	246-3CLPHENOL	EPA625.1/3510C	.26	ug/L
2,4,6-Trichlorophenol	246-3CLPHENOL	EPA625.1/3510C	.261	ug/L
2,4-Dichlorophenol	24-2CLPHN	EPA625.1/3510C	.263	ug/L
2,4-Dichlorophenol	24-2CLPHN	EPA625.1/3510C	.265	ug/L
2,4-Dichlorophenol	24-2CLPHN	EPA625.1/3510C	.266	ug/L
2,4-Dichlorophenol	24-2CLPHN	EPA625.1/3510C	.267	ug/L
2,4-Dichlorophenol	24-2CLPHN	EPA625.1/3510C	.268	ug/L
2,4-Dichlorophenol	24-2CLPHN	EPA625.1/3510C	.27	ug/L
2,4-Dichlorophenol	24-2CLPHN	EPA625.1/3510C	.271	ug/L
2,4-Dichlorophenol	24-2CLPHN	EPA625.1/3510C	.273	ug/L
2,4-Dichlorophenol	24-2CLPHN	EPA625.1/3510C	.274	ug/L
2,4-Dimethylphenol	24-2MPHN	EPA625.1/3510C	.841	ug/L
2,4-Dimethylphenol	24-2MPHN	EPA625.1/3510C	.845	ug/L
2,4-Dimethylphenol	24-2MPHN	EPA625.1/3510C	.849	ug/L
2,4-Dimethylphenol	24-2MPHN	EPA625.1/3510C	.853	ug/L
2,4-Dimethylphenol	24-2MPHN	EPA625.1/3510C	.857	ug/L
2,4-Dimethylphenol	24-2MPHN	EPA625.1/3510C	.861	ug/L
2,4-Dimethylphenol	24-2MPHN	EPA625.1/3510C	.866	ug/L
2,4-Dimethylphenol	24-2MPHN	EPA625.1/3510C	.87	ug/L
2,4-Dimethylphenol	24-2MPHN	EPA625.1/3510C	.874	ug/L
2,4-Dimethylphenol	24-2MPHN	EPA625.1/3510C	3.22	ug/L
2,4-Dimethylphenol	24-2MPHN	EPA625.1/3510C	3.41	ug/L
2,4-Dimethylphenol	24-2MPHN	EPA625.1/3510C	3.48	ug/L
2,4-Dimethylphenol	24-2MPHN	EPA625.1/3510C	6.77	ug/L
2,4-Dinitrophenol	24-2NPHN	EPA625.1/3510C	1.43	ug/L
2,4-Dinitrophenol	24-2NPHN	EPA625.1/3510C	1.44	ug/L
2,4-Dinitrophenol	24-2NPHN	EPA625.1/3510C	1.45	ug/L

Analytical Methods Used by the IWLab in 2022

Report run on: Friday, February 10, 2023 3:14 pm

Page 3

<i>Parmname</i>	<i>Parmcode</i>	<i>Protocol</i>	<i>Mdl</i>	<i>Units</i>
2,4-Dinitrophenol	24-2NPHN	EPA625.1/3510C	1.46	ug/L
2,4-Dinitrophenol	24-2NPHN	EPA625.1/3510C	1.47	ug/L
2,4-Dinitrophenol	24-2NPHN	EPA625.1/3510C	1.48	ug/L
2,4-Dinitrophenol	24-2NPHN	EPA625.1/3510C	1.49	ug/L
2,4-Dinitrotoluene	24-2NTOL	EPA625.1	.541	ug/L
2,4-Dinitrotoluene	24-2NTOL	EPA625.1	.544	ug/L
2,4-Dinitrotoluene	24-2NTOL	EPA625.1	.549	ug/L
2,4-Dinitrotoluene	24-2NTOL	EPA625.1	.552	ug/L
2,4-Dinitrotoluene	24-2NTOL	EPA625.1	.554	ug/L
2,4-Dinitrotoluene	24-2NTOL	EPA625.1	.557	ug/L
2,4-Dinitrotoluene	24-2NTOL	EPA625.1	.56	ug/L
2,6-Dinitrotoluene	26-2NTOL	EPA625.1	.454	ug/L
2,6-Dinitrotoluene	26-2NTOL	EPA625.1	.456	ug/L
2,6-Dinitrotoluene	26-2NTOL	EPA625.1	.461	ug/L
2,6-Dinitrotoluene	26-2NTOL	EPA625.1	.463	ug/L
2,6-Dinitrotoluene	26-2NTOL	EPA625.1	.465	ug/L
2,6-Dinitrotoluene	26-2NTOL	EPA625.1	.468	ug/L
2,6-Dinitrotoluene	26-2NTOL	EPA625.1	.47	ug/L
2-Chloroethyl vinyl ether	2CLETHYLVINYL	EPA624.1	.29	ug/L
2-Chloroethyl vinyl ether	2CLETHYLVINYL	EPA624.1	.648	ug/L
2-Chloronaphthalene	2-CLNAPTH	EPA625.1	.27	ug/L
2-Chloronaphthalene	2-CLNAPTH	EPA625.1	.271	ug/L
2-Chloronaphthalene	2-CLNAPTH	EPA625.1	.274	ug/L
2-Chloronaphthalene	2-CLNAPTH	EPA625.1	.275	ug/L
2-Chloronaphthalene	2-CLNAPTH	EPA625.1	.277	ug/L
2-Chloronaphthalene	2-CLNAPTH	EPA625.1	.278	ug/L
2-Chloronaphthalene	2-CLNAPTH	EPA625.1	.28	ug/L
2-Chlorophenol	2-CLPHN	EPA625.1/3510C	.214	ug/L
2-Chlorophenol	2-CLPHN	EPA625.1/3510C	.215	ug/L
2-Chlorophenol	2-CLPHN	EPA625.1/3510C	.216	ug/L
2-Chlorophenol	2-CLPHN	EPA625.1/3510C	.217	ug/L
2-Chlorophenol	2-CLPHN	EPA625.1/3510C	.218	ug/L
2-Chlorophenol	2-CLPHN	EPA625.1/3510C	.219	ug/L
2-Chlorophenol	2-CLPHN	EPA625.1/3510C	.22	ug/L
2-Chlorophenol	2-CLPHN	EPA625.1/3510C	.221	ug/L
2-Chlorophenol	2-CLPHN	EPA625.1/3510C	.222	ug/L
2-Nitrophenol	2-NPHN	EPA625.1/3510C	.322	ug/L
2-Nitrophenol	2-NPHN	EPA625.1/3510C	.324	ug/L
2-Nitrophenol	2-NPHN	EPA625.1/3510C	.325	ug/L
2-Nitrophenol	2-NPHN	EPA625.1/3510C	.327	ug/L
2-Nitrophenol	2-NPHN	EPA625.1/3510C	.329	ug/L
2-Nitrophenol	2-NPHN	EPA625.1/3510C	.33	ug/L
2-Nitrophenol	2-NPHN	EPA625.1/3510C	.332	ug/L
2-Nitrophenol	2-NPHN	EPA625.1/3510C	.334	ug/L
2-Nitrophenol	2-NPHN	EPA625.1/3510C	.335	ug/L
3,3-Dichlorobenzidine	33-2CLBZID	EPA625.1	41.3	ug/L
3,3-Dichlorobenzidine	33-2CLBZID	EPA625.1	41.5	ug/L
3,3-Dichlorobenzidine	33-2CLBZID	EPA625.1	41.9	ug/L
3,3-Dichlorobenzidine	33-2CLBZID	EPA625.1	42.1	ug/L
3,3-Dichlorobenzidine	33-2CLBZID	EPA625.1	42.3	ug/L
3,3-Dichlorobenzidine	33-2CLBZID	EPA625.1	42.5	ug/L
3,3-Dichlorobenzidine	33-2CLBZID	EPA625.1	42.7	ug/L

Analytical Methods Used by the IWLab in 2022

Report run on: Friday, February 10, 2023 3:14 pm

Page 4

<i>Parmname</i>	<i>Parmcode</i>	<i>Protocol</i>	<i>Mdl</i>	<i>Units</i>
3,4-Benzofluoranthene (benzo(b)fluoranthene)	BBF	EPA625.1	.458	ug/L
3,4-Benzofluoranthene (benzo(b)fluoranthene)	BBF	EPA625.1	.461	ug/L
3,4-Benzofluoranthene (benzo(b)fluoranthene)	BBF	EPA625.1	.463	ug/L
3,4-Benzofluoranthene (benzo(b)fluoranthene)	BBF	EPA625.1	.465	ug/L
3,4-Benzofluoranthene (benzo(b)fluoranthene)	BBF	EPA625.1	.467	ug/L
3,4-Benzofluoranthene (benzo(b)fluoranthene)	BBF	EPA625.1	.47	ug/L
3,4-Benzofluoranthene (benzo(b)fluoranthene)	BBF	EPA625.1	.472	ug/L
3,4-Benzofluoranthene (benzo(b)fluoranthene)	BBF	EPA625.1	.475	ug/L
3,4-Benzofluoranthene (benzo(b)fluoranthene)	BBF	EPA625.1	.477	ug/L
4,4'-DDD (p,p-TDE)	44-DDD	EPA608.3/3510	.00625	ug/L
4,4'-DDD (p,p-TDE)	44-DDD	EPA608.3/3510	.0293	ug/L
4,4'-DDE (p,p-DDX)	44-DDE	EPA608.3/3510	.00505	ug/L
4,4'-DDE (p,p-DDX)	44-DDE	EPA608.3/3510	.0128	ug/L
4,4'-DDT	44-DDT(W/OAGG)		.0109	ug/L
4,4'-DDT	44-DDT(W/OAGG)		.0775	ug/L
4,4'-DDT	44-DDT(W/OAGG)		.109	ug/L
4,6-Dinitro-o-cresol	2M46-2NPHN	EPA625.1/3510C	.763	ug/L
4,6-Dinitro-o-cresol	2M46-2NPHN	EPA625.1/3510C	.767	ug/L
4,6-Dinitro-o-cresol	2M46-2NPHN	EPA625.1/3510C	.771	ug/L
4,6-Dinitro-o-cresol	2M46-2NPHN	EPA625.1/3510C	.775	ug/L
4,6-Dinitro-o-cresol	2M46-2NPHN	EPA625.1/3510C	.778	ug/L
4,6-Dinitro-o-cresol	2M46-2NPHN	EPA625.1/3510C	.782	ug/L
4,6-Dinitro-o-cresol	2M46-2NPHN	EPA625.1/3510C	.786	ug/L
4,6-Dinitro-o-cresol	2M46-2NPHN	EPA625.1/3510C	.79	ug/L
4,6-Dinitro-o-cresol	2M46-2NPHN	EPA625.1/3510C	.794	ug/L
4-Bromophenyl phenyl ether	4-BPPE	EPA625.1	.425	ug/L
4-Bromophenyl phenyl ether	4-BPPE	EPA625.1	.427	ug/L
4-Bromophenyl phenyl ether	4-BPPE	EPA625.1	.431	ug/L
4-Bromophenyl phenyl ether	4-BPPE	EPA625.1	.433	ug/L
4-Bromophenyl phenyl ether	4-BPPE	EPA625.1	.435	ug/L
4-Bromophenyl phenyl ether	4-BPPE	EPA625.1	.437	ug/L
4-Bromophenyl phenyl ether	4-BPPE	EPA625.1	.44	ug/L
4-Chlorophenyl phenyl ether	4-CLPHPHE	EPA625.1	.386	ug/L
4-Chlorophenyl phenyl ether	4-CLPHPHE	EPA625.1	.388	ug/L
4-Chlorophenyl phenyl ether	4-CLPHPHE	EPA625.1	.392	ug/L
4-Chlorophenyl phenyl ether	4-CLPHPHE	EPA625.1	.394	ug/L
4-Chlorophenyl phenyl ether	4-CLPHPHE	EPA625.1	.396	ug/L
4-Chlorophenyl phenyl ether	4-CLPHPHE	EPA625.1	.398	ug/L
4-Chlorophenyl phenyl ether	4-CLPHPHE	EPA625.1	.4	ug/L
4-Nitrophenol	4-NPHN	EPA625.1/3510C	1.04	ug/L
4-Nitrophenol	4-NPHN	EPA625.1/3510C	1.05	ug/L
4-Nitrophenol	4-NPHN	EPA625.1/3510C	1.06	ug/L
4-Nitrophenol	4-NPHN	EPA625.1/3510C	1.07	ug/L
4-Nitrophenol	4-NPHN	EPA625.1/3510C	1.08	ug/L
4-Nitrophenol	4-NPHN	EPA625.1/3510C	1.09	ug/L
Acenaphthene	ACENAPE	EPA625.1	.345	ug/L
Acenaphthene	ACENAPE	EPA625.1	.347	ug/L
Acenaphthene	ACENAPE	EPA625.1	.35	ug/L
Acenaphthene	ACENAPE	EPA625.1	.352	ug/L
Acenaphthene	ACENAPE	EPA625.1	.353	ug/L
Acenaphthene	ACENAPE	EPA625.1	.355	ug/L
Acenaphthene	ACENAPE	EPA625.1	.357	ug/L

Analytical Methods Used by the IWLab in 2022

Report run on: Friday, February 10, 2023 3:14 pm

Page 5

<i>Parmname</i>	<i>Parmcode</i>	<i>Protocol</i>	<i>Mdl</i>	<i>Units</i>
Acenaphthylene	ACENAPTYLE	EPA625.1	.331	ug/L
Acenaphthylene	ACENAPTYLE	EPA625.1	.333	ug/L
Acenaphthylene	ACENAPTYLE	EPA625.1	.334	ug/L
Acenaphthylene	ACENAPTYLE	EPA625.1	.336	ug/L
Acenaphthylene	ACENAPTYLE	EPA625.1	.337	ug/L
Acenaphthylene	ACENAPTYLE	EPA625.1	.339	ug/L
Acenaphthylene	ACENAPTYLE	EPA625.1	.341	ug/L
Acenaphthylene	ACENAPTYLE	EPA625.1	.343	ug/L
Acenaphthylene	ACENAPTYLE	EPA625.1	.344	ug/L
Acetone - 40CFR136.3 Table 1F	ACETONE:P-O	EPA1666	5	ug/L
Acetone - 40CFR136.3 Table 1F	ACETONE:P-O	EPA1666	25	ug/L
Acetone - 40CFR136.3 Table 1F	ACETONE:P-O	EPA1666	100	ug/L
Acetone - 40CFR136.3 Table 1F	ACETONE:P-O	EPA1666	250	ug/L
Acetone - 40CFR136.3 Table 1F	ACETONE:P-O	EPA1666	500	ug/L
Acetone - 40CFR136.3 Table 1F	ACETONE:P-O	EPA1666	1000	ug/L
Acrolein	ACROLEIN	EPA624.1	1.24	ug/L
Acrolein	ACROLEIN	EPA624.1	2.1	ug/L
Acrylonitrile	ACRYLONITRIL	EPA624.1	.55	ug/L
Acrylonitrile	ACRYLONITRIL	EPA624.1	.581	ug/L
Aldrin	ALDRIN	EPA608.3/3510	.00865	ug/L
Aldrin	ALDRIN	EPA608.3/3510	.0131	ug/L
Alpha-BHC (BHC=hexachloro-cyclohexane)	6CL-CHX-A	EPA608.3/3510	.00775	ug/L
Alpha-BHC (BHC=hexachloro-cyclohexane)	6CL-CHX-A	EPA608.3/3510	.0129	ug/L
Alpha-endosulfan	ENDOSLFN-A	EPA608.3/3510	.00775	ug/L
Alpha-endosulfan	ENDOSLFN-A	EPA608.3/3510	.0134	ug/L
Aluminum, Total	ALUMINUM	EPA200.7	.0597	mg/L
Ammonia (as nitrogen)	AMMONIA	SM4500-NH3 B,C	.3	mg/L
Anthracene	ANTHRACENE	EPA625.1	.589	ug/L
Anthracene	ANTHRACENE	EPA625.1	.592	ug/L
Anthracene	ANTHRACENE	EPA625.1	.595	ug/L
Anthracene	ANTHRACENE	EPA625.1	.598	ug/L
Anthracene	ANTHRACENE	EPA625.1	.601	ug/L
Anthracene	ANTHRACENE	EPA625.1	.604	ug/L
Anthracene	ANTHRACENE	EPA625.1	.607	ug/L
Anthracene	ANTHRACENE	EPA625.1	.61	ug/L
Anthracene	ANTHRACENE	EPA625.1	.613	ug/L
Antimony, Total	ANTIMONY	EPA200.7	.003	mg/L
Arsenic, Total	ARSENIC	EPA200.7	.003	mg/L
Arsenic, Total	ARSENIC	EPA200.7	.00386	mg/L
Barium, Total	BARIUM	EPA200.7	.002	mg/L
Beginning Meter Read and Date	FLOWMETER READ 1	FLOW		gals
Benzene	BNZ	EPA624.1	.173	ug/L
Benzene	BNZ(W/OAGG)		.173	ug/L
Benzene	BNZ(W/OAGG)		.507	ug/L
Benzene	BNZ(W/OAGG)		2.54	ug/L
Benzidine	BZID	EPA625.1	16.2	ug/L
Benzidine	BZID	EPA625.1	16.3	ug/L
Benzidine	BZID	EPA625.1	16.5	ug/L
Benzidine	BZID	EPA625.1	16.6	ug/L
Benzidine	BZID	EPA625.1	16.7	ug/L
Benzidine	BZID	EPA625.1	16.8	ug/L
Benzo(a)pyrene (3,4-benzopyrene)	BAP	EPA625.1	.585	ug/L

Analytical Methods Used by the IWLab in 2022

Report run on: Friday, February 10, 2023 3:14 pm

Page 6

<i>Parmname</i>	<i>Parmcode</i>	<i>Protocol</i>	<i>Mdl</i>	<i>Units</i>
Benzo(a)pyrene (3,4-benzopyrene)	BAP	EPA625.1	.587	ug/L
Benzo(a)pyrene (3,4-benzopyrene)	BAP	EPA625.1	.59	ug/L
Benzo(a)pyrene (3,4-benzopyrene)	BAP	EPA625.1	.593	ug/L
Benzo(a)pyrene (3,4-benzopyrene)	BAP	EPA625.1	.596	ug/L
Benzo(a)pyrene (3,4-benzopyrene)	BAP	EPA625.1	.599	ug/L
Benzo(a)pyrene (3,4-benzopyrene)	BAP	EPA625.1	.602	ug/L
Benzo(a)pyrene (3,4-benzopyrene)	BAP	EPA625.1	.605	ug/L
Benzo(a)pyrene (3,4-benzopyrene)	BAP	EPA625.1	.608	ug/L
Beryllium, Total	BERYLLIUM	EPA200.7	.001	mg/L
Beta-BHC	6CL-CHX-B	EPA608.3/3510	.00486	ug/L
Beta-BHC	6CL-CHX-B	EPA608.3/3510	.0144	ug/L
Beta-endosulfan	ENDOSLFN-B	EPA608.3/3510	.00875	ug/L
Beta-endosulfan	ENDOSLFN-B	EPA608.3/3510	.0163	ug/L
Bis(2-chloroethoxy) methane	BCEOM	EPA625.1	.271	ug/L
Bis(2-chloroethoxy) methane	BCEOM	EPA625.1	.272	ug/L
Bis(2-chloroethoxy) methane	BCEOM	EPA625.1	.275	ug/L
Bis(2-chloroethoxy) methane	BCEOM	EPA625.1	.276	ug/L
Bis(2-chloroethoxy) methane	BCEOM	EPA625.1	.278	ug/L
Bis(2-chloroethoxy) methane	BCEOM	EPA625.1	.279	ug/L
Bis(2-chloroethoxy) methane	BCEOM	EPA625.1	.281	ug/L
Bis(2-chloroethyl) ether	B2CLEETHER	EPA625.1	.225	ug/L
Bis(2-chloroethyl) ether	B2CLEETHER	EPA625.1	.226	ug/L
Bis(2-chloroethyl) ether	B2CLEETHER	EPA625.1	.228	ug/L
Bis(2-chloroethyl) ether	B2CLEETHER	EPA625.1	.23	ug/L
Bis(2-chloroethyl) ether	B2CLEETHER	EPA625.1	.231	ug/L
Bis(2-chloroethyl) ether	B2CLEETHER	EPA625.1	.232	ug/L
Bis(2-chloroethyl) ether	B2CLEETHER	EPA625.1	.233	ug/L
Bis(2-chloroisopropyl) ether	B2CIE	EPA625.1	.324	ug/L
Bis(2-chloroisopropyl) ether	B2CIE	EPA625.1	.326	ug/L
Bis(2-chloroisopropyl) ether	B2CIE	EPA625.1	.329	ug/L
Bis(2-chloroisopropyl) ether	B2CIE	EPA625.1	.331	ug/L
Bis(2-chloroisopropyl) ether	B2CIE	EPA625.1	.332	ug/L
Bis(2-chloroisopropyl) ether	B2CIE	EPA625.1	.334	ug/L
Bis(2-chloroisopropyl) ether	B2CIE	EPA625.1	.336	ug/L
Bis(2-ethylhexyl) phthalate	B2ETHXPHTH	EPA625.1	1.58	ug/L
Bis(2-ethylhexyl) phthalate	B2ETHXPHTH	EPA625.1	1.59	ug/L
Bis(2-ethylhexyl) phthalate	B2ETHXPHTH	EPA625.1	1.6	ug/L
Bis(2-ethylhexyl) phthalate	B2ETHXPHTH	EPA625.1	1.61	ug/L
Bis(2-ethylhexyl) phthalate	B2ETHXPHTH	EPA625.1	1.62	ug/L
Bis(2-ethylhexyl) phthalate	B2ETHXPHTH	EPA625.1	1.63	ug/L
Bis(2-ethylhexyl) phthalate	B2ETHXPHTH	EPA625.1	1.64	ug/L
Bis(2-ethylhexyl) phthalate	B2ETHXPHTH	EPA625.1	5.84	ug/L
Bis(2-ethylhexyl) phthalate	B2ETHXPHTH	EPA625.1	6.41	ug/L
Bis(2-ethylhexyl) phthalate	B2ETHXPHTH	EPA625.1	9.62	ug/L
Bis(2-ethylhexyl) phthalate	B2ETHXPHTH	EPA625.1	9.91	ug/L
Bis(2-ethylhexyl) phthalate	B2ETHXPHTH	EPA625.1	11.3	ug/L
Bis(2-ethylhexyl) phthalate	B2ETHXPHTH	EPA625.1	12.1	ug/L
Bis(2-ethylhexyl) phthalate	B2ETHXPHTH	EPA625.1	12.6	ug/L
Boron, Total	BORON	EPA200.7	.00338	mg/L
Bromoform (tribromomethane)	BROMOFORM	EPA624.1	.447	ug/L
Bromoform (tribromomethane)	BROMOFORM	EPA624.1	.637	ug/L
Butyl benzyl phthalate	BUTBNZ PHT	EPA625.1	.457	ug/L

Analytical Methods Used by the IWLab in 2022

Report run on: Friday, February 10, 2023 3:14 pm

Page 7

<i>Parmname</i>	<i>Parmcode</i>	<i>Protocol</i>	<i>Mdl</i>	<i>Units</i>
Butyl benzyl phthalate	BUTBNZ PHT	EPA625.1	.459	ug/L
Butyl benzyl phthalate	BUTBNZ PHT	EPA625.1	.464	ug/L
Butyl benzyl phthalate	BUTBNZ PHT	EPA625.1	.466	ug/L
Butyl benzyl phthalate	BUTBNZ PHT	EPA625.1	.468	ug/L
Butyl benzyl phthalate	BUTBNZ PHT	EPA625.1	.471	ug/L
Butyl benzyl phthalate	BUTBNZ PHT	EPA625.1	.473	ug/L
Cadmium, Total	CADMIUM	EPA200.7	.001	mg/L
Cadmium, Total	CADMIUM	EPA200.7	.002	mg/L
Cadmium, Total	CADMIUM	EPA200.7	.005	mg/L
Cadmium, Total	CADMIUM	EPA200.7	.01	mg/L
Carbon tetrachloride (tetrachloromethane)	CARBON TET	EPA624.1	.333	ug/L
Carbon tetrachloride (tetrachloromethane)	CARBON TET	EPA624.1	.575	ug/L
Chemical Oxygen Demand	COD	COD_HACH8000	4.5	mg/L
Chemical Oxygen Demand	COD	COD_HACH8000	18	mg/L
Chemical Oxygen Demand	COD	COD_HACH8000	19	mg/L
Chemical Oxygen Demand	COD	COD_HACH8000	36	mg/L
Chemical Oxygen Demand	COD	COD_HACH8000	38	mg/L
Chemical Oxygen Demand	COD	COD_HACH8000	72	mg/L
Chemical Oxygen Demand	COD	COD_HACH8000	76	mg/L
Chemical Oxygen Demand	COD	COD_HACH8000	90	mg/L
Chemical Oxygen Demand	COD	COD_HACH8000	95	mg/L
Chemical Oxygen Demand	COD	COD_HACH8000	144	mg/L
Chemical Oxygen Demand	COD	COD_HACH8000	152	mg/L
Chemical Oxygen Demand	COD	COD_HACH8000	180	mg/L
Chemical Oxygen Demand	COD	COD_HACH8000	190	mg/L
Chemical Oxygen Demand	COD	COD_HACH8000	225	mg/L
Chemical Oxygen Demand	COD	COD_HACH8000	238	mg/L
Chemical Oxygen Demand	COD	COD_HACH8000	288	mg/L
Chemical Oxygen Demand	COD	COD_HACH8000	304	mg/L
Chemical Oxygen Demand	COD	COD_HACH8000	360	mg/L
Chemical Oxygen Demand	COD	COD_HACH8000	380	mg/L
Chemical Oxygen Demand	COD	COD_HACH8000	450	mg/L
Chemical Oxygen Demand	COD	COD_HACH8000	475	mg/L
Chemical Oxygen Demand	COD	COD_HACH8000	608	mg/L
Chemical Oxygen Demand	COD	COD_HACH8000	720	mg/L
Chemical Oxygen Demand	COD	COD_HACH8000	900	mg/L
Chemical Oxygen Demand	COD	COD_HACH8000	950	mg/L
Chemical Oxygen Demand	COD	COD_HACH8000	1270	mg/L
Chemical Oxygen Demand	COD	COD_HACH8000	1800	mg/L
Chemical Oxygen Demand	COD	COD_HACH8000	1900	mg/L
Chemical Oxygen Demand	COD	COD_HACH8000	3600	mg/L
Chemical Oxygen Demand	COD	COD_HACH8000	3800	mg/L
Chemical Oxygen Demand, Soluble	COD SOLUBLE	COD_HACH8000	152	mg/L
Chlordane	CHLORDANE	EPA608.3/3510	.0093	ug/L
Chlordane	CHLORDANE	EPA608.3/3510	.0139	ug/L
Chloride, Total	CHLORIDE	SM4500CLB		mg/L
Chlorobenzene	CLBNZ	EPA624.1	.276	ug/L
Chlorobenzene	CLBNZ	EPA624.1	.435	ug/L
Chlorodibromomethane (dibromochloromethane)	2BRCLMETH	EPA624.1	.545	ug/L
Chlorodibromomethane (dibromochloromethane)	2BRCLMETH	EPA624.1	.55	ug/L
Chloroethane	ETHYL CL	EPA624.1	.265	ug/L
Chloroethane	ETHYL CL	EPA624.1	.814	ug/L

Analytical Methods Used by the IWLab in 2022

Report run on: Friday, February 10, 2023 3:14 pm

Page 8

<i>Parmname</i>	<i>Parmcode</i>	<i>Protocol</i>	<i>Mdl</i>	<i>Units</i>
Chloroform (trichloromethane)	CHLOROFORM	EPA624.1	.299	ug/L
Chloroform (trichloromethane)	CHLOROFORM	EPA624.1	.552	ug/L
Chloroform (trichloromethane)	CHLOROFORM	EPA624.1	.598	ug/L
Chloroform (trichloromethane)	CHLOROFORM	EPA624.1	1.5	ug/L
Chloroform (trichloromethane)	CHLOROFORM	EPA624.1	5.52	ug/L
Chromium, Total	CHROMIUM	EPA200.7	.001	mg/L
Chromium, Total	CHROMIUM	EPA200.7	.002	mg/L
Chromium, Total	CHROMIUM	EPA200.7	.00281	mg/L
Chromium, Total	CHROMIUM	EPA200.7	.005	mg/L
Chromium, Total	CHROMIUM	EPA200.7	.0281	mg/L
Chrysene	CHRYSENE	EPA625.1	.388	ug/L
Chrysene	CHRYSENE	EPA625.1	.39	ug/L
Chrysene	CHRYSENE	EPA625.1	.392	ug/L
Chrysene	CHRYSENE	EPA625.1	.394	ug/L
Chrysene	CHRYSENE	EPA625.1	.396	ug/L
Chrysene	CHRYSENE	EPA625.1	.398	ug/L
Chrysene	CHRYSENE	EPA625.1	.4	ug/L
Chrysene	CHRYSENE	EPA625.1	.402	ug/L
Chrysene	CHRYSENE	EPA625.1	.404	ug/L
Cobalt, Total	COBALT	EPA200.7	.002	mg/L
Combustibles, in air	COMBUSTIBLES-AIR	AIR		PercentLEL
Copper, Total	COPPER	EPA200.7	.00396	mg/L
Copper, Total	COPPER	EPA200.7	.012	mg/L
Copper, Total	COPPER	EPA200.7	.024	mg/L
Copper, Total	COPPER	EPA200.7	.0396	mg/L
Copper, Total	COPPER	EPA200.7	.06	mg/L
Cyanide, Amenable	CYANIDE(A)	335.4_4500CNG	.006	mg/L
Cyanide, Amenable	CYANIDE(A)	335.4_4500CNG	.015	mg/L
Cyanide, Amenable	CYANIDE(A)	335.4_4500CNG	.024	mg/L
Cyanide, Amenable	CYANIDE(A)	335.4_4500CNG		mg/L
Cyanide, Total	CYANIDE(T)	335.4_4500CNG	.002	mg/L
Cyanide, Total	CYANIDE(T)	335.4_4500CNG	.0038	mg/L
Cyanide, Total	CYANIDE(T)	335.4_4500CNG	.004	mg/L
Cyanide, Total	CYANIDE(T)	335.4_4500CNG	.005	mg/L
Cyanide, Total	CYANIDE(T)	335.4_4500CNG	.008	mg/L
Cyanide, Total	CYANIDE(T)	335.4_4500CNG		mg/L
Delta-BHC	6CL-CHX-D	EPA608.3/3510	.00805	ug/L
Delta-BHC	6CL-CHX-D	EPA608.3/3510	.0124	ug/L
Di-n-butyl phthalate	DINBP	EPA625.1	.995	ug/L
Di-n-butyl phthalate	DINBP	EPA625.1	1	ug/L
Di-n-butyl phthalate	DINBP	EPA625.1	1.01	ug/L
Di-n-butyl phthalate	DINBP	EPA625.1	1.02	ug/L
Di-n-butyl phthalate	DINBP	EPA625.1	1.03	ug/L
Di-n-octyl phthalate	2NOCTP	EPA625.1	.696	ug/L
Di-n-octyl phthalate	2NOCTP	EPA625.1	.699	ug/L
Di-n-octyl phthalate	2NOCTP	EPA625.1	.706	ug/L
Di-n-octyl phthalate	2NOCTP	EPA625.1	.709	ug/L
Di-n-octyl phthalate	2NOCTP	EPA625.1	.713	ug/L
Di-n-octyl phthalate	2NOCTP	EPA625.1	.716	ug/L
Di-n-octyl phthalate	2NOCTP	EPA625.1	.72	ug/L
Dichlorobromomethane (bromodichloromethane)	BR2CLMETH	EPA624.1	.445	ug/L
Dichlorobromomethane (bromodichloromethane)	BR2CLMETH	EPA624.1	.52	ug/L

Analytical Methods Used by the IWLab in 2022

Report run on: Friday, February 10, 2023 3:14 pm

Page 9

<i>Parmname</i>	<i>Parmcode</i>	<i>Protocol</i>	<i>Mdl</i>	<i>Units</i>
Dieldrin	DIELDRIN	EPA608.3/3510	.00525	ug/L
Dieldrin	DIELDRIN	EPA608.3/3510	.011	ug/L
Diethyl phthalate	DEP	EPA625.1	.758	ug/L
Diethyl phthalate	DEP	EPA625.1	.762	ug/L
Diethyl phthalate	DEP	EPA625.1	.766	ug/L
Diethyl phthalate	DEP	EPA625.1	.77	ug/L
Diethyl phthalate	DEP	EPA625.1	.773	ug/L
Diethyl phthalate	DEP	EPA625.1	.777	ug/L
Diethyl phthalate	DEP	EPA625.1	.781	ug/L
Diethyl phthalate	DEP	EPA625.1	.785	ug/L
Diethyl phthalate	DEP	EPA625.1	.789	ug/L
Dimethyl phthalate	DIMP	EPA625.1	.536	ug/L
Dimethyl phthalate	DIMP	EPA625.1	.539	ug/L
Dimethyl phthalate	DIMP	EPA625.1	.544	ug/L
Dimethyl phthalate	DIMP	EPA625.1	.547	ug/L
Dimethyl phthalate	DIMP	EPA625.1	.55	ug/L
Dimethyl phthalate	DIMP	EPA625.1	.552	ug/L
Dimethyl phthalate	DIMP	EPA625.1	.555	ug/L
Dimethyl phthalate	DIMP	EPA625.1	3.83	ug/L
Ending Meter Read and Date	FLOWMETER READ 2	FLOW		gals
Endosulfan sulfate	ENDOSLFN-S	EPA608.3/3510	.0111	ug/L
Endosulfan sulfate	ENDOSLFN-S	EPA608.3/3510	.0139	ug/L
Endrin	ENDRIN	EPA608.3/3510	.0094	ug/L
Endrin	ENDRIN	EPA608.3/3510	.0111	ug/L
Endrin aldehyde	ENDRIN-ALD	EPA608.3/3510	.0105	ug/L
Endrin aldehyde	ENDRIN-ALD	EPA608.3/3510	.0135	ug/L
Ethyl acetate - 40CFR136.3 Table 1F	ETHYL ACET:P-O	EPA1666	25	ug/L
Ethyl acetate - 40CFR136.3 Table 1F	ETHYL ACET:P-O	EPA1666	50	ug/L
Ethyl acetate - 40CFR136.3 Table 1F	ETHYL ACET:P-O	EPA1666	250	ug/L
Ethyl acetate - 40CFR136.3 Table 1F	ETHYL ACET:P-O	EPA1666	1000	ug/L
Ethylbenzene	ETHYL BNZ	EPA624.1	.26	ug/L
Ethylbenzene	ETHYL BNZ	EPA624.1	.428	ug/L
Flash Point-Instantaneous	FLASH	ASTMD56	60	DegF
Flash Point-Instantaneous	FLASH	ASTMD56		DegF
Flow/calendar day thru Connection	FLOW (MGD)			MGD
Fluoranthene	FLUORANTHN	EPA625.1	.725	ug/L
Fluoranthene	FLUORANTHN	EPA625.1	.728	ug/L
Fluoranthene	FLUORANTHN	EPA625.1	.735	ug/L
Fluoranthene	FLUORANTHN	EPA625.1	.739	ug/L
Fluoranthene	FLUORANTHN	EPA625.1	.743	ug/L
Fluoranthene	FLUORANTHN	EPA625.1	.746	ug/L
Fluoranthene	FLUORANTHN	EPA625.1	.75	ug/L
Fluorene	FLUORENE	EPA625.1	.402	ug/L
Fluorene	FLUORENE	EPA625.1	.404	ug/L
Fluorene	FLUORENE	EPA625.1	.406	ug/L
Fluorene	FLUORENE	EPA625.1	.408	ug/L
Fluorene	FLUORENE	EPA625.1	.41	ug/L
Fluorene	FLUORENE	EPA625.1	.412	ug/L
Fluorene	FLUORENE	EPA625.1	.414	ug/L
Fluorene	FLUORENE	EPA625.1	.416	ug/L
Fluorene	FLUORENE	EPA625.1	.418	ug/L
Fluoride, Total	FLUORIDE	EPA300	.05	mg/L

Analytical Methods Used by the IWLab in 2022

Report run on: Friday, February 10, 2023 3:14 pm

Page 10

<i>Parmname</i>	<i>Parmcode</i>	<i>Protocol</i>	<i>Mdl</i>	<i>Units</i>
Fluoride, Total	FLUORIDE	EPA300	.065	mg/L
Fluoride, Total	FLUORIDE	EPA300	.13	mg/L
Fluoride, Total	FLUORIDE	EPA300	.65	mg/L
Fluoride, Total	FLUORIDE	EPA300	1.25	mg/L
Fluoride, Total	FLUORIDE	EPA300	2.5	mg/L
Fluoride, Total	FLUORIDE	EPA300	5	mg/L
Fluoride, Total	FLUORIDE	EPA300	6.5	mg/L
Gamma-BHC (Lindane)	6CL-CHX-G	EPA608.3/3510	.0083	ug/L
Gamma-BHC (Lindane)	6CL-CHX-G	EPA608.3/3510	.0129	ug/L
Gamma-BHC (Lindane)	6CL-CHX-G	EPA608.3/3510	.083	ug/L
Gross Alpha Radioactivity	RADIOACTA	EPA900	4.64	pCi/L
Gross Alpha Radioactivity	RADIOACTA	EPA900		pCi/L
Gross Beta Radioactivity	RADIOACTB	EPA900	2.28	pCi/L
Gross Beta Radioactivity	RADIOACTB	EPA900		pCi/L
Heptachlor	HEPTACHLOR	EPA608.3/3510	.0118	ug/L
Heptachlor epoxide	HEPCL EPOX	EPA608.3/3510	.0101	ug/L
Heptachlor epoxide	HEPCL EPOX	EPA608.3/3510	.0152	ug/L
Hexachlorobenzene	6CLBNZ	EPA625.1	.349	ug/L
Hexachlorobenzene	6CLBNZ	EPA625.1	.351	ug/L
Hexachlorobenzene	6CLBNZ	EPA625.1	.354	ug/L
Hexachlorobenzene	6CLBNZ	EPA625.1	.356	ug/L
Hexachlorobenzene	6CLBNZ	EPA625.1	.358	ug/L
Hexachlorobenzene	6CLBNZ	EPA625.1	.36	ug/L
Hexachlorobenzene	6CLBNZ	EPA625.1	.362	ug/L
Hexachlorobutadiene	6CLBUTAD	EPA625.1	.546	ug/L
Hexachlorobutadiene	6CLBUTAD	EPA625.1	.549	ug/L
Hexachlorobutadiene	6CLBUTAD	EPA625.1	.551	ug/L
Hexachlorobutadiene	6CLBUTAD	EPA625.1	.554	ug/L
Hexachlorobutadiene	6CLBUTAD	EPA625.1	.557	ug/L
Hexachlorobutadiene	6CLBUTAD	EPA625.1	.559	ug/L
Hexachlorobutadiene	6CLBUTAD	EPA625.1	.562	ug/L
Hexachlorobutadiene	6CLBUTAD	EPA625.1	.565	ug/L
Hexachlorobutadiene	6CLBUTAD	EPA625.1	.568	ug/L
Hexachloroethane	6CLETH	EPA625.1	1.51	ug/L
Hexachloroethane	6CLETH	EPA625.1	1.53	ug/L
Hexachloroethane	6CLETH	EPA625.1	1.54	ug/L
Hexachloroethane	6CLETH	EPA625.1	1.55	ug/L
Hexachloroethane	6CLETH	EPA625.1	1.56	ug/L
Hydrogen sulfide, in air	H2S-AIR	AIR		ppm
Indeno(1,2,3-cd)pyrene (2,3-o-phenylene pyrene	ICDP	EPA625.1	.599	ug/L
Indeno(1,2,3-cd)pyrene (2,3-o-phenylene pyrene	ICDP	EPA625.1	.602	ug/L
Indeno(1,2,3-cd)pyrene (2,3-o-phenylene pyrene	ICDP	EPA625.1	.605	ug/L
Indeno(1,2,3-cd)pyrene (2,3-o-phenylene pyrene	ICDP	EPA625.1	.608	ug/L
Indeno(1,2,3-cd)pyrene (2,3-o-phenylene pyrene	ICDP	EPA625.1	.611	ug/L
Indeno(1,2,3-cd)pyrene (2,3-o-phenylene pyrene	ICDP	EPA625.1	.614	ug/L
Indeno(1,2,3-cd)pyrene (2,3-o-phenylene pyrene	ICDP	EPA625.1	.617	ug/L
Indeno(1,2,3-cd)pyrene (2,3-o-phenylene pyrene	ICDP	EPA625.1	.62	ug/L
Indeno(1,2,3-cd)pyrene (2,3-o-phenylene pyrene	ICDP	EPA625.1	.623	ug/L
Industry Sump Maintenance	INDSUMP	SUMP		Grade
Iron, Total	IRON	EPA200.7	.048	mg/L
Isophorone	ISOPHORONE	EPA625.1	.357	ug/L
Isophorone	ISOPHORONE	EPA625.1	.359	ug/L

Analytical Methods Used by the IWLab in 2022

Report run on: Friday, February 10, 2023 3:14 pm

Page 11

<i>Parmname</i>	<i>Parmcode</i>	<i>Protocol</i>	<i>Mdl</i>	<i>Units</i>
Isophorone	ISOPHORONE	EPA625.1	.363	ug/L
Isophorone	ISOPHORONE	EPA625.1	.365	ug/L
Isophorone	ISOPHORONE	EPA625.1	.366	ug/L
Isophorone	ISOPHORONE	EPA625.1	.368	ug/L
Isophorone	ISOPHORONE	EPA625.1	.37	ug/L
Isopropyl acetate - 40CFR136.3 Table 1F	ISOP ACETATE:P-O	EPA1666	25	ug/L
Isopropyl acetate - 40CFR136.3 Table 1F	ISOP ACETATE:P-O	EPA1666	50	ug/L
Isopropyl acetate - 40CFR136.3 Table 1F	ISOP ACETATE:P-O	EPA1666	250	ug/L
Isopropyl acetate - 40CFR136.3 Table 1F	ISOP ACETATE:P-O	EPA1666	1000	ug/L
Lead, Total	LEAD	EPA200.7	.002	mg/L
Lead, Total	LEAD	EPA200.7	.00351	mg/L
Lead, Total	LEAD	EPA200.7	.004	mg/L
Lead, Total	LEAD	EPA200.7	.01	mg/L
Lead, Total	LEAD	EPA200.7	.0351	mg/L
Manganese, Total	MANGANESE	EPA200.7	.001	mg/L
Manganese, Total	MANGANESE	EPA200.7	.00139	mg/L
Mercury, Total	MERCURY	EPA200.7	.001	mg/L
Methyl bromide (bromomethane)	BRMETHANE	EPA624.1	.793	ug/L
Methyl bromide (bromomethane)	BRMETHANE	EPA624.1	1.69	ug/L
Methyl chloride (chloromethane)	CLMETHANE	EPA624.1	.238	ug/L
Methyl chloride (chloromethane)	CLMETHANE	EPA624.1	.678	ug/L
Methylene chloride (dichloromethane)	METHYLE CL	EPA624.1	.283	ug/L
Methylene chloride (dichloromethane)	METHYLE CL	EPA624.1	.672	ug/L
Methylene chloride - 40CFR136.3 Table 1F	METHYLE CL:P-O	EPA1666	.5	ug/L
Methylene chloride - 40CFR136.3 Table 1F	METHYLE CL:P-O	EPA1666	2.5	ug/L
Methylene chloride - 40CFR136.3 Table 1F	METHYLE CL:P-O	EPA1666	10	ug/L
Methylene chloride - 40CFR136.3 Table 1F	METHYLE CL:P-O	EPA1666	25	ug/L
Methylene chloride - 40CFR136.3 Table 1F	METHYLE CL:P-O	EPA1666	50	ug/L
Methylene chloride - 40CFR136.3 Table 1F	METHYLE CL:P-O	EPA1666	100	ug/L
Molybdenum, Total	MOLYBDENUM	EPA200.7	.001	mg/L
Molybdenum, Total	MOLYBDENUM	EPA200.7	.00598	mg/L
N-nitrosodi-n-propylamine	NNDNPRA	EPA625.1	.279	ug/L
N-nitrosodi-n-propylamine	NNDNPRA	EPA625.1	.281	ug/L
N-nitrosodi-n-propylamine	NNDNPRA	EPA625.1	.283	ug/L
N-nitrosodi-n-propylamine	NNDNPRA	EPA625.1	.285	ug/L
N-nitrosodi-n-propylamine	NNDNPRA	EPA625.1	.286	ug/L
N-nitrosodi-n-propylamine	NNDNPRA	EPA625.1	.288	ug/L
N-nitrosodi-n-propylamine	NNDNPRA	EPA625.1	.289	ug/L
N-nitrosodimethyla (N,N Dimethyl Acrylamide) NNDMA		EPA625.1	.536	ug/L
N-nitrosodimethyla (N,N Dimethyl Acrylamide) NNDMA		EPA625.1	.539	ug/L
N-nitrosodimethyla (N,N Dimethyl Acrylamide) NNDMA		EPA625.1	.544	ug/L
N-nitrosodimethyla (N,N Dimethyl Acrylamide) NNDMA		EPA625.1	.547	ug/L
N-nitrosodimethyla (N,N Dimethyl Acrylamide) NNDMA		EPA625.1	.55	ug/L
N-nitrosodimethyla (N,N Dimethyl Acrylamide) NNDMA		EPA625.1	.552	ug/L
N-nitrosodimethyla (N,N Dimethyl Acrylamide) NNDMA		EPA625.1	.555	ug/L
N-nitrosodimethyla (N,N Dimethyl Acrylamide) NNDMA		EPA625.1	2.22	ug/L
N-nitrosodiphenylamine	NNP	EPA625.1	.546	ug/L
N-nitrosodiphenylamine	NNP	EPA625.1	.549	ug/L
N-nitrosodiphenylamine	NNP	EPA625.1	.554	ug/L
N-nitrosodiphenylamine	NNP	EPA625.1	.557	ug/L
N-nitrosodiphenylamine	NNP	EPA625.1	.559	ug/L
N-nitrosodiphenylamine	NNP	EPA625.1	.562	ug/L

Analytical Methods Used by the IWLab in 2022

Report run on: Friday, February 10, 2023 3:14 pm

Page 12

<i>Parmname</i>	<i>Parmcode</i>	<i>Protocol</i>	<i>Mdl</i>	<i>Units</i>
N-nitrosodiphenylamine	NNP	EPA625.1	.565	ug/L
Naphthalene	NAPTHALENE	EPA625.1	.334	ug/L
Naphthalene	NAPTHALENE	EPA625.1	.336	ug/L
Naphthalene	NAPTHALENE	EPA625.1	.339	ug/L
Naphthalene	NAPTHALENE	EPA625.1	.341	ug/L
Naphthalene	NAPTHALENE	EPA625.1	.343	ug/L
Naphthalene	NAPTHALENE	EPA625.1	.344	ug/L
Naphthalene	NAPTHALENE	EPA625.1	.346	ug/L
Naphthalene	NAPTHALENE	EPA625.1	1.36	ug/L
Nickel, Total	NICKEL	EPA200.7	.001	mg/L
Nickel, Total	NICKEL	EPA200.7	.002	mg/L
Nickel, Total	NICKEL	EPA200.7	.005	mg/L
Nickel, Total	NICKEL	EPA200.7	.01	mg/L
Nitrobenzene	NBNZ	EPA625.1	.376	ug/L
Nitrobenzene	NBNZ	EPA625.1	.378	ug/L
Nitrobenzene	NBNZ	EPA625.1	.381	ug/L
Nitrobenzene	NBNZ	EPA625.1	.383	ug/L
Nitrobenzene	NBNZ	EPA625.1	.385	ug/L
Nitrobenzene	NBNZ	EPA625.1	.387	ug/L
Nitrobenzene	NBNZ	EPA625.1	.389	ug/L
Oil and grease screen	OIL/G SCREEN	EPA1664-B	.6	mg/L
Oil and grease screen	OIL/G SCREEN	EPA1664-B	.7	mg/L
Oil and grease, SGT-HEM	PETROLEUM HC	EPA1664-B	.5	mg/L
Oil and grease, SGT-HEM	PETROLEUM HC	EPA1664-B	.6	mg/L
Oil and grease, SGT-HEM	PETROLEUM HC	EPA1664-B	.7	mg/L
Oil and grease, SGT-HEM	PETROLEUM HC	EPA1664-B	.8	mg/L
Oil and grease, SGT-HEM	PETROLEUM HC	EPA1664-B	2.06	mg/L
Oil and grease, SGT-HEM	PETROLEUM HC	EPA1664-B	2.2	mg/L
Oil and grease, SGT-HEM	PETROLEUM HC	EPA1664-B	2.27	mg/L
Oil and grease, SGT-HEM	PETROLEUM HC	EPA1664-B	2.35	mg/L
Oil and grease, SGT-HEM	PETROLEUM HC	EPA1664-B	2.61	mg/L
Oil and grease, SGT-HEM	PETROLEUM HC	EPA1664-B		mg/L
Oil and grease, Total-Instantaneous	OIL/GREASE		.5	mg/L
Oil and grease, Total-Instantaneous	OIL/GREASE		.6	mg/L
Oil and grease, Total-Instantaneous	OIL/GREASE		.7	mg/L
Oil and grease, Total-Instantaneous	OIL/GREASE		.8	mg/L
Oil and grease, Total-Instantaneous	OIL/GREASE		2.37	mg/L
Oil and grease, Total-Instantaneous	OIL/GREASE		2.38	mg/L
Oil and grease, Total-Instantaneous	OIL/GREASE		2.44	mg/L
Oil and grease, Total-Instantaneous	OIL/GREASE		2.46	mg/L
Oil and grease, Total-Instantaneous	OIL/GREASE		2.47	mg/L
Oil and grease, Total-Instantaneous	OIL/GREASE		2.49	mg/L
Oil and grease, Total-Instantaneous	OIL/GREASE		2.5	mg/L
Oil and grease, Total-Instantaneous	OIL/GREASE		2.51	mg/L
Oil and grease, Total-Instantaneous	OIL/GREASE		2.57	mg/L
Oil and grease, Total-Instantaneous	OIL/GREASE		2.58	mg/L
Oil and grease, Total-Instantaneous	OIL/GREASE		2.59	mg/L
Oil and grease, Total-Instantaneous	OIL/GREASE		2.6	mg/L
Oil and grease, Total-Instantaneous	OIL/GREASE		2.61	mg/L
Oil and grease, Total-Instantaneous	OIL/GREASE		2.62	mg/L
Oil and grease, Total-Instantaneous	OIL/GREASE		2.63	mg/L
Oil and grease, Total-Instantaneous	OIL/GREASE		2.64	mg/L

Analytical Methods Used by the IWLab in 2022

Report run on: Friday, February 10, 2023 3:14 pm

Page 13

<i>Parmname</i>	<i>Parmcode</i>	<i>Protocol</i>	<i>Mdl</i>	<i>Units</i>
Oil and grease, Total-Instantaneous	OIL/GREASE		2.65	mg/L
Oil and grease, Total-Instantaneous	OIL/GREASE		2.66	mg/L
Oil and grease, Total-Instantaneous	OIL/GREASE		2.67	mg/L
Oil and grease, Total-Instantaneous	OIL/GREASE		2.68	mg/L
Oil and grease, Total-Instantaneous	OIL/GREASE		2.69	mg/L
Oil and grease, Total-Instantaneous	OIL/GREASE		2.7	mg/L
Oil and grease, Total-Instantaneous	OIL/GREASE		2.71	mg/L
Oil and grease, Total-Instantaneous	OIL/GREASE		2.72	mg/L
Oil and grease, Total-Instantaneous	OIL/GREASE		2.73	mg/L
Oil and grease, Total-Instantaneous	OIL/GREASE		2.74	mg/L
Oil and grease, Total-Instantaneous	OIL/GREASE		2.75	mg/L
Oil and grease, Total-Instantaneous	OIL/GREASE		2.76	mg/L
Oil and grease, Total-Instantaneous	OIL/GREASE		2.77	mg/L
Oil and grease, Total-Instantaneous	OIL/GREASE		2.78	mg/L
Oil and grease, Total-Instantaneous	OIL/GREASE		2.82	mg/L
Oil and grease, Total-Instantaneous	OIL/GREASE		2.83	mg/L
Oil and grease, Total-Instantaneous	OIL/GREASE		2.84	mg/L
Oil and grease, Total-Instantaneous	OIL/GREASE		2.85	mg/L
Oil and grease, Total-Instantaneous	OIL/GREASE		2.88	mg/L
Oil and grease, Total-Instantaneous	OIL/GREASE		2.9	mg/L
Oil and grease, Total-Instantaneous	OIL/GREASE		2.91	mg/L
Oil and grease, Total-Instantaneous	OIL/GREASE		2.94	mg/L
Oil and grease, Total-Instantaneous	OIL/GREASE		2.96	mg/L
Oil and grease, Total-Instantaneous	OIL/GREASE		2.97	mg/L
Oil and grease, Total-Instantaneous	OIL/GREASE		2.98	mg/L
Oil and grease, Total-Instantaneous	OIL/GREASE		3	mg/L
Oil and grease, Total-Instantaneous	OIL/GREASE		3.01	mg/L
Oil and grease, Total-Instantaneous	OIL/GREASE		3.04	mg/L
Oil and grease, Total-Instantaneous	OIL/GREASE		3.06	mg/L
Oil and grease, Total-Instantaneous	OIL/GREASE		3.07	mg/L
Oil and grease, Total-Instantaneous	OIL/GREASE		3.08	mg/L
Oil and grease, Total-Instantaneous	OIL/GREASE		3.09	mg/L
Oil and grease, Total-Instantaneous	OIL/GREASE		3.1	mg/L
Oil and grease, Total-Instantaneous	OIL/GREASE		3.13	mg/L
Oil and grease, Total-Instantaneous	OIL/GREASE		3.14	mg/L
Oil and grease, Total-Instantaneous	OIL/GREASE		3.15	mg/L
Oil and grease, Total-Instantaneous	OIL/GREASE		3.16	mg/L
Oil and grease, Total-Instantaneous	OIL/GREASE		3.17	mg/L
Oil and grease, Total-Instantaneous	OIL/GREASE		3.21	mg/L
Oil and grease, Total-Instantaneous	OIL/GREASE		3.25	mg/L
Oil and grease, Total-Instantaneous	OIL/GREASE		3.26	mg/L
Oil and grease, Total-Instantaneous	OIL/GREASE		3.27	mg/L
Oil and grease, Total-Instantaneous	OIL/GREASE		3.31	mg/L
Oil and grease, Total-Instantaneous	OIL/GREASE		3.32	mg/L
Oil and grease, Total-Instantaneous	OIL/GREASE		3.33	mg/L
Oil and grease, Total-Instantaneous	OIL/GREASE		3.34	mg/L
Oil and grease, Total-Instantaneous	OIL/GREASE		3.35	mg/L
Oil and grease, Total-Instantaneous	OIL/GREASE		3.36	mg/L
Oil and grease, Total-Instantaneous	OIL/GREASE		3.37	mg/L
Oil and grease, Total-Instantaneous	OIL/GREASE		3.38	mg/L
Oil and grease, Total-Instantaneous	OIL/GREASE		3.39	mg/L
Oil and grease, Total-Instantaneous	OIL/GREASE		3.42	mg/L

Analytical Methods Used by the IWLab in 2022

Report run on: Friday, February 10, 2023 3:14 pm

Page 14

<i>Parmname</i>	<i>Parmcode</i>	<i>Protocol</i>	<i>Mdl</i>	<i>Units</i>
Oil and grease, Total-Instantaneous	OIL/GREASE		3.43	mg/L
Oil and grease, Total-Instantaneous	OIL/GREASE		3.47	mg/L
Oil and grease, Total-Instantaneous	OIL/GREASE		3.48	mg/L
Oil and grease, Total-Instantaneous	OIL/GREASE		3.52	mg/L
Oil and grease, Total-Instantaneous	OIL/GREASE		3.56	mg/L
Oil and grease, Total-Instantaneous	OIL/GREASE		3.58	mg/L
Oil and grease, Total-Instantaneous	OIL/GREASE		3.66	mg/L
Oil and grease, Total-Instantaneous	OIL/GREASE		3.68	mg/L
Oil and grease, Total-Instantaneous	OIL/GREASE		3.69	mg/L
Oil and grease, Total-Instantaneous	OIL/GREASE			mg/L
Oxygen, in air	OXYGEN-AIR	AIR		Percent
P-chloro-m-cresol (4-chloro-3-methyl-phenol)	4-CL3-MPHN	EPA625.1/3510C	.271	ug/L
P-chloro-m-cresol (4-chloro-3-methyl-phenol)	4-CL3-MPHN	EPA625.1/3510C	.272	ug/L
P-chloro-m-cresol (4-chloro-3-methyl-phenol)	4-CL3-MPHN	EPA625.1/3510C	.273	ug/L
P-chloro-m-cresol (4-chloro-3-methyl-phenol)	4-CL3-MPHN	EPA625.1/3510C	.275	ug/L
P-chloro-m-cresol (4-chloro-3-methyl-phenol)	4-CL3-MPHN	EPA625.1/3510C	.276	ug/L
P-chloro-m-cresol (4-chloro-3-methyl-phenol)	4-CL3-MPHN	EPA625.1/3510C	.277	ug/L
P-chloro-m-cresol (4-chloro-3-methyl-phenol)	4-CL3-MPHN	EPA625.1/3510C	.279	ug/L
P-chloro-m-cresol (4-chloro-3-methyl-phenol)	4-CL3-MPHN	EPA625.1/3510C	.28	ug/L
P-chloro-m-cresol (4-chloro-3-methyl-phenol)	4-CL3-MPHN	EPA625.1/3510C	.281	ug/L
P-chloro-m-cresol (4-chloro-3-methyl-phenol)	4-CL3-MPHN	EPA625.1/3510C	1.93	ug/L
PCB-1016 (Arochlor 1016)	PCB 1016	EPA608.3/3510	.488	ug/L
PCB-1016 (Arochlor 1016)	PCB 1016	EPA608.3/3510	.775	ug/L
PCB-1221 (Arochlor 1221)	PCB 1221	EPA608.3/3510	.775	ug/L
PCB-1221 (Arochlor 1221)	PCB 1221	EPA608.3/3510	.995	ug/L
PCB-1232 (Arochlor 1232)	PCB 1232	EPA608.3/3510	.775	ug/L
PCB-1232 (Arochlor 1232)	PCB 1232	EPA608.3/3510	.995	ug/L
PCB-1242 (Arochlor 1242)	PCB 1242	EPA608.3/3510	.775	ug/L
PCB-1242 (Arochlor 1242)	PCB 1242	EPA608.3/3510	.995	ug/L
PCB-1248 (Arochlor 1248)	PCB 1248	EPA608.3/3510	.775	ug/L
PCB-1248 (Arochlor 1248)	PCB 1248	EPA608.3/3510	.995	ug/L
PCB-1254 (Arochlor 1254)	PCB 1254	EPA608.3/3510	.775	ug/L
PCB-1254 (Arochlor 1254)	PCB 1254	EPA608.3/3510	.995	ug/L
PCB-1260 (Arochlor 1260)	PCB 1260	EPA608.3/3510	.775	ug/L
PCB-1260 (Arochlor 1260)	PCB 1260	EPA608.3/3510	.995	ug/L
Pentachlorophenol	5CLPHN	EPA625.1/3510C	1.29	ug/L
Pentachlorophenol	5CLPHN	EPA625.1/3510C	1.3	ug/L
Pentachlorophenol	5CLPHN	EPA625.1/3510C	1.31	ug/L
Pentachlorophenol	5CLPHN	EPA625.1/3510C	1.32	ug/L
Pentachlorophenol	5CLPHN	EPA625.1/3510C	1.33	ug/L
Pentachlorophenol	5CLPHN	EPA625.1/3510C	1.34	ug/L
Phenanthrene	PHENATHRN	EPA625.1	.355	ug/L
Phenanthrene	PHENATHRN	EPA625.1	.357	ug/L
Phenanthrene	PHENATHRN	EPA625.1	.359	ug/L
Phenanthrene	PHENATHRN	EPA625.1	.36	ug/L
Phenanthrene	PHENATHRN	EPA625.1	.362	ug/L
Phenanthrene	PHENATHRN	EPA625.1	.364	ug/L
Phenanthrene	PHENATHRN	EPA625.1	.366	ug/L
Phenanthrene	PHENATHRN	EPA625.1	.368	ug/L
Phenanthrene	PHENATHRN	EPA625.1	.369	ug/L
Phenol	PHENOL	EPA625.1/3510C	.658	ug/L
Phenol	PHENOL	EPA625.1/3510C	.997	ug/L

Analytical Methods Used by the IWLab in 2022

Report run on: Friday, February 10, 2023 3:14 pm

Page 15

<i>Parmname</i>	<i>Parmcode</i>	<i>Protocol</i>	<i>Mdl</i>	<i>Units</i>
Phenol	PHENOL	EPA625.1/3510C	1.27	ug/L
Phenol	PHENOL	EPA625.1/3510C	1.94	ug/L
Phenol	PHENOL(W/OAGG)		.159	ug/L
Phenol	PHENOL(W/OAGG)		.16	ug/L
Phenol	PHENOL(W/OAGG)		.161	ug/L
Phenol	PHENOL(W/OAGG)		.162	ug/L
Phenol	PHENOL(W/OAGG)		.163	ug/L
Phenol	PHENOL(W/OAGG)		.164	ug/L
Phenol	PHENOL(W/OAGG)		.165	ug/L
Phenol	PHENOL(W/OAGG)		.621	ug/L
Phenol	PHENOL(W/OAGG)		.633	ug/L
Phenol	PHENOL(W/OAGG)		.658	ug/L
Phenol	PHENOL(W/OAGG)		.765	ug/L
Phenol	PHENOL(W/OAGG)		.968	ug/L
Phenol	PHENOL(W/OAGG)		.997	ug/L
Phenol	PHENOL(W/OAGG)		1.03	ug/L
Phenol	PHENOL(W/OAGG)		1.06	ug/L
Phenol	PHENOL(W/OAGG)		1.1	ug/L
Phenol	PHENOL(W/OAGG)		1.13	ug/L
Phenol	PHENOL(W/OAGG)		1.18	ug/L
Phenol	PHENOL(W/OAGG)		1.22	ug/L
Phenol	PHENOL(W/OAGG)		1.27	ug/L
Phenol	PHENOL(W/OAGG)		1.32	ug/L
Phenol	PHENOL(W/OAGG)		1.57	ug/L
Phenol	PHENOL(W/OAGG)		4.8	ug/L
Phenol	PHENOL(W/OAGG)		6	ug/L
Phenol	PHENOL(W/OAGG)		6.86	ug/L
Phenol	PHENOL(W/OAGG)		7.2	ug/L
Pyrene	PYRENE	EPA625.1	.546	ug/L
Pyrene	PYRENE	EPA625.1	.549	ug/L
Pyrene	PYRENE	EPA625.1	.551	ug/L
Pyrene	PYRENE	EPA625.1	.554	ug/L
Pyrene	PYRENE	EPA625.1	.557	ug/L
Pyrene	PYRENE	EPA625.1	.559	ug/L
Pyrene	PYRENE	EPA625.1	.562	ug/L
Pyrene	PYRENE	EPA625.1	.565	ug/L
Pyrene	PYRENE	EPA625.1	.568	ug/L
Radiator Sump Maintenance	RADSUMP	SUMP		Grade
Selenium, Total	SELENIUM	EPA200.7	.003	mg/L
Selenium, Total	SELENIUM	EPA200.7	.00748	mg/L
Selenium, Total	SELENIUM	EPA200.7	.0075	mg/L
Silver, Total	SILVER	EPA200.7	0	mg/L
Silver, Total	SILVER	EPA200.7	.001	mg/L
Silver, Total	SILVER	EPA200.7	.0021	mg/L
Sodium, Total	SODIUM	EPA200.7	.782	mg/L
Solids, Total Dissolved	TDS	SM2540-C	25	mg/L
Solids, Total Dissolved	TDS	SM2540-C	100	mg/L
Solids, Total Dissolved	TDS	SM2540-C	125	mg/L
Solids, Total Dissolved	TDS	SM2540-C	167	mg/L
Solids, Total Dissolved	TDS	SM2540-C	192	mg/L
Solids, Total Dissolved	TDS	SM2540-C	250	mg/L
Solids, Total Dissolved	TDS	SM2540-C	313	mg/L

Analytical Methods Used by the IWLab in 2022

Report run on: Friday, February 10, 2023 3:14 pm

Page 16

<i>Parmname</i>	<i>Parmcode</i>	<i>Protocol</i>	<i>Mdl</i>	<i>Units</i>
Solids, Total Dissolved	TDS	SM2540-C	357	mg/L
Solids, Total Dissolved	TDS	SM2540-C	417	mg/L
Solids, Total Dissolved	TDS	SM2540-C	500	mg/L
Solids, Total Dissolved	TDS	SM2540-C	625	mg/L
Solids, Total Dissolved	TDS	SM2540-C	658	mg/L
Solids, Total Dissolved	TDS	SM2540-C	833	mg/L
Solids, Total Dissolved	TDS	SM2540-C	1000	mg/L
Solids, Total Dissolved	TDS	SM2540-C	1250	mg/L
Solids, Total Dissolved	TDS	SM2540-C	2500	mg/L
Solids, Total Fixed Dissolved	TFDS	SM2540-E	100	mg/L
Solids, Total Fixed Dissolved	TFDS	SM2540-E	125	mg/L
Solids, Total Fixed Dissolved	TFDS	SM2540-E	179	mg/L
Solids, Total Fixed Dissolved	TFDS	SM2540-E	208	mg/L
Solids, Total Fixed Dissolved	TFDS	SM2540-E	250	mg/L
Solids, Total Fixed Dissolved	TFDS	SM2540-E	313	mg/L
Solids, Total Fixed Dissolved	TFDS	SM2540-E	357	mg/L
Solids, Total Suspended	TSS	SM2540-D	2.4	mg/L
Solids, Total Suspended	TSS	SM2540-D	2.5	mg/L
Solids, Total Suspended	TSS	SM2540-D	2.6	mg/L
Solids, Total Suspended	TSS	SM2540-D	2.7	mg/L
Solids, Total Suspended	TSS	SM2540-D	2.8	mg/L
Solids, Total Suspended	TSS	SM2540-D	2.9	mg/L
Solids, Total Suspended	TSS	SM2540-D	3	mg/L
Solids, Total Suspended	TSS	SM2540-D	3.1	mg/L
Solids, Total Suspended	TSS	SM2540-D	3.3	mg/L
Solids, Total Suspended	TSS	SM2540-D	3.6	mg/L
Solids, Total Suspended	TSS	SM2540-D	3.7	mg/L
Solids, Total Suspended	TSS	SM2540-D	3.8	mg/L
Solids, Total Suspended	TSS	SM2540-D	4.2	mg/L
Solids, Total Suspended	TSS	SM2540-D	4.7	mg/L
Solids, Total Suspended	TSS	SM2540-D	5	mg/L
Solids, Total Suspended	TSS	SM2540-D	5.2	mg/L
Solids, Total Suspended	TSS	SM2540-D	5.6	mg/L
Solids, Total Suspended	TSS	SM2540-D	6.3	mg/L
Solids, Total Suspended	TSS	SM2540-D	7.1	mg/L
Solids, Total Suspended	TSS	SM2540-D	8.3	mg/L
Solids, Total Suspended	TSS	SM2540-D	10	mg/L
Solids, Total Suspended	TSS	SM2540-D	12.5	mg/L
Solids, Total Suspended	TSS	SM2540-D	13.9	mg/L
Solids, Total Suspended	TSS	SM2540-D	14.3	mg/L
Solids, Total Suspended	TSS	SM2540-D	14.4	mg/L
Solids, Total Suspended	TSS	SM2540-D	14.7	mg/L
Solids, Total Suspended	TSS	SM2540-D	16.7	mg/L
Solids, Total Suspended	TSS	SM2540-D	17.9	mg/L
Solids, Total Suspended	TSS	SM2540-D	20	mg/L
Solids, Total Suspended	TSS	SM2540-D	20.8	mg/L
Solids, Total Suspended	TSS	SM2540-D	22.7	mg/L
Solids, Total Suspended	TSS	SM2540-D	24.5	mg/L
Solids, Total Suspended	TSS	SM2540-D	25	mg/L
Solids, Total Suspended	TSS	SM2540-D	29.4	mg/L
Solids, Total Suspended	TSS	SM2540-D	31.3	mg/L
Solids, Total Suspended	TSS	SM2540-D	32.9	mg/L

Analytical Methods Used by the IWLab in 2022

Report run on: Friday, February 10, 2023 3:14 pm

Page 17

<i>Parmname</i>	<i>Parmcode</i>	<i>Protocol</i>	<i>Mdl</i>	<i>Units</i>
Solids, Total Suspended	TSS	SM2540-D	33.3	mg/L
Solids, Total Suspended	TSS	SM2540-D	34.7	mg/L
Solids, Total Suspended	TSS	SM2540-D	35.7	mg/L
Solids, Total Suspended	TSS	SM2540-D	38.5	mg/L
Solids, Total Suspended	TSS	SM2540-D	41.7	mg/L
Solids, Total Suspended	TSS	SM2540-D	43.1	mg/L
Solids, Total Suspended	TSS	SM2540-D	43.9	mg/L
Solids, Total Suspended	TSS	SM2540-D	45.5	mg/L
Solids, Total Suspended	TSS	SM2540-D	46.3	mg/L
Solids, Total Suspended	TSS	SM2540-D	48.1	mg/L
Solids, Total Suspended	TSS	SM2540-D	49	mg/L
Solids, Total Suspended	TSS	SM2540-D	50	mg/L
Solids, Total Suspended	TSS	SM2540-D	55.6	mg/L
Solids, Total Suspended	TSS	SM2540-D	58.1	mg/L
Solids, Total Suspended	TSS	SM2540-D	61.7	mg/L
Solids, Total Suspended	TSS	SM2540-D	62.5	mg/L
Solids, Total Suspended	TSS	SM2540-D	67.6	mg/L
Solids, Total Suspended	TSS	SM2540-D	69.4	mg/L
Solids, Total Suspended	TSS	SM2540-D	71.4	mg/L
Solids, Total Suspended	TSS	SM2540-D	83.3	mg/L
Solids, Total Suspended	TSS	SM2540-D	89.3	mg/L
Solids, Total Suspended	TSS	SM2540-D	92.6	mg/L
Solids, Total Suspended	TSS	SM2540-D	100	mg/L
Solids, Total Suspended	TSS	SM2540-D	104	mg/L
Solids, Total Suspended	TSS	SM2540-D	125	mg/L
Solids, Total Suspended	TSS	SM2540-D	139	mg/L
Solids, Total Suspended	TSS	SM2540-D	167	mg/L
Solids, Total Suspended	TSS	SM2540-D	179	mg/L
Solids, Total Suspended	TSS	SM2540-D	208	mg/L
Solids, Total Suspended	TSS	SM2540-D	250	mg/L
Solids, Total Suspended	TSS	SM2540-D	278	mg/L
Solids, Total Suspended	TSS	SM2540-D	313	mg/L
Solids, Total Suspended	TSS	SM2540-D	357	mg/L
Solids, Total Suspended	TSS	SM2540-D	417	mg/L
Solids, Total Suspended	TSS	SM2540-D	500	mg/L
Solids, Total Suspended	TSS	SM2540-D	625	mg/L
Solids, Total Suspended	TSS	SM2540-D	833	mg/L
Solids, Total Suspended	TSS	SM2540-D	1250	mg/L
Solids, Total Suspended	TSS	SM2540-D	1670	mg/L
Solids, Total Suspended	TSS	SM2540-D	2500	mg/L
Solids, Total Suspended	TSS	SM2540-D	3130	mg/L
Solids, Total Suspended	TSS	SM2540-D	5000	mg/L
Solids, Total Suspended - modified 1/10 dil	TSS 1/10 DIL	SM2540-D	125	mg/L
Solids, Total Suspended - modified 1/10 dil	TSS 1/10 DIL	SM2540-D	250	mg/L
Specific Conductance	CONDUCT	EPA120.1		umhos/cm
Specific Conductance-Composite	CONDUCT-COMP	EPA120.1		umhos/cm
Sulfides, Dissolved-Instantaneous	SULFIDE DISSOLVD	EPA376.2		mg/L
TPH, DOHS modified 8015	TPH			mg/L
Temperature-Instantaneous	TEMP	SM2550-B		DegC
Tetrachloroethene (PCE)	4CLETHE	EPA624.1	.209	ug/L
Tetrachloroethene (PCE)	4CLETHE	EPA624.1	.594	ug/L
Thallium, Total	THALLIUM	EPA200.7	.00314	mg/L

Analytical Methods Used by the IWLab in 2022

Report run on: Friday, February 10, 2023 3:14 pm

Page 18

<i>Parmname</i>	<i>Parmcode</i>	<i>Protocol</i>	<i>Mdl</i>	<i>Units</i>
Toluene	TOLUENE	EPA624.1	.245	ug/L
Toluene	TOLUENE	EPA624.1	.467	ug/L
Toxaphene	TOXAPHENE	EPA608.3/3510	.595	ug/L
Toxaphene	TOXAPHENE	EPA608.3/3510	1.04	ug/L
Trichloroethylene (trichloroethene) (TCE)	3CLETHE	EPA624.1	.328	ug/L
Trichloroethylene (trichloroethene) (TCE)	3CLETHE	EPA624.1	.456	ug/L
Trichlorofluoromethane	3CLFLMETH	EPA624.1	.248	ug/L
Trichlorofluoromethane	3CLFLMETH	EPA624.1	.554	ug/L
Vanadium, Total	VANADIUM	EPA200.7	.001	mg/L
Vinyl chloride (chloroethylene)	VINYL CL	EPA624.1	.242	ug/L
Vinyl chloride (chloroethylene)	VINYL CL	EPA624.1	.777	ug/L
Zinc, Total	ZINC	EPA200.7	.006	mg/L
Zinc, Total	ZINC	EPA200.7	.012	mg/L
Zinc, Total	ZINC	EPA200.7	.03	mg/L
Zinc, Total	ZINC	EPA200.7	.06	mg/L
cis-1,3-Dichloropropene	C13-2CLPRE	EPA624.1	.392	ug/L
cis-1,3-Dichloropropene	C13-2CLPRE	EPA624.1	.505	ug/L
n-Amyl acetate - 40CFR136.3 Table 1F	N-AMYL ACET:P-O	EPA1666	25	ug/L
n-Amyl acetate - 40CFR136.3 Table 1F	N-AMYL ACET:P-O	EPA1666	50	ug/L
n-Amyl acetate - 40CFR136.3 Table 1F	N-AMYL ACET:P-O	EPA1666	250	ug/L
n-Amyl acetate - 40CFR136.3 Table 1F	N-AMYL ACET:P-O	EPA1666	1000	ug/L
pH-Instantaneous	PH	SM4500-H+B		pH
pH-highest value	PH HIGHEST	SM4500-H+B		pH
pH-lowest value	PH LOWEST	EPA150.1		pH
trans-1,3-Dichloropropene	T13-2CLPRE	EPA624.1	.526	ug/L
trans-1,3-Dichloropropene	T13-2CLPRE	EPA624.1	.555	ug/L

Mdl = Method Detection Limit

CHAPTER 5 - INDUSTRIAL POLLUTANT DISCHARGES

5.1 INTRODUCTION

This section presents the results of influent and effluent monitoring for industrial pollutants as well as historical influent and effluent data. The data demonstrate that there has been a steady decline in industrial pollutants discharged to the plants over the past 30 years. Since 1982, when the pretreatment program received EPA approval, the total influent metal loadings have declined by more than 70%, and the total effluent metal loadings have declined by 89%. During the same period growth has resulted in a 11% increase in wastewater flows to the system, while the total heavy metals discharged by industry has declined by about 94%. Some of the reductions are attributed to the diversion of wastestreams to the South Bay and North City Water Reclamation Plants. The effluent from North City discharges through PLWTP and the SBWRP effluent is discharged through its ocean outfall.

5.2 INFLUENT / EFFLUENT METALS TRENDS

For the PLWTP, Figure 5.2-1 presents the long-term trends in influent and effluent metals loadings. Figures 5.2-2 through 5.2-8 are graphs of individual constituent metals in the influent and effluent over the period of 1982 through the year covered in this report. The constituents presented are cadmium, chromium, copper, lead, nickel, silver, and zinc.

For the SBWRP, the pretreatment program had already been fully implemented when the plant began operations, thus the metals have been consistently low.

Implementation of Pretreatment Standards and Source Control Programs have effectively reduced or controlled pollutant loadings at the plant headworks, ensuring that there are no incidents of pass-through or interference attributed to industrial discharges at both the Point Loma and South Bay facilities, the receiving waters are protected, and the generated biosolids qualify for maximum beneficial use.

5.3 POINT LOMA AND SOUTH BAY PLANTS MONITORING

During the year covered in this report, the PLWTP and SBWRP did not experience any upset, interference, or pass through incidents attributable to non-domestic users of the Metropolitan Sewerage system. A summary of the influent and effluent average metals loadings for the PLWTP and SBWRP is presented on pages 5-6 and 5-7, Tables 5.3-1 and 5.3-2 and Tables 5.3-3 and 5.3-4, respectively. For monthly averaging purposes in these tables and graphs, “less than” and “not detected” values were treated as zero when all values for a given month were < Method Detection Limit (MDL).

Figure 5.2-1
Point Loma Influent/Effluent Metals
Total of Cd, Cr, Cu, Pb, Ni, Ag, Zn

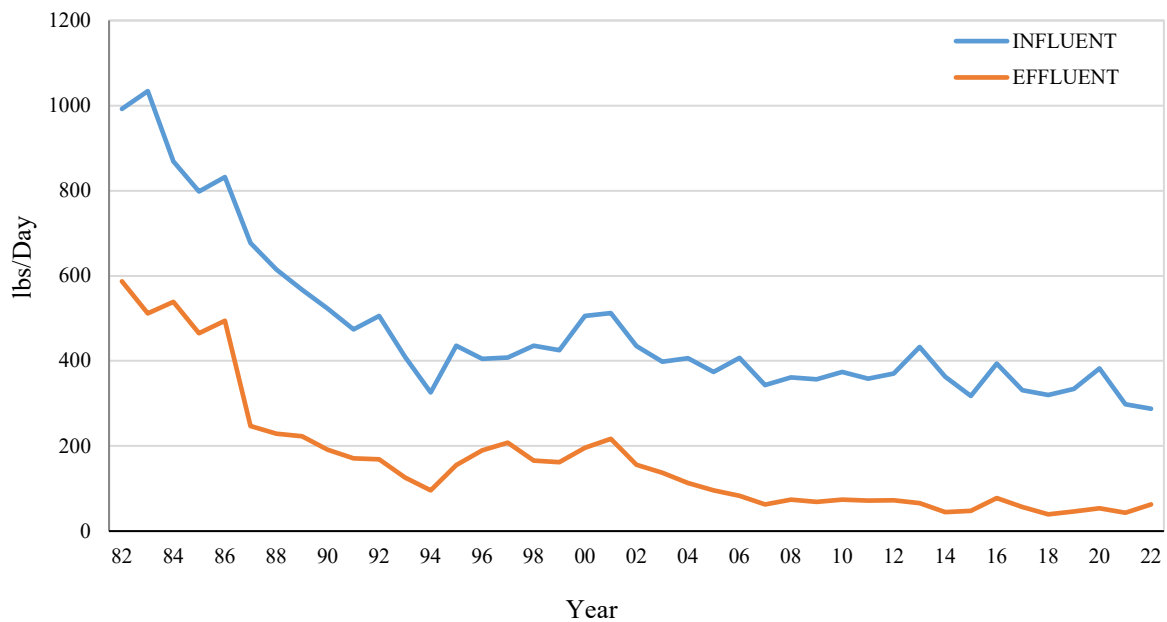


Figure 5.2-2
Cadmium
Point Loma Influent/Effluent History

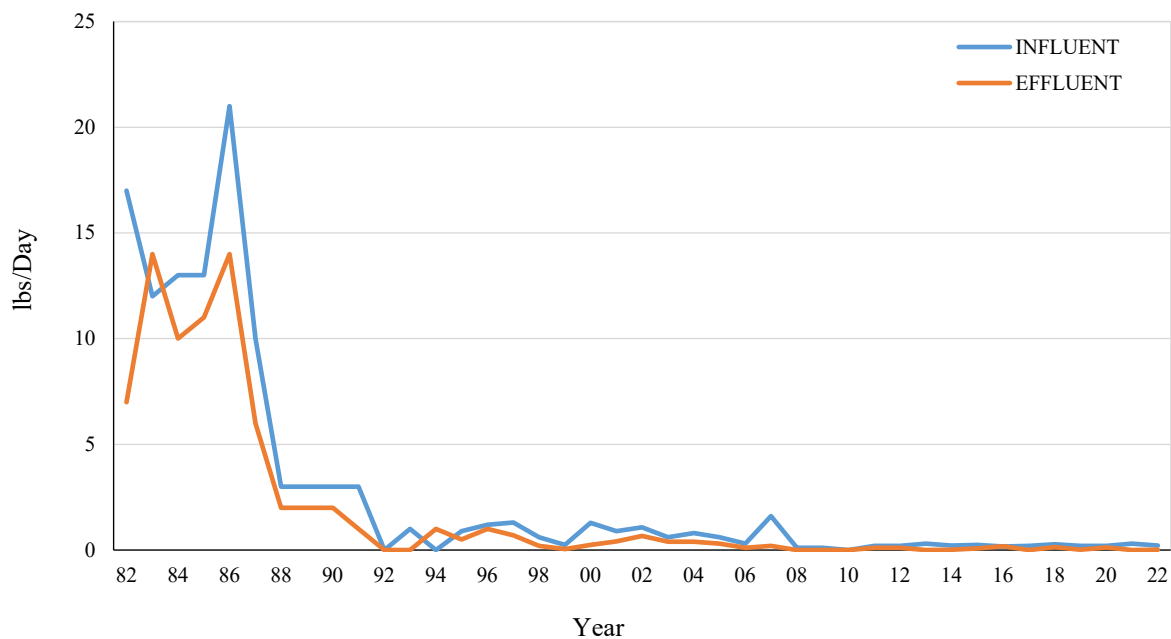


Figure 5.2-3
Chromium
Point Loma Influent/Effluent History

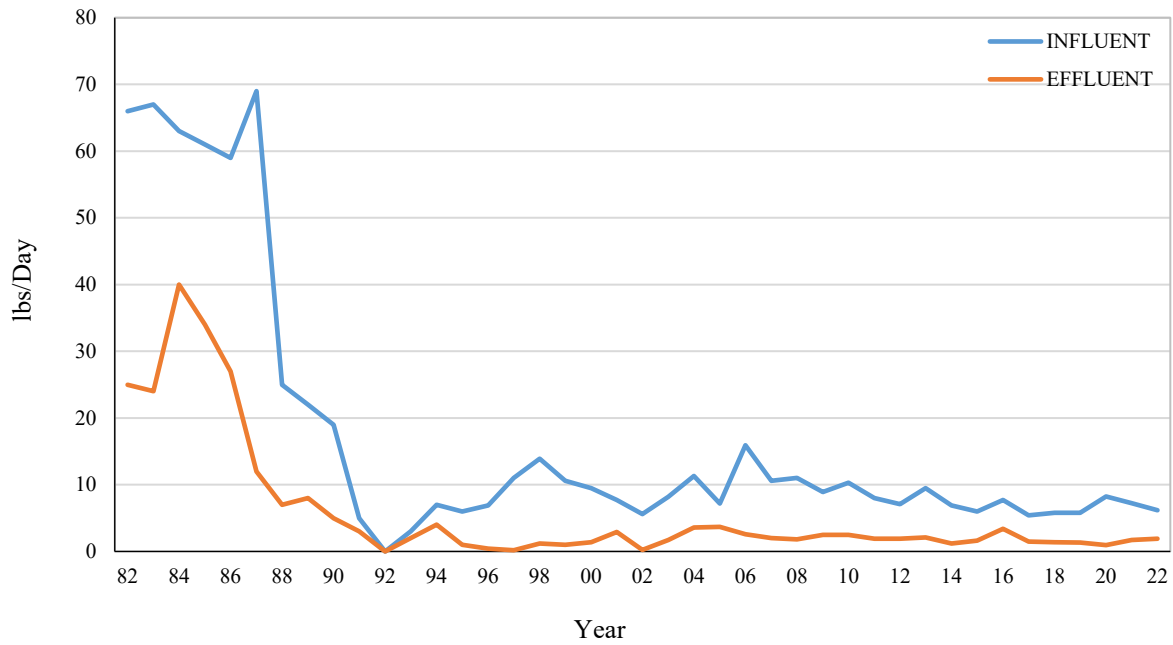


Figure 5.2-4
Copper
Point Loma Influent/Effluent History

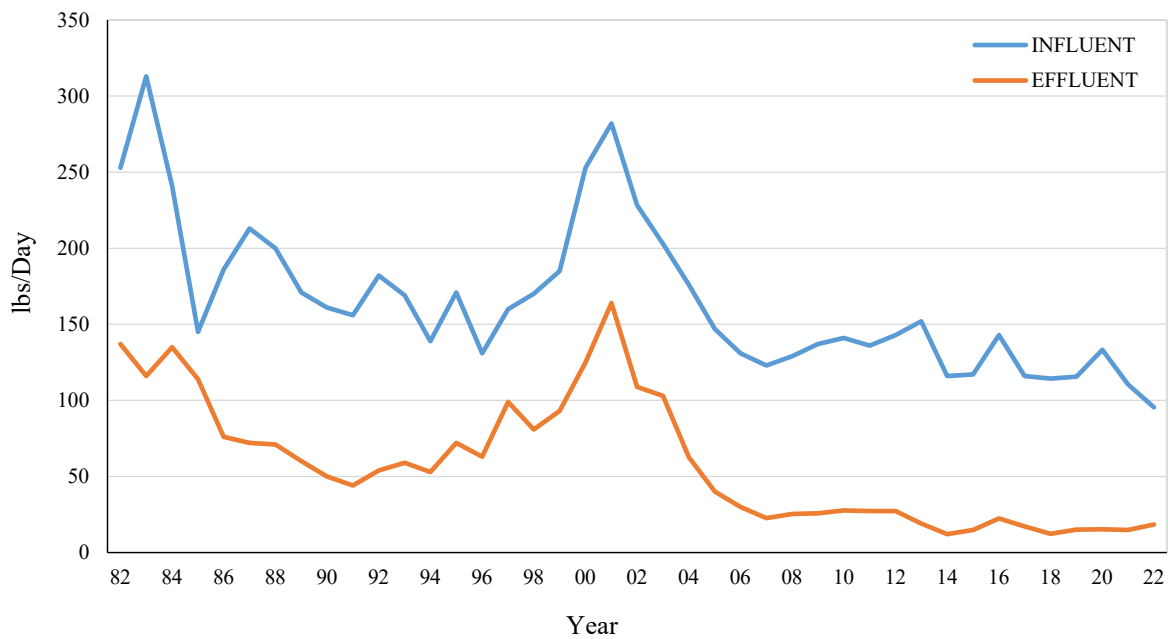


Figure 5.2-5
Lead
Point Loma Influent/Effluent History

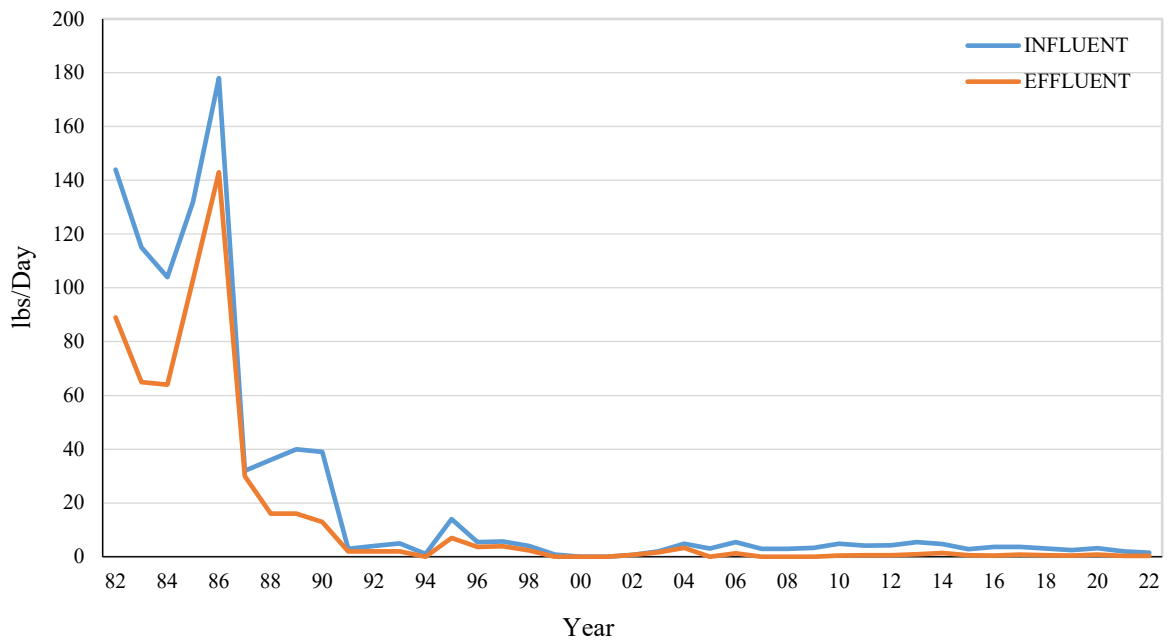


Figure 5.2-6
Nickel
Point Loma Influent/Effluent History

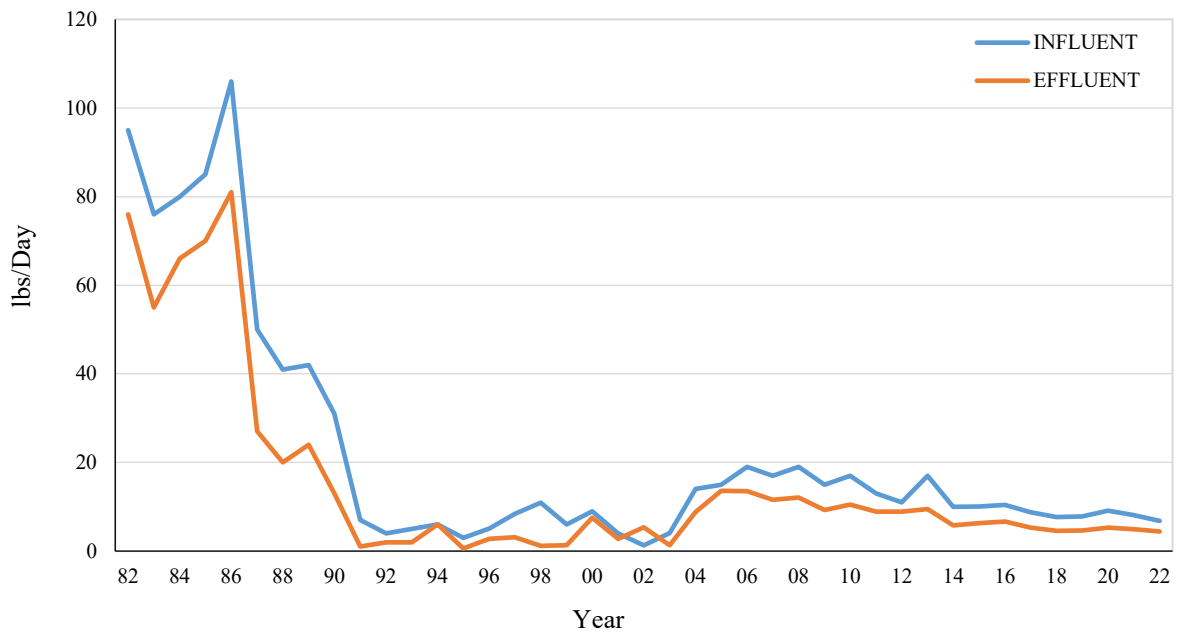


Figure 5.2-7
Silver
Point Loma Influent/Effluent History

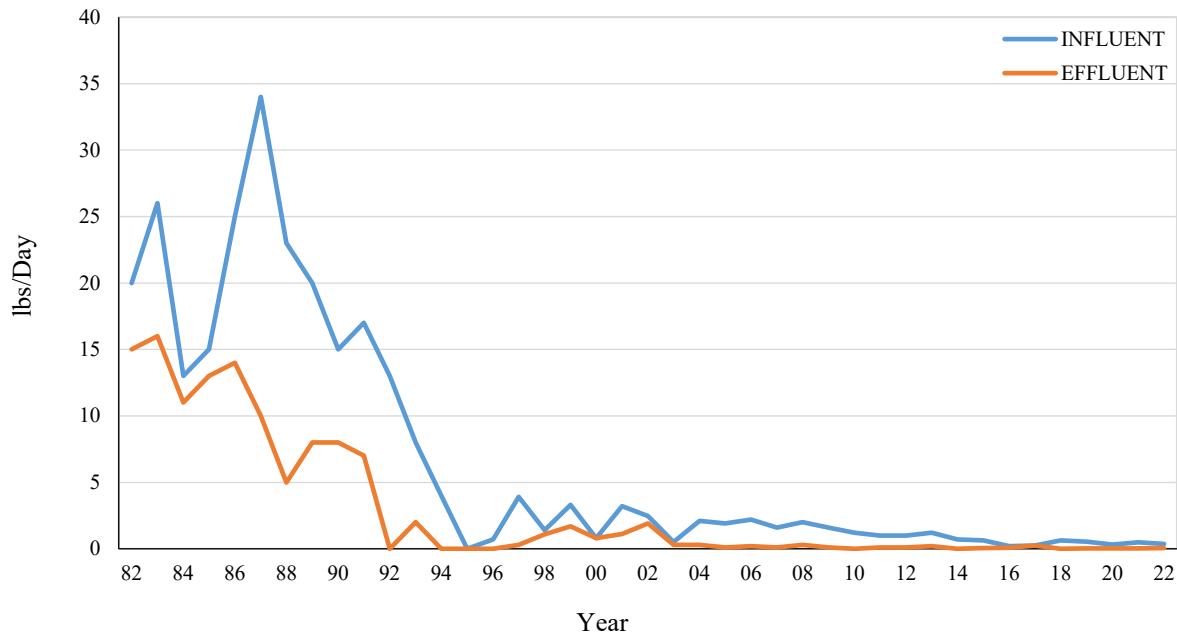


Figure 5.2-8
Zinc
Point Loma Influent/Effluent History

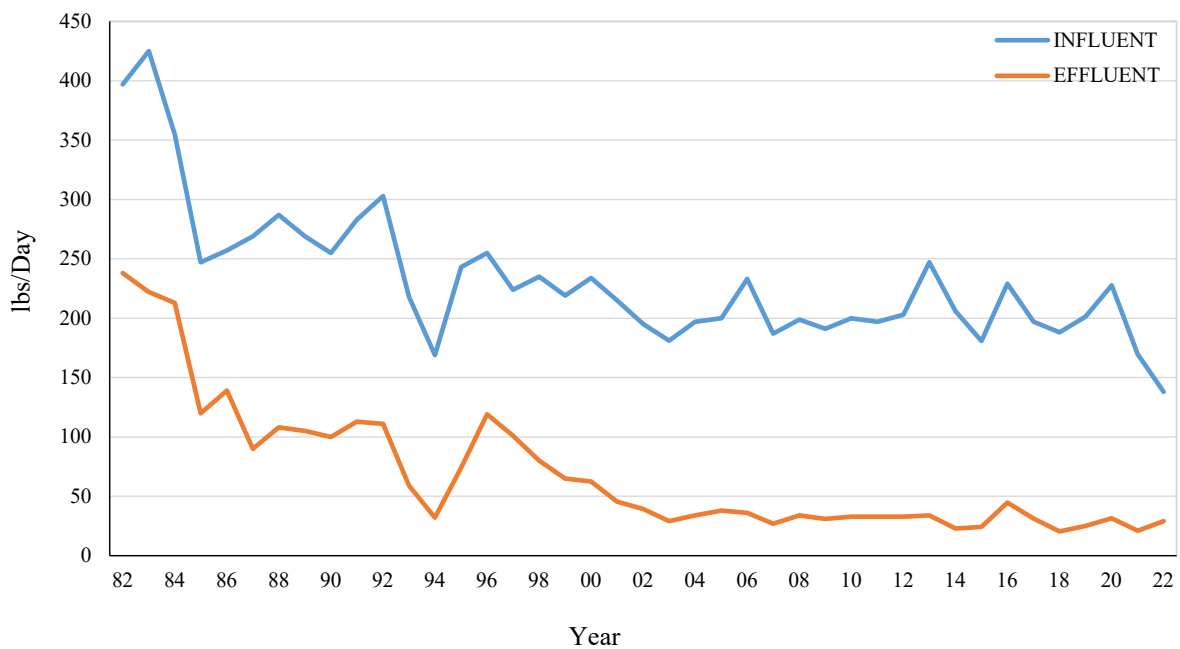


TABLE 5.3-1 POINT LOMA WASTEWATER TREATMENT PLANT INFLUENT HEAVY METALS Average Concentration and Loadings for 2022								
ND or <MDL = 0								
Month	Flow MGD	Cd µg/L	Cr µg/L	Cu µg/L	Pb µg/L	Ni µg/L	Ag µg/L	Zn µg/L
Max MDL (ug/L)		0.073	1.01	0.388	0.1	0.17	0.0718	1.18
Jan	127.0	0.25	6.81	110	1.46	8.37	0.43	161
Feb	142.1	0.23	6.08	87.1	1.58	6.42	0.30	134
Mar	146.5	0.20	5.66	74.6	1.31	5.78	0.27	115
Apr	142.8	0.23	5.63	86.3	1.48	6.87	0.57	136
May	139.0	0.28	6.45	115	1.83	6.99	0.49	159
Jun	137.7	0.16	4.73	69.8	0.97	5.29	0.26	100
Jul	132.3	0.26	7.13	117	1.90	7.52	0.39	172
Aug	137.2	0.22	6.46	133	1.46	6.89	0.41	152
Sep	142.1	0.18	5.41	77.3	1.23	6.51	0.25	108
Oct	137.6	0.18	5.46	78.7	1.28	6.08	0.26	118
Nov	141.4	0.25	7.29	96.2	1.68	8.04	0.36	143
Dec	141.3	0.24	6.92	101	1.64	7.34	0.36	154
Average Flow MGD	138.9							
Average ug/L		0.22	6.17	95.5	1.49	6.84	0.36	138
lbs/day		0.26	7.15	110.6	1.72	7.93	0.42	159
PL Total lbs HM	287.6							
PL Total lbs (-)Ag	287.2							

TABLE 5.3-2 POINT LOMA WASTEWATER TREATMENT PLANT EFFLUENT HEAVY METALS Average Concentration and Loadings for 2022								
ND or <MDL = 0								
Month	Flow MGD	Cd µg/L	Cr µg/L	Cu µg/L	Pb µg/L	Ni µg/L	Ag µg/L	Zn µg/L
Max MDL (ug/L)		0.073	1.01	0.388	0.1	0.17	0.0718	1.18
Jan	127.0	0.00	1.35	16.5	0.22	4.20	0.03	23.0
Feb	142.1	0.00	1.55	14.5	0.24	4.40	0.00	20.3
Mar	146.5	0.00	1.96	17.7	0.28	4.33	0.05	26.6
Apr	142.8	0.11	4.26	49.5	0.83	5.25	0.23	79.7
May	139.0	0.00	2.48	28.8	0.41	4.58	0.11	39.2
Jun	137.7	0.00	2.41	23.3	0.37	4.40	0.09	37.2
Jul	132.3	0.00	1.57	13.9	0.20	4.31	0.04	20.1
Aug	137.2	0.00	1.70	13.7	0.21	4.39	0.05	22.2
Sep	142.1	0.00	1.34	10.0	0.20	4.01	0.00	18.9
Oct	137.6	0.00	1.38	11.0	0.17	4.01	0.00	25.0
Nov	141.4	0.00	1.61	11.1	0.19	4.80	0.03	17.9
Dec	141.3	0.00	1.49	12.5	0.20	4.59	0.00	17.6
Average Flow MGD	138.9							
Average ug/L		0.01	1.93	18.5	0.29	4.44	0.05	29.0
lbs/day		0.01	2.23	21.5	0.34	5.14	0.06	33.6
PL Total lbs HM	62.8							
PL Total lbs (-)Ag	62.8							

TABLE 5.3-3 SOUTH BAY WATER RECLAMATION PLANT INFLUENT HEAVY METALS Average Concentration and Loadings for 2022								
ND or <MDL = 0								
Month	Flow MGD	Cd µg/L	Cr µg/L	Cu µg/L	Pb µg/L	Ni µg/L	Ag µg/L	Zn µg/L
Max MDL (ug/L)		0.073	1.01	0.388	0.1	0.17	0.0718	1.18
Jan	6.82	0.21	4.07	109	1.61	4.54	0.24	177
Feb	6.78	0.29	5.99	156	2.67	8.25	0.62	224
Mar	6.70	0.25	2.46	85.4	1.39	4.11	0.25	155
Apr	6.74	0.15	2.06	83.8	1.26	4.21	0.21	139
May	6.69	0.38	4.23	171	2.51	6.82	0.51	332
Jun	6.58	0.16	1.45	69.5	1.17	3.34	0.17	119
Jul	6.78	0.10	0.00	68.0	0.95	3.13	0.11	103
Aug	6.83	0.13	1.24	72.8	1.11	3.57	0.15	128
Sep	6.93	0.12	1.78	69.1	0.89	3.91	0.17	108
Oct	6.31	0.24	2.56	109	1.78	5.97	0.27	203
Nov	6.34	0.20	4.29	96.8	1.49	5.06	0.20	172
Dec	6.47	0.21	4.88	91.1	1.40	4.70	0.21	161
Average Flow MGD	6.66							
Average ug/L		0.20	2.92	98.5	1.52	4.80	0.26	168
lbs/day		0.01	0.16	5.47	0.08	0.27	0.01	9.36
SB Total lbs HM	15.37							
SB Total lbs (-)Ag	15.36							

TABLE 5.3-4 SOUTH BAY WATER RECLAMATION PLANT EFFLUENT HEAVY METALS Average Concentration and Loadings for 2022								
ND or <MDL = 0								
Month	Flow MGD	Cd µg/L	Cr µg/L	Cu µg/L	Pb µg/L	Ni µg/L	Ag µg/L	Zn µg/L
Max MDL (ug/L)		0.058	0.804	0.31	0.08	0.136	0.0574	0.944
Jan	6.40	0.00	0.00	13.5	0.12	1.63	0.00	29.0
Feb	4.69	0.00	0.00	20.6	0.14	2.28	0.00	33.5
Mar	4.94	0.00	0.00	11.3	0.13	1.67	0.00	31.4
Apr	3.65	0.00	0.00	10.5	0.10	1.95	0.00	32.5
May	2.43	0.00	0.00	15.1	0.10	1.74	0.00	30.3
Jun	1.83	0.00	0.00	14.8	0.17	1.88	0.00	25.7
Jul	1.43	0.00	0.00	13.0	0.10	1.96	0.00	25.3
Aug	1.48	0.00	0.00	12.0	0.09	2.04	0.00	23.4
Sep	2.51	0.00	0.00	11.2	0.10	1.85	0.00	27.7
Oct	2.78	0.00	0.00	7.25	0.00	2.17	0.00	24.9
Nov	4.59	0.00	0.00	6.68	0.09	1.70	0.00	25.8
Dec	5.36	0.00	0.36	6.39	0.12	1.65	0.00	20.3
Average Flow MGD	3.51							
Average ug/L		0.00	0.03	11.9	0.10	1.88	0.00	27.5
lbs/day		0.00	0.00	0.35	0.00	0.05	0.00	0.80
SB Total lbs HM	1.21							
SB Total lbs (-)Ag	1.21							

5.4 POINT LOMA INFLUENT AND EFFLUENT ANALYTICAL RESULTS

The following pages summarize analytical results from representative flow-proportioned 24-hour composite sampling of the influent and effluent for those pollutants the EPA has identified under Section 307(a) of the Clean Water Act, which are known or suspected to be discharged by nondomestic users, and for non-priority pollutants. The data include results of monthly full priority pollutant scans.

POINT LOMA WASTEWATER TREATMENT PLANT DAILY INFLUENT AND EFFLUENT

ANNUAL 2022
SM5210B/4500OCG

Biochemical Oxygen Demand (BOD) Concentration (24-hour composite)

Month/ Year		Influent Flow (MGD)	Daily Influent Value (mg/L)	Daily Influent Value (lbs/Day)	Daily Effluent Value (mg/L)	Daily Effluent Value (lbs/Day)	Percent Removal BOD (%)
=====	=====	=====	=====	=====	=====	=====	=====
JANUARY	-2022	127.0	332	351648	140	148285	57.8
FEBRUARY	-2022	142.1	353	418345	147	174212	58.4
MARCH	-2022	146.5	332	405641	180	219926	45.8
APRIL	-2022	142.8	328	390632	212	252482	35.4
MAY	-2022	139.0	325	376760	195	226056	40.0
JUNE	-2022	137.7	339	389314	166	190637	51.0
JULY	-2022	132.3	332	366323	112	123579	66.3
AUGUST	-2022	137.2	286	327255	96	109848	66.4
SEPTEMBER	-2022	142.1	255	302204	94	111401	63.1
OCTOBER	-2022	137.6	255	292634	104	119349	59.2
NOVEMBER	-2022	141.4	263	310150	105	123824	60.1
DECEMBER	-2022	141.3	259	305216	104	122558	59.8
=====	=====	=====	=====	=====	=====	=====	=====
Average		138.9	305	353010	138	160180	55.3

Annual Mass Emissions are calculated from monthly averages of flow and BOD, whereas monthly Report average mass emissions are calculated from average daily mass emissions.

POINT LOMA WASTEWATER TREATMENT PLANT DAILY
INFLUENT AND EFFLUENT

ANNUAL 2022

Total Suspended Solids (TSS) Concentration
(24-hour composite)

	Flow	Daily Influent TSS (mg/L)	Daily Influent VSS (mg/L)	Percent VSS of TSS (%)	Daily Influent Value (lbs/Day)	Daily Effluent TSS (mg/L)	Daily Effluent VSS (mg/L)	Percent VSS of TSS (%)	Daily Effluent Value (lbs/Day)
JANUARY -2022	127.0	315	281	89.2	333642	42.0	32.8	78.1	44486
FEBRUARY -2022	142.1	355	316	89.0	420715	45.2	34.8	77.0	53567
MARCH -2022	146.5	352	302	85.8	430077	83.7	65.5	78.3	102265
APRIL -2022	142.8	345	297	86.1	410878	128	100	78.1	152442
MAY -2022	139.0	353	308	87.3	409219	117	97.7	83.5	135633
JUNE -2022	137.7	370	325	87.8	424915	79.8	66.3	83.1	91644
JULY -2022	132.3	368	325	88.3	406045	40.6	31.0	76.4	44797
AUGUST -2022	137.2	320	283	88.4	366159	41.5	35.2	84.8	47486
SEPTEMBER-2022	142.1	284	247	87.0	336572	41.9	35.4	84.5	49656
OCTOBER -2022	137.6	269	237	88.1	308700	43.0	33.5	77.9	49346
NOVEMBER -2022	141.4	271	243	89.7	319584	39.1	32.6	83.4	46110
DECEMBER -2022	141.3	298	266	89.3	351176	38.1	31.9	83.7	44899
Average	138.9	325	286		376474	61.7	49.7		71861

	Percent Removal TSS (%)	Percent Removal VSS (%)
JANUARY -2022	86.7	88.3
FEBRUARY -2022	87.3	89.0
MARCH -2022	76.2	78.3
APRIL -2022	62.9	66.3
MAY -2022	66.9	68.3
JUNE -2022	78.4	79.6
JULY -2022	88.4	90.5
AUGUST -2022	86.7	87.6
SEPTEMBER-2022	84.2	85.7
OCTOBER -2022	83.5	85.9
NOVEMBER -2022	84.7	86.6
DECEMBER -2022	86.7	88.0
Average	81.1	82.8

Annual Mass Emissions are calculated from monthly averages of flow and TSS, whereas Monthly Report average mass emissions are calculated from average daily mass emissions.

TSS/VSS by SM2540D

POINT LOMA WASTEWATER TREATMENT PLANT

ANNUAL 2022

Systemwide BOD Removals

MONTH	Pt. Loma Influent Mass Emissions	NCWRP PS64 Mass Emissions	NCWRP Penasquitos Mass Emissions	MBC Return Mass Emissions	NCWRP Return Mass Emissions	Total Return Mass Emissions	Pt. Loma Effluent Mass Emissions	System wide Adjusted BOD Removals	Pt. Loma Daily BOD Removals	Pt. Loma Daily BOD Eff Conc.
01-2022	352,423	12,031	4,178	5,445	5,872	11,317	148,942	57.9	57.4	140
02-2022	418,052	0	8,658	6,672	3,713	10,385	173,903	57.8	58.0	147
03-2022	405,236	0	11,058	5,310	2,058	7,369	219,705	46.1	45.6	180
04-2022	390,528	697	12,438	3,706	1,342	5,048	252,253	36.0	34.6	212
05-2022	378,516	7,050	12,350	3,677	6,335	10,013	221,869	42.5	41.1	191
06-2022	388,847	21,114	13,980	8,673	7,103	15,775	191,210	53.0	50.7	166
07-2022	366,029	28,962	14,372	9,137	6,612	15,750	123,839	68.6	66.2	112
08-2022	332,614	28,566	13,837	8,414	6,558	14,972	114,202	68.1	65.4	100
09-2022	314,098	29,981	12,066	6,804	5,476	12,280	116,161	65.7	62.1	98.0
10-2022	293,022	24,546	6,248	7,055	5,821	12,876	118,996	60.7	58.5	104
11-2022	307,059	18,162	12,276	7,938	6,240	14,178	123,003	61.2	59.1	105
12-2022	304,681	16,461	13,275	7,605	6,099	13,704	122,426	60.7	58.6	104
avg	354,259	15,631	11,228	6,703	5,269	11,972	160,542	56.5	54.8	138

POINT LOMA WASTEWATER TREATMENT PLANT

ANNUAL 2022

Systemwide TSS Removals

MONTH	Pt. Loma Influent Mass Emissions Lbs/day	NCWRP PS64 Mass Emissions Lbs/day	NCWRP Penasquitos Mass Emissions Lbs/day	MBC Return Mass Emissions Lbs/day	NCWRP Return Mass Emissions Lbs/day	Total Return Mass Emissions Lbs/day	Pt. Loma Effluent Mass Emissions Lbs/day	System wide Adjusted TSS Removals	Pt. Loma Daily TSS Removals	Pt. Loma Daily TSS Eff Conc. mg/L
01-2022	333,642	13,505	5,677	11,683	7,627	19,310	44,701	85.9	86.2	42
02-2022	419,827	0	12,237	21,191	6,546	27,737	53,920	86.4	87.1	45
03-2022	428,906	0	15,172	15,648	2,856	18,505	102,383	75.5	75.7	84
04-2022	411,131	785	17,783	6,741	4,019	10,760	151,807	62.7	62.7	128
05-2022	409,940	8,266	15,651	10,256	17,364	27,619	136,701	65.7	66.5	117
06-2022	424,689	22,375	17,349	18,427	14,104	32,532	91,922	78.5	78.1	80
07-2022	404,249	30,145	17,672	22,378	12,718	35,096	45,060	88.8	88.4	41
08-2022	366,553	30,875	17,833	20,152	12,862	33,013	47,596	87.3	86.7	42
09-2022	336,109	32,850	14,948	15,403	11,591	26,994	49,649	85.3	84.2	42
10-2022	311,253	33,396	13,043	13,140	11,181	24,321	48,698	84.8	83.5	43
11-2022	315,688	26,275	19,374	16,424	11,933	28,357	46,029	85.6	84.7	39
12-2022	351,221	19,853	20,786	19,830	11,620	31,450	45,024	87.1	86.7	38
avg	376,101	18,194	15,627	15,939	10,368	26,308	71,958	81.1	80.9	61.75

POINT LOMA WASTEWATER TREATMENT PLANT

ANNUAL 2022

Influent to Plant
(PLR)

		pH	Settleable Solids (ml/L)	Biochemical Oxygen Demand (mg/L)	Hexane Extractable Material (mg/L)	Temperature (C)	Floating Particulates (mg/L)	Turbidity (NTU)
=====	=====	=====	=====	=====	=====	=====	=====	=====
JANUARY -2022		7.10	17.8	332	60.6	24.0	<1.00	144
FEBRUARY -2022		7.07	17.3	353	66.8	23.9	1.49	115
MARCH -2022		7.13	18.6	332	68.2	24.0	1.23	141
APRIL -2022		7.16	20.4	328	71.3	25.1	<1.00	155
MAY -2022		7.12	19.3	325	73.0	25.8	<1.00	129
JUNE -2022		7.18	18.1	339	64.8	26.6	<1.00	119
JULY -2022		7.17	21.2	332	68.7	27.1	<1.00	120
AUGUST -2022		7.21	17.2	286	63.0	28.1	<1.00	118
SEPTEMBER-2022		7.23	18.7	255	60.9	28.6	<1.00	141
OCTOBER -2022		7.23	19.5	255	65.1	27.7	<1.00	194
NOVEMBER -2022		7.21	16.2	263	59.4	25.2	1.01	118
DECEMBER -2022		7.23	16.6	259	54.7	23.3	1.89	137
=====	=====	=====	=====	=====	=====	=====	=====	=====
Average		7.17	18.4	305	64.7	25.8	0.5	136

Effluent to Ocean Outfall
(PLE)

		pH	Settleable Solids (ml/L)	Biochemical Oxygen Demand (mg/L)	Hexane Extractable Material (mg/L)	Temperature (C)	Floating Particulates (mg/L)	Turbidity (NTU)
=====	=====	=====	=====	=====	=====	=====	=====	=====
JANUARY -2022		7.13	0.1	140	17.6	23.7	ND	49
FEBRUARY -2022		7.08	0.1	147	13.7	23.6	ND	44
MARCH -2022		7.01	0.4	180	21.7	23.8	ND	63
APRIL -2022		6.93	0.6	212	28.5	25.0	ND	83
MAY -2022		6.91	0.9	195	30.0	25.8	ND	90
JUNE -2022		6.99	0.7	166	22.5	26.6	<1.00	82
JULY -2022		7.16	0.2	112	15.1	27.0	<1.00	70
AUGUST -2022		7.16	0.2	96.0	15.6	27.9	ND	71
SEPTEMBER-2022		7.14	0.2	94.0	13.2	28.6	ND	57
OCTOBER -2022		7.15	0.2	104	13.0	27.5	<1.00	54
NOVEMBER -2022		7.13	0.3	105	DNQ13.4	25.1	ND	44
DECEMBER -2022		7.14	0.3	104	13.3	23.3	ND	41
=====	=====	=====	=====	=====	=====	=====	=====	=====
Average		7.08	0.4	138	DNQ18.1	25.7	0.00	62

ND=not detected; NS=not sampled; NA=not analyzed.

DNQ= Detected but not quantified. Sample result is less than reporting level but greater than or equal to MDL.

pH by Method SM4500H_B
Settleable Solids by SM2540F
BOD by SM5210B/4500OCG
Oil and Grease(HEM) by EPA Method 1664B
Temperature by SM2550-B
Floatables Method SM2530B
Turbidity by SM2130B

POINT LOMA WASTEWATER TREATMENT PLANT

ANNUAL 2022

Trace Metals
EPA Method 200.8

Analyte:		Antimony	Antimony	Arsenic	Arsenic	Beryllium	Beryllium	Cadmium	Cadmium
Max MDL		0.258	0.258	0.168	0.168	0.318	0.318	0.073	0.073
Units		UG/L	UG/L	UG/L	UG/L	UG/L	UG/L	UG/L	UG/L
Source:		PLR	PLE	PLR	PLE	PLR	PLE	PLR	PLE
=====		=====		=====		=====		=====	
JANUARY -2022		1.21	0.88	DNQ2.17	DNQ1.28	ND	ND	0.25	<0.073
FEBRUARY -2022		1.09	1.01	DNQ1.76	DNQ1.33	ND	ND	DNQ0.23	ND
MARCH -2022		1.31	0.83	DNQ1.75	DNQ1.38	ND	ND	DNQ0.20	<0.073
APRIL -2022		1.71	1.45	DNQ1.71	DNQ1.65	ND	ND	DNQ0.23	DNQ0.11
MAY -2022		1.17	0.93	DNQ2.14	DNQ1.49	ND	ND	DNQ0.28	<0.073
JUNE -2022		1.08	0.95	DNQ1.88	DNQ1.50	ND	ND	DNQ0.16	<0.073
JULY -2022		1.56	0.95	DNQ1.85	DNQ1.55	ND	ND	DNQ0.26	ND
AUGUST -2022		1.19	0.94	DNQ1.74	DNQ1.48	ND	ND	DNQ0.22	ND
SEPTEMBER -2022		1.11	1.15	DNQ1.78	DNQ1.51	ND	ND	DNQ0.18	ND
OCTOBER -2022		1.12	1.41	DNQ1.76	DNQ1.50	ND	ND	DNQ0.18	ND
NOVEMBER -2022		1.35	0.91	DNQ2.11	DNQ1.47	ND	ND	DNQ0.25	ND
DECEMBER -2022		1.30	0.93	DNQ1.91	DNQ1.28	ND	ND	0.24	ND
=====		=====		=====		=====		=====	
AVERAGE		1.27	1.03	DNQ1.88	DNQ1.45	ND	ND	DNQ0.22	DNQ0.01

Analyte:		Chromium	Chromium	Copper	Copper	Iron	Iron	Lead	Lead
Max MDL		1.01	1.01	0.388	0.388	10.8	10.8	0.1	0.1
Units		UG/L	UG/L	UG/L	UG/L	UG/L	UG/L	UG/L	UG/L
Source:		PLR	PLE	PLR	PLE	PLR	PLE	PLR	PLE
=====		=====		=====		=====		=====	
JANUARY -2022		6.81	1.35	110	16.5	8560	3800	1.46	DNQ0.22
FEBRUARY -2022		6.08	1.55	87.1	14.5	7330	4430	1.58	DNQ0.24
MARCH -2022		5.66	1.96	74.6	17.7	14000	4390	1.31	DNQ0.28
APRIL -2022		5.63	4.26	86.3	49.5	9040	4500	1.48	DNQ0.83
MAY -2022		6.45	2.48	115	28.8	9100^	5270^	1.83	DNQ0.41
JUNE -2022		4.73	2.41	69.8	23.3	9440	3560	0.97	DNQ0.37
JULY -2022		7.13	1.57	117	13.9	13600	2830	1.90	DNQ0.20
AUGUST -2022		6.46	1.70	133	13.7	14100	4060	1.46	DNQ0.21
SEPTEMBER -2022		5.41	1.34	77.3	10.0	9490	1970	1.23	DNQ0.20
OCTOBER -2022		5.46	1.38	78.7	11.0	8140	2260	1.28	DNQ0.17
NOVEMBER -2022		7.29	1.61	96.2	11.1	10700	2530	1.68	DNQ0.19
DECEMBER -2022		6.92	1.49	101	12.5	10100	2920	1.64	DNQ0.20
=====		=====		=====		=====		=====	
AVERAGE		6.17	1.93	95.5	18.5	10409	3386	1.49	DNQ0.29

Analyte:		Nickel	Nickel	Selenium	Selenium	Silver	Silver	Thallium	Thallium
Max MDL		0.17	0.17	1.18	1.18	0.0718	0.0718	0.068	0.068
Units		UG/L	UG/L	UG/L	UG/L	UG/L	UG/L	UG/L	UG/L
Source:		PLR	PLE	PLR	PLE	PLR	PLE	PLR	PLE
=====		=====		=====		=====		=====	
JANUARY -2022		8.37	4.20	DNQ1.90	DNQ1.55	0.43	DNQ0.03	ND	ND
FEBRUARY -2022		6.42	4.40	DNQ1.99	DNQ1.73	DNQ0.30	<0.03	ND	ND
MARCH -2022		5.78	4.33	DNQ1.77	DNQ1.55	0.27	DNQ0.05	ND	ND
APRIL -2022		6.87	5.25	DNQ1.72	DNQ1.72	0.57	DNQ0.23	ND	ND
MAY -2022		6.99	4.58	DNQ1.79	DNQ1.55	0.49	DNQ0.11	ND	ND
JUNE -2022		5.29	4.40	<1.18	DNQ1.27	DNQ0.26	DNQ0.09	ND	ND
JULY -2022		7.52	4.31	DNQ1.99	DNQ1.43	DNQ0.39	DNQ0.04	ND	ND
AUGUST -2022		6.89	4.39	DNQ1.96	DNQ1.39	DNQ0.41	DNQ0.05	ND	ND
SEPTEMBER -2022		6.51	4.01	DNQ1.54	<1.18	DNQ0.25	<0.03	ND	ND
OCTOBER -2022		6.08	4.01	DNQ1.49	<1.18	DNQ0.26	ND	ND	ND
NOVEMBER -2022		8.04	4.80	DNQ2.33	<1.18	DNQ0.36	DNQ0.03	ND	ND
DECEMBER -2022		7.34	4.59	DNQ2.11	DNQ1.61	0.36	ND	ND	ND
=====		=====		=====		=====		=====	
AVERAGE		6.84	4.44	DNQ1.72	DNQ1.15	DNQ0.36	DNQ0.05	ND	ND

^ = The relative percent difference of sample duplicates is outside method acceptance criteria.

ND= not detected, NA= not analyzed, NS= not sampled

DNQ= Detected but not quantified. One or more monthly values were qualified as DNQ.

POINT LOMA WASTEWATER TREATMENT PLANT

ANNUAL 2022

Trace Metals
EPA Method 200.8

Analyte:		Zinc	Zinc	Mercury	Mercury
Max MDL		1.18	1.18	0.005	0.0005
Units		UG/L	UG/L	UG/L	UG/L
Source:		PLR	PLE	PLR	PLE
=====		=====		=====	
JANUARY -2022		161	23.0	0.0583	0.0105
FEBRUARY -2022		134	20.3	0.0420	0.0085
MARCH -2022		115	26.6	0.0650	0.0150
APRIL -2022		136	79.7	0.1288	0.0325
MAY -2022		159	39.2	0.0401	0.0184
JUNE -2022		100	37.2	0.0150	0.0081
JULY -2022		172	20.1	0.0076	0.0054
AUGUST -2022		152	22.2	0.0065	0.0033
SEPTEMBER-2022		108	18.9	0.0072	0.0033
OCTOBER -2022		118	25.0	0.0315	0.0070
NOVEMBER -2022		143	17.9	0.0459	0.0061
DECEMBER -2022		154	17.6	0.0665	0.0071
=====		=====		=====	
AVERAGE		138	29.0	0.0429	0.0104

ND= not detected, NA= not analyzed, NS= not sampled

Mercury by EPA method 1631E

POINT LOMA WASTEWATER TREATMENT PLANT

ANNUAL 2022

Ammonia-Nitrogen, Total Cyanides and Total Residual Chlorine

Analyte		Ammonia-N	Ammonia-N	Cyanide, Total	Cyanide, Total
MDL/ Units		0.3 mg/L	0.3 mg/L	0.004 mg/L	0.005 mg/L
Source		PLR	PLE	PLR	PLE
Limit			490		0.82
=====		=====		=====	
JANUARY -2022		42.0	43.0	<0.0040	ND
FEBRUARY -2022		44.5	43.9	ND	<0.0050
MARCH -2022		42.3	43.0	<0.0040	<0.0040
APRIL -2022		40.9	41.8	<0.0040	<0.0040
MAY -2022		42.2	41.6	ND	ND
JUNE -2022		41.5	40.7	ND	ND
JULY -2022		40.6	40.8	ND	ND
AUGUST -2022		40.4	40.3	<0.0040	<0.0040
SEPTEMBER-2022		37.9	37.8	<0.0040	<0.0040
OCTOBER -2022		39.4	38.7	ND	ND
NOVEMBER -2022		41.9	40.0	ND	ND
DECEMBER -2022		38.1	37.9	ND	ND
=====		=====		=====	
Average:		41.0	40.8	0.0000	0.0000

Analyte	Chlorine Residual, Total
MDL	0.065 mg/L
Source	PLE
Limit	1.6
=====	=====
JANUARY -2022	ND
FEBRUARY -2022	ND
MARCH -2022	ND
APRIL -2022	ND
MAY -2022	ND
JUNE -2022	ND
JULY -2022	ND
AUGUST -2022	ND
SEPTEMBER-2022	ND
OCTOBER -2022	ND
NOVEMBER -2022	ND
DECEMBER -2022	ND
=====	=====
Average:	ND

Ammonia Nitrogen (EPA Method 335.4/SM4500_G)
Cyanide Total (Method SM4500-NH3B.c)
Residual Chlorine (Method SM4500-CL.G)

NA= Not Analyzed
ND= Not Detected
NS= Not Sampled

POINT LOMA WASTEWATER TREATMENT PLANT

ANNUAL 2022

Radioactivity
EPA Method 900.0

Source	Month	Gross Alpha Radiation	Gross Beta Radiation
=====	=====	=====	=====
PLR	JANUARY -2022	8.6±1.7	6.8±1.4
PLR	FEBRUARY -2022	7.1±2.1	5.4±1.3
PLR	MARCH -2022	8.7±1.8	6.1±1.4
PLR	APRIL -2022	7.7±1.9	6.4±1.3
PLR	MAY -2022	8.7±1.9	7.4±1.1
PLR	JUNE -2022	9.4±1.8	7.2±1.3
PLR	JULY -2022	8.3±2.3	2.3±1.6
PLR	AUGUST -2022	6.8±2.8	22.7±2.3
PLR	SEPTEMBER-2022	5.2±3.0	21.6±2.2
PLR	OCTOBER -2022	4.9±2.5	5.3±1.7
PLR	NOVEMBER -2022	5.4±2.8	20.8±4.3
PLR	DECEMBER -2022	3.4±1.5	5.0±1.6
=====	=====	=====	=====
AVERAGE		7.0±2.2	9.6±1.8

Source	Month	Gross Alpha Radiation	Gross Beta Radiation
=====	=====	=====	=====
PLE	JANUARY -2022	7.2±1.6	5.4±1.3
PLE	FEBRUARY -2022	9.2±2.1	6.9±1.4
PLE	MARCH -2022	6.4±1.7	6.3±1.3
PLE	APRIL -2022	9.1±1.8	7.0±1.3
PLE	MAY -2022	8.3±2.2	7.7±1.3
PLE	JUNE -2022	5.5±1.9	6.9±1.3
PLE	JULY -2022	5.0±2.3	4.3±1.7
PLE	AUGUST -2022	8.3±3.0	7.9±1.8
PLE	SEPTEMBER-2022	4.1±2.1	18.5±2.2
PLE	OCTOBER -2022	5.0±3.2	16.6±2.1
PLE	NOVEMBER -2022	5.9±3.3	22.0±4.7
PLE	DECEMBER -2022	3.7±2.4	10.0±1.9
=====	=====	=====	=====
AVERAGE		6.2±2.3	10.0±1.9

ND= not detected, NA= not analyzed, NS= not sampled

Units in picocuries/liter (pCi/L)

Analyzed by: FGL Environmental Agricultural Analytical

POINT LOMA WASTEWATER TREATMENT PLANT

ANNUAL 2022

Chlorinated Pesticide Analysis
EPA Method 608.3

Source Date Analyte	MDL	Units	PLR JAN Avg	PLR FEB Avg	PLR MAR Avg	PLR APR Avg	PLR MAY Avg	PLR JUN Avg	PLR JUL Avg	PLR AUG Avg	PLR SEP Avg	PLR OCT Avg	PLR NOV Avg	PLR DEC Avg	PLR Average
=====	=====	=====	=====	=====	=====	=====	=====	=====	=====	=====	=====	=====	=====	=====	=====
Aldrin	11.6	NG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Dieldrin	9.76	NG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
BHC, Alpha isomer	11.5	NG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
BHC, Beta isomer	12.8	NG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
BHC, Gamma isomer	11.5	NG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
BHC, Delta isomer	11.1	NG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
p,p-DDD	26.1	NG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
p,p-DDE	11.4	NG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
p,p-DDT	69.2	NG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
o,p-DDD	11.6	NG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
o,p-DDE	12.2	NG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
o,p-DDT	7.76	NG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Heptachlor	11.2	NG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Heptachlor epoxide	13.5	NG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Alpha (cis) Chlordane	32.7	NG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Gamma (trans) Chlordane	13.5	NG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Alpha Chlordene		NG/L	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA
Gamma Chlordene		NG/L	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA
Oxychlordane	18.5	NG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Trans Nonachlor	12.4	NG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Cis Nonachlor	11.2	NG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Alpha Endosulfan	12	NG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Beta Endosulfan	15.4	NG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Endosulfan Sulfate	12.4	NG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Endrin	10.5	NG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Endrin aldehyde	12	NG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Mirex	23.7	NG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Methoxychlor	130	NG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Toxaphene	928	NG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
PCB 1016	732	NG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
PCB 1221	888	NG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
PCB 1232	888	NG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
PCB 1242	888	NG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
PCB 1248	888	NG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
PCB 1254	888	NG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
PCB 1260	888	NG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
PCB 1262	888	NG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
=====	=====	=====	=====	=====	=====	=====	=====	=====	=====	=====	=====	=====	=====	=====	=====
Aldrin + Dieldrin	11.6	NG/L	0	0	0	0	0	0	0	0	0	0	0	0	0
Hexachlorocyclohexanes	12.8	NG/L	0	0	0	0	0	0	0	0	0	0	0	0	0
DDT and derivatives	69.2	NG/L	0	0	0	0	0	0	0	0	0	0	0	0	0
Chlordane + related cmpds.	32.7	NG/L	0	0	0	0	0	0	0	0	0	0	0	0	0
Polychlorinated biphenyls	888	NG/L	0	0	0	0	0	0	0	0	0	0	0	0	0
Endosulfans	15.4	NG/L	0	0	0	0	0	0	0	0	0	0	0	0	0
=====	=====	=====	=====	=====	=====	=====	=====	=====	=====	=====	=====	=====	=====	=====	=====
Heptachlors	13.5	NG/L	0	0	0	0	0	0	0	0	0	0	0	0	0
=====	=====	=====	=====	=====	=====	=====	=====	=====	=====	=====	=====	=====	=====	=====	=====
Chlorinated Hydrocarbons	928	NG/L	0	0	0	0	0	0	0	0	0	0	0	0	0

ND=not detected; NS=not sampled; NA=not analyzed

Standards for alpha and gamma chlordene are no longer available in the U.S. for the analysis of these compounds.

POINT LOMA WASTEWATER TREATMENT PLANT

ANNUAL 2022

Chlorinated Pesticide Analysis
EPA Method 608.3

Source Date Analyte	Max MDL	Units	PLE JAN Avg	PLE FEB Avg	PLE MAR Avg	PLE APR Avg	PLE MAY Avg	PLE JUN Avg	PLE JUL Avg	PLE AUG Avg	PLE SEP Avg	PLE OCT Avg	PLE NOV Avg	PLE DEC Avg	PLE Average
=====															
Aldrin	11.6	NG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Dieldrin	9.76	NG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
BHC, Alpha isomer	11.5	NG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
BHC, Beta isomer	12.8	NG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
BHC, Gamma isomer	11.5	NG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
BHC, Delta isomer	11.1	NG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
p,p-DDD	26.1	NG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
p,p-DDE	11.4	NG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
p,p-DDT	69.2	NG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
o,p-DDD	11.6	NG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
o,p-DDE	12.2	NG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
o,p-DDT	7.76	NG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Heptachlor	11.2	NG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Heptachlor epoxide	13.5	NG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Alpha (cis) Chlordane	32.7	NG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Gamma (trans) Chlordane	13.5	NG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Alpha Chlordene		NG/L	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA
Gamma Chlordene		NG/L	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA
Oxychlordane	18.5	NG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Trans Nonachlor	12.4	NG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Cis Nonachlor	11.2	NG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Alpha Endosulfan	12	NG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Beta Endosulfan	15.4	NG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Endosulfan Sulfate	12.4	NG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Endrin	10.5	NG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Endrin aldehyde	12	NG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Mirex	23.7	NG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Methoxychlor	130	NG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Toxaphene	928	NG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
PCB 1016	732	NG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
PCB 1221	888	NG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
PCB 1232	888	NG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
PCB 1242	888	NG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
PCB 1248	888	NG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
PCB 1254	888	NG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
PCB 1260	888	NG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
PCB 1262	888	NG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
=====															
Aldrin + Dieldrin	11.6	NG/L	0	0	0	0	0	0	0	0	0	0	0	0	0
Hexachlorocyclohexanes	12.8	NG/L	0	0	0	0	0	0	0	0	0	0	0	0	0
DDT and derivatives	69.2	NG/L	0	0	0	0	0	0	0	0	0	0	0	0	0
Chlordane + related cmpds.	32.7	NG/L	0	0	0	0	0	0	0	0	0	0	0	0	0
Polychlorinated biphenyls	888	NG/L	0	0	0	0	0	0	0	0	0	0	0	0	0
Endosulfans	15.4	NG/L	0	0	0	0	0	0	0	0	0	0	0	0	0
=====															
Heptachlors	13.5	NG/L	0	0	0	0	0	0	0	0	0	0	0	0	0
=====															
Chlorinated Hydrocarbons	928	NG/L	0	0	0	0	0	0	0	0	0	0	0	0	0

ND=not detected; NS=not sampled; NA=not analyzed

Standards for alpha and gamma chlordene are no longer available in the U.S. for the analysis of these compounds.

POINT LOMA WASTEWATER TREATMENT PLANT

ANNUAL 2022

Organophosphorus Pesticides
EPA Method 614

Source Date Analyte	Max MDL Units	PLR 03-JAN-2022 P1278424	PLR 01-FEB-2022 P1282716	PLR 07-MAR-2022 P1290175	PLR 04-APR-2022 P1295046	PLR 10-MAY-2022 P1300318	PLR 01-JUN-2022 P1305763
Demeton O	15.1 UG/L	ND	ND	ND	ND	ND	ND
Demeton S	33.3 UG/L	ND	ND	ND	ND	ND	ND
Diazinon	16.7 UG/L	ND	ND	ND	ND	ND	ND
Guthion	65.5 UG/L	ND	ND	ND	ND	ND	ND
Malathion	12.2 UG/L	ND	ND	ND	ND	ND	ND
Parathion	10.1 UG/L	ND	ND	ND	ND	ND	ND
Chlorpyrifos	12.4 UG/L	ND	ND	ND	ND	ND	ND
Coumaphos	27.8 UG/L	ND	ND	ND	ND	ND	ND
Dichlorvos	14.6 UG/L	ND	ND	ND	ND	ND	ND
Disulfoton	9.28 UG/L	ND	ND	ND	ND	ND	ND
Stirophos	19.9 UG/L	ND	ND	ND	ND	ND	ND
Thiophosphorus Pesticides	65.5 UG/L	0.00	0.00	0.00	0.00	0.00	0.00
Demeton -O, -S	33.3 UG/L	0.00	0.00	0.00	0.00	0.00	0.00
Total Organophosphorus Pesticides	65.5 UG/L	0.00	0.00	0.00	0.00	0.00	0.00

Source Date Analyte	Max MDL Units	PLR 06-JUL-2022 P1311425	PLR 03-AUG-2022 P1316280	PLR 07-SEP-2022 P1322242	PLR 05-OCT-2022 P1326522	PLR 02-NOV-2022 P1331048	PLR 05-DEC-2022 P1338735
Demeton O	15.1 UG/L	ND	ND	ND	ND	ND	ND
Demeton S	33.3 UG/L	ND	ND	ND	ND	ND	ND
Diazinon	16.7 UG/L	ND	ND	ND	ND	ND	ND
Guthion	65.5 UG/L	ND	ND	ND	ND	ND	ND
Malathion	12.2 UG/L	ND	ND	ND	ND	ND	ND
Parathion	10.1 UG/L	ND	ND	ND	ND	ND	ND
Chlorpyrifos	12.4 UG/L	ND	ND	ND	ND	ND	ND
Coumaphos	27.8 UG/L	ND	ND	ND	ND	ND	ND
Dichlorvos	14.6 UG/L	ND	ND	ND	ND	ND	ND
Disulfoton	9.28 UG/L	ND	ND	ND	ND	ND	ND*
Stirophos	19.9 UG/L	ND	ND	ND	ND	ND	ND
Thiophosphorus Pesticides	65.5 UG/L	0.00	0.00	0.00	0.00	0.00	0.00
Demeton -O, -S	33.3 UG/L	0.00	0.00	0.00	0.00	0.00	0.00
Total Organophosphorus Pesticides	65.5 UG/L	0.00	0.00	0.00	0.00	0.00	0.00

NA= Not Analyzed, ND= Not Detected, NS= Not Sampled

* = The recovery of the analyte in the internal check sample is outside method acceptance limits.

POINT LOMA WASTEWATER TREATMENT PLANT

ANNUAL 2022

Organophosphorus Pesticides
EPA Method 614

Source			PLE	PLE	PLE	PLE	PLE
Date	Max		03-JAN-2022	01-FEB-2022	07-MAR-2022	04-APR-2022	10-MAY-2022
Analyte	MDL	Units	P1278421	P1282710	P1290172	P1295043	P1300312
Demeton O	15.1	UG/L	ND	ND	ND	ND	ND
Demeton S	33.3	UG/L	ND	ND	ND	ND	ND
Diazinon	16.7	UG/L	ND	ND	ND	ND	ND
Guthion	65.5	UG/L	ND	ND	ND	ND	ND
Malathion	12.2	UG/L	ND	ND	ND	ND	ND
Parathion	10.1	UG/L	ND	ND	ND	ND	ND
Chlorpyrifos	12.4	UG/L	ND	ND	ND	ND	ND
Coumaphos	27.8	UG/L	ND	ND	ND	ND	ND
Dichlorvos	14.6	UG/L	ND	ND	ND	ND	ND
Disulfoton	9.28	UG/L	ND	ND	ND	ND	ND
Stirophos	19.9	UG/L	ND	ND	ND	ND	ND
Thiophosphorus Pesticides	65.5	UG/L	0.00	0.00	0.00	0.00	0.00
Demeton -O, -S	33.3	UG/L	0.00	0.00	0.00	0.00	0.00
Total Organophosphorus Pesticides	65.5	UG/L	0.00	0.00	0.00	0.00	0.00

Source			PLE	PLE	PLE	PLE	PLE
Date	Max		01-JUN-2022	06-JUL-2022	03-AUG-2022	07-SEP-2022	05-OCT-2022
Analyte	MDL	Units	P1305760	P1311422	P1316277	P1322239	P1326519
Demeton O	15.1	UG/L	ND	ND	ND	ND	ND
Demeton S	33.3	UG/L	ND	ND	ND	ND	ND
Diazinon	16.7	UG/L	ND	ND	ND	ND	ND
Guthion	65.5	UG/L	ND	ND	ND	ND	ND
Malathion	12.2	UG/L	ND	ND	ND	ND	ND
Parathion	10.1	UG/L	ND	ND	ND	ND	ND
Chlorpyrifos	12.4	UG/L	ND	ND	ND	ND	ND
Coumaphos	27.8	UG/L	ND	ND	ND	ND	ND
Dichlorvos	14.6	UG/L	ND	ND	ND	ND	ND
Disulfoton	9.28	UG/L	ND	ND	ND	ND	ND
Stirophos	19.9	UG/L	ND	ND	ND	ND	ND
Thiophosphorus Pesticides	65.5	UG/L	0.00	0.00	0.00	0.00	0.00
Demeton -O, -S	33.3	UG/L	0.00	0.00	0.00	0.00	0.00
Total Organophosphorus Pesticides	65.5	UG/L	0.00	0.00	0.00	0.00	0.00

Source			PLE	PLE
Date			02-NOV-2022	05-DEC-2022
Analyte	MDL	Units	P1331045	P1338732
Demeton O	15.1	UG/L	ND	ND
Demeton S	33.3	UG/L	ND	ND
Diazinon	16.7	UG/L	ND	ND
Guthion	65.5	UG/L	ND	ND
Malathion	12.2	UG/L	ND	ND
Parathion	10.1	UG/L	ND	ND
Chlorpyrifos	12.4	UG/L	ND	ND
Coumaphos	27.8	UG/L	ND	ND
Dichlorvos	14.6	UG/L	ND	ND
Disulfoton	9.28	UG/L	ND	ND*
Stirophos	19.9	UG/L	ND	ND
Thiophosphorus Pesticides	65.5	UG/L	0.00	0.00
Demeton -O, -S	33.3	UG/L	0.00	0.00
Total Organophosphorus Pesticides	65.5	UG/L	0.00	0.00

NA= Not Analyzed, ND= Not Detected, NS= Not Sampled

* = The recovery of the analyte in the internal check sample is outside method acceptance limits.

POINT LOMA WASTEWATER TREATMENT PLANT

ANNUAL 2022

Tributyl Tin analysis
(in-house method)

Source Month	Max		PLR	PLR	PLR	PLR	PLR	PLR	PLR	PLR	PLR
Analyte	MDL	Units	JAN	FEB	MAR	APR	MAY	JUN	JUL	AUG	SEP
=====	=====	=====	=====	=====	=====	=====	=====	=====	=====	=====	=====
Dibutyltin	0.0207	UG/L	ND	ND	ND*	ND	ND	ND	ND	NA	NA
Monobutyltin	0.013	UG/L	ND	ND	ND	ND	ND	ND	ND	NA	NA
Tributyltin	0.0193	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND

Source Month	Max		PLR	PLR	PLR	
Analyte	MDL	Units	OCT	NOV	DEC	Average
=====	=====	=====	=====	=====	=====	=====
Dibutyltin	0.0207	UG/L	NA	NA	NA	ND
Monobutyltin	0.013	UG/L	NA	NA	NA	ND
Tributyltin	0.0193	UG/L	ND	ND	ND	ND

Source Month	Max		PLE	PLE	PLE	PLE	PLE	PLE	PLE	PLE	PLE
Analyte	MDL	Units	JAN	FEB	MAR	APR	MAY	JUN	JUL	AUG	SEP
=====	=====	=====	=====	=====	=====	=====	=====	=====	=====	=====	=====
Dibutyltin	0.0207	UG/L	ND	ND	ND*	ND	ND	ND	ND	NA	NA
Monobutyltin	0.013	UG/L	ND	ND	ND	ND	ND	ND	ND	NA	NA
Tributyltin	0.0193	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND

Source Month	Max		PLE	PLE	PLE	
Analyte	MDL	Units	OCT	NOV	DEC	Average
=====	=====	=====	=====	=====	=====	=====
Dibutyltin	0.0207	UG/L	NA	NA	NA	ND
Monobutyltin	0.013	UG/L	NA	NA	NA	ND
Tributyltin	0.0193	UG/L	ND	ND	ND	ND

ND=not detected, NS=not sampled, NA=not analyzed

DNQ= Detected but not quantified. Sample result is less than minimum Level but greater than or equal to MDL.

* = Relative percent difference of matrix spike duplicates outside quality control criteria; sample result not included in average calculations.

POINT LOMA WASTEWATER TREATMENT PLANT

ANNUAL 2022

Phenolic Compounds
EPA Method 625.1

Source Month Analyte	MDL	Units	PLR JAN Avg	PLR FEB Avg	PLR MAR Avg	PLR APR Avg	PLR MAY Avg	PLR JUN Avg	PLR JUL Avg	PLR AUG Avg	PLR SEP Avg	PLR OCT Avg	PLR NOV Avg	PLR DEC Avg	Average
=====	=====	=====	=====	=====	=====	=====	=====	=====	=====	=====	=====	=====	=====	=====	=====
2-Chlorophenol	0.12	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
4-Chloro-3-methylphenol	0.136	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
2,4-Dichlorophenol	0.115	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
2,4-Dimethylphenol	0.26	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
2,4-Dinitrophenol	0.549	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
4,6-dinitro-2-methylphenol	0.162	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
2-Nitrophenol	0.171	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
4-Nitrophenol	0.169	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Pentachlorophenol	0.367	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Phenol	0.178	UG/L	35.6	53.0	44.6	42.3	41.2	45.9	37.4	39.8	40.1	36.1	39.0	31.9	40.6
2,4,6-Trichlorophenol	0.136	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
2-Methylphenol	0.169	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
4-Methylphenol(3-MP is unresolved)	0.247	UG/L	69.0	85.9	79.7	74.5	70.6	79.5	56.5	64.2	63.3	58.7	68.9	66.7	69.8
2,4,5-Trichlorophenol	0.197	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
=====	=====	=====	=====	=====	=====	=====	=====	=====	=====	=====	=====	=====	=====	=====	=====
Total Chlorinated Phenols	0.367	UG/L	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Total Non-Chlorinated Phenols	0.549	UG/L	105	139	124	117	119	125	93.9	104	103	94.8	108	98.6	110
=====	=====	=====	=====	=====	=====	=====	=====	=====	=====	=====	=====	=====	=====	=====	=====
Phenols	0.549	UG/L	105	139	124	117	119	125	93.9	104	103	94.8	108	98.6	110

Source Month Analyte	MDL	Units	PLE JAN Avg	PLE FEB Avg	PLE MAR Avg	PLE APR Avg	PLE MAY Avg	PLE JUN Avg	PLE JUL Avg	PLE AUG Avg	PLE SEP Avg	PLE OCT Avg	PLE NOV Avg	PLE DEC Avg	Average
=====	=====	=====	=====	=====	=====	=====	=====	=====	=====	=====	=====	=====	=====	=====	=====
2-Chlorophenol	0.12	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
4-Chloro-3-methylphenol	0.136	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
2,4-Dichlorophenol	0.115	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
2,4-Dimethylphenol	0.26	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
2,4-Dinitrophenol	0.549	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
4,6-dinitro-2-methylphenol	0.162	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
2-Nitrophenol	0.171	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
4-Nitrophenol	0.169	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Pentachlorophenol	0.367	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Phenol	0.178	UG/L	22.1	37.9	30.0	29.6	27.8	31.1	26.4	23.1	25.1	20.3	23.1	19.3	26.3
2,4,6-Trichlorophenol	0.136	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	0.0
2-Methylphenol	0.169	UG/L	ND	ND	ND	ND	ND	ND	ND	0.6	ND	ND	ND	ND	0.05
4-Methylphenol(3-MP is unresolved)	0.247	UG/L	43.1	51.6	53.7	66.3	51.4	55.5	44.0	36.0	36.9	34.3	38.6	43.0	46.2
2,4,5-Trichlorophenol	0.197	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
=====	=====	=====	=====	=====	=====	=====	=====	=====	=====	=====	=====	=====	=====	=====	=====
Total Chlorinated Phenols	0.367	UG/L	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Total Non-Chlorinated Phenols	0.549	UG/L	65.2	89.5	83.7	95.9	79.2	86.6	70.4	59.1	62.6	54.6	61.7	62.3	72.6
=====	=====	=====	=====	=====	=====	=====	=====	=====	=====	=====	=====	=====	=====	=====	=====
Phenols	0.549	UG/L	65.2	89.5	83.7	95.9	79.2	86.6	70.4	59.1	62.6	54.6	61.7	62.3	72.6

ND=not detected; NS=not sampled; NA=not analyzed

POINT LOMA WASTEWATER TREATMENT PLANT
ANNUAL 2022

Priority Pollutants Base/Neutrals
EPA Method 625.1

Source Month Analyte	Max MDL	Units	PLR JAN Avg	PLR FEB Avg	PLR MAR Avg	PLR APR Avg	PLR MAY Avg	PLR JUN Avg	PLR JUL Avg	PLR AUG Avg	PLR SEP Avg	PLR OCT Avg	PLR NOV Avg	PLR DEC Avg	PLR Average
Acenaphthene	0.108	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Acenaphthylene	0.111	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Anthracene	0.0761	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Benzidine	3.2	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Benzo[a]anthracene	0.0796	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
3,4-Benzo(b)fluoranthene	0.131	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Benzo[k]fluoranthene	0.135	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Benzo[a]pyrene	0.139	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Benzo[g,h,i]perylene	0.14	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
4-Bromophenyl phenyl ether	0.143	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Bis-(2-chloroethoxy) methane	0.141	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Bis-(2-chloroethyl) ether	0.152	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Bis-(2-chloroisopropyl) ether	0.207	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
4-Chlorophenyl phenyl ether	0.144	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
2-Chloronaphthalene	0.102	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Chrysene	0.0811	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Dibenzo(a,h)anthracene	0.148	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Butyl benzyl phthalate	0.189	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Di-n-butyl phthalate	0.224	UG/L	ND	DNQ0.3	ND	ND	ND	0.52	DNQ0.2	0.86	0.73	0.78	ND	1.2#	DNQ0.28
Bis-(2-ethylhexyl) phthalate	2.93	UG/L	ND	<2.86	ND	ND	ND	3.78	ND	DNQ3.0	DNQ4.8	5.4^	6.97	7.4#	DNQ1.85
Diethyl phthalate	0.485	UG/L	1.7	1.9	2.3	1.9	2.7	2.3	2.7	2.5	1.2	2.5	2.7	2.9	2.3
Dimethyl phthalate	0.145	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Di-n-octyl phthalate	0.115	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
3,3-Dichlorobenzidine	3.54	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND*	ND	ND	ND	ND
2,4-Dinitrotoluene	0.179	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
2,6-Dinitrotoluene	0.241	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
1,2-Diphenylhydrazine	0.246	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Fluoranthene	0.0703	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Fluorene	0.142	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Hexachlorobenzene	0.0993	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Hexachlorobutadiene	0.106	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Hexachlorocyclopentadiene	0.187	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Hexachloroethane	0.123	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Indeno(1,2,3-CD)pyrene	0.134	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Isophorone	0.166	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Naphthalene	0.103	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Nitrobenzene	0.155	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
N-nitrosodimethylamine	0.214	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
N-nitrosodi-n-propylamine	0.205	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
N-nitrosodiphenylamine	0.202	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Phenanthrene	0.0449	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Pyrene	0.164	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
1,2,4-Trichlorobenzene	0.382	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Polynuc. Aromatic Hydrocarbons	0.164	UG/L	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Base/Neutral Compounds	3.54	UG/L	1.7	1.9	2.3	1.9	2.7	6.6	2.7	3.4	1.9	3.3	9.7	2.9	2.3

Additional Analytes Determined:

Benzo[e]pyrene	0.149	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Biphenyl	0.124	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
2,6-Dimethylnaphthalene	0.117	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
1-Methylnaphthalene	0.126	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
1-Methylphenanthrene	0.103	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
2-Methylnaphthalene	0.112	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
1,6,7-Trimethylnaphthalene	0.168	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Perylene	0.227	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND

ND=not detected; NS=not sampled; NA=not analyzed

DNQ= Detected but not quantified. Sample result is less than minimum Level but greater than or equal to MDL.

* = The percent recoveries of the analyte in the LCS and matrix spikes were not acceptable; incorrect spiking solution was used.

^ = The internal standard recovery in the sample is outside method acceptance limits.

= Analyte present in the method blank at a concentration greater than 10% of the sample result.

POINT LOMA WASTEWATER TREATMENT PLANT
ANNUAL 2022

Priority Pollutants Base/Neutrals
EPA Method 625.1

Source Month Analyte	Max MDL	Units	PLE JAN Avg	PLE FEB Avg	PLE MAR Avg	PLE APR Avg	PLE MAY Avg	PLE JUN Avg	PLE JUL Avg	PLE AUG Avg	PLE SEP Avg	PLE OCT Avg	PLE NOV Avg	PLE DEC Avg	PLE Average
Acenaphthene	0.108	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Acenaphthylene	0.111	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Anthracene	0.0761	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Benzidine	3.2	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Benzo[a]anthracene	0.0796	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
3,4-Benzo(b)fluoranthene	0.131	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Benzo[k]fluoranthene	0.135	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Benzo[a]pyrene	0.139	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Benzo[g,h,i]perylene	0.14	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
4-Bromophenyl phenyl ether	0.143	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Bis-(2-chloroethoxy) methane	0.141	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Bis-(2-chloroethyl) ether	0.152	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Bis-(2-chloroisopropyl) ether	0.207	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
4-Chlorophenyl phenyl ether	0.144	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
2-Chloronaphthalene	0.102	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Chrysene	0.0811	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Dibenzo(a,h)anthracene	0.148	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Butyl benzyl phthalate	0.189	UG/L	ND	ND	ND	ND	ND	ND	ND	DNQ0.2	ND	ND	ND	ND	0.0
Di-n-butyl phthalate	0.224	UG/L	ND	DNQ0.3	ND	ND	ND	0.55	DNQ0.2	0.71	0.82	ND	ND	0.45#	DNQ0.2
Bis-(2-ethylhexyl) phthalate	2.93	UG/L	DNQ5.1	ND	<2.78	ND	ND	3.91	DNQ2.7	<2.69	ND	DNQ5.7	8.17	3.6#	DNQ2.1
Diethyl phthalate	0.485	UG/L	2.8	2.0	3.4	2.0	2.2	2.5	2.9	2.2	DNQ1.1	2.9	2.4	2.8	DNQ2.4
Dimethyl phthalate	0.145	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	DNQ0.3	ND	ND	0.0
Di-n-octyl phthalate	0.115	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
3,3-Dichlorobenzidine	3.54	UG/L	ND	ND	ND	ND	ND	ND	ND	ND*	ND	ND	ND	ND	ND
2,4-Dinitrotoluene	0.179	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
2,6-Dinitrotoluene	0.241	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
1,2-Diphenylhydrazine	0.246	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Fluoranthene	0.0703	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Fluorene	0.142	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Hexachlorobenzene	0.0993	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Hexachlorobutadiene	0.106	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Hexachlorocyclopentadiene	0.187	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Hexachloroethane	0.123	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Indeno(1,2,3-CD)pyrene	0.134	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Isophorone	0.166	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Naphthalene	0.103	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Nitrobenzene	0.155	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
N-nitrosodimethylamine	0.214	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
N-nitrosodi-n-propylamine	0.205	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
N-nitrosodiphenylamine	0.202	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Phenanthrene	0.0449	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Pyrene	0.164	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
1,2,4-Trichlorobenzene	0.382	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Polynuc. Aromatic Hydrocarbons	0.164	UG/L	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Base/Neutral Compounds	3.54	UG/L	2.8	2.0	3.4	2.0	2.2	7.0	2.9	2.9	0.8	2.9	10.6	2.8	0.0

Additional Analytes Determined:

Benzo[e]pyrene	0.149	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Biphenyl	0.124	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
2,6-Dimethylnaphthalene	0.117	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
1-Methylnaphthalene	0.126	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
1-Methylphenanthrene	0.103	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
2-Methylnaphthalene	0.112	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
1,6,7-Trimethylnaphthalene	0.168	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Perylene	0.227	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND

ND=not detected; NS=not sampled; NA=not analyzed

DNQ= Detected but not quantified. Sample result is less than minimum Level but greater than or equal to MDL.

* = The percent recoveries of the analyte in the LCS and matrix spikes were not acceptable; incorrect spiking solution was used.

^ = The internal standard recovery in the sample is outside method acceptance limits.

= Analyte present in the method blank at a concentration greater than 10% of the sample result.

POINT LOMA WASTEWATER TREATMENT PLANT

ANNUAL 2022

Priority Pollutants Purgeables
EPA Method 624.1

Source Month	Max		PLE JAN	PLE FEB	PLE MAR	PLE APR	PLE MAY	PLE JUN	PLE JUL	PLE AUG	PLE SEP	PLE OCT
Analyte	MDL	Units	Avg	Avg	Avg	Avg	Avg	Avg	Avg	Avg	Avg	Avg
Acrolein	2.1	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Acrylonitrile	0.581	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Benzene	0.507	UG/L	ND	ND	DNQ0.4	ND	ND	ND	ND	ND	ND	ND
Bromodichloromethane	0.52	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Bromoform	0.637	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Bromomethane	1.69	UG/L	ND	ND	ND	ND	<0.8	ND	ND	ND	ND	ND
Carbon tetrachloride	0.575	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Chlorobenzene	0.435	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Chloroethane	0.814	UG/L	ND	1.1	ND	DNQ0.8	1.0	DNQ0.5	DNQ1.0	ND	1.1	ND
Chloroform	0.552	UG/L	6.9	15.1	5.7	9.6	2.9	4.9	5.2	2.9	4.6	4.1
Chloromethane	0.678	UG/L	DNQ0.3	6.0	DNQ1.8	3.7	3.1	2.1	7.1	DNQ1.1	6.7	ND
Dibromochloromethane	0.55	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
1,2-Dichlorobenzene	0.51	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
1,3-Dichlorobenzene	0.427	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
1,4-Dichlorobenzene	0.439	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
1,1-Dichloroethane	0.568	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
1,2-Dichloroethane	0.611	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
1,1-Dichloroethene	0.58	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
trans-1,2-dichloroethene	0.529	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
1,2-Dichloropropane	0.459	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
cis-1,3-dichloropropene	0.505	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
trans-1,3-dichloropropene	0.555	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Ethylbenzene	0.428	UG/L	ND	ND	DNQ0.6	ND	DNQ0.3	ND	ND	<0.4	ND	ND
Methylene chloride	0.672	UG/L	DNQ0.7	DNQ0.9	DNQ0.8	DNQ0.9	DNQ0.7	DNQ0.6	3.0	DNQ0.7	DNQ0.9	DNQ1.2
1,1,2,2-Tetrachloroethane	0.412	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Tetrachloroethene	0.594	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Toluene	0.467	UG/L	DNQ0.7	DNQ0.8	3.7	DNQ1.0	DNQ2.0	DNQ1.1	DNQ1.2	2.7	DNQ0.9	DNQ0.8
1,1,1-Trichloroethane	0.547	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
1,1,2-Trichloroethane	0.504	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Trichloroethene	0.456	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Trichlorofluoromethane	0.554	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Vinyl chloride	0.777	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Halomethane Purgeable Cmpnds	1.69	UG/L	0.0	6.0	1.0	3.7	3.1	2.1	7.1	0.0	6.7	0.0
Dichlorobenzenes	0.51	UG/L	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Total Chloromethanes	0.678	UG/L	6.9	21.1	5.7	13.3	6.0	7.0	15.3	2.9	11.3	4.1
Purgeable Compounds	2.1	UG/L	6.9	22.0	9.40	13.3	7.6	7.0	15.3	2.9	12.4	4.1

Additional Analytes Determined:

Acetone	8.16	UG/L	NA	NA	463	NA	NA	NA	NA	NA	NA	NA
Allyl chloride	0.588	UG/L	NA	NA	ND	NA	NA	NA	NA	NA	NA	NA
Benzyl chloride	0.701	UG/L	NA	NA	ND	NA	NA	NA	NA	NA	NA	NA
2-Butanone	6.32	UG/L	NA	NA	DNQ7.3	NA	NA	NA	NA	NA	NA	NA
Carbon disulfide	1.6	UG/L	NA	NA	1.7	NA	NA	NA	NA	NA	NA	NA
Chloroprene	0.585	UG/L	NA	NA	ND	NA	NA	NA	NA	NA	NA	NA
1,2-Dibromoethane	0.483	UG/L	NA	NA	ND	NA	NA	NA	NA	NA	NA	NA
Isopropylbenzene	0.432	UG/L	NA	NA	ND	NA	NA	NA	NA	NA	NA	NA
Methyl Iodide	1.47	UG/L	NA	NA	ND	NA	NA	NA	NA	NA	NA	NA
Methyl methacrylate	0.672	UG/L	NA	NA	ND	NA	NA	NA	NA	NA	NA	NA
Methyl tert-butyl ether	0.669	UG/L	NA	NA	ND	NA	NA	NA	NA	NA	NA	NA
2-Nitropropane	0.953	UG/L	NA	NA	ND	NA	NA	NA	NA	NA	NA	NA
ortho-xylene	0.421	UG/L	NA	NA	1.2	NA	NA	NA	NA	NA	NA	NA
Styrene	0.648	UG/L	NA	NA	ND	NA	NA	NA	NA	NA	NA	NA
meta,para xylenes	0.83	UG/L	NA	NA	2.4	NA	NA	NA	NA	NA	NA	NA
4-Methyl-2-pentanone	0.627	UG/L	NA	NA	ND	NA	NA	NA	NA	NA	NA	NA

ND=not detected; NS=not sampled; NA=not analyzed

DNQ= Detected but not quantified. Sample result is less than minimum Level but greater than or equal to MDL.

POINT LOMA WASTEWATER TREATMENT PLANT

ANNUAL 2022

Priority Pollutants Purgeables
EPA Method 624.1

Source Month Analyte	Max MDL	Units	PLE NOV Avg	PLE DEC Avg	PLE Average
Acrolein	2.1	UG/L	ND	ND	ND
Acrylonitrile	0.581	UG/L	ND	ND	ND
Benzene	0.507	UG/L	ND	ND	0.0
Bromodichloromethane	0.52	UG/L	ND	ND	ND
Bromoform	0.637	UG/L	ND	ND	ND
Bromomethane	1.69	UG/L	ND	ND	0.0
Carbon tetrachloride	0.575	UG/L	ND	ND	ND
Chlorobenzene	0.435	UG/L	ND	ND	ND
Chloroethane	0.814	UG/L	1.2	ND	DNQ0.6
Chloroform	0.552	UG/L	4.9	DNQ2.0	DNQ5.7
Chloromethane	0.678	UG/L	6.5	DNQ1.2	DNQ3.3
Dibromochloromethane	0.55	UG/L	ND	ND	ND
1,2-Dichlorobenzene	0.51	UG/L	ND	ND	ND
1,3-Dichlorobenzene	0.427	UG/L	ND	ND	ND
1,4-Dichlorobenzene	0.439	UG/L	ND	ND	ND
1,1-Dichloroethane	0.568	UG/L	ND	ND	ND
1,2-Dichloroethane	0.611	UG/L	ND	ND	ND
1,1-Dichloroethene	0.58	UG/L	ND	ND	ND
trans-1,2-dichloroethene	0.529	UG/L	ND	ND	ND
1,2-Dichloropropane	0.459	UG/L	ND	ND	ND
cis-1,3-dichloropropene	0.505	UG/L	ND	ND	ND
trans-1,3-dichloropropene	0.555	UG/L	ND	ND	ND
Ethylbenzene	0.428	UG/L	ND	ND	DNQ0.1
Methylene chloride	0.672	UG/L	ND	ND	DNQ0.9
1,1,2,2-Tetrachloroethane	0.412	UG/L	ND	ND	ND
Tetrachloroethene	0.594	UG/L	ND	ND	ND
Toluene	0.467	UG/L	DNQ1.2	DNQ0.5	DNQ1.4
1,1,1-Trichloroethane	0.547	UG/L	ND	ND	ND
1,1,2-Trichloroethane	0.504	UG/L	ND	ND	ND
Trichloroethene	0.456	UG/L	ND	ND	ND
Trichlorofluoromethane	0.554	UG/L	ND	ND	ND
Vinyl chloride	0.777	UG/L	ND	ND	ND
Halomethane Purgeable Cmpnds	1.69	UG/L	6.5	0.0	3.1
Dichlorobenzenes	0.51	UG/L	0.0	0.0	0.0
Total Chloromethanes	0.678	UG/L	11.4	0.0	9.0
Purgeable Compounds	2.1	UG/L	12.6	0.0	9.46

Additional Analytes Determined:

Acetone	8.16	UG/L	NA	NA	463
Allyl chloride	0.588	UG/L	NA	NA	ND
Benzyl chloride	0.701	UG/L	NA	NA	ND
2-Butanone	6.32	UG/L	NA	NA	DNQ7.3
Carbon disulfide	1.6	UG/L	NA	NA	1.7
Chloroprene	0.585	UG/L	NA	NA	ND
1,2-Dibromoethane	0.483	UG/L	NA	NA	ND
Isopropylbenzene	0.432	UG/L	NA	NA	ND
Methyl Iodide	1.47	UG/L	NA	NA	ND
Methyl methacrylate	0.672	UG/L	NA	NA	ND
Methyl tert-butyl ether	0.669	UG/L	NA	NA	ND
2-Nitropropane	0.953	UG/L	NA	NA	ND
ortho-xylene	0.421	UG/L	NA	NA	1.2
Styrene	0.648	UG/L	NA	NA	ND
meta,para xylenes	0.83	UG/L	NA	NA	2.4
4-Methyl-2-pentanone	0.627	UG/L	NA	NA	ND

ND=not detected; NS=not sampled; NA=not analyzed

DNQ= Detected but not quantified. Sample result is less than minimum Level but greater than or equal to MDL.

POINT LOMA WASTEWATER TREATMENT PLANT

ANNUAL 2022

Priority Pollutants Purgeables
EPA Method 624.1

Source Month Analyte	Max MDL	Units	PLR JAN Avg	PLR FEB Avg	PLR MAR Avg	PLR APR Avg	PLR MAY Avg	PLR JUN Avg	PLR JUL Avg	PLR AUG Avg	PLR SEP Avg	PLR OCT Avg
Acrolein	2.1	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Acrylonitrile	0.581	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Benzene	0.507	UG/L	ND	ND	DNQ0.3	ND	ND	ND	ND	ND	ND	ND
Bromodichloromethane	0.52	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Bromoform	0.637	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Bromomethane	1.69	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Carbon tetrachloride	0.575	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Chlorobenzene	0.435	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Chloroethane	0.814	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Chloroform	0.552	UG/L	3.7	7.4	5.0	6.1	2.2	5.0	2.6	2.4	2.6	4.1
Chloromethane	0.678	UG/L	DNQ0.3	DNQ0.3	DNQ0.4	DNQ0.3	DNQ0.3	ND	ND	ND	ND	ND
Dibromochloromethane	0.55	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
1,2-Dichlorobenzene	0.51	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
1,3-Dichlorobenzene	0.427	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
1,4-Dichlorobenzene	0.439	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
1,1-Dichloroethane	0.568	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
1,2-Dichloroethane	0.611	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
1,1-Dichloroethene	0.58	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
trans-1,2-dichloroethene	0.529	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
1,2-Dichloropropane	0.459	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
cis-1,3-dichloropropene	0.505	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
trans-1,3-dichloropropene	0.555	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Ethylbenzene	0.428	UG/L	ND	ND	DNQ0.5	ND	ND	ND	ND	ND	ND	ND
Methylene chloride	0.672	UG/L	DNQ0.6	DNQ0.8	DNQ0.9	DNQ0.8	DNQ0.7	DNQ0.7	3.2	ND	DNQ1.0	DNQ1.3
1,1,2,2-Tetrachloroethane	0.412	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Tetrachloroethene	0.594	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Toluene	0.467	UG/L	DNQ0.4	DNQ0.6	2.3	DNQ0.9	DNQ1.1	DNQ0.8	DNQ0.6	DNQ0.8	DNQ0.7	DNQ1.0
1,1,1-Trichloroethane	0.547	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
1,1,2-Trichloroethane	0.504	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Trichloroethene	0.456	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Trichlorofluoromethane	0.554	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Vinyl chloride	0.777	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Halomethane Purgeable Cmpnds	1.69	UG/L	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Dichlorobenzenes	0.51	UG/L	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Total Chloromethanes	0.678	UG/L	3.7	7.4	5.0	6.1	2.2	5.0	5.8	2.4	2.6	4.1
Purgeable Compounds	2.1	UG/L	3.7	7.4	7.3	6.1	2.2	5.0	5.8	2.4	2.6	4.1

ND=not detected; NS=not sampled; NA=not analyzed

POINT LOMA WASTEWATER TREATMENT PLANT

ANNUAL 2022

Priority Pollutants Purgeables
EPA Method 624.1

Source Month Analyte	Max MDL	Units	PLR NOV Avg	PLR DEC Avg	PLR Average
=====	=====	=====	=====	=====	=====
Acrolein	2.1	UG/L	ND	ND	ND
Acrylonitrile	0.581	UG/L	ND	ND	ND
Benzene	0.507	UG/L	ND	ND	0.0
Bromodichloromethane	0.52	UG/L	ND	ND	ND
Bromoform	0.637	UG/L	ND	ND	ND
Bromomethane	1.69	UG/L	ND	ND	ND
Carbon tetrachloride	0.575	UG/L	ND	ND	ND
Chlorobenzene	0.435	UG/L	ND	ND	ND
Chloroethane	0.814	UG/L	ND	ND	ND
Chloroform	0.552	UG/L	2.1	DNQ1.3	DNQ3.7
Chloromethane	0.678	UG/L	ND	ND	DNQ0.1
Dibromochloromethane	0.55	UG/L	ND	ND	ND
1,2-Dichlorobenzene	0.51	UG/L	ND	ND	ND
1,3-Dichlorobenzene	0.427	UG/L	ND	ND	ND
1,4-Dichlorobenzene	0.439	UG/L	ND	ND	ND
Dichlorodifluoromethane	1.16	UG/L	NA	NA	NA
1,1-Dichloroethane	0.568	UG/L	ND	ND	ND
1,2-Dichloroethane	0.611	UG/L	ND	ND	ND
1,1-Dichloroethene	0.58	UG/L	ND	ND	ND
trans-1,2-dichloroethene	0.529	UG/L	ND	ND	ND
1,2-Dichloropropane	0.459	UG/L	ND	ND	ND
cis-1,3-dichloropropene	0.505	UG/L	ND	ND	ND
trans-1,3-dichloropropene	0.555	UG/L	ND	ND	ND
Ethylbenzene	0.428	UG/L	ND	ND	0.0
Methylene chloride	0.672	UG/L	ND	ND	DNQ0.8
1,1,2,2-Tetrachloroethane	0.412	UG/L	ND	ND	ND
Tetrachloroethene	0.594	UG/L	ND	ND	ND
Toluene	0.467	UG/L	DNQ0.5	DNQ0.6	DNQ0.9
1,1,1-Trichloroethane	0.547	UG/L	ND	ND	ND
1,1,2-Trichloroethane	0.504	UG/L	ND	ND	ND
Trichloroethene	0.456	UG/L	ND	ND	ND
Trichlorofluoromethane	0.554	UG/L	ND	ND	ND
Vinyl chloride	0.777	UG/L	ND	ND	ND
=====	=====	=====	=====	=====	=====
Halomethane Purgeable Cmpnds	1.69	UG/L	0.0	0.0	0.0
Dichlorobenzenes	0.51	UG/L	0.0	0.0	0.0
Total Chloromethanes	0.678	UG/L	2.1	0.0	3.9
=====	=====	=====	=====	=====	=====
Purgeable Compounds	2.1	UG/L	2.1	0.0	4.1

ND=not detected; NS=not sampled; NA=not analyzed

POINT LOMA WASTEWATER TREATMENT

ANNUAL 2022

Dioxin and Furan Analysis
EPA Method 1613

Source Month Analyte	Max MDL	Units	PLR JAN P1278424	PLR FEB P1282716	PLR MAR P289898	PLR APR P1295046	PLR MAY P1300318	PLR JUN P1305763	PLR JUL P1311702	PLR AUG P1316280
=====	=====	=====	=====	=====	=====	=====	=====	=====	=====	=====
2,3,7,8-tetra CDD	0.64	PG/L	ND	ND	ND	ND	ND	ND	ND	ND
1,2,3,7,8-penta CDD	0.783	PG/L	ND	ND	ND	ND	ND	ND	ND	ND
1,2,3,4,7,8-hexa CDD	1.3	PG/L	ND	ND	ND	ND	ND	ND	ND	ND
1,2,3,6,7,8-hexa CDD	1.39	PG/L	ND	ND	ND	ND	ND	ND	ND	ND
1,2,3,7,8,9-hexa CDD	1.28	PG/L	ND	ND	ND	ND	ND	ND	ND	ND
1,2,3,4,6,7,8-hepta CDD	1.17	PG/L	DNQ9.43	DNQ18.5	DNQ9.22	DNQ5.38	DNQ7.48	DNQ9.94	26.6	DNQ8.66
octa CDD	2	PG/L	92.0	160	87.0	DNQ40.6	67.0	84.0	280	78.0
2,3,7,8-tetra CDF	0.624	PG/L	ND	ND	ND	ND	ND	ND	ND	ND
1,2,3,7,8-penta CDF	0.751	PG/L	ND	ND	ND	ND	ND	ND	ND	ND
2,3,4,7,8-penta CDF	0.793	PG/L	ND	ND	ND	ND	ND	ND	ND	ND
1,2,3,4,7,8-hexa CDF	0.781	PG/L	ND	ND	ND	ND	ND	ND	ND	ND
1,2,3,6,7,8-hexa CDF	0.803	PG/L	ND	ND	ND	ND	ND	DNQ1.90	ND	ND
1,2,3,7,8,9-hexa CDF	0.973	PG/L	ND	ND	ND	ND	ND	ND	ND	ND
2,3,4,6,7,8-hexa CDF	0.827	PG/L	ND	ND	ND	ND	ND	ND	ND	ND
1,2,3,4,6,7,8-hepta CDF	0.773	PG/L	DNQ2.85	DNQ4.91	DNQ2.47	ND	ND	DNQ2.78	DNQ4.74	ND
1,2,3,4,7,8,9-hepta CDF	0.978	PG/L	ND	ND	ND	ND	ND	ND	ND	ND
octa CDF	1.71	PG/L	DNQ5.71	DNQ14.3	DNQ5.45	ND	ND	DNQ4.87	DNQ11.0	ND

Source Month Analyte	Max MDL	Units	PLR SEP P1322242	PLR OCT P1326522	PLR NOV P1331048	PLR DEC P1338735
=====	=====	=====	=====	=====	=====	=====
2,3,7,8-tetra CDD	0.64	PG/L	ND	ND	ND	ND
1,2,3,7,8-penta CDD	0.783	PG/L	ND	ND	ND	ND
1,2,3,4,7,8-hexa CDD	1.3	PG/L	ND	ND	ND	ND
1,2,3,6,7,8-hexa CDD	1.39	PG/L	ND	ND	ND	ND
1,2,3,7,8,9-hexa CDD	1.28	PG/L	ND	ND	ND	ND
1,2,3,4,6,7,8-hepta CDD	1.17	PG/L	DNQ9.80	DNQ10.7	DNQ22.1	DNQ12.9
octa CDD	2	PG/L	66.0	78.0	280	110
2,3,7,8-tetra CDF	0.624	PG/L	ND	ND	ND	ND
1,2,3,7,8-penta CDF	0.751	PG/L	ND	ND	ND	ND
2,3,4,7,8-penta CDF	0.793	PG/L	ND	ND	ND	ND
1,2,3,4,7,8-hexa CDF	0.781	PG/L	ND	ND	ND	ND
1,2,3,6,7,8-hexa CDF	0.803	PG/L	ND	ND	DNQ3.43	ND
1,2,3,7,8,9-hexa CDF	0.973	PG/L	ND	ND	ND	ND
2,3,4,6,7,8-hexa CDF	0.827	PG/L	ND	ND	ND	ND
1,2,3,4,6,7,8-hepta CDF	0.773	PG/L	ND	ND	DNQ5.43	ND
1,2,3,4,7,8,9-hepta CDF	0.978	PG/L	ND	ND	ND	ND
octa CDF	1.71	PG/L	ND	ND	DNQ7.92	ND

Above are permit required CDD/CDF isomers.

ND=not detected; NS=not sampled; NA=not analyzed; NR=not required

DNQ= Detected but not quantified. Sample result is less than minimum level but greater than or equal to MDL.

ANALYZED BY: Frontier Analytical Laboratories

POINT LOMA WASTEWATER TREATMENT

ANNUAL 2022

Dioxin and Furan Analysis
EPA Method 1613

Analyte	MDL	Units	PLE	PLE	PLE	PLE	PLE	PLE	PLE	PLE
			JAN	FEB	MAR	APR	MAY	JUN	JUL	AUG
			P1278421	P1282710	P1322239	P1295043	P1300312	P1305760	P1311699	P1316277
2,3,7,8-tetra CDD	0.64	PG/L	ND	ND	ND	ND	ND	ND	ND	ND
1,2,3,7,8-penta CDD	0.783	PG/L	ND	ND	ND	ND	ND	ND	ND	ND
1,2,3,4,7,8-hexa CDD	1.3	PG/L	ND	ND	ND	ND	ND	ND	ND	ND
1,2,3,6,7,8-hexa CDD	1.39	PG/L	ND	ND	ND	ND	ND	ND	ND	ND
1,2,3,7,8,9-hexa CDD	1.28	PG/L	ND	ND	ND	ND	ND	ND	ND	ND
1,2,3,4,6,7,8-hepta CDD	1.17	PG/L	DNQ2.89	ND	DNQ1.98	DNQ4.02	DNQ4.66	DNQ3.48	DNQ3.40	DNQ17.50
octa CDD	2	PG/L	DNQ18.0	DNQ47.0	DNQ12.0	DNQ29.0	DNQ29.0	DNQ22.0	DNQ16.0	DNQ340.0
2,3,7,8-tetra CDF	0.624	PG/L	ND	ND	ND	ND	ND	ND	ND	ND
1,2,3,7,8-penta CDF	0.751	PG/L	ND	ND	ND	ND	ND	ND	ND	ND
2,3,4,7,8-penta CDF	0.793	PG/L	ND	ND	ND	ND	ND	ND	ND	ND
1,2,3,4,7,8-hexa CDF	0.781	PG/L	ND	ND	ND	ND	ND	ND	ND	ND
1,2,3,6,7,8-hexa CDF	0.803	PG/L	ND	ND	ND	ND	ND	ND	ND	ND
1,2,3,7,8,9-hexa CDF	0.973	PG/L	ND	ND	ND	ND	ND	ND	ND	ND
2,3,4,6,7,8-hexa CDF	0.827	PG/L	ND	ND	ND	ND	ND	ND	ND	ND
1,2,3,4,6,7,8-hepta CDF	0.773	PG/L	ND	ND	ND	ND	ND	ND	ND	ND
1,2,3,4,7,8,9-hepta CDF	0.978	PG/L	ND	ND	ND	ND	ND	ND	ND	ND
octa CDF	1.71	PG/L	ND	ND	ND	ND	ND	ND	ND	DNQ4.5

Analyte	MDL	Units	PLE	PLE	PLE	PLE
			SEP	OCT	NOV	DEC
			P1322239	P1326519	P1331045	P1338732
2,3,7,8-tetra CDD	0.64	PG/L	ND	ND	ND	ND
1,2,3,7,8-penta CDD	0.783	PG/L	ND	ND	ND	ND
1,2,3,4,7,8-hexa CDD	1.3	PG/L	ND	ND	ND	ND
1,2,3,6,7,8-hexa CDD	1.39	PG/L	ND	ND	ND	ND
1,2,3,7,8,9-hexa CDD	1.28	PG/L	ND	ND	ND	ND
1,2,3,4,6,7,8-hepta CDD	1.17	PG/L	ND	ND	ND	ND
octa CDD	2	PG/L	ND	ND	DNQ9.1	DNQ12.0
2,3,7,8-tetra CDF	0.624	PG/L	ND	ND	ND	ND
1,2,3,7,8-penta CDF	0.751	PG/L	ND	ND	ND	ND
2,3,4,7,8-penta CDF	0.793	PG/L	ND	ND	ND	ND
1,2,3,4,7,8-hexa CDF	0.781	PG/L	ND	ND	ND	ND
1,2,3,6,7,8-hexa CDF	0.803	PG/L	ND	ND	ND	ND
1,2,3,7,8,9-hexa CDF	0.973	PG/L	ND	ND	ND	ND
2,3,4,6,7,8-hexa CDF	0.827	PG/L	ND	ND	ND	ND
1,2,3,4,6,7,8-hepta CDF	0.773	PG/L	ND	ND	ND	ND
1,2,3,4,7,8,9-hepta CDF	0.978	PG/L	ND	ND	ND	ND
octa CDF	1.71	PG/L	ND	ND	ND	ND

Above are permit required CDD/CDF isomers.

ND=not detected; NS=not sampled; NA=not analyzed; NR=not required

DNQ= Detected but not quantified. Sample result is less than minimum level but greater than or equal to MDL.

ANALYZED BY: Frontier Analytical Laboratories

5.5 SOUTH BAY INFLUENT AND EFFLUENT ANALYTICAL RESULTS

The following pages summarize analytical results from representative flow-proportioned, 24-hour composite sampling of the SBWRP influent and effluent for those pollutants the United States EPA has identified under Section 307(a) of the Clean Water Act, which are known or suspected to be discharged by nondomestic users, and for non-priority pollutants. The data include results of monthly full priority pollutant scans.

SOUTH BAY WATER RECLAMATION PLANT SEWAGE INFLUENT and EFFLUENT

ANNUAL 2022

Biochemical Oxygen Demand Concentration (24-hour composite)

Month/ Year		Influent Flow (MGD)	Daily Influent Value (mg/L)	Daily Influent Value (lbs/Day)	Effluent Flow (MGD)	Daily Effluent Value (mg/L)	Daily Effluent Value (lbs/Day)	Percent Removal BOD (%)
=====	=====	=====	=====	=====	=====	=====	=====	=====
JANUARY	-2022	6.82	404	22979	6.40	6	320	98.5
FEBRUARY	-2022	6.78	346	19565	4.69	4	156	98.8
MARCH	-2022	6.70	360	20116	4.94	5	206	98.6
APRIL	-2022	6.74	345	19393	3.65	4	122	98.8
MAY	-2022	6.69	400	22318	2.43	3	61	99.3
JUNE	-2022	6.58	420	23048	1.83	<2	0	100.0
JULY	-2022	6.78	365	20639	1.43	<3	0	100.0
AUGUST	-2022	6.83	362	20620	1.48	3	37	99.2
SEPTEMBER	-2022	6.93	366	21153	2.51	3	63	99.2
OCTOBER	-2022	6.31	422	22208	2.78	3	70	99.3
NOVEMBER	-2022	6.34	348	18401	4.59	3	115	99.1
DECEMBER	-2022	6.47	423	22825	5.36	2	89	99.5
=====	=====	=====	=====	=====	=====	=====	=====	=====
Average		6.66	380	21105	3.50	3	103	99.2

Annual Mass Emissions are calculated from monthly averages of flow for BOD, whereas monthly Report average mass emissions are calculated from average daily mass emissions.

ND=not detected

SOUTH BAY WATER RECLAMATION PLANT
SEWAGE INFLUENT and EFFLUENT

ANNUAL 2022

Total Suspended Solids Concentration
(24-hour composite)

Source:		Influent Flow	Influent Daily TSS	Influent Daily VSS	Percent VSS	Influent Daily Mass Emission
Analyte:						
Month/ Units:		(MGD)	(mg/L)	(mg/L)	(%)	(lbs/Day)
JANUARY -2022		6.82	430	394	91.6	24458
FEBRUARY -2022		6.78	345	317	91.9	19508
MARCH -2022		6.70	355	325	91.5	19837
APRIL -2022		6.74	367	335	91.3	20630
MAY -2022		6.69	367	338	92.1	20477
JUNE -2022		6.58	385	356	92.5	21128
JULY -2022		6.78	388	358	92.3	21940
AUGUST -2022		6.83	355	325	91.5	20222
SEPTEMBER-2022		6.93	353	325	92.1	20402
OCTOBER -2022		6.31	339	317	93.5	17840
NOVEMBER -2022		6.34	375	347	92.5	19828
DECEMBER -2022		6.47	354	327	92.4	19102
Average		6.66	368	339	92.1	20448

Total Suspended Solids Concentration
(24-hour composite)

Source:		Effluent Flow	Effluent Daily TSS	Effluent Daily VSS	Percent VSS	Effluent Daily Mass Emission	Percent Removal TSS	Percent Removal VSS
Analyte:								
Month/ Units:		(MGD)	(mg/L)	(mg/L)	(%)	(lbs/Day)	(%)	(%)
JANUARY -2022		6.40	<5.0	<5.0	*	0	100.0	100.0
FEBRUARY -2022		4.69	<2.5	<2.5	*	0	100.0	100.0
MARCH -2022		4.94	4.7	4.2	89.4	194	98.7	98.7
APRIL -2022		3.65	<3.6	<3.6	*	0	100.0	100.0
MAY -2022		2.43	<2.5	<2.5	*	0	100.0	100.0
JUNE -2022		1.83	<2.5	<2.5	*	0	100.0	100.0
JULY -2022		1.43	<2.5	<2.5	*	0	100.0	100.0
AUGUST -2022		1.48	<2.5	<2.5	*	0	100.0	100.0
SEPTEMBER-2022		2.51	2.8	<2.5	0.0	59	99.2	100.0
OCTOBER -2022		2.78	3.8	3.1	81.6	88	98.9	99.0
NOVEMBER -2022		4.59	<2.5	<2.5	*	0	100.0	100.0
DECEMBER -2022		5.36	<5.0	<2.5	*	0	100.0	100.0
Average		3.50	0.9	0.6	57.0	28	99.7	99.8

*= undetermined, the percent VSS was not calculated because TSS and VSS results were below the MDL.

Annual Mass Emissions are calculated from monthly averages of flow and TSS, whereas
Monthly Report average mass emissions are calculated from average daily mass emissions.

VSS= Volatile Suspended Solids

TSS= Total Suspended Solids

ND= not detected

SOUTH BAY WATER RECLAMATION PLANT

ANNUAL 2022

Influent to Plant
(SB_INF_02)

Analyte:	Flow	pH*	Total* Dissolved Solids	Biochemical* Oxygen Demand	Total* Suspended Solids	Volatile* Suspended Solids	Turbidity*
Units:	(mgd)	SU	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(NTU)
=====	=====	=====	=====	=====	=====	=====	=====
JANUARY -2022	6.82	NR	1080	404	430	394	NR
FEBRUARY -2022	6.78	7.46	1040	346	345	317	NR
MARCH -2022	6.70	NR	995	360	355	325	NR
APRIL -2022	6.74	NR	1020	345	367	335	NR
MAY -2022	6.69	7.33	1110	400	367	338	17.0
JUNE -2022	6.58	NR	1130	420	385	356	NR
JULY -2022	6.78	NR	1080	365	388	358	NR
AUGUST -2022	6.83	NR	1080	362	355	325	NR
SEPTEMBER-2022	6.93	NR	1120	366	353	325	NR
OCTOBER -2022	6.31	NR	1100	422	339	317	NR
NOVEMBER -2022	6.34	NR	1100	348	375	347	NR
DECEMBER -2022	6.47	NR	1140	423	354	327	NR
=====	=====	=====	=====	=====	=====	=====	=====
Average	6.66	7.40	1083	380	368	339	17.0

ND= not detected; NR= not required

pH by Method SM4500H_B

Turbidity by SM2130B

BOD by SM5210B/4500OCG

TSS/VSS by SM2540D

Total Dissolved Solids Method SM2540C

*= Analyzed by South Bay Wastewater Chemistry Laboratory (ELAP Cert. 2539)

SOUTH BAY WATER RECLAMATION PLANT

ANNUAL 2022

Effluent to Ocean Outfall
(SB_OUTFALL_01)

Analyte:	Flow	pH*	Settleable* Solids	Biochemical* Oxygen Demand	Total* Suspended Solids	Volatile* Suspended Solids	Total* Dissolved Solids
Units:	(mgd)	SU	(ml/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)
=====	=====	=====	=====	=====	=====	=====	=====
JANUARY -2022	6.40	7.28	ND	6	<5.0	<5.0	1030
FEBRUARY -2022	4.69	7.26	ND	4	<2.5	<2.5	997
MARCH -2022	4.94	7.23	ND	5	4.7	4.2	953
APRIL -2022	3.65	7.26	ND	4	<3.6	<3.6	1000
MAY -2022	2.43	7.29	ND	3	<2.5	<2.5	1020
JUNE -2022	1.83	7.28	ND	<2	<2.5	<2.5	1040
JULY -2022	1.43	7.23	ND	<3	<2.5	<2.5	1030
AUGUST -2022	1.48	7.34	ND	3	<2.5	<2.5	980
SEPTEMBER-2022	2.51	7.40	ND	3	2.8	<2.5	1060
OCTOBER -2022	2.78	7.42	ND	3	3.8	3.1	1020
NOVEMBER -2022	4.59	7.36	ND	3	<2.5	<2.5	1080
DECEMBER -2022	5.36	7.38	ND	2	<5.0	<2.5	1040
=====	=====	=====	=====	=====	=====	=====	=====
Average	3.50	7.31	0.0	3	0.9	0.6	1021

Analyte:	Oil & Grease	Outfall* Temperature	Residual* Chlorine	Turbidity* (NTU)	Dissolved* Oxygen
Units:	(mg/L)	(°C)	(mg/L)	(NTU)	(mg/L)
=====	=====	=====	=====	=====	=====
JANUARY -2022	<2.73	23.4	^	2.13	3.77
FEBRUARY -2022	<2.81	22.3	^	1.37	3.72
MARCH -2022	<2.65	22.9	^	1.93	2.53
APRIL -2022	<2.78	23.6	^	1.24	3.59
MAY -2022	DNQ2.80	24.5	^	1.29	2.23
JUNE -2022	DNQ3.59	26.4	^	0.97	2.50
JULY -2022	DNQ3.11	27.3	^	0.96	2.54
AUGUST -2022	DNQ2.77	28.1	^	1.52	3.56
SEPTEMBER-2022	DNQ3.76	28.6	^	1.21	4.71
OCTOBER -2022	<2.70	27.1	^	1.23	5.31
NOVEMBER -2022	DNQ5.12	24.4	^	0.82	4.73
DECEMBER -2022	DNQ3.37	22.1	^	0.99	4.34
=====	=====	=====	=====	=====	=====
Average	DNQ2.04	25.1	^	1.31	3.63

^= Monitoring of total chlorine residual is only required on days when the Facility or any of its treatment units that are subject to this Order use chlorine for disinfection.

ND= not detected; NR= not required

DNQ = sample result is less than the reported minimum level, but is greater than or equal to the laboratory's method detection limit; trace or estimated concentration.

pH by Method SM4500H_B
Settleable Solids by SM2540F
Turbidity by SM2130B
BOD by SM5210B/4500OCG
Oil and Grease by EPA Method 1664B
TSS/VSS by SM2540D
Total Dissolved Solids Method SM2540C
Residual Chlorine by SM4500CL-G
Dissolved Oxygen by SM4500-O G
Temperature by SM2550B

*= Analyzed by South Bay Wastewater Chemistry Laboratory (ELAP Cert. 2539)

SOUTH BAY WATER RECLAMATION PLANT
SAMPLE SOURCE: INFLUENT (SB_INF_02) AND EFFLUENT (SB_OUTFALL_01)

ANNUAL 2022

Trace Metals
EPA Method 200.8

Analyte:	Aluminum	Aluminum	Antimony	Antimony	Arsenic	Arsenic
MAX_MDL Units:	8 UG/L	6.4 UG/L	0.515 UG/L	0.343 UG/L	0.168 UG/L	0.134 UG/L
Source:	Influent	Effluent	Influent	Effluent	Influent	Effluent
Month/Limit:						2800
=====	=====	=====	=====	=====	=====	=====
JANUARY -2022	4280	12.0	1.78	1.00	DNQ1.40	DNQ0.530
FEBRUARY -2022	962	12.7	9.55	1.10	DNQ1.54	DNQ0.795
MARCH -2022	490	41.6	2.71	0.988	DNQ1.47	DNQ0.709
APRIL -2022	489	22.9	1.31	1.18	DNQ1.49	DNQ0.995
MAY -2022	1000	12.8	1.95	DNQ0.434	DNQ1.78	DNQ0.696
JUNE -2022	313	16.9	1.48	0.940	DNQ1.18	DNQ0.528
JULY -2022	152	10.5	1.42	1.01	DNQ1.25	DNQ0.581
AUGUST -2022	309	13.9	1.20	1.07	DNQ1.12	DNQ0.606
SEPTEMBER-2022	258	17.7	2.05	2.03	DNQ1.15	DNQ0.488
OCTOBER -2022	456	13.6	1.82	1.11	DNQ1.51	DNQ0.697
NOVEMBER -2022	452	16.5	1.37	1.08	DNQ1.38	DNQ0.716
DECEMBER -2022	456	13.2	1.94	1.05	DNQ1.43	DNQ0.567
=====	=====	=====	=====	=====	=====	=====
AVERAGE	801	17.0	2.38	DNQ1.08	DNQ1.39	DNQ0.659

Analyte:	Barium	Barium	Beryllium	Beryllium	Boron	Boron
MAX_MDL Units:	0.225 UG/L	0.18 UG/L	0.318 UG/L	0.254 UG/L	4.43 UG/L	3.54 UG/L
Source:	Influent	Effluent	Influent	Effluent	Influent	Effluent
Month/Limit:						
=====	=====	=====	=====	=====	=====	=====
JANUARY -2022	100	63.7	ND	ND	459	393
FEBRUARY -2022	153	64.6	ND	ND	438	414
MARCH -2022	89.0	57.2	ND	ND	424	419
APRIL -2022	84.9	55.4	ND	ND	396	407
MAY -2022	145	65.6	ND	ND	393	390
JUNE -2022	89.1	61.9	ND	ND	522	410
JULY -2022	85.1	70.2	ND	ND	521	469
AUGUST -2022	88.6	63.1	ND	ND	439	446
SEPTEMBER-2022	87.6	78.0	ND	ND	529	475
OCTOBER -2022	103	70.3	ND	ND	667	463
NOVEMBER -2022	98.7	65.7	ND	ND	488	481
DECEMBER -2022	127	81.8	ND	ND	438	426
=====	=====	=====	=====	=====	=====	=====
AVERAGE	104	66.5	0.0	0.0	476	433

Analyte:	Cadmium	Cadmium	Chromium	Chromium	Cobalt	Cobalt
MAX_MDL Units:	0.073 UG/L	0.058 UG/L	1.01 UG/L	0.804 UG/L	0.225 UG/L	0.225 UG/L
Source:	Influent	Effluent	Influent	Effluent	Influent	Effluent
Month/Limit:		48		760		
=====	=====	=====	=====	=====	=====	=====
JANUARY -2022	0.212	ND	4.07	<0.402	0.505	DNQ0.103
FEBRUARY -2022	0.291	ND	5.99	ND	0.705	DNQ0.140
MARCH -2022	0.248	ND	2.46	<0.402	0.427	DNQ0.158
APRIL -2022	DNQ0.149	ND	2.06	ND	0.542	DNQ0.156
MAY -2022	0.375	ND	4.23	ND	0.870	<0.225
JUNE -2022	DNQ0.163	ND	1.45	ND	DNQ0.383	<0.0900
JULY -2022	DNQ0.0980	ND	ND	ND	DNQ0.309	<0.180
AUGUST -2022	DNQ0.134	ND	1.24	ND	DNQ0.370	ND
SEPTEMBER-2022	DNQ0.116	ND	1.78	ND	0.400	ND
OCTOBER -2022	0.235	ND	2.56	ND	0.497	ND
NOVEMBER -2022	DNQ0.198	ND	4.29	ND	0.562	ND
DECEMBER -2022	0.205	ND	4.88	DNQ0.360	0.492	DNQ0.122
=====	=====	=====	=====	=====	=====	=====
AVERAGE	DNQ0.202	0.0	2.92	DNQ0.0300	DNQ0.505	DNQ0.0566

ND= not detected

DNQ = sample result is less than the reported minimum level, but is greater than or equal to the laboratory's method detection limit; trace or estimated concentration.

SOUTH BAY WATER RECLAMATION PLANT
SAMPLE SOURCE: INFLUENT (SB_INF_02) AND EFFLUENT (SB_OUTFALL_01)

ANNUAL 2022

Trace Metals
EPA Method 200.8

Analyte:	Copper	Copper	Iron	Iron	Lead	Lead
MAX_MDL Units:	0.388 UG/L	0.31 UG/L	10.8 UG/L	8.62 UG/L	0.1 UG/L	0.08 UG/L
Source:	Influent	Effluent	Influent	Effluent	Influent	Effluent
Month/Limit:		960				760
=====	=====	=====	=====	=====	=====	=====
JANUARY -2022	109	13.5	780	26.0	1.61	DNQ0.121
FEBRUARY -2022	156	20.6	1900	29.8	2.67	DNQ0.139
MARCH -2022	85.4	11.3	680	34.8	1.39	DNQ0.126
APRIL -2022	83.8	10.5	623	29.7	1.26	DNQ0.104
MAY -2022	171	15.1	1840	27.7	2.51	DNQ0.103
JUNE -2022	69.5	14.8	464	24.8	1.17	DNQ0.167
JULY -2022	68.0	13.0	319	54.9	0.947	DNQ0.0950
AUGUST -2022	72.8	12.0	494	23.3	1.11	DNQ0.0910
SEPTEMBER-2022	69.1	11.2	448	26.5	0.888	DNQ0.101
OCTOBER -2022	109	7.25	825	32.9	1.78	ND
NOVEMBER -2022	96.8	6.68	802	36.3	1.49	DNQ0.0910
DECEMBER -2022	91.1	6.39	808	42.1	1.40	DNQ0.121
=====	=====	=====	=====	=====	=====	=====
AVERAGE	98.5	11.9	832	32.4	1.52	DNQ0.105

Analyte:	Manganese	Manganese	Mercury	Mercury	Molybdenum	Molybdenum
MAX_MDL Units:	0.123 UG/L	0.098 UG/L	0.003 UG/L	0.001 UG/L	0.168 UG/L	0.134 UG/L
Source:	Influent	Effluent	Influent	Effluent	Influent	Effluent
Month/Limit:				15.0		
=====	=====	=====	=====	=====	=====	=====
JANUARY -2022	111	9.10	0.0790	0.00200	7.11	1.78
FEBRUARY -2022	130	17.7	0.399	DNQ0.00300	7.59	3.14
MARCH -2022	108	16.2	0.0790	0.00600	5.82	2.97
APRIL -2022	110	8.24	0.0945	DNQ0.00342	5.61	3.24
MAY -2022	149	13.7	0.0810	DNQ0.00400	9.26	2.90
JUNE -2022	87.4	7.93	0.0520	DNQ0.00400	4.18	2.06
JULY -2022	122	11.3	0.0160	DNQ0.00140	5.11	2.43
AUGUST -2022	114	4.53	0.0124	DNQ0.00170	5.98	2.58
SEPTEMBER-2022	88.6	13.9	0.0280	DNQ0.00450	5.86	3.39
OCTOBER -2022	106	14.9	0.0392	DNQ0.00110	7.29	2.81
NOVEMBER -2022	123	54.4	0.0660	DNQ0.00120	6.03	2.64
DECEMBER -2022	138	28.8	0.0841	DNQ0.00170	8.02	3.44
=====	=====	=====	=====	=====	=====	=====
AVERAGE	116	16.7	0.0859	DNQ0.00284	6.49	2.78

Analyte:	Nickel	Nickel	Selenium	Selenium	Silver	Silver
MAX_MDL Units:	0.17 UG/L	0.136 UG/L	1.18 UG/L	0.944 UG/L	0.0718 UG/L	0.0574 UG/L
Source:	Influent	Effluent	Influent	Effluent	Influent	Effluent
Month/Limit:		1900		5700		250
=====	=====	=====	=====	=====	=====	=====
JANUARY -2022	4.54	1.63	DNQ1.75	DNQ0.712	0.236	ND
FEBRUARY -2022	8.25	2.28	DNQ1.91	DNQ1.150	0.623	ND
MARCH -2022	4.11	1.67	2.02	DNQ0.832	0.246	ND
APRIL -2022	4.21	1.95	DNQ1.71	DNQ0.892	0.214	ND
MAY -2022	6.82	1.74	2.61	DNQ0.783	0.506	ND
JUNE -2022	3.34	1.88	ND	ND	DNQ0.168	ND
JULY -2022	3.13	1.96	DNQ1.48	ND	DNQ0.114	ND
AUGUST -2022	3.57	2.04	DNQ1.78	ND	DNQ0.148	ND
SEPTEMBER-2022	3.91	1.85	ND	ND	DNQ0.173	ND
OCTOBER -2022	5.97	2.17	DNQ1.97	<0.944	0.265	ND
NOVEMBER -2022	5.06	1.70	DNQ1.78	ND	DNQ0.196	ND
DECEMBER -2022	4.70	1.65	2.05	DNQ0.827	0.212	ND
=====	=====	=====	=====	=====	=====	=====
AVERAGE	4.80	1.88	DNQ1.59	DNQ0.433	DNQ0.258	0.0

ND= not detected

DNQ = sample result is less than the reported minimum level, but is greater than or equal to the laboratory's method detection limit; trace or estimated concentration.

SOUTH BAY WATER RECLAMATION PLANT
SAMPLE SOURCE: INFLUENT (SB_INF_02) AND EFFLUENT (SB_OUTFALL_01)

ANNUAL 2022

Trace Metals
EPA Method 200.8

Analyte:	Thallium	Thallium	Vanadium	Vanadium	Zinc	Zinc
MAX_MDL Units:	0.068 UG/L	0.054 UG/L	1.08 UG/L	0.864 UG/L	1.18 UG/L	0.944 UG/L
Source:	Influent	Effluent	Influent	Effluent	Influent	Effluent
Month/Limit:						6900
=====	=====	=====	=====	=====	=====	=====
JANUARY -2022	ND	ND	4.03	1.25	177	29.0
FEBRUARY -2022	ND	ND	4.11	1.41	224	33.5
MARCH -2022	ND	ND	3.52	1.60	155	31.4
APRIL -2022	ND	ND	3.70	1.53	139	32.5
MAY -2022	ND	ND	5.74	1.25	332	30.3
JUNE -2022	ND	ND	1.94	DNQ0.942	119	25.7
JULY -2022	ND	ND	1.96	1.09	103	25.3
AUGUST -2022	ND	ND	2.11	1.11	128	23.4
SEPTEMBER-2022	ND	ND	1.57	1.07	108	27.7
OCTOBER -2022	ND	ND	2.60	1.23	203	24.9
NOVEMBER -2022	ND	ND	2.81	1.12	172	25.8
DECEMBER -2022	ND	ND	3.50	1.40	161	20.3
=====	=====	=====	=====	=====	=====	=====
AVERAGE	0.0	0.0	3.13	DNQ1.25	168	27.5

ND= not detected

DNQ = sample result is less than the reported minimum level, but is greater than or equal to the laboratory's method detection limit; trace or estimated concentration.

SOUTH BAY WATER RECLAMATION PLANT
SAMPLE SOURCE: INFLUENT (SB_INF_02) AND EFFLUENT (SB_OUTFALL_01)

ANNUAL 2022

Trace Metals
EPA Method 200.8
Grab only

Analyte:	Iron	Iron
MAX_MDL Units:		8.62 UG/L
Source:	Influent	Effluent
Month/Limit:		
=====	=====	=====
JANUARY -2022	NR	24.8
FEBRUARY -2022	NR	26.8
MARCH -2022	NR	34.5
APRIL -2022	NR	31.7
MAY -2022	NR	21.2
JUNE -2022	NR	19.1
JULY -2022	NR	21.5
AUGUST -2022	NR	NR
SEPTEMBER-2022	NR	NR
OCTOBER -2022	NR	NR
NOVEMBER -2022	NR	NR
DECEMBER -2022	NR	NR
=====	=====	=====
AVERAGE	NR	25.7

ND= not detected

SBWRP Permit Amendment JUL 29,2022, San Diego Water Board agreed to composite sampling.

SOUTH BAY WATER RECLAMATION PLANT
SAMPLE SOURCE: INFLUENT (SB_INF_02) AND EFFLUENT (SB_OUTFALL_01)

ANNUAL 2022

Ammonia-Nitrogen and Total Cyanides
Composite samples

Analyte:	Ammonia-N	Ammonia-N	Total Cyanide	Total Cyanide
Max MDL/ Units:	0.3 MG/L	0.3 MG/L	4 UG/L	4 UG/L
Source:	SB_INF_02	SB_OUTFALL_01	SB_INF_02	SB_OUTFALL_01
=====	=====	=====	=====	=====
JANUARY -2022	36.3	0.439	4.0	ND
FEBRUARY -2022	40.2	1.420	ND	ND
MARCH -2022	32.4	0.530	ND	ND
APRIL -2022	31.1	ND	ND	ND
MAY -2022	35.3	ND	ND	ND
JUNE -2022	29.3	0.325	4.0	ND
JULY -2022	37.4	ND	ND	ND
AUGUST -2022	33.2	ND	ND	4.0
SEPTEMBER-2022	33.2	ND	ND	ND
OCTOBER -2022	34.6	ND	ND	ND
NOVEMBER -2022	36.8	<0.300	ND	ND
DECEMBER -2022	35.8	ND	ND	ND
=====	=====	=====	=====	=====
Average:	34.6	0.226	0.667	0.333

Ammonia as N by SM4500-NH3 C
Cyanide, Total by EPA 335.4

ND= not detected

SOUTH BAY WATER RECLAMATION PLANT
Effluent to the Ocean (SB_OUTFALL_01)

ANNUAL 2022

Radioactivity
EPA Method 900.0

Month/Year		Gross Alpha Radiation	Gross Beta Radiation
=====	=====	=====	=====
JANUARY -2022		7.22 ± 1.59	6.63 ± 1.35
FEBRUARY -2022		8.16 ± 1.63	5.72 ± 1.29
MARCH -2022		10.2 ± 1.90	6.42 ± 1.38
APRIL -2022		8.34 ± 1.78	6.33 ± 1.30
MAY -2022		8.59 ± 1.83	8.25 ± 1.36
JUNE -2022		8.73 ± 1.86	6.54 ± 1.31
JULY -2022		4.31 ± 1.99	2.26 ± 1.63
AUGUST -2022		2.88 ± 1.82	2.26 ± 1.53
SEPTEMBER-2022		1.20 ± 0.78	1.03 ± 0.72
OCTOBER -2022		3.54 ± 2.05	2.27 ± 1.58
NOVEMBER -2022		4.10 ± 2.47	11.3 ± 3.98
DECEMBER -2022		1.21 ± 0.89	7.70 ± 1.85
=====	=====	=====	=====
AVERAGE		5.27 ± 1.72	4.91 ± 1.61

Units in picocuries/liter (pCi/L)

Analyzed by: FGL Environmental Agricultural Analytical

SOUTH BAY WATER RECLAMATION PLANT
SOURCE: INFLUENT (SB_INF_02)

ANNUAL 2022

Chlorinated Pesticide Analysis
EPA Method 608.3 (WITH ADDITIONS)

Source:	INFLUENT					
Date:						
Analyte	Max MDL	Units	FEB	MAY	NOV	Avg
=====	=====	=====	=====	=====	=====	=====
Aldrin	0.00996	UG/L	ND	ND	ND	ND
Dieldrin	0.00836	UG/L	ND	ND	ND	ND
BHC, Alpha isomer	0.0098	UG/L	ND	ND	ND	ND
BHC, Beta isomer	0.011	UG/L	ND	ND	ND	ND
BHC, Gamma isomer	0.00984	UG/L	ND	ND	ND	ND
BHC, Delta isomer	0.00948	UG/L	ND	ND	ND	ND
p,p-DDD	0.0223	UG/L	ND	ND	ND	ND
p,p-DDE	0.00972	UG/L	ND	ND	ND	ND
p,p-DDT	0.0592	UG/L	ND	ND	ND	ND
o,p-DDD	0.00992	UG/L	ND	ND	ND	ND
o,p-DDE	0.0104	UG/L	ND	ND	ND	ND
o,p-DDT	0.007	UG/L	ND	ND	ND	ND
Heptachlor	0.0108	UG/L	ND	ND	ND	ND
Heptachlor epoxide	0.0116	UG/L	ND	ND	ND	ND
Alpha (cis) Chlordane	0.028	UG/L	ND	ND	ND	ND
Gamma (trans) Chlordane	0.0115	UG/L	ND	ND	ND	ND
Alpha Chlordene	0	UG/L	NA	NA	NA	NA
Gamma Chlordene	0	UG/L	NA	NA	NA	NA
Oxychlordane	0.0179	UG/L	ND	ND	ND	ND
Trans Nonachlor	0.0106	UG/L	ND	ND	ND	ND
Cis Nonachlor	0.0109	UG/L	ND	ND	ND	ND
Alpha Endosulfan	0.0102	UG/L	ND	ND	ND	ND
Beta Endosulfan	0.0149	UG/L	ND	ND	ND	ND
Endosulfan Sulfate	0.0106	UG/L	ND	ND	ND	ND
Endrin	0.0102	UG/L	ND	ND	ND	ND
Endrin aldehyde	0.0103	UG/L	ND	ND	ND	ND
Mirex	0.0203	UG/L	ND	ND	ND	ND
Methoxychlor	0.111	UG/L	ND	ND	ND	ND
Toxaphene	0.792	UG/L	ND	ND	ND	ND
PCB 1016	0.708	UG/L	ND	ND	ND	ND
PCB 1221	0.76	UG/L	ND	ND	ND	ND
PCB 1232	0.76	UG/L	ND	ND	ND	ND
PCB 1242	0.76	UG/L	ND	ND	ND	ND
PCB 1248	0.76	UG/L	ND	ND	ND	ND
PCB 1254	0.76	UG/L	ND	ND	ND	ND
PCB 1260	0.76	UG/L	ND	ND	ND	ND
PCB 1262	0.76	UG/L	ND	ND	ND	ND
=====	=====	=====	=====	=====	=====	=====
Aldrin + Dieldrin	0.00996	UG/L	0.0	0.0	0.0	0.0
Hexachlorocyclohexanes	0.011	UG/L	0.0	0.0	0.0	0.0
DDT and derivatives	0.0592	UG/L	0.0	0.0	0.0	0.0
Chlordane + related cmpds.	0.028	UG/L	0.0	0.0	0.0	0.0
Polychlorinated biphenyls	0.76	UG/L	0.0	0.0	0.0	0.0
Endosulfans	0.0149	UG/L	0.0	0.0	0.0	0.0
=====	=====	=====	=====	=====	=====	=====
Heptachlors	0.0116	UG/L	0.0	0.0	0.0	0.0
=====	=====	=====	=====	=====	=====	=====
Chlorinated Hydrocarbons	0.792	UG/L	0.0	0.0	0.0	0.0

Influent sample not collected from 01-July-2022 to 30-September 2022

ND= not detected; NA= not analyzed

Standards for alpha and gamma chlordene are no longer available in the U.S. for the analysis of these compounds.

SOUTH BAY WATER RECLAMATION PLANT
SOURCE: EFFLUENT (SB_OUTFALL_01)

ANNUAL 2022

Chlorinated Pesticide Analysis
EPA Method 608.3 (WITH ADDITIONS)

Source:			EFFLUENT												
Date:			JAN	FEB	MAR*	APR	MAY	JUN	JUL	AUG	SEP	OCT	NOV	DEC	
Analyte	Max	MDL Units													Avg
=====	=====	=====	=====	=====	=====	=====	=====	=====	=====	=====	=====	=====	=====	=====	=====
Aldrin	0.00996	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Dieldrin	0.00836	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
BHC, Alpha isomer	0.0098	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
BHC, Beta isomer	0.011	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
BHC, Gamma isomer	0.00984	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
BHC, Delta isomer	0.00948	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
p,p-DDD	0.0223	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
p,p-DDE	0.00972	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
p,p-DDT	0.0592	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
o,p-DDD	0.00992	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
o,p-DDE	0.0104	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
o,p-DDT	0.007	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Heptachlor	0.0108	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Heptachlor epoxide	0.0116	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Alpha (cis) Chlordane	0.028	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Gamma (trans) Chlordane	0.0115	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Alpha Chlordene	0	UG/L	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA
Gamma Chlordene	0	UG/L	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA
Oxychlordane	0.0179	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Trans Nonachlor	0.0106	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Cis Nonachlor	0.0109	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Alpha Endosulfan	0.0102	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Beta Endosulfan	0.0149	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Endosulfan Sulfate	0.0106	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Endrin	0.0102	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Endrin aldehyde	0.0103	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Mirex	0.0203	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Methoxychlor	0.111	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Toxaphene	0.792	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
PCB 1016	0.708	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
PCB 1221	0.76	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
PCB 1232	0.76	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
PCB 1242	0.76	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
PCB 1248	0.76	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
PCB 1254	0.76	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
PCB 1260	0.76	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
PCB 1262	0.76	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
=====	=====	=====	=====	=====	=====	=====	=====	=====	=====	=====	=====	=====	=====	=====	=====
Aldrin + Dieldrin	0.00996	UG/L	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Hexachlorocyclohexanes	0.011	UG/L	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
DDT and derivatives	0.0592	UG/L	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Chlordane + related cmpds.	0.028	UG/L	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Polychlorinated biphenyls	0.76	UG/L	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Endosulfans	0.0149	UG/L	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
=====	=====	=====	=====	=====	=====	=====	=====	=====	=====	=====	=====	=====	=====	=====	=====
Heptachlors	0.0116	UG/L	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
=====	=====	=====	=====	=====	=====	=====	=====	=====	=====	=====	=====	=====	=====	=====	=====
Chlorinated Hydrocarbons	0.792	UG/L	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

*= Sample extracted outside holding time; sample result not included in average calculations.

ND= not detected; NA= not analyzed

Standards for alpha and gamma chlordene are no longer available in the U.S. for the analysis of these compounds.

SOUTH BAY WATER RECLAMATION PLANT
SAMPLE SOURCE: INFLUENT(SB_INF_02) & EFFLUENT(SB_OUTFALL_01)

ANNUAL 2022

Organophosphorus Pesticides
EPA Method 614 (with additions)

Source:			Influent	Influent
Date:			01-FEB-2022	10-MAY-2022
Analyte	Max MDL	Units	P1282796	P1300393
Demeton O	0.965	UG/L	ND	ND
Demeton S	2.13	UG/L	ND	ND
Diazinon	1.07	UG/L	ND	ND
Guthion	4.19	UG/L	ND	ND
Malathion	0.782	UG/L	ND	ND
Parathion	0.646	UG/L	ND	ND
Dichlorvos	0.936	UG/L	ND	ND
Disulfoton	0.594	UG/L	ND	ND
Stirophos	1.27	UG/L	ND	ND
Coumaphos	1.78	UG/L	ND	ND
Chlorpyrifos	0.79	UG/L	ND	ND
Thiophosphorus Pesticides	4.19	UG/L	0.0	0.0
Demeton -O, -S	2.13	UG/L	0.0	0.0
Total Organophosphorus Pesticides	4.19	UG/L	0.0	0.0

Source:			Effluent	Effluent
Date:			01-FEB-2022	10-MAY-2022
Analyte	Max MDL	Units	P1282801	P1300398
Demeton O	0.965	UG/L	ND	ND
Demeton S	2.13	UG/L	ND	ND
Diazinon	1.07	UG/L	ND	ND
Guthion	4.19	UG/L	ND	ND
Malathion	0.782	UG/L	ND	ND
Parathion	0.646	UG/L	ND	ND
Dichlorvos	0.936	UG/L	ND	ND
Disulfoton	0.594	UG/L	ND	ND
Stirophos	1.27	UG/L	ND	ND
Coumaphos	1.78	UG/L	ND	ND
Chlorpyrifos	0.79	UG/L	ND	ND
Thiophosphorus Pesticides	4.19	UG/L	0.0	0.0
Demeton -O, -S	2.13	UG/L	0.0	0.0
Total Organophosphorus Pesticides	4.19	UG/L	0.0	0.0

ND= not detected

SOUTH BAY WATER RECLAMATION PLANT
SAMPLE SOURCE: EFFLUENT(SB_OUTFALL_01)

ANNUAL 2022

Organophosphorus Pesticides
EPA Method 614 (with additions)

Source:			Effluent	Effluent
Date:			07-JUN-2022	02-AUG-2022
Analyte	Max MDL	Units	P1306115	P1316175
Demeton O	0.965	UG/L	ND	ND
Demeton S	2.13	UG/L	ND	ND
Diazinon	1.07	UG/L	ND	ND
Guthion	4.19	UG/L	ND	ND
Malathion	0.782	UG/L	ND	ND
Parathion	0.646	UG/L	ND	ND
Dichlorvos	0.936	UG/L	ND	ND
Disulfoton	0.594	UG/L	ND	ND
Stirophos	1.27	UG/L	ND	ND
Coumaphos	1.78	UG/L	ND	ND
Chlorpyrifos	0.79	UG/L	ND	ND
Thiophosphorus Pesticides	4.19	UG/L	0.0	0.0
Demeton -O, -S	2.13	UG/L	0.0	0.0
Total Organophosphorus Pesticides	4.19	UG/L	0.0	0.0

Source:			Effluent
Date:			01-NOV-2022
Analyte	Max MDL	Units	P1330963
Demeton O	0.965	UG/L	ND
Demeton S	2.13	UG/L	ND
Diazinon	1.07	UG/L	ND
Guthion	4.19	UG/L	ND
Malathion	0.782	UG/L	ND
Parathion	0.646	UG/L	ND
Dichlorvos	0.936	UG/L	ND
Disulfoton	0.594	UG/L	ND
Stirophos	1.27	UG/L	ND
Coumaphos	1.78	UG/L	ND
Chlorpyrifos	0.79	UG/L	ND
Thiophosphorus Pesticides	4.19	UG/L	0.0
Demeton -O, -S	2.13	UG/L	0.0
Total Organophosphorus Pesticides	4.19	UG/L	0.0

ND= not detected

SOUTH BAY WATER RECLAMATION PLANT
SAMPLE SOURCE: INFLUENT (SB_INF_02) AND EFFLUENT (SB_OUTFALL_01)

ANNUAL 2022

Tributyl Tin Analysis
(In-house Method)

Source:				INFLUENT				
Date:				FEB	MAY	AUG	SEP	
Analyte	Max	MDL	Units					Average
=====	=====	=====	=====	=====	=====	=====	=====	=====
Dibutyltin	0.0211		UG/L	ND	ND	NR	NR	0.0
Monobutyltin	0.0133		UG/L	ND	ND	NR	NR	0.0
Tributyltin	0.0197		UG/L	ND	ND	ND	ND	0.0

Source:				EFFLUENT				
Date:				FEB	MAY	AUG	SEP	DEC
Analyte	Max	MDL	Units					Average
=====	=====	=====	=====	=====	=====	=====	=====	=====
Dibutyltin	0.0211		UG/L	ND	ND	NR	NR	NR
Monobutyltin	0.0133		UG/L	ND	ND	NR	NR	NR
Tributyltin	0.0197		UG/L	ND	ND	ND	ND	ND

ND= not detected

SOUTH BAY WATER RECLAMATION PLANT
SAMPLE SOURCE: INFLUENT (SB_INF_02) AND EFFLUENT (SB_OUTFALL_01)

ANNUAL 2022

Phenolic Compounds
EPA Method 625.1

Source:			INFLUENT		
Date:			FEB	MAY	
Analyte	Max MDL	Units	Average		
=====	=====	=====	=====	=====	=====
2-Chlorophenol	0.125	UG/L	ND	ND	ND
2,4-Dichlorophenol	0.12	UG/L	ND	ND	ND
4-Chloro-3-methylphenol	0.134	UG/L	ND	ND	ND
2,4,6-Trichlorophenol	0.142	UG/L	ND	ND	ND
Pentachlorophenol	0.384	UG/L	ND	ND	ND
Phenol	0.175	UG/L	27.6	51.2	39.4
2-Nitrophenol	0.179	UG/L	ND	ND	ND
2,4-Dimethylphenol	0.255	UG/L	ND	ND	ND
2,4-Dinitrophenol	0.54	UG/L	ND	ND	ND
4-Nitrophenol	0.176	UG/L	ND	ND	ND
4,6-dinitro-2-methylphenol	0.169	UG/L	ND	ND	ND
2-Methylphenol	0.176	UG/L	ND	ND	ND
3-Methylphenol(4-MP is unresolved)		UG/L	NA	NA	NA
4-Methylphenol(3-MP is unresolved)	0.243	UG/L	29.5	101	65.3
2,4,5-Trichlorophenol	0.206	UG/L	ND	ND	ND
=====	=====	=====	=====	=====	=====
Total Chlorinated Phenols	0.384	UG/L	0.0	0.0	0.0
Total Non-Chlorinated Phenols	0.54	UG/L	57.1	152	105
=====	=====	=====	=====	=====	=====
Total Phenols	0.54	UG/L	57.1	152	105

Source:			EFFLUENT											
Date:			JAN	FEB	MAR	APR	MAY	JUN	JUL	AUG	SEP	OCT	NOV	DEC
Analyte	Max MDL	Units	Average											
=====	=====	=====	=====	=====	=====	=====	=====	=====	=====	=====	=====	=====	=====	=====
2-Chlorophenol	0.125	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
2,4-Dichlorophenol	0.12	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
4-Chloro-3-methylphenol	0.134	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
2,4,6-Trichlorophenol	0.142	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Pentachlorophenol	0.384	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Phenol	0.175	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
2-Nitrophenol	0.179	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
2,4-Dimethylphenol	0.255	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
2,4-Dinitrophenol	0.54	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
4-Nitrophenol	0.176	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
4,6-dinitro-2-methylphenol	0.169	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
2-Methylphenol	0.176	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
3-Methylphenol(4-MP is unresolved)		UG/L	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA
4-Methylphenol(3-MP is unresolved)	0.243	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
2,4,5-Trichlorophenol	0.206	UG/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
=====	=====	=====	=====	=====	=====	=====	=====	=====	=====	=====	=====	=====	=====	=====
Total Chlorinated Phenols	0.384	UG/L	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Total Non-Chlorinated Phenols	0.54	UG/L	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
=====	=====	=====	=====	=====	=====	=====	=====	=====	=====	=====	=====	=====	=====	=====
Total Phenols	0.54	UG/L	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

ND=not detected; NA=not analyzed

SOUTH BAY WATER RECLAMATION PLANT
SAMPLE SOURCE: INFLUENT (SB_INF_02)

ANNUAL 2022

Priority Pollutants Base/Neutral Compounds
EPA Method 625.1

Source:			INF	INF	INF
Date:			FEB	MAY	
Analyte	Max MDL	Units			Avg
=====	=====	=====	=====	=====	=====
Bis-(2-chloroethyl) ether	0.162	UG/L	ND	ND	ND
Bis-(2-chloroisopropyl) ether	0.22	UG/L	ND	ND	ND
N-nitrosodi-n-propylamine	0.218	UG/L	ND	ND	ND
Nitrobenzene	0.164	UG/L	ND	ND	ND
Hexachloroethane	0.13	UG/L	ND	ND	ND
Isophorone	0.175	UG/L	ND	ND	ND
Bis-(2-chloroethoxy) methane	0.15	UG/L	ND	ND	ND
1,2,4-Trichlorobenzene	0.125	UG/L	ND	ND	ND
Naphthalene	0.109	UG/L	ND	ND	ND
Hexachlorobutadiene	0.113	UG/L	ND	ND	ND
Hexachlorocyclopentadiene	0.197	UG/L	ND	ND	ND
Acenaphthylene	0.118	UG/L	ND	ND	ND
Dimethyl phthalate	0.155	UG/L	ND	ND	ND
2,6-Dinitrotoluene	0.255	UG/L	ND	ND	ND
Acenaphthene	0.115	UG/L	ND	ND	ND
2,4-Dinitrotoluene	0.19	UG/L	ND	ND	ND
Fluorene	0.151	UG/L	ND	ND	ND
4-Chlorophenyl phenyl ether	0.152	UG/L	ND	ND	ND
Diethyl phthalate	0.504	UG/L	2.88	2.13	2.51
N-nitrosodiphenylamine	0.214	UG/L	ND	ND	ND
4-Bromophenyl phenyl ether	0.152	UG/L	ND	ND	ND
Hexachlorobenzene	0.105	UG/L	ND	ND	ND
Phenanthrene	0.0477	UG/L	ND	ND	ND
Anthracene	0.0808	UG/L	ND	ND	ND
Di-n-butyl phthalate	0.232	UG/L	ND	ND	ND
N-nitrosodimethylamine	0.227	UG/L	ND	ND	ND
Fluoranthene	0.0747	UG/L	ND	ND	ND
Pyrene	0.174	UG/L	ND	ND	ND
Benzidine	3.39	UG/L	ND	ND	ND
Butyl benzyl phthalate	0.201	UG/L	ND	ND	ND
Chrysene	0.0861	UG/L	ND	ND	ND
Benzo[a]anthracene	0.0845	UG/L	ND	ND	ND
Bis-(2-ethylhexyl) phthalate	3.04	UG/L	14.1	DNQ3.01	DNQ8.56
Di-n-octyl phthalate	0.122	UG/L	ND	ND	ND
3,3-Dichlorobenzidine	3.76	UG/L	ND	ND	ND
Benzo[k]fluoranthene	0.144	UG/L	ND	ND	ND
3,4-Benzo(b)fluoranthene	0.139	UG/L	ND	ND	ND
Benzo[a]pyrene	0.147	UG/L	ND	ND	ND
Indeno(1,2,3-CD)pyrene	0.142	UG/L	ND	ND	ND
Dibenzo(a,h)anthracene	0.157	UG/L	ND	ND	ND
Benzo[g,h,i]perylene	0.148	UG/L	ND	ND	ND
1,2-Diphenylhydrazine	0.262	UG/L	ND	ND	ND
=====	=====	=====	=====	=====	=====
Polynuc. Aromatic Hydrocarbons	0.174	UG/L	0.0	0.0	0.0
=====	=====	=====	=====	=====	=====
Base/Neutral Compounds	3.76	UG/L	17.0	2.13	2.51

Additional analytes determined

=====	=====	=====	=====	=====	=====
1-Methylnaphthalene	.134	UG/L	ND	ND	ND
2-Methylnaphthalene	.118	UG/L	ND	ND	ND
2,6-Dimethylnaphthalene	.124	UG/L	ND	ND	ND
1,6,7-Trimethylnaphthalene	.178	UG/L	ND	ND	ND
1-Methylphenanthrene	.109	UG/L	ND	ND	ND
Benzo[e]pyrene	.158	UG/L	ND	ND	ND
Perylene	.241	UG/L	ND	ND	ND
Biphenyl	.131	UG/L	ND	ND	ND
Pyridine	.17	UG/L	1.60	1.53	1.57

ND= not detected

DNQ = sample result is less than the reported minimum level, but is greater than or equal to the laboratory's method detection limit; trace or estimated concentration.

SOUTH BAY WATER RECLAMATION PLANT
SAMPLE SOURCE: EFFLUENT (SB_OUTFALL_01)

ANNUAL 2022

Priority Pollutants Base/Neutral Compounds
EPA Method 625.1

Source:			EFFLUENT				
Date:			FEB	MAY	AUG	NOV	
Analyte	Max MDL	Units	Avg	Avg	Avg	Avg	Average
Bis-(2-chloroethyl) ether	0.147	UG/L	ND	ND	ND	ND	ND
Bis-(2-chloroisopropyl) ether	0.2	UG/L	ND	ND	ND	ND	ND
N-nitrosodi-n-propylamine	0.194	UG/L	ND	ND	ND	ND	ND
Nitrobenzene	0.146	UG/L	ND	ND	ND	ND	ND
Hexachloroethane	0.118	UG/L	ND	ND	ND	ND	ND
Isophorone	0.159	UG/L	ND	ND	ND	ND	ND
Bis-(2-chloroethoxy) methane	0.136	UG/L	ND	ND	ND	ND	ND
1,2,4-Trichlorobenzene	0.117	UG/L	ND	ND	ND	ND	ND
Naphthalene	0.0953	UG/L	ND	ND	ND	ND	ND
Hexachlorobutadiene	0.102	UG/L	ND	ND	ND	ND	ND
Hexachlorocyclopentadiene	0.179	UG/L	ND	ND	ND	ND	ND
Acenaphthylene	0.107	UG/L	ND	ND	ND	ND	ND
Dimethyl phthalate	0.14	UG/L	ND	ND	ND	ND	ND
2,6-Dinitrotoluene	0.239	UG/L	ND	ND	ND	ND	ND
Acenaphthene	0.104	UG/L	ND	ND	ND	ND	ND
2,4-Dinitrotoluene	0.177	UG/L	ND	ND	ND	ND	ND
Fluorene	0.137	UG/L	ND	ND	ND	ND	ND
4-Chlorophenyl phenyl ether	0.138	UG/L	ND	ND	ND	ND	ND
Diethyl phthalate	0.456	UG/L	ND	ND	ND	DNQ0.53	DNQ0.11
N-nitrosodiphenylamine	0.191	UG/L	ND	ND	ND	ND	ND
4-Bromophenyl phenyl ether	0.138	UG/L	ND	ND	ND	ND	ND
Hexachlorobenzene	0.0956	UG/L	ND	ND	ND	ND	ND
Phenanthrene	0.0425	UG/L	ND	ND	ND	ND	ND
Anthracene	0.0732	UG/L	ND	ND	ND	ND	ND
Di-n-butyl phthalate	0.217	UG/L	ND	ND	0.53	ND	0.13
N-nitrosodimethylamine	0.203	UG/L	ND	ND	ND	ND	ND
Fluoranthene	0.0677	UG/L	ND	ND	ND	ND	ND
Pyrene	0.155	UG/L	ND	ND	ND	ND	ND
Benzidine	3.08	UG/L	ND	ND	ND	ND	ND
Butyl benzyl phthalate	0.182	UG/L	ND	ND	ND	ND	ND
Chrysene	0.0781	UG/L	ND	ND	ND	ND	ND
Benzo[a]anthracene	0.0766	UG/L	ND	ND	ND	ND	ND
Bis-(2-ethylhexyl) phthalate	2.84	UG/L	ND	ND	<2.84	<2.71	ND
Di-n-octyl phthalate	0.11	UG/L	ND	ND	ND	ND	ND
3,3-Dichlorobenzidine	3.41	UG/L	ND	ND	ND	ND	ND
Benzo[k]fluoranthene	0.13	UG/L	ND	ND	ND	ND	ND
3,4-Benzo(b)fluoranthene	0.126	UG/L	ND	ND	ND	ND	ND
Benzo[a]pyrene	0.133	UG/L	ND	ND	ND	ND	ND
Indeno(1,2,3-CD)pyrene	0.129	UG/L	ND	ND	ND	ND	ND
Dibenzo(a,h)anthracene	0.147	UG/L	ND	ND	ND	ND	ND
Benzo[g,h,i]perylene	0.135	UG/L	ND	ND	ND	ND	ND
1,2-Diphenylhydrazine	0.237	UG/L	ND	ND	ND	ND	ND
Polynuc. Aromatic Hydrocarbons	0.155	UG/L	0.00	0.00	0.00	0.00	0.00
Base/Neutral Compounds	3.41	UG/L	0.00	0.00	0.53	0.00	0.13

Additional analytes determined

1-Methylnaphthalene	0.121	UG/L	ND	ND	ND	ND	ND
2-Methylnaphthalene	0.11	UG/L	ND	ND	ND	ND	ND
2,6-Dimethylnaphthalene	0.116	UG/L	ND	ND	ND	ND	ND
1,6,7-Trimethylnaphthalene	0.166	UG/L	ND	ND	ND	ND	ND
1-Methylphenanthrene	0.102	UG/L	ND	ND	ND	ND	ND
Benzo[e]pyrene	0.143	UG/L	ND	ND	ND	ND	ND
Perylene	0.21	UG/L	ND	ND	ND	ND	ND
Biphenyl	0.119	UG/L	ND	ND	ND	ND	ND
Pyridine	0.154	UG/L	ND	ND	ND	ND	ND

ND= not detected

DNQ = sample result is less than the reported minimum level, but is greater than or equal to the laboratory's method detection limit; trace or estimated concentration.

SOUTH BAY WATER RECLAMATION PLANT
SOURCE: INFLUENT (SB_INF_02)

ANNUAL 2022

Priority Pollutants Purgeable Compounds
EPA Method 624.1

Source:			INF	INF	INF
Date:			FEB	MAY	
Analyte	Max MDL	Units			Average
Chloromethane	0.238	UG/L	ND	ND	ND
Vinyl chloride	0.242	UG/L	ND	ND	ND
Bromomethane	0.793	UG/L	ND	ND	ND
Chloroethane	0.265	UG/L	ND	ND	ND
Trichlorofluoromethane	0.248	UG/L	ND	ND	ND
Acrolein	1.24	UG/L	ND	ND	ND
1,1-Dichloroethane	0.278	UG/L	ND	ND	ND
Methylene chloride	0.283	UG/L	DNQ0.51	DNQ0.69	DNQ0.60
trans-1,2-dichloroethene	0.287	UG/L	ND	ND	ND
1,1-Dichloroethene	0.253	UG/L	ND	ND	ND
Acrylonitrile	0.550	UG/L	ND	ND	ND
Chloroform	0.299	UG/L	DNQ1.47	DNQ1.65	DNQ1.56
1,1,1-Trichloroethane	0.320	UG/L	ND	ND	ND
Carbon tetrachloride	0.333	UG/L	ND	ND	ND
Benzene	0.173	UG/L	ND	ND	ND
1,2-Dichloroethane	0.236	UG/L	ND	ND	ND
Trichloroethene	0.328	UG/L	ND	ND	ND
1,2-Dichloropropane	0.392	UG/L	ND	ND	ND
Bromodichloromethane	0.445	UG/L	ND	ND	ND
2-Chloroethylvinyl ether	0.290	UG/L	ND	ND	ND
cis-1,3-dichloropropene	0.392	UG/L	ND	ND	ND
Toluene	0.245	UG/L	6.15	2.97	4.56
trans-1,3-dichloropropene	0.526	UG/L	ND	ND	ND
1,1,2-Trichloroethane	0.363	UG/L	ND	ND	ND
Tetrachloroethene	0.209	UG/L	ND	ND	ND
Dibromochloromethane	0.545	UG/L	ND	ND	ND
Chlorobenzene	0.276	UG/L	ND	ND	ND
Ethylbenzene	0.260	UG/L	ND	ND	ND
Bromoform	0.447	UG/L	ND	ND	ND
1,1,2,2-Tetrachloroethane	0.349	UG/L	ND	ND	ND
1,3-Dichlorobenzene	0.318	UG/L	ND	ND	ND
1,4-Dichlorobenzene	0.319	UG/L	ND	ND	ND
1,2-Dichlorobenzene	0.289	UG/L	DNQ0.336	DNQ0.412	DNQ0.374
Halomethane Purgeable Cmpnds	0.793	UG/L	0.0	0.0	0.0
Total Dichlorobenzenes	0.319	UG/L	0.0	0.0	0.0
Total Chloromethanes	0.333	UG/L	0.0	0.0	0.0
Purgeable Compounds	1.24	UG/L	6.15	2.97	4.56

ND= not detected

DNQ= sample result is less than the reported minimum level, but is greater than or equal to the laboratory's method detection limit; trace or estimated concentration.

SOUTH BAY WATER RECLAMATION PLANT
SOURCE: EFFLUENT (SB_OUTFALL_01)

ANNUAL 2022

Priority Pollutants Purgeable Compounds
EPA Method 624.1

Source:			EFF	EFF	EFF	EFF	EFF
Date:			FEB	MAY	AUG	NOV	
Analyte	Max MDL	Units					Average
Chloromethane	0.678	UG/L	ND	ND	ND	ND	ND
Vinyl chloride	0.777	UG/L	ND	ND	ND	ND	ND
Bromomethane	1.69	UG/L	ND	ND	ND	ND	ND
Chloroethane	0.814	UG/L	ND	ND	ND	ND	ND
Trichlorofluoromethane	0.554	UG/L	ND	ND	ND	ND	ND
Acrolein	2.10	UG/L	ND	ND	ND	ND	ND
1,1-Dichloroethane	0.568	UG/L	ND	ND	ND	ND	ND
Methylene chloride	0.672	UG/L	ND	ND	ND	ND	ND
trans-1,2-dichloroethene	0.529	UG/L	ND	ND	ND	ND	ND
1,1-Dichloroethene	0.580	UG/L	ND	ND	ND	ND	ND
Acrylonitrile	0.581	UG/L	ND	ND	ND	ND	ND
Chloroform	0.552	UG/L	ND	ND	ND	ND	ND
1,1,1-Trichloroethane	0.547	UG/L	ND	ND	ND	ND	ND
Carbon tetrachloride	0.575	UG/L	ND	ND	ND	ND	ND
Benzene	0.507	UG/L	ND	ND	ND	ND	ND
1,2-Dichloroethane	0.611	UG/L	ND	ND	ND	ND	ND
Trichloroethene	0.456	UG/L	ND	ND	ND	ND	ND
1,2-Dichloropropane	0.459	UG/L	ND	ND	ND	ND	ND
Bromodichloromethane	0.520	UG/L	ND	ND	ND	ND	ND
2-Chloroethylvinyl ether	0.648	UG/L	ND	ND	ND	ND	ND
cis-1,3-dichloropropene	0.505	UG/L	ND	ND	ND	ND	ND
Toluene	0.467	UG/L	ND	ND	ND	ND	ND
trans-1,3-dichloropropene	0.555	UG/L	ND	ND	ND	ND	ND
1,1,2-Trichloroethane	0.504	UG/L	ND	ND	ND	ND	ND
Tetrachloroethene	0.594	UG/L	ND	ND	ND	ND	ND
Dibromochloromethane	0.550	UG/L	ND	ND	ND	ND	ND
Chlorobenzene	0.435	UG/L	ND	ND	ND	ND	ND
Ethylbenzene	0.428	UG/L	ND	ND	ND	ND	ND
Bromoform	0.637	UG/L	ND	ND	ND	ND	ND
1,1,2,2-Tetrachloroethane	0.412	UG/L	ND	ND	ND	ND	ND
1,3-Dichlorobenzene	0.427	UG/L	ND	ND	ND	ND	ND
1,4-Dichlorobenzene	0.439	UG/L	ND	ND	ND	ND	ND
1,2-Dichlorobenzene	0.442	UG/L	ND	ND	ND	ND	ND
Halomethane Purgeable Cmpnds	1.69	UG/L	0.0	0.0	0.0	0.0	0.0
Total Dichlorobenzenes	0.442	UG/L	0.0	0.0	0.0	0.0	0.0
Total Chloromethanes	0.678	UG/L	0.0	0.0	0.0	0.0	0.0
Purgeable Compounds	2.10	UG/L	0.0	0.0	0.0	0.0	0.0

ND= not detected

SOUTH BAY WATER RECLAMATION PLANT
SAMPLE SOURCE: INFLUENT (SB_INF_02)

ANNUAL 2022

Dioxin and Furan Analysis
EPA Method 1613

Source:				INF	INF	INF	INF
Date:				JAN	FEB	MAR	APR
Analyte	MDL	Units	Equiv	P1278534	P1282796	P1289859	P1295240
=====	=====	=====	=====	=====	=====	=====	=====
2,3,7,8-tetra CDD	0.640	PG/L	1.000	ND	ND	ND	ND
1,2,3,7,8-penta CDD	0.783	PG/L	0.500	ND	ND	ND	ND
1,2,3,4,7,8-hexa CDD	1.3	PG/L	0.100	ND	ND	ND	ND
1,2,3,6,7,8-hexa CDD	1.39	PG/L	0.100	ND	ND	ND	ND
1,2,3,7,8,9-hexa CDD	1.28	PG/L	0.100	ND	ND	ND	ND
1,2,3,4,6,7,8-hepta CDD	1.17	PG/L	0.010	DNQ17.2	DNQ25.1	DNQ12.3	DNQ9.93
octa CDD	2	PG/L	0.001	160	260	130	85.0
2,3,7,8-tetra CDF	0.624	PG/L	0.100	ND	ND	ND	ND
1,2,3,7,8-penta CDF	0.751	PG/L	0.050	ND	ND	ND	ND
2,3,4,7,8-penta CDF	0.793	PG/L	0.500	ND	ND	ND	ND
1,2,3,4,7,8-hexa CDF	0.781	PG/L	0.100	ND	ND	ND	ND
1,2,3,6,7,8-hexa CDF	0.803	PG/L	0.100	ND	ND	ND	ND
1,2,3,7,8,9-hexa CDF	0.973	PG/L	0.100	ND	ND	ND	ND
2,3,4,6,7,8-hexa CDF	0.827	PG/L	0.100	ND	ND	ND	ND
1,2,3,4,6,7,8-hepta CDF	0.773	PG/L	0.010	DNQ3.36	DNQ7.86	DNQ1.99	ND
1,2,3,4,7,8,9-hepta CDF	0.978	PG/L	0.010	ND	ND	ND	ND
octa CDF	1.71	PG/L	0.001	DNQ5.03	DNQ18.1	DNQ5.43	ND

Source:				INF	INF	INF	INF
Date:				MAY	JUN	JUL	AUG
Analyte	MDL	Units	Equiv	P1300393	P1306112	P1311340	P1316183
=====	=====	=====	=====	=====	=====	=====	=====
2,3,7,8-tetra CDD	0.640	PG/L	1.000	ND	ND	ND	ND
1,2,3,7,8-penta CDD	0.783	PG/L	0.500	ND	ND	ND	ND
1,2,3,4,7,8-hexa CDD	1.3	PG/L	0.100	ND	DNQ3.46	DNQ7.11	ND
1,2,3,6,7,8-hexa CDD	1.39	PG/L	0.100	ND	DNQ7.60	30.9	DNQ5.63
1,2,3,7,8,9-hexa CDD	1.28	PG/L	0.100	ND	DNQ2.43	DNQ7.45	ND
1,2,3,4,6,7,8-hepta CDD	1.17	PG/L	0.010	DNQ14.9	45.0	207	33.6
octa CDD	2	PG/L	0.001	130	71.0	210	140
2,3,7,8-tetra CDF	0.624	PG/L	0.100	ND	ND	ND	ND
1,2,3,7,8-penta CDF	0.751	PG/L	0.050	ND	DNQ1.75	DNQ3.91	ND
2,3,4,7,8-penta CDF	0.793	PG/L	0.500	ND	ND	ND	ND
1,2,3,4,7,8-hexa CDF	0.781	PG/L	0.100	ND	ND	ND	ND
1,2,3,6,7,8-hexa CDF	0.803	PG/L	0.100	ND	ND	DNQ2.35	ND
1,2,3,7,8,9-hexa CDF	0.973	PG/L	0.100	ND	ND	ND	ND
2,3,4,6,7,8-hexa CDF	0.827	PG/L	0.100	ND	ND	DNQ1.95	ND
1,2,3,4,6,7,8-hepta CDF	0.773	PG/L	0.010	DNQ2.78	DNQ2.38	DNQ5.43	ND
1,2,3,4,7,8,9-hepta CDF	0.978	PG/L	0.010	ND	ND	ND	ND
octa CDF	1.71	PG/L	0.001	DNQ5.69	ND	DNQ5.99	ND

Source:				INF	INF	INF	INF
Date:				SEP	OCT	NOV	DEC
Analyte	MDL	Units	Equiv	P1322159	P1326442	P1330971	P1338657
=====	=====	=====	=====	=====	=====	=====	=====
2,3,7,8-tetra CDD	0.640	PG/L	1.000	ND	ND	ND	ND
1,2,3,7,8-penta CDD	0.783	PG/L	0.500	ND	ND	ND	ND
1,2,3,4,7,8-hexa CDD	1.3	PG/L	0.100	ND	ND	ND	ND
1,2,3,6,7,8-hexa CDD	1.39	PG/L	0.100	ND	ND	ND	ND
1,2,3,7,8,9-hexa CDD	1.28	PG/L	0.100	ND	ND	ND	ND
1,2,3,4,6,7,8-hepta CDD	1.17	PG/L	0.010	DNQ11.2	DNQ15.0	DNQ10.7	DNQ9.99
octa CDD	2	PG/L	0.001	60.0	110	95.0	90.0
2,3,7,8-tetra CDF	0.624	PG/L	0.100	ND	ND	ND	ND
1,2,3,7,8-penta CDF	0.751	PG/L	0.050	ND	ND	DNQ1.74	ND
2,3,4,7,8-penta CDF	0.793	PG/L	0.500	ND	ND	ND	ND
1,2,3,4,7,8-hexa CDF	0.781	PG/L	0.100	ND	ND	ND	ND
1,2,3,6,7,8-hexa CDF	0.803	PG/L	0.100	ND	ND	ND	ND
1,2,3,7,8,9-hexa CDF	0.973	PG/L	0.100	ND	ND	ND	ND
2,3,4,6,7,8-hexa CDF	0.827	PG/L	0.100	ND	ND	ND	ND
1,2,3,4,6,7,8-hepta CDF	0.773	PG/L	0.010	ND	ND	DNQ3.11	ND
1,2,3,4,7,8,9-hepta CDF	0.978	PG/L	0.010	ND	ND	ND	ND
octa CDF	1.71	PG/L	0.001	ND	ND	DNQ5.24	ND

Above are permit required CDD/CDF isomers.

ND= not detected

DNQ = sample result is less than the reported minimum level, but is greater than or equal to the laboratory's method detection limit; trace or estimated concentration.

Analyzed by: Frontier Analytical Laboratories

SOUTH BAY WATER RECLAMATION PLANT
SAMPLE SOURCE: EFFLUENT (SB_OUTFALL_01)

ANNUAL 2022

Dioxin and Furan Analysis
EPA Method 1613

Source:				EFF	EFF	EFF	EFF
Date:				JAN	FEB	MAR	APR
Analyte	MDL	Units	Equiv	P1278537	P1282801	P1289862	P1295243
2,3,7,8-tetra CDD	0.640	PG/L	1.000	ND	ND	ND	ND
1,2,3,7,8-penta CDD	0.783	PG/L	0.500	ND	ND	ND	ND
1,2,3,4,7,8-hexa CDD	1.3	PG/L	0.100	ND	ND	ND	ND
1,2,3,6,7,8-hexa CDD	1.39	PG/L	0.100	ND	ND	ND	ND
1,2,3,7,8,9-hexa CDD	1.28	PG/L	0.100	ND	ND	ND	ND
1,2,3,4,6,7,8-hepta CDD	1.17	PG/L	0.010	ND	ND	ND	ND
octa CDD	2	PG/L	0.001	ND	DNQ33.0	DNQ4.15	ND
2,3,7,8-tetra CDF	0.624	PG/L	0.100	ND	ND	ND	ND
1,2,3,7,8-penta CDF	0.751	PG/L	0.050	ND	ND	ND	ND
2,3,4,7,8-penta CDF	0.793	PG/L	0.500	ND	ND	ND	ND
1,2,3,4,7,8-hexa CDF	0.781	PG/L	0.100	ND	ND	ND	ND
1,2,3,6,7,8-hexa CDF	0.803	PG/L	0.100	ND	ND	ND	ND
1,2,3,7,8,9-hexa CDF	0.973	PG/L	0.100	ND	ND	ND	ND
2,3,4,6,7,8-hexa CDF	0.827	PG/L	0.100	ND	ND	ND	ND
1,2,3,4,6,7,8-hepta CDF	0.773	PG/L	0.010	ND	ND	ND	ND
1,2,3,4,7,8,9-hepta CDF	0.978	PG/L	0.010	ND	ND	ND	ND
octa CDF	1.71	PG/L	0.001	ND	ND	ND	ND

Source:				EFF	EFF	EFF	EFF
Date:				MAY	JUN	JUL	AUG
Analyte	MDL	Units	Equiv	P1300398	P1306115	P1311343	P1316175
2,3,7,8-tetra CDD	0.640	PG/L	1.000	ND	ND	ND	ND
1,2,3,7,8-penta CDD	0.783	PG/L	0.500	ND	ND	ND	ND
1,2,3,4,7,8-hexa CDD	1.3	PG/L	0.100	ND	ND	ND	ND
1,2,3,6,7,8-hexa CDD	1.39	PG/L	0.100	ND	ND	ND	ND
1,2,3,7,8,9-hexa CDD	1.28	PG/L	0.100	ND	ND	ND	ND
1,2,3,4,6,7,8-hepta CDD	1.17	PG/L	0.010	ND	ND	ND	ND
octa CDD	2	PG/L	0.001	ND	ND	DNQ5.99	ND
2,3,7,8-tetra CDF	0.624	PG/L	0.100	ND	ND	ND	ND
1,2,3,7,8-penta CDF	0.751	PG/L	0.050	ND	ND	ND	ND
2,3,4,7,8-penta CDF	0.793	PG/L	0.500	ND	ND	ND	ND
1,2,3,4,7,8-hexa CDF	0.781	PG/L	0.100	ND	ND	ND	ND
1,2,3,6,7,8-hexa CDF	0.803	PG/L	0.100	ND	ND	ND	ND
1,2,3,7,8,9-hexa CDF	0.973	PG/L	0.100	ND	ND	ND	ND
2,3,4,6,7,8-hexa CDF	0.827	PG/L	0.100	ND	ND	ND	ND
1,2,3,4,6,7,8-hepta CDF	0.773	PG/L	0.010	ND	ND	ND	ND
1,2,3,4,7,8,9-hepta CDF	0.978	PG/L	0.010	ND	ND	ND	ND
octa CDF	1.71	PG/L	0.001	ND	ND	ND	ND

Source:				EFF	EFF	EFF	EFF
Date:				SEP	OCT	NOV	DEC
Analyte	MDL	Units	Equiv	P1322162	P1326445	P1330963	P1338660
2,3,7,8-tetra CDD	0.640	PG/L	1.000	ND	ND	ND	ND
1,2,3,7,8-penta CDD	0.783	PG/L	0.500	ND	ND	ND	ND
1,2,3,4,7,8-hexa CDD	1.3	PG/L	0.100	ND	ND	ND	ND
1,2,3,6,7,8-hexa CDD	1.39	PG/L	0.100	ND	ND	ND	ND
1,2,3,7,8,9-hexa CDD	1.28	PG/L	0.100	ND	ND	ND	ND
1,2,3,4,6,7,8-hepta CDD	1.17	PG/L	0.010	ND	ND	ND	ND
octa CDD	2	PG/L	0.001	ND	ND	ND	ND
2,3,7,8-tetra CDF	0.624	PG/L	0.100	ND	ND	ND	ND
1,2,3,7,8-penta CDF	0.751	PG/L	0.050	ND	ND	ND	ND
2,3,4,7,8-penta CDF	0.793	PG/L	0.500	ND	ND	ND	ND
1,2,3,4,7,8-hexa CDF	0.781	PG/L	0.100	ND	ND	ND	ND
1,2,3,6,7,8-hexa CDF	0.803	PG/L	0.100	ND	ND	ND	ND
1,2,3,7,8,9-hexa CDF	0.973	PG/L	0.100	ND	ND	ND	ND
2,3,4,6,7,8-hexa CDF	0.827	PG/L	0.100	ND	ND	ND	ND
1,2,3,4,6,7,8-hepta CDF	0.773	PG/L	0.010	ND	ND	ND	ND
1,2,3,4,7,8,9-hepta CDF	0.978	PG/L	0.010	ND	ND	ND	ND
octa CDF	1.71	PG/L	0.001	ND	ND	ND	ND

Above are permit required CDD/CDF isomers.

ND= not detected

DNQ = sample result is less than the reported minimum level, but is greater than or equal to the laboratory's method detection limit; trace or estimated concentration.

Analyzed by: Frontier Analytical Laboratories

SOUTH BAY WATER RECLAMATION PLANT
SAMPLE SOURCE: INFLUENT (SB_INF_02)

ANNUAL 2022

Dioxin and Furan Analysis
EPA Method 1613

Source:				INF	INF	INF	INF
				TCCD	TCCD	TCCD	TCCD
Date:				JAN	FEB	MAR	APR
Analyte	MDL	Units	Equiv	P1278534	P1282796	P1289859	P1295240
2,3,7,8-tetra CDD	0.640	PG/L	1.000	ND	ND	ND	ND
1,2,3,7,8-penta CDD	0.783	PG/L	0.500	ND	ND	ND	ND
1,2,3,4,7,8_hexa_CDD	1.3	PG/L	0.100	ND	ND	ND	ND
1,2,3,6,7,8-hexa CDD	1.39	PG/L	0.100	ND	ND	ND	ND
1,2,3,7,8,9-hexa CDD	1.28	PG/L	0.100	ND	ND	ND	ND
1,2,3,4,6,7,8-hepta CDD	1.17	PG/L	0.010	DNQ0.172	DNQ0.251	DNQ0.123	DNQ0.0993
octa CDD	2	PG/L	0.001	0.160	0.260	0.130	0.0850
2,3,7,8-tetra CDF	0.624	PG/L	0.100	ND	ND	ND	ND
1,2,3,7,8-penta CDF	0.751	PG/L	0.050	ND	ND	ND	ND
2,3,4,7,8-penta CDF	0.793	PG/L	0.500	ND	ND	ND	ND
1,2,3,4,7,8-hexa CDF	0.781	PG/L	0.100	ND	ND	ND	ND
1,2,3,6,7,8-hexa CDF	0.803	PG/L	0.100	ND	ND	ND	ND
1,2,3,7,8,9-hexa CDF	0.973	PG/L	0.100	ND	ND	ND	ND
2,3,4,6,7,8-hexa CDF	0.827	PG/L	0.100	ND	ND	ND	ND
1,2,3,4,6,7,8-hepta CDF	0.773	PG/L	0.010	DNQ0.0336	DNQ0.0786	DNQ0.0199	ND
1,2,3,4,7,8,9-hepta CDF	0.978	PG/L	0.010	ND	ND	ND	ND
octa CDF	1.71	PG/L	0.001	DNQ0.00503	DNQ0.0181	DNQ0.00543	ND

Source:				INF	INF	INF	INF
				TCCD	TCCD	TCCD	TCCD
Date:				MAY	JUN	JUL	AUG
Analyte	MDL	Units	Equiv	P1300393	P1306112	P1311340	P1316183
2,3,7,8-tetra CDD	0.640	PG/L	1.000	ND	ND	ND	ND
1,2,3,7,8-penta CDD	0.783	PG/L	0.500	ND	ND	ND	ND
1,2,3,4,7,8_hexa_CDD	1.3	PG/L	0.100	ND	DNQ0.346	DNQ0.711	ND
1,2,3,6,7,8-hexa CDD	1.39	PG/L	0.100	ND	DNQ0.760	3.09	DNQ0.563
1,2,3,7,8,9-hexa CDD	1.28	PG/L	0.100	ND	DNQ0.243	DNQ0.745	ND
1,2,3,4,6,7,8-hepta CDD	1.17	PG/L	0.010	DNQ0.149	0.450	2.07	0.336
octa CDD	2	PG/L	0.001	0.130	0.071	0.210	0.140
2,3,7,8-tetra CDF	0.624	PG/L	0.100	ND	ND	ND	ND
1,2,3,7,8-penta CDF	0.751	PG/L	0.050	ND	DNQ0.088	DNQ0.196	ND
2,3,4,7,8-penta CDF	0.793	PG/L	0.500	ND	ND	ND	ND
1,2,3,4,7,8-hexa CDF	0.781	PG/L	0.100	ND	ND	ND	ND
1,2,3,6,7,8-hexa CDF	0.803	PG/L	0.100	ND	ND	DNQ0.235	ND
1,2,3,7,8,9-hexa CDF	0.973	PG/L	0.100	ND	ND	ND	ND
2,3,4,6,7,8-hexa CDF	0.827	PG/L	0.100	ND	ND	DNQ0.195	ND
1,2,3,4,6,7,8-hepta CDF	0.773	PG/L	0.010	DNQ0.0278	DNQ0.0238	DNQ0.0543	ND
1,2,3,4,7,8,9-hepta CDF	0.978	PG/L	0.010	ND	ND	ND	ND
octa CDF	1.71	PG/L	0.001	DNQ0.00569	ND	DNQ0.00599	ND

Source:				INF	INF	INF	INF
				TCCD	TCCD	TCCD	TCCD
Date:				SEP	OCT	NOV	DEC
Analyte	MDL	Units	Equiv	P1322159	P1326442	P1330971	P1338657
2,3,7,8-tetra CDD	0.640	PG/L	1.000	ND	ND	ND	ND
1,2,3,7,8-penta CDD	0.783	PG/L	0.500	ND	ND	ND	ND
1,2,3,4,7,8_hexa_CDD	1.3	PG/L	0.100	ND	ND	ND	ND
1,2,3,6,7,8-hexa CDD	1.39	PG/L	0.100	ND	ND	ND	ND
1,2,3,7,8,9-hexa CDD	1.28	PG/L	0.100	ND	ND	ND	ND
1,2,3,4,6,7,8-hepta CDD	1.17	PG/L	0.010	DNQ0.112	DNQ0.150	DNQ0.107	DNQ0.0999
octa CDD	2	PG/L	0.001	0.060	0.110	0.095	0.090
2,3,7,8-tetra CDF	0.624	PG/L	0.100	ND	ND	ND	ND
1,2,3,7,8-penta CDF	0.751	PG/L	0.050	ND	ND	DNQ0.087	ND
2,3,4,7,8-penta CDF	0.793	PG/L	0.500	ND	ND	ND	ND
1,2,3,4,7,8-hexa CDF	0.781	PG/L	0.100	ND	ND	ND	ND
1,2,3,6,7,8-hexa CDF	0.803	PG/L	0.100	ND	ND	ND	ND
1,2,3,7,8,9-hexa CDF	0.973	PG/L	0.100	ND	ND	ND	ND
2,3,4,6,7,8-hexa CDF	0.827	PG/L	0.100	ND	ND	ND	ND
1,2,3,4,6,7,8-hepta CDF	0.773	PG/L	0.010	ND	ND	DNQ0.0311	ND
1,2,3,4,7,8,9-hepta CDF	0.978	PG/L	0.010	ND	ND	ND	ND
octa CDF	1.71	PG/L	0.001	ND	ND	DNQ0.00524	ND

Above are permit required CDD/CDF isomers.

ND= not detected

DNQ = sample result is less than the reported minimum level, but is greater than or equal to the laboratory's method detection limit; trace or estimated concentration.

Analyzed by: Frontier Analytical Laboratories

SOUTH BAY WATER RECLAMATION PLANT
SAMPLE SOURCE: EFFLUENT (SB_OUTFALL_01)

ANNUAL 2022

Dioxin and Furan Analysis
EPA Method 1613

Effluent Limit (TCDD): 0.37 pg/L (30-day Average)

Source:				EFF TCCD JAN P1278537	EFF TCCD FEB P1282801	EFF TCCD MAR P1289862	EFF TCCD APR P1295243
Date:	MDL	Units	Equiv				
Analyte							
2,3,7,8-tetra CDD	0.640	PG/L	1.000	ND	ND	ND	ND
1,2,3,7,8-penta CDD	0.783	PG/L	0.500	ND	ND	ND	ND
1,2,3,4,7,8-hexa_CDD	1.3	PG/L	0.100	ND	ND	ND	ND
1,2,3,6,7,8-hexa CDD	1.39	PG/L	0.100	ND	ND	ND	ND
1,2,3,7,8,9-hexa CDD	1.28	PG/L	0.100	ND	ND	ND	ND
1,2,3,4,6,7,8-hepta CDD	1.17	PG/L	0.010	ND	ND	ND	ND
octa CDD	2	PG/L	0.001	ND	DNQ0.033	DNQ0.00415	ND
2,3,7,8-tetra CDF	0.624	PG/L	0.100	ND	ND	ND	ND
1,2,3,7,8-penta CDF	0.751	PG/L	0.050	ND	ND	ND	ND
2,3,4,7,8-penta CDF	0.793	PG/L	0.500	ND	ND	ND	ND
1,2,3,4,7,8-hexa CDF	0.781	PG/L	0.100	ND	ND	ND	ND
1,2,3,6,7,8-hexa CDF	0.803	PG/L	0.100	ND	ND	ND	ND
1,2,3,7,8,9-hexa CDF	0.973	PG/L	0.100	ND	ND	ND	ND
2,3,4,6,7,8-hexa CDF	0.827	PG/L	0.100	ND	ND	ND	ND
1,2,3,4,6,7,8-hepta CDF	0.773	PG/L	0.010	ND	ND	ND	ND
1,2,3,4,7,8,9-hepta CDF	0.978	PG/L	0.010	ND	ND	ND	ND
octa CDF	1.71	PG/L	0.001	ND	ND	ND	ND

Source:				EFF TCCD MAY P1300398	EFF TCCD JUN P1306115	EFF TCCD JUL P1311343	EFF TCCD AUG P1316175
Date:	MDL	Units	Equiv				
Analyte							
2,3,7,8-tetra CDD	0.640	PG/L	1.000	ND	ND	ND	ND
1,2,3,7,8-penta CDD	0.783	PG/L	0.500	ND	ND	ND	ND
1,2,3,4,7,8-hexa_CDD	1.3	PG/L	0.100	ND	ND	ND	ND
1,2,3,6,7,8-hexa CDD	1.39	PG/L	0.100	ND	ND	ND	ND
1,2,3,7,8,9-hexa CDD	1.28	PG/L	0.100	ND	ND	ND	ND
1,2,3,4,6,7,8-hepta CDD	1.17	PG/L	0.010	ND	ND	ND	ND
octa CDD	2	PG/L	0.001	ND	ND	DNQ0.00599	ND
2,3,7,8-tetra CDF	0.624	PG/L	0.100	ND	ND	ND	ND
1,2,3,7,8-penta CDF	0.751	PG/L	0.050	ND	ND	ND	ND
2,3,4,7,8-penta CDF	0.793	PG/L	0.500	ND	ND	ND	ND
1,2,3,4,7,8-hexa CDF	0.781	PG/L	0.100	ND	ND	ND	ND
1,2,3,6,7,8-hexa CDF	0.803	PG/L	0.100	ND	ND	ND	ND
1,2,3,7,8,9-hexa CDF	0.973	PG/L	0.100	ND	ND	ND	ND
2,3,4,6,7,8-hexa CDF	0.827	PG/L	0.100	ND	ND	ND	ND
1,2,3,4,6,7,8-hepta CDF	0.773	PG/L	0.010	ND	ND	ND	ND
1,2,3,4,7,8,9-hepta CDF	0.978	PG/L	0.010	ND	ND	ND	ND
octa CDF	1.71	PG/L	0.001	ND	ND	ND	ND

Source:				EFF TCCD SEP P1322162	EFF TCCD OCT P1326445	EFF TCCD NOV P1330963	EFF TCCD DEC P1338660
Date:	MDL	Units	Equiv				
Analyte							
2,3,7,8-tetra CDD	0.640	PG/L	1.000	ND	ND	ND	ND
1,2,3,7,8-penta CDD	0.783	PG/L	0.500	ND	ND	ND	ND
1,2,3,4,7,8-hexa_CDD	1.3	PG/L	0.100	ND	ND	ND	ND
1,2,3,6,7,8-hexa CDD	1.39	PG/L	0.100	ND	ND	ND	ND
1,2,3,7,8,9-hexa CDD	1.28	PG/L	0.100	ND	ND	ND	ND
1,2,3,4,6,7,8-hepta CDD	1.17	PG/L	0.010	ND	ND	ND	ND
octa CDD	2	PG/L	0.001	ND	ND	ND	ND
2,3,7,8-tetra CDF	0.624	PG/L	0.100	ND	ND	ND	ND
1,2,3,7,8-penta CDF	0.751	PG/L	0.050	ND	ND	ND	ND
2,3,4,7,8-penta CDF	0.793	PG/L	0.500	ND	ND	ND	ND
1,2,3,4,7,8-hexa CDF	0.781	PG/L	0.100	ND	ND	ND	ND
1,2,3,6,7,8-hexa CDF	0.803	PG/L	0.100	ND	ND	ND	ND
1,2,3,7,8,9-hexa CDF	0.973	PG/L	0.100	ND	ND	ND	ND
2,3,4,6,7,8-hexa CDF	0.827	PG/L	0.100	ND	ND	ND	ND
1,2,3,4,6,7,8-hepta CDF	0.773	PG/L	0.010	ND	ND	ND	ND
1,2,3,4,7,8,9-hepta CDF	0.978	PG/L	0.010	ND	ND	ND	ND
octa CDF	1.71	PG/L	0.001	ND	ND	ND	ND

Above are permit required CDD/CDF isomers. ND= not detected

DNQ = sample result is less than the reported minimum level, but is greater than or equal to the laboratory's method detection limit; trace or estimated concentration.

Analyzed by: Frontier Analytical Laboratories

SOUTH BAY WATER RECLAMATION PLANT
SAMPLE SOURCE: INFLUENT (SB_INF_02) AND EFFLUENT (SB_OUTFALL_01)

ANNUAL 2022

Anions
EPA Method 300.0
GRAB SAMPLES

Analyte:		Bromide	Bromide	Chloride	Chloride	Fluoride	Fluoride
Max MDL:			1		35		0.065
Units:		MG/L	MG/L	MG/L	MG/L	MG/L	MG/L
Source:		INFLUENT	EFFLUENT	INFLUENT	EFFLUENT	INFLUENT	EFFLUENT
=====		=====		=====		=====	
JANUARY -2022		NR	ND	NR	274	NR	0.520
FEBRUARY -2022		NR	<1.0	NR	270	NR	0.549
MARCH -2022		NR	<1.0	NR	276	NR	0.500
APRIL -2022		NR	0.520	NR	260	NR	0.590
MAY -2022		NR	0.493	NR	278	NR	0.625
JUNE -2022		NR	0.510	NR	300	NR	0.630
JULY -2022		NR	0.500	NR	290	NR	0.547
AUGUST -2022		NR	NR	NR	NR	NR	NR
SEPTEMBER-2022		NR	NR	NR	NR	NR	NR
OCTOBER -2022		NR	NR	NR	NR	NR	NR
NOVEMBER -2022		NR	NR	NR	NR	NR	NR
DECEMBER -2022		NR	NR	NR	NR	NR	NR
=====		=====		=====		=====	
AVERAGE		NR	0.289	NR	278	NR	0.566

Analyte:		Nitrate	Nitrate	Nitrate as N	Nitrate as N	Nitrite	Nitrite
Max MDL:			2.4		0.54		0.44
Units:		MG/L	MG/L	MG/L	MG/L	MG/L	MG/L
Source:		INFLUENT	EFFLUENT	INFLUENT	EFFLUENT	INFLUENT	EFFLUENT
=====		=====		=====		=====	
JANUARY -2022		NR	24.8	NR	5.11	NR	0.667
FEBRUARY -2022		NR	35.3	NR	7.96	NR	ND
MARCH -2022		NR	29.9	NR	6.74	NR	0.475
APRIL -2022		NR	33.2	NR	7.50	NR	0.246
MAY -2022		NR	33.4	NR	7.53	NR	<0.328
JUNE -2022		NR	32.4	NR	7.30	NR	0.410
JULY -2022		NR	35.7	NR	8.05	NR	0.432
AUGUST -2022		NR	NR	NR	NR	NR	NR
SEPTEMBER-2022		NR	NR	NR	NR	NR	NR
OCTOBER -2022		NR	NR	NR	NR	NR	NR
NOVEMBER -2022		NR	NR	NR	NR	NR	NR
DECEMBER -2022		NR	NR	NR	NR	NR	NR
=====		=====		=====		=====	
AVERAGE		NR	32.1	NR	7.17	NR	0.319

Analyte:		Nitrite as N	Nitrite as N	O-Phos as P04	O-Phos as P04	O_Phosphate as P	O_Phosphate as P
Max MDL:			0.13		0.042		0.009
Units:		MG/L	MG/L	MG/L	MG/L	MG/L	MG/L
Source:		INFLUENT	EFFLUENT	INFLUENT	EFFLUENT	INFLUENT	EFFLUENT
=====		=====		=====		=====	
JANUARY -2022		NR	0.255	NR	0.730	NR	NR
FEBRUARY -2022		NR	ND	NR	2.37	NR	NR
MARCH -2022		NR	0.145	NR	0.900	NR	NR
APRIL -2022		NR	0.0750	NR	0.952	NR	0.310
MAY -2022		NR	0.0340	NR	0.996	NR	0.325
JUNE -2022		NR	0.125	NR	0.430	NR	0.140
JULY -2022		NR	0.132	NR	0.576	NR	0.188
AUGUST -2022		NR	NR	NR	NR	NR	NR
SEPTEMBER-2022		NR	NR	NR	NR	NR	NR
OCTOBER -2022		NR	NR	NR	NR	NR	NR
NOVEMBER -2022		NR	NR	NR	NR	NR	NR
DECEMBER -2022		NR	NR	NR	NR	NR	NR
=====		=====		=====		=====	
AVERAGE		NR	0.109	NR	0.993	NR	0.241

ND= not detected; NR= not required

SBWRP Permit Amendment JUL 29,2022, San Diego Water Board agreed to composite sampling.

SOUTH BAY WATER RECLAMATION PLANT
SAMPLE SOURCE: INFLUENT (SB_INF_02) AND EFFLUENT (SB_OUTFALL_01)

ANNUAL 2022

Anions
EPA Method 300.0
GRAB SAMPLES

Analyte:		Sulfate	Sulfate
Max MDL:			14
Units:		MG/L	MG/L
Source:		INFLUENT	EFFLUENT
=====		=====	=====
JANUARY -2022		NR	200
FEBRUARY -2022		NR	208
MARCH -2022		NR	202
APRIL -2022		NR	190
MAY -2022		NR	195
JUNE -2022		NR	180
JULY -2022		NR	195
AUGUST -2022		NR	NR
SEPTEMBER-2022		NR	NR
OCTOBER -2022		NR	NR
NOVEMBER -2022		NR	NR
DECEMBER -2022		NR	NR
=====		=====	=====
AVERAGE		NR	196

ND= not detected; NR= not required

SBWRP Permit Amendment JUL 29,2022, San Diego Water Board agreed to composite sampling.

SOUTH BAY WATER RECLAMATION PLANT
SAMPLE SOURCE: INFLUENT (SB_INF_02) AND EFFLUENT (SB_OUTFALL_01)

ANNUAL 2022

Anions
EPA 300.0
COMPOSITE SAMPLES

Analyte:	Bromide	Bromide	Chloride	Chloride	Fluoride	Fluoride
Max MDL:	0.5	1.1	17.5	35	0.065	0.065
Units:	MG/L	MG/L	MG/L	MG/L	MG/L	MG/L
Source:	INFLUENT	EFFLUENT	INFLUENT	EFFLUENT	INFLUENT	EFFLUENT
=====						
JANUARY -2022	NR	NR	NR	NR	NR	NR
FEBRUARY -2022	0.607	0.515	264	256	0.452	0.545
MARCH -2022	NR	NR	NR	NR	NR	NR
APRIL -2022	NR	NR	NR	NR	NR	NR
MAY -2022	0.490	0.515	300	280	0.480	0.620
JUNE -2022	NR	NR	NR	NR	NR	NR
JULY -2022	NR	NR	NR	NR	NR	NR
AUGUST -2022	NR	0.563	NR	290	NR	0.580
SEPTEMBER-2022	NR	0.510	NR	290	NR	0.660
OCTOBER -2022	NR	0.543	NR	285	NR	0.638
NOVEMBER -2022	NR	0.530	NR	285	NR	0.630
DECEMBER -2022	NR	ND	NR	255	NR	0.618
=====						
AVERAGE	0.549	0.454	282	277	0.466	0.613

Analyte:	Nitrate	Nitrate	Nitrate as N	Nitrate as N	Nitrite	Nitrite
Max MDL:	1.2	2.4	0.018	0.18		0.44
Units:	MG/L	MG/L	MG/L	MG/L	MG/L	MG/L
Source:	INFLUENT	EFFLUENT	INFLUENT	EFFLUENT	INFLUENT	EFFLUENT
=====						
JANUARY -2022	NR	NR	NR	NR	NR	NR
FEBRUARY -2022	ND	30.5	NR	6.89	NR	ND
MARCH -2022	NR	NR	NR	NR	NR	NR
APRIL -2022	NR	NR	NR	NR	NR	NR
MAY -2022	ND	36.3	ND	8.20	NR	ND
JUNE -2022	NR	NR	NR	NR	NR	NR
JULY -2022	NR	NR	NR	NR	NR	NR
AUGUST -2022	NR	44.3^	NR	10.0	NR	ND
SEPTEMBER-2022	NR	22.4^	NR	5.05	NR	ND
OCTOBER -2022	NR	34.1^	NR	7.70	NR	ND
NOVEMBER -2022	NR	30.3^	NR	6.85	NR	ND
DECEMBER -2022	NR	23.7^	NR	5.35	NR	ND
=====						
AVERAGE	0.0	31.7	0.0	7.15	NR	0.0

Analyte:	Nitrite as N	Nitrite as N	O-Phos as P04	O-Phos as P04	O-Phos as P	O-Phos as P
Max MDL:		0.3	0.042	0.042	0.009	0.009
Units:	MG/L	MG/L	MG/L	MG/L	MG/L	MG/L
Source:	INFLUENT	EFFLUENT	INFLUENT	EFFLUENT	INFLUENT	EFFLUENT
=====						
JANUARY -2022	NR	NR	NR	NR	NR	NR
FEBRUARY -2022	NR	0.310	14.6	4.79	NR	NR
MARCH -2022	NR	NR	NR	NR	NR	NR
APRIL -2022	NR	NR	NR	NR	NR	NR
MAY -2022	NR	ND	14.1	1.01	4.60	0.330
JUNE -2022	NR	NR	NR	NR	NR	NR
JULY -2022	NR	NR	NR	NR	NR	NR
AUGUST -2022	NR	<0.100	NR	NR	NR	2.46
SEPTEMBER-2022	NR	ND	NR	NR	NR	0.285
OCTOBER -2022	NR	ND	NR	NR	NR	0.628
NOVEMBER -2022	NR	ND	NR	NR	NR	0.420
DECEMBER -2022	NR	<0.300	NR	NR	NR	0.403
=====						
AVERAGE	NR	0.0443	14.4	2.90	4.60	0.754

^= calculated value

ND= not detected; NR= not required

SBWRP Permit Amendment JUL 29,2022, San Diego Water Board agreed to composite sampling.

SOUTH BAY WATER RECLAMATION PLANT
SAMPLE SOURCE: INFLUENT (SB_INF_02) AND EFFLUENT (SB_OUTFALL_01)

ANNUAL 2022

Anions
EPA 300.0
COMPOSITE SAMPLES

Analyte:	Sulfate	Sulfate
Max MDL:	1.4	14
Units:	MG/L	MG/L
Source:	INFLUENT	EFFLUENT
=====	=====	=====
JANUARY -2022	NR	NR
FEBRUARY -2022	182	200
MARCH -2022	NR	NR
APRIL -2022	NR	NR
MAY -2022	160	200
JUNE -2022	NR	NR
JULY -2022	NR	NR
AUGUST -2022	NR	190
SEPTEMBER-2022	NR	190
OCTOBER -2022	NR	188
NOVEMBER -2022	NR	195
DECEMBER -2022	NR	210
=====	=====	=====
AVERAGE	171	196

ND= not detected; NR= not required

SBWRP Permit Amendment JUL 29,2022, San Diego Water Board agreed to composite sampling.

SOUTH BAY WATER RECLAMATION PLANT
SAMPLE SOURCE: INFLUENT (SB_INF_02) AND EFFLUENT (SB_OUTFALL_01)

ANNUAL 2022

Cations
EPA 200.7
Composite samples

Analyte:		Calcium		Magnesium		Lithium	
Max MDL/ Units:		.0588 mg/L		.0775 mg/L		.005 mg/L	
Source:		INF	EFF	INF	EFF	INF	EFF
=====		=====	=====	=====	=====	=====	=====
JANUARY	-2022	NR	73.7	NR	30.6	NR	0.0320
FEBRUARY	-2022	79.4	77.5	29.8	29.3	0.0350	0.0335
MARCH	-2022	NR	77.2	NR	29.5	NR	0.0335
APRIL	-2022	NR	74.2	NR	29.3	NR	0.0315
MAY	-2022	83.6	77.3	34.7	32.5	0.0308	0.0319
JUNE	-2022	NR	74.4	NR	31.5	NR	0.0306
JULY	-2022	NR	76.8	NR	32.2	NR	0.0353
AUGUST	-2022	NR	78.5	NR	32.6	NR	0.0363
SEPTEMBER	-2022	NR	78.3	NR	31.6	NR	0.0364
OCTOBER	-2022	NR	74.5	NR	31.2	NR	0.0352
NOVEMBER	-2022	NR	73.9	NR	32.3	NR	0.0324
DECEMBER	-2022	NR	84.2	NR	31.8	NR	0.0418
=====		=====	=====	=====	=====	=====	=====
Average:		81.5	76.7	32.3	31.2	0.0329	0.0342

Analyte:		Sodium		Potassium	
Max MDL/ Units:		.782 mg/L		.142 mg/L	
Source:		INF	EFF	INF	EFF
=====		=====	=====	=====	=====
JANUARY	-2022	NR	224	NR	16.0
FEBRUARY	-2022	213	212	19.1	16.7
MARCH	-2022	NR	215	NR	17.5
APRIL	-2022	NR	205	NR	16.8
MAY	-2022	224	228	19.8	17.6
JUNE	-2022	NR	227	NR	17.9
JULY	-2022	NR	239	NR	17.7
AUGUST	-2022	NR	231	NR	18.8
SEPTEMBER	-2022	NR	229	NR	17.8
OCTOBER	-2022	NR	222	NR	16.8
NOVEMBER	-2022	NR	226	NR	18.0
DECEMBER	-2022	NR	213	NR	17.2
=====		=====	=====	=====	=====
Average:		219	223	19.5	17.4

ND= not detected; NR= not required

5.6 BIOSOLIDS BENEFICIAL USE AND LANDFILL DISPOSAL SUMMARY

The table below summarizes the biosolids beneficially used as alternate cover and land applied.

Table 5.6-1 Annual Biosolids Beneficial Use & Landfill Disposal Summary

2022 Month	Otay Landfill Beneficial Use ^(PTL) (wet Tons)	Otay Landfill Beneficial Use ^(MBC) (wet Tons)	Otay Landfill (PTL) (wet Tons)	Otay Landfill (MBC) (wet Tons)	Otay Landfill Total (wet Tons)	Yuma County, AZ Total (wet Tons)	Mercopa County, AZ Total (wet Tons)	Total Dry Tons*	Total Biosolids (dry metric tons) *
January		0.00		0.00	0.00	10,710.17	0.00	3,009.6	2,730.23
February		0.00		0.00	0.00	8,147.76	0.00	2,342.5	2,125.06
March		0.00		0.00	0.00	9,760.57	0.00	2,732.0	2,478.41
April		0.00		0.00	0.00	7,840.58	0.00	2,268.3	2,057.75
May		0.00		0.00	0.00	7,138.26	0.00	2,013.0	1,826.15
June		0.00		0.00	0.00	9,159.78	0.00	2,509.8	2,276.83
July		0.00		0.00	0.00	10,996.73	0.00	2,909.7	2,639.67
August		0.00		0.00	0.00	11,867.23	0.00	3,207.7	2,909.99
September		0.00		0.00	0.00	12,019.92	0.00	3,239.4	2,938.71
October		0.00		0.00	0.00	11,408.20	0.00	3,096.2	2,808.81
November		0.00		0.00	0.00	11,018.41	0.00	2,966.2	2,690.85
December		0.00		0.00	0.00	11,495.21	0.00	3,107.2	2,818.76
Total:		0.00		0.00	0.00	121,562.82	0.00	33,401.38	30,301.23
Monthly Average:		0.00		0.00	0.00	10,130.24	0.00	2,783.45	2,525.10

* NOTE: Value is not in complete agreement with Operations reports; there is a < 1% difference due to the rounding and/or truncation of %TS results.

No Biosolids were shipped to, disposed of, or beneficially used at Otay landfill.
Biosolids generated by Point Loma/MBC were land applied in Arizona.