




PLAN

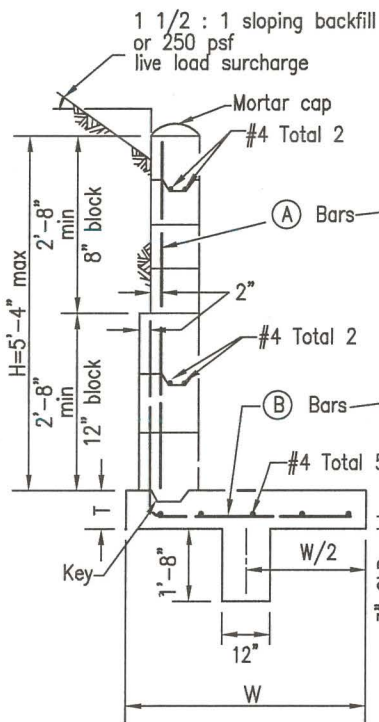

TYPICAL SECTION
over 3'-8"

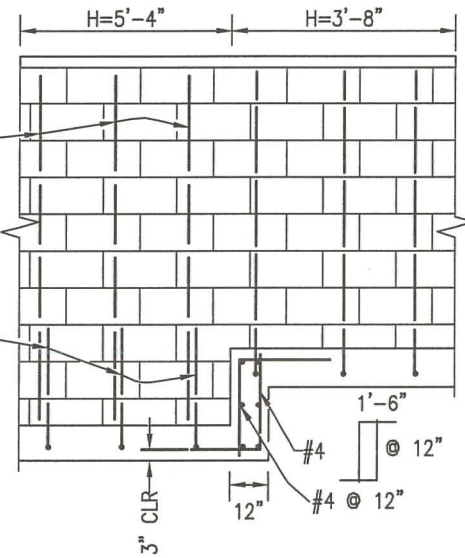

ELEVATION
Horizontal reinf. not shown

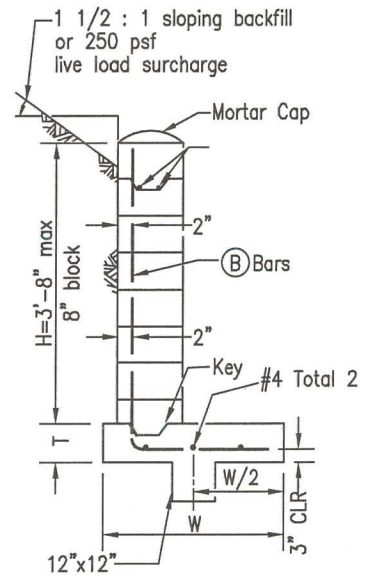

TYPICAL SECTION
3'-8" max

DIMENSIONS AND REINFORCING STEEL		
H (max)	5'-4"	3'-8"
T (min)	0'-10"	0'-10"
W (min)	5'-0"	3'-9"
(A) Bars	#4@16"	—
(B) Bars	#6@16"	#4@16"
max soil pressure	700psf	550psf

NOTES:

1. See C-7 and C-8 for additional notes and details.
2. Fill all block cells with grout.

Revision	By	Approved	Date
ORIGINAL		Kercheval	12/75
Add Metric		T. Stanton	03/03
Delete Metric	S.S.	T. Shell	03/11

SAN DIEGO REGIONAL STANDARD DRAWING

MASONRY RETAINING WALL TYPE 2
(LIVE LOAD SURCHARGE OR SLOPING BACKFILL)

RECOMMENDED BY THE SAN DIEGO REGIONAL STANDARDS COMMITTEE

T. Stanton 7/26/2012
Chairperson R.C.E. 19246 Date

DRAWING NUMBER **C-2**