


PLAN

TYPE	PIPE DIAMETER (D1)	X	Y (See Note 8)	Z
A4	up to 39"	4'	4'	6'
A5	42" to 48"	5'	4'	6'
A6	51" to 60"	6'	4'	6'
A7	63" to 66"	7'	4'	7'
A8	69" to 78"	8'	4'	8'

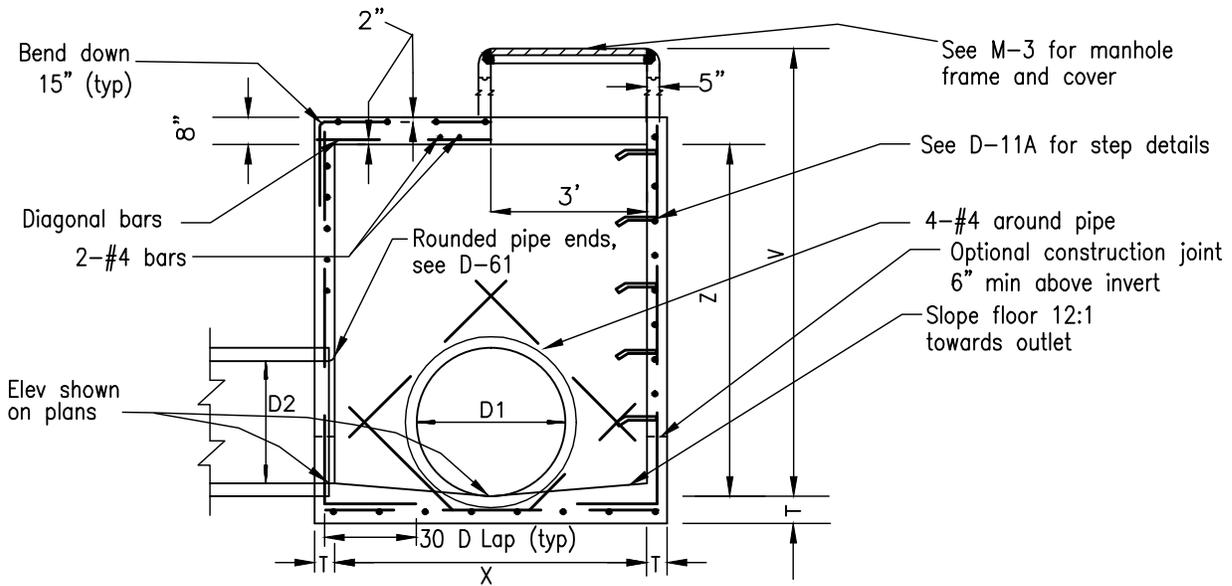


SECTION A-A

NOTES

1. See D-11A & D-11B for additional notes and details.
2. Concrete base shall be 560-C-3250.
3. All precast components shall be reinforced with 1/4" diameter steel, wound spirally on 4" centers.
4. All joints shall be set in Class C mortar.
5. Maintain 1-1/2" clear spacing between reinforcing and concrete surface unless otherwise noted.
6. Exposed edges of concrete shall be rounded with a radius of 1/2".
7. Manhole cover to be marked "Storm Drain".
8. Modifications to "Y" dimension required if pipe (D2) exceeds 39".
9. If constructed adjacent to sidewalk, top of manhole to match sidewalk slope.

LEGEND ON PLANS



Revision	By	Approved	Date
ORIGINAL		Kercheval	12/75
Add Metric		T. Stanton	03/03
Reformatted		T. Stanton	04/06
Edited		T. Stanton	02/09
Edited	S.S.	T. Regello	03/11

SAN DIEGO REGIONAL STANDARD DRAWING

STORM DRAIN CLEANOUT - TYPE A

RECOMMENDED BY THE SAN DIEGO REGIONAL STANDARDS COMMITTEE

T. Stanton 7/26/2012
Chairperson R.C.E. 19246 Date

DRAWING NUMBER **D-09**