



TYPE	PIPE DIAMETER (D1)	X	Y	Z
B5	up to 51"	5'	4'	5'
B6	54" to 60"	6'	4'	6'
B7	63" to 69"	7'	4'	7'
B8	72" to 81"	8'	4'	8'
B9	84" to 90"	9'	4'	9'

**NOTES**

1. See D-11A & D-11B for additional notes and details.
2. All joints shall be set in Class C mortar.
3. All precast components shall be reinforced with 1/4" diameter steel wound spirally on 4" centers.
4. Maintain 1-1/2" clear spacing between reinforcing and concrete surface.
5. Concrete base shall be 560-C-3250.
6. Exposed edges of concrete shall be rounded with a 1/2" radius.
7. Manhole cover to be marked "Storm Drain".
8. Modifications to "Y" dimension required if pipe (D2) exceeds 39".
9. If constructed adjacent to sidewalk, top of manhole to match sidewalk slope.

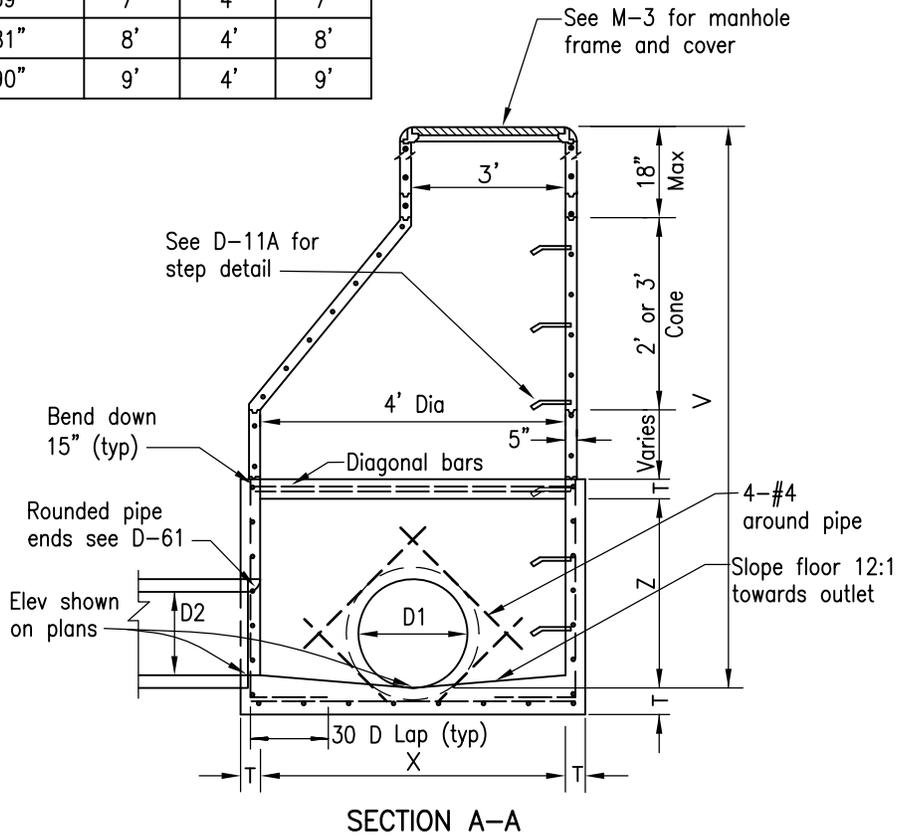

**LEGEND ON PLANS**



Revision	By	Approved	Date
ORIGINAL		Kercheval	12/75
Add Metric		T. Stanton	03/03
Reformatted		T. Stanton	04/06
Edited		T. Stanton	02/09
Edited	S.S.	T. Regello	03/11

**SAN DIEGO REGIONAL STANDARD DRAWING**

**STORM DRAIN CLEANOUT - TYPE B**

RECOMMENDED BY THE SAN DIEGO REGIONAL STANDARDS COMMITTEE

*T. Stanton* 7/26/2012

Chairperson R.C.E. 19246 Date

DRAWING NUMBER **D-10**