


ELEVATION

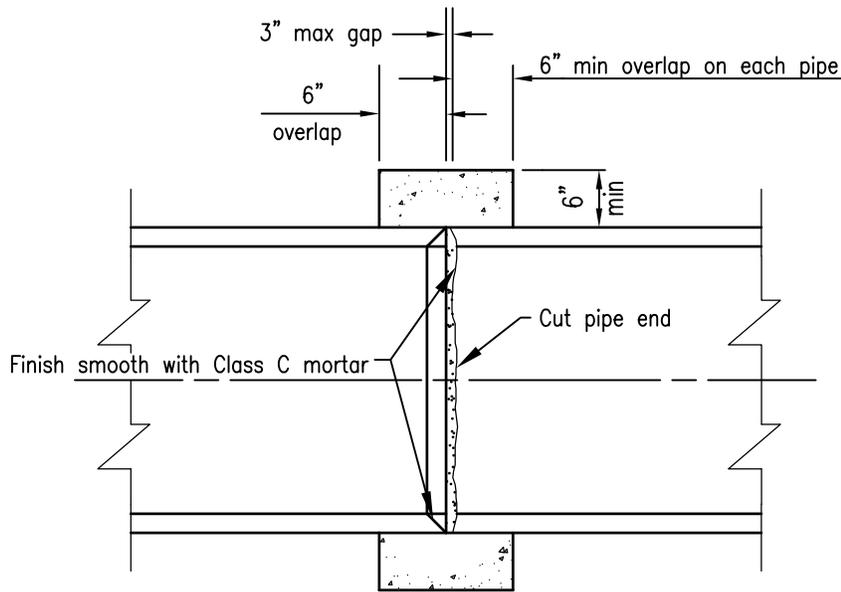


SECTION A-A

NOTES

1. Pipe collar does not have to be finished if covered.
2. Concrete shall be 560-C-3250.
3. Where gap exceeds 3" but is not more than 6" an internal form shall be used.

LEGEND ON PLANS



Revision	By	Approved	Date
ORIGINAL		Kercheval	12/75
Add Metric		T. Stanton	03/03
Reviewed		T. Stanton	04/06
Edited	S.S.	T. Regello	03/11

SAN DIEGO REGIONAL STANDARD DRAWING

PIPE COLLAR

RECOMMENDED BY THE SAN DIEGO REGIONAL STANDARDS COMMITTEE

*T. Stanton* 7/26/2012

Chairperson R.C.E. 19246 Date

DRAWING NUMBER **D-62**