


A ←

SECTION A-A

CSP INLET

CATCH BASIN

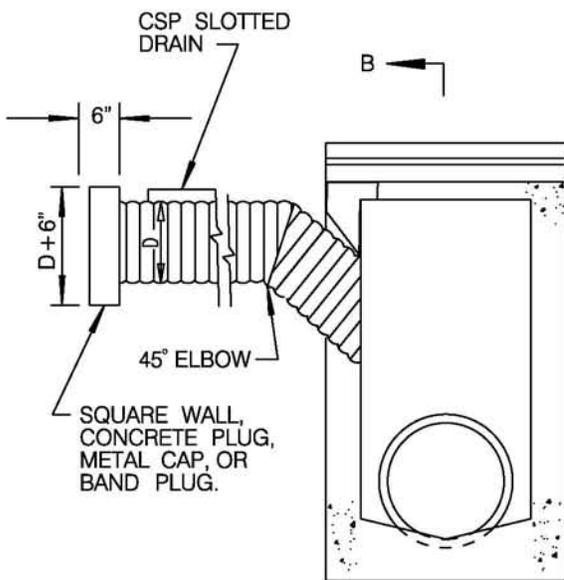

B ←

SECTION B-B

ALTERNATE SECTION B-B

INLETS

NOTES:

1. EITHER FIELD JOINT WITH A PLIABLE MIXTURE OF SAND, PORTLAND CEMENT EMULSIFIED ASPHALT (MIXTURE OF 1 PART PORTLAND CEMENT, 3-5 PARTS SAND, AND 1 1/2 PARTS SSI EMULSIFIED ASPHALT) OR CONTINUOUS WELD.
2. SLOTTED DRAIN INSTALLATIONS SHALL BE ENCASED WITH 6 INCH PCC 520-C-2500 ALL AROUND AND SHALL BE POURED MONOLITHICALLY WITH THE CURB AND GUTTER.

REVISION	BY	APPROVED	DATE
ORIGINAL*	KA	J. NAGELVOORT	01/12

CITY OF SAN DIEGO - STANDARD DRAWING

RECOMMENDED BY THE CITY OF SAN DIEGO STANDARDS COMMITTEE

H. Hadli 1/31/2012
COORDINATOR R.C.E. 65271 DATE

**SLOTTED DRAIN CONNECTIONS
TO STANDARD INLETS**

DRAWING NUMBER **SDD-103**