


TYPE A

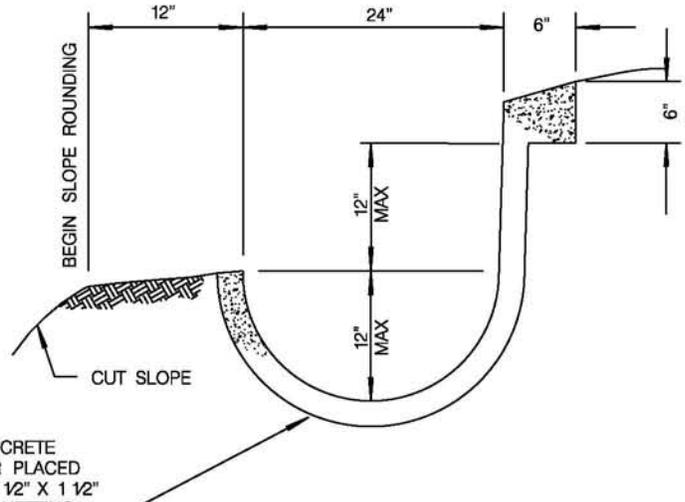


TYPE B


BROW DITCH

BOTTOM MAY BE ROUNDED AT THE OPTION OF THE CONTRACTOR

3" 470-C-2000 CONCRETE OR 3" 2500 PSI, AIR PLACED CONCRETE WITH 1 1/2" X 1 1/2" 17 GAGE STUCCO NETTING.

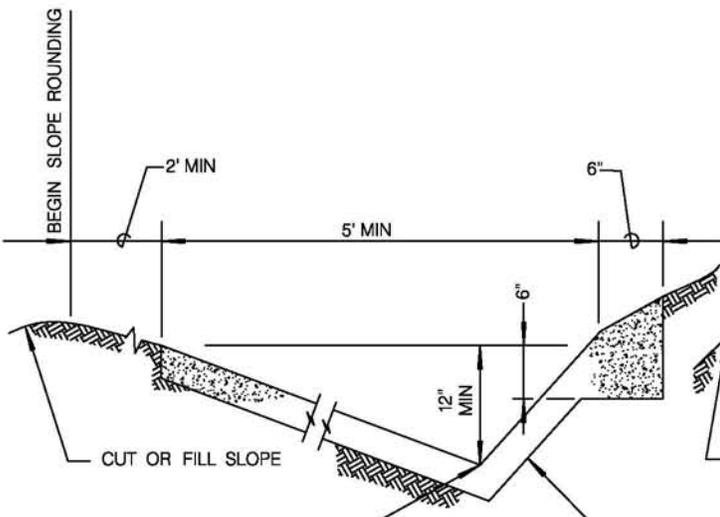

TYPE C

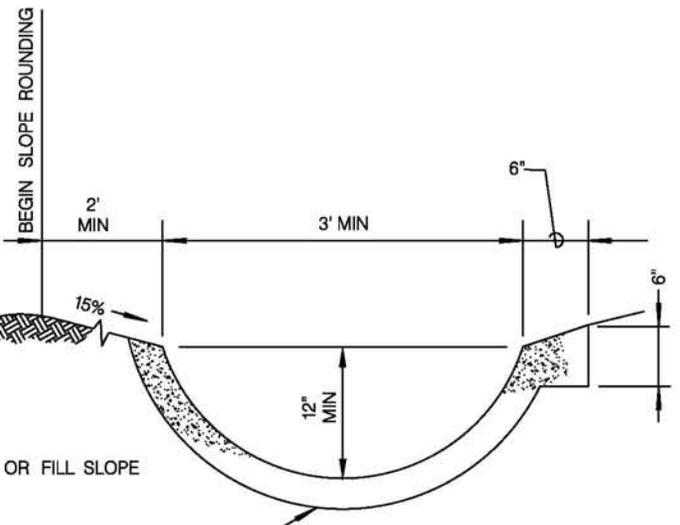

TYPE D

TERRACE DITCH

BOTTOM MAY BE ROUNDED AT THE OPTION OF THE CONTRACTOR

3" 470-C-2000 CONCRETE OR 3" 2500PSI, AIR PLACED CONCRETE WITH 1 1/2" X 1 1/2" 17 GAGE STUCCO NETTING.

NOTES:

1. LONGITUDINAL SLOPE OF LINED DITCH SHALL BE 2% MINIMUM.
2. OVER SLOPE DOWN DITCHES SHALL EMPLOY 6" THICKENED EDGE SECTION AT BOTH SIDES OF DITCH.
3. STUCCO NETTING SHALL BE GALVANIZED AND SHALL HAVE 1 1/2" COVER.

LEGEND ON PLANS



| REVISION | BY | APPROVED | DATE |
|-----------|----|---------------|-------|
| ORIGINAL* | KA | J. NAGELVOORT | 01/12 |
| | | | |
| | | | |
| | | | |

CITY OF SAN DIEGO - STANDARD DRAWING

DRAINAGE DITCHES

RECOMMENDED BY THE CITY OF SAN DIEGO STANDARDS COMMITTEE

H. Hadli 1/31/2012
COORDINATOR R.C.E. 65271 DATE

DRAWING NUMBER **SDD-106**