



PLAN

TRANSITION TO NORMAL CURB HEIGHT IN 10' ON BOTH SIDES UNLESS OTHERWISE NOTED

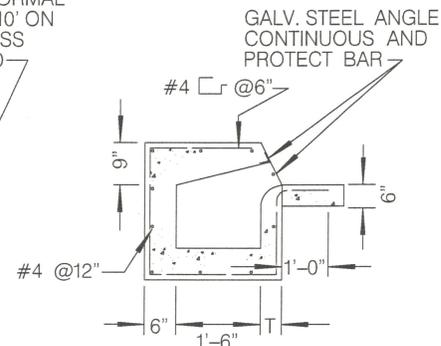


SECTION B-B

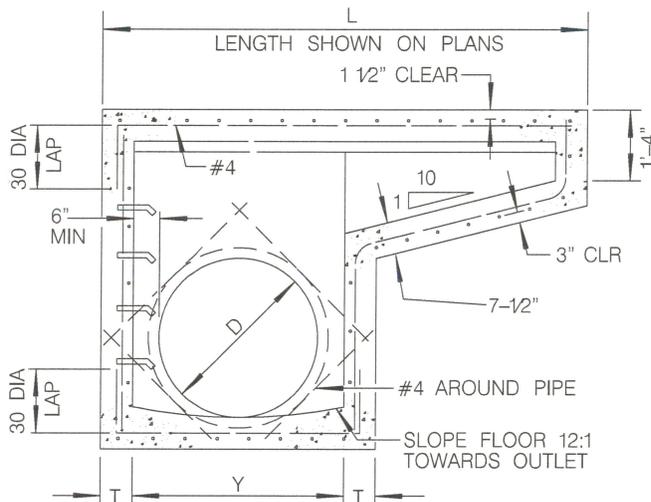

SECTION C-C

Y IS DETERMINED BY PIPE SIZE-4' MIN, 8' MAX

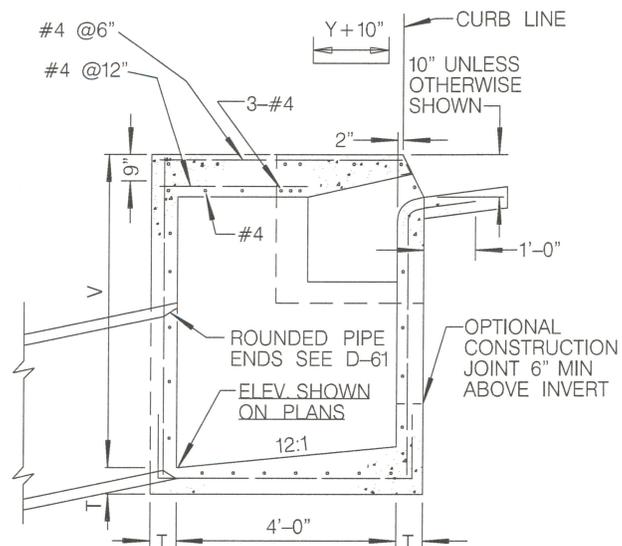

SECTION A-A

NOTES

1. TYPES ARE DESIGNATED AS FOLLOWS: (NO WING)B, (ONE WING)B-1, (TWO WINGS)B-2.
2. EXPOSED EDGES OF CONCRETE SHALL BE ROUNDED WITH A RADIUS OF 1/2".
3. WHEN V EXCEEDS 4', STEPS SHALL BE INSTALLED.
4. CONCRETE GUTTER TO MATCH ADJACENT GUTTERS.
5. AN EXPANSION JOINT SHALL BE PLACED AT THE ENDS OF THE INLET WHERE THE CURB IS TO ADJOIN PER G-10.
6. PROVIDE 1/4" TOOLED GROOVE IN TOP SLAB IN LINE WITH BACK OF ADJACENT CURB.
7. SURFACE OF TOP SLAB BE SIDEWALK FINISHED TO DRAIN TOWARD STREET AT A SLOPE OF 1/4" PER FOOT.
8. ELEVATIONS SHALL BE SHOWN ON THE PLANS WHERE INDICATED BY "O" SYMBOL.

LEGEND ON PLANS



REVISION	BY	APPROVED	DATE
ORIGINAL*	KA	J. NAGELVOORT	01/12
UPDATED	RB	J. NAGELVOORT	10/15

CITY OF SAN DIEGO - STANDARD DRAWING

RECOMMENDED BY THE CITY OF SAN DIEGO STANDARDS COMMITTEE

CAWingra 10/5/15
COORDINATOR R.C.E. 56523 DATE

CURB INLET - TYPE B

DRAWING NUMBER **SDD-116**