


PERMEABLE INTERLOCKING CONCRETE PAVERS A NOT TO SCALE

NOTES:

1. ALL PICP SHALL CONFORM TO ASTM D636 AND ADA DESIGN GUIDELINES.
2. PICP CROSS-SLOPE SHALL BE 1.5%; MAXIMUM RUNNING SLOPE SHALL NOT EXCEED 5.0%.
3. ELEVATION GRADIENT BETWEEN THE CONCRETE GUTTER AND ADJACENT PICP SHALL NOT EXCEED 1/4"; OTHERWISE, PROVIDE 1:2 BEVEL ON EDGE OF GUTTER.
4. OPEN VOID FILL MEDIA AROUND PICP SHALL BE NO. 8 WASHED DRAINAGE STONE.
5. ATTACH 30 MIL PLASTIC LINER PER SDD-127.
6. ALL AGGREGATE SIZED ACCORDING TO ASTM D448.
7. LOCATE UNDERDRAIN AS SHOWN ON THE IMPROVEMENT PLANS. HORIZONTAL LOCATION MAY VARY WITHIN PAVEMENT SECTION AS LONG AS MINIMUM OFFSET DISTANCES AND BOTTOM SLOPES ARE MAINTAINED.
8. DEPTH OF PERFORATED PVC PIPE MAY BE ADJUSTED TO TIE INTO THE ADJACENT CONNECTION POINT TO BMP DRAINAGE INFRASTRUCTURE AS NEEDED.
9. PIPE PENETRATIONS THROUGH PLASTIC LINER SHALL BE SEALED ACCORDING TO ASTM D6497.

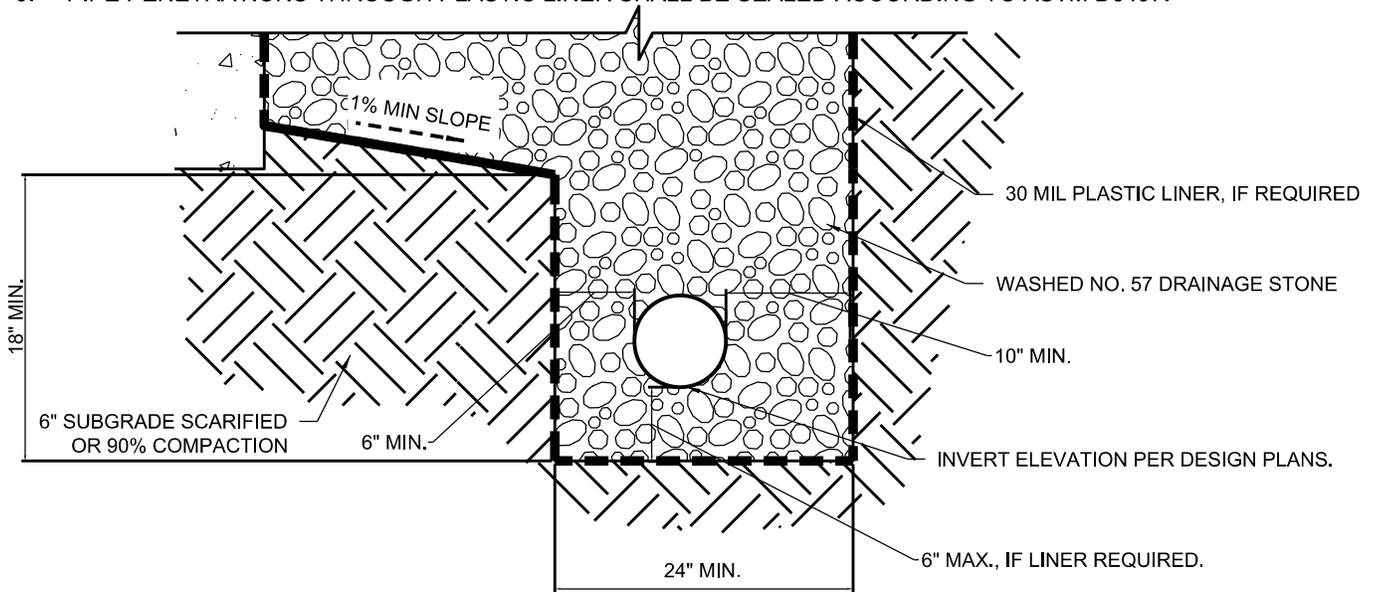

UNDERDRAIN DETAIL B NOT TO SCALE

REVISION	BY	APPROVED	DATE	CITY OF SAN DIEGO - STANDARD DRAWING	RECOMMENDED BY THE CITY OF SAN DIEGO STANDARDS COMMITTEE
ORIGINAL	JT	J. NAGELVOORT	10/15		COORDINATOR R.C.E. 56523 DATE
				PERMEABLE INTERLOCKING CONCRETE PAVER DETAIL	DRAWING NUMBER SDD-129