



EXISTING FLOW LINE (FL)  
ELEVATION OR ELEVATION  
PER PLAN

PROPOSED OR EXISTING  
CURB AND GUTTER

ENERGY DISSIPATION PAD  
6" THICK, 3" TO 6" RIVER ROCK,  
MORTAR IN PLACE

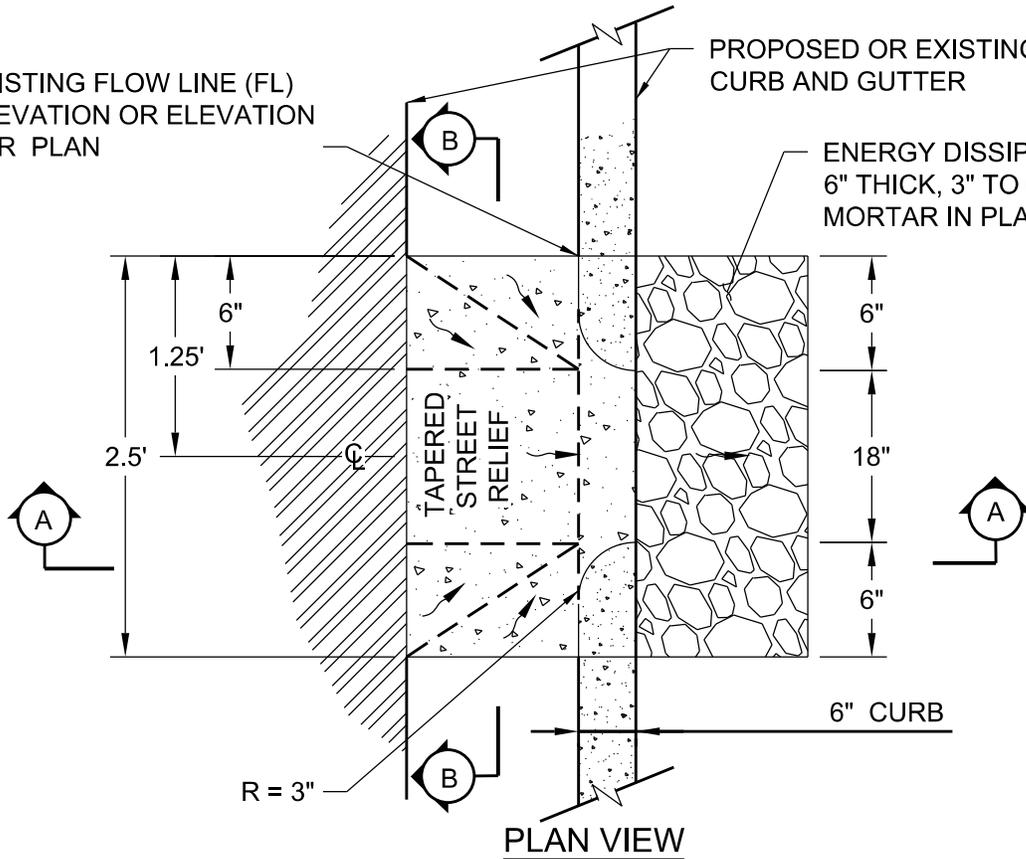


6" CURB & GUTTER PER STD. DWG.

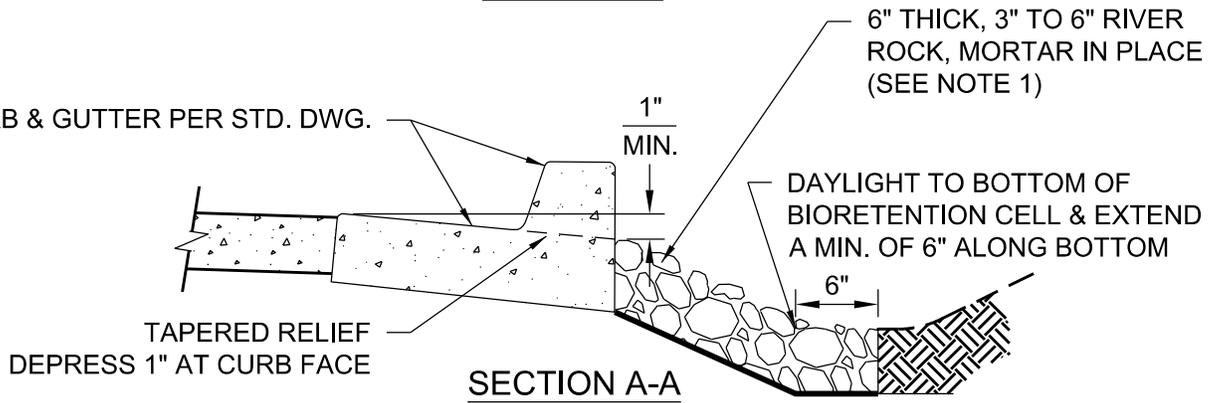

**CONSTRUCTION NOTE:**

1. RIVER ROCK DISSIPATION PAD PROVIDED AS STABILIZED ENTRANCE TO BIOFILTRATION SYSTEM. ROCK SHALL BE PLACED IN IRREGULAR PATTERN USING NON-UNIFORM SIZES TO PREVENT PREFERENTIAL FLOW PATHS, INCREASE ENERGY DISSIPATION, AND TO LIMIT THE SURFACE AREA OF EXPOSED MORTAR.

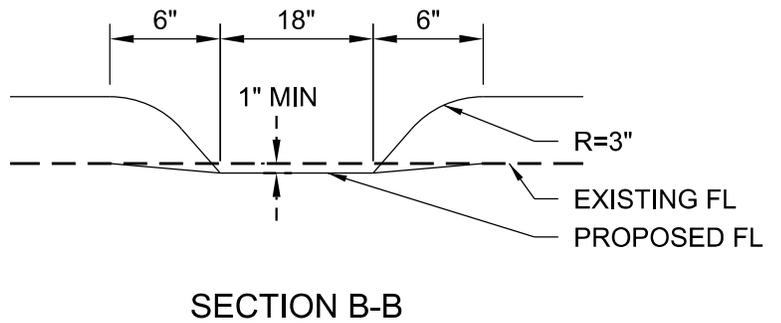

REVISION	BY	APPROVED	DATE
ORIGINAL	JT	J. NAGELVOORT	10/15

CITY OF SAN DIEGO - STANDARD DRAWING

RECOMMENDED BY THE CITY OF SAN DIEGO  
STANDARDS COMMITTEE

**CURB CUT INLET WITH RIVER ROCK  
DISSIPATION**

COORDINATOR R.C.E. 56523 DATE

DRAWING  
NUMBER

**SDD-136**