


PLAN

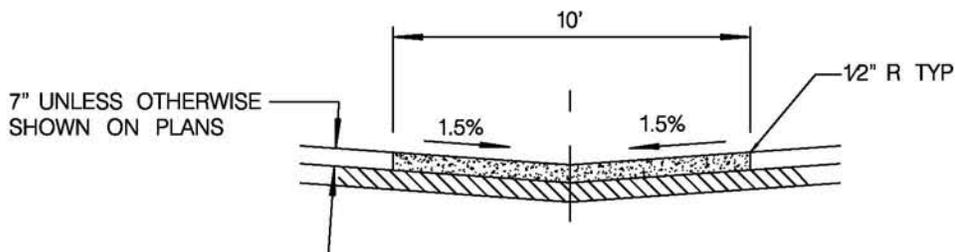

SECTION A-A

NOTES:

1. CROSS GUTTER TO BE CONSTRUCTED WHERE THE DRAINAGE IS CARRIED ACROSS STREET.
2. MINIMUM ALLOWABLE CROSS GUTTER SLOPE IS 0.5%.
3. CONCRETE SHALL BE 560-C-3250.
4. IN ALL CASES SUBGRADE SHALL BE COMPACTED TO 95% MIN RELATIVE COMPACTION TO A DEPTH OF 12".
5. ALL HISTORICAL STAMPS / IMPRESSIONS (STREET NAME, CONTRACTOR NAME, AND DATE) SHALL BE PRESERVED.

LEGEND ON PLANS



REVISION	BY	APPROVED	DATE
ORIGINAL*	KA	J. NAGELVOORT	01/12

CITY OF SAN DIEGO - STANDARD DRAWING

RECOMMENDED BY THE CITY OF SAN DIEGO STANDARDS COMMITTEE

H. Hadli 1/31/2012
COORDINATOR R.C.E. 65271 DATE

MID-BLOCK CROSS GUTTER

DRAWING NUMBER **SDG-158**