


HINGED LOCKING BRASS CAP,  
SOLVENT WELDED TO SLEEVE  
(SHOWN WITH CAP KEY)

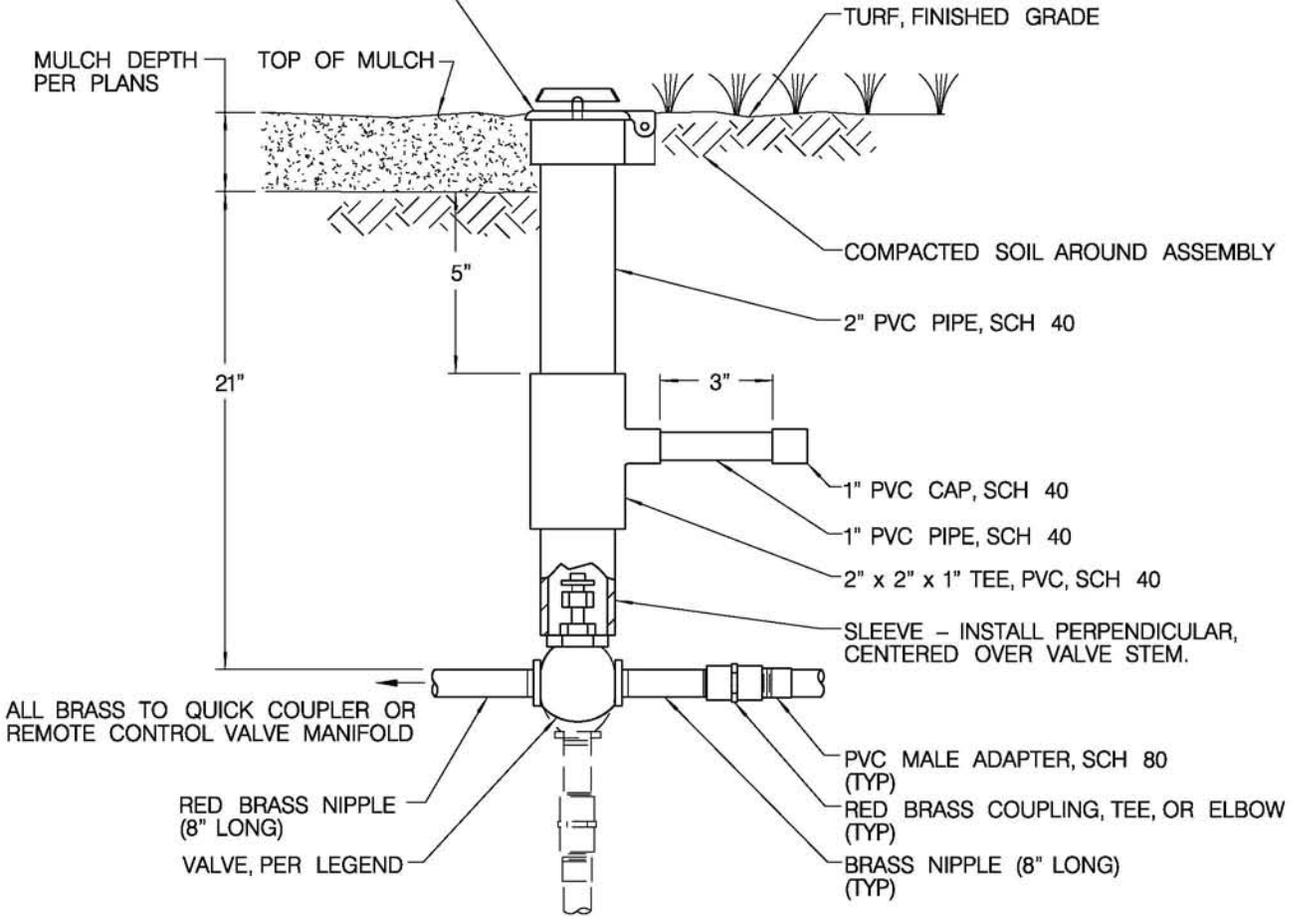

**NOTES:**

1. GLOBE VALVES SHALL BE FURNISHED WITH A STANDARD BRONZE CROSS HANDLE, CENTERED IN PIPE SLEEVE.
2. VALVES SHALL BE INSTALLED WITHIN 12" OF HARDSCAPE.
3. GLOBE VALVES SHALL BE FURNISHED WITH A REMOVABLE BONNET AND PACKING GLAND NUT.
4. CLOSE NIPPLES SHALL NOT BE USED.
5. LOCKING CAP SHALL BE MOUNTED FLUSH WITH FINISHED GRADE IN TURF AREAS AND ABOVE FINISHED GRADE IN SHRUB AREAS, PER DEPTH OF MULCH.
6. PROVIDE APPROPRIATE LOCKING CAP KEY AND VALVE KEY TO OPERATE VALVE AT DEPTH.
7. LOCATE OUTSIDE OF TURF WHEN POSSIBLE.
8. TEFLON TAPE SHALL BE USED ON ALL THREADED CONNECTIONS.
9. WHEN INSTALLED AS MAINLINE ISOLATION VALVE, NIPPLES AND FITTINGS MAY BE SCH 80 PVC.

**LEGEND**



GV

REVISION	BY	APPROVED	DATE
ORIGINAL*	RH	J. NAGELVOORT	01/12

CITY OF SAN DIEGO - STANDARD DRAWING

**ISOLATION GLOBE VALVE  
2" AND SMALLER**

RECOMMENDED BY THE CITY OF SAN DIEGO  
STANDARDS COMMITTEE

*H. Hadli* 1/31/2012  
COORDINATOR R.C.E. 65271 DATE

DRAWING  
NUMBER **SDI-106**