


PLAN VIEW (FOR CONCRETE PAD)

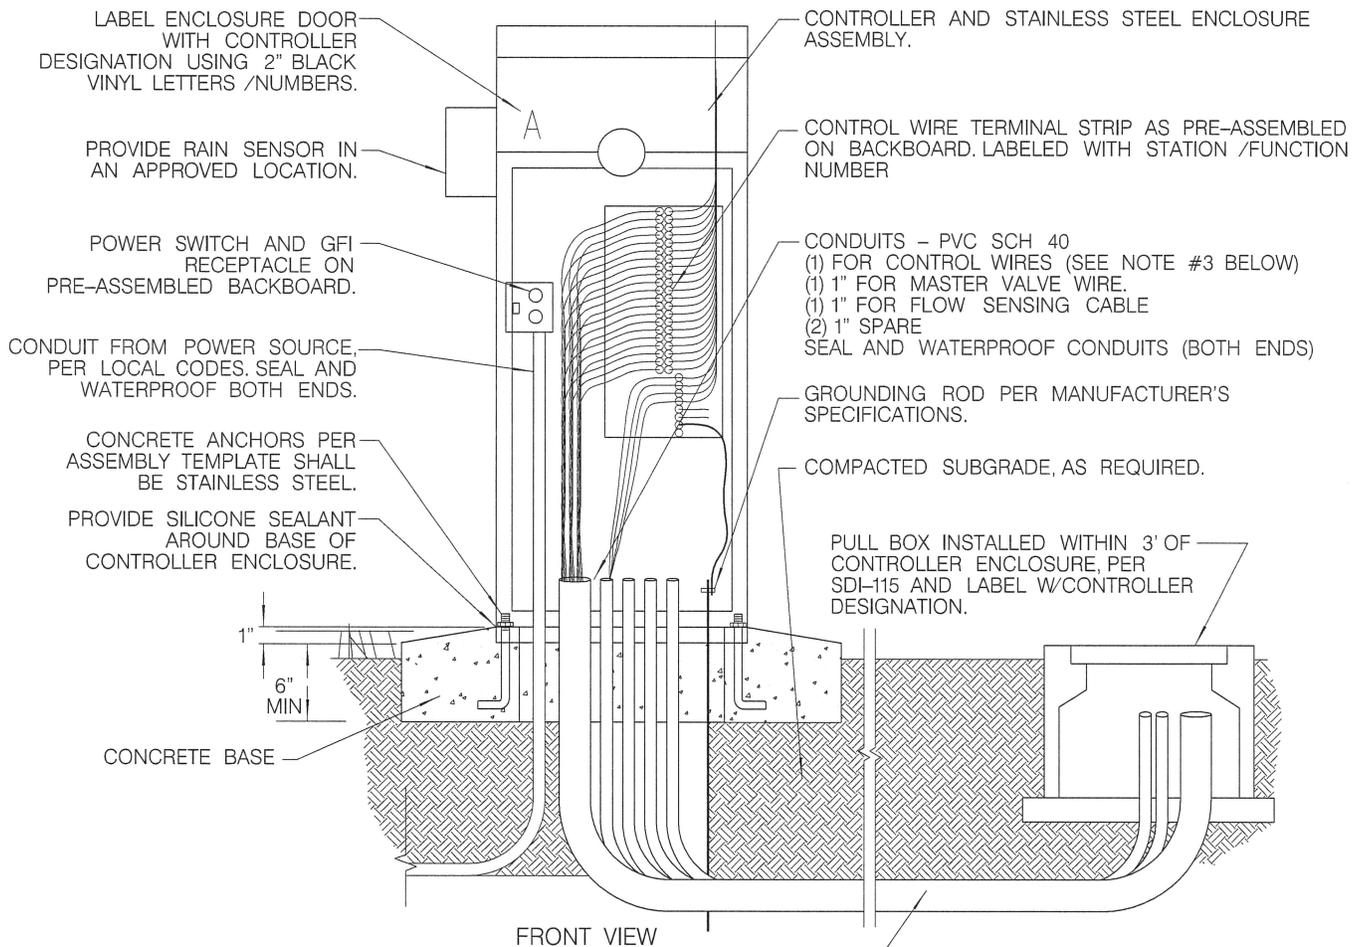

FRONT VIEW

NOTES:

1. ALL CONTROLLER ASSEMBLIES AND OPTIONS SHALL BE COMPLETELY PRE-ASSEMBLED IN A STAINLESS STEEL ENCLOSURE.
2. CONTROL WIRE CONDUIT SHALL BE TWICE THE DIAMETER OF THE WIRE BUNDLE, 2" MINIMUM.
3. PROVIDE SEPARATE CIRCUIT BREAKER FOR CONTROLLER(S) AT ELECTRICAL CONTROL PANEL AND LABEL.
4. SEAL CONDUIT OPENINGS WITH ELECTRICAL SEALANT, AS APPROVED BY THE ENGINEER.

LEGEND ON PLANS



CONDUIT SWEEPS TO TRENCH DEPTH. REFER TO TRENCH DETAIL, SDI-110.

REVISION	BY	APPROVED	DATE
ORIGINAL*	RH	J. NAGELVOORT	01/12
UPDATED	AR	J. NAGELVOORT	10/15

CITY OF SAN DIEGO - STANDARD DRAWING

**AUTOMATIC IRRIGATION CONTROLLER
PEDESTAL MOUNTED**

RECOMMENDED BY THE CITY OF SAN DIEGO STANDARDS COMMITTEE

Chungwa 10/5/15
COORDINATOR R.C.E. 56523 DATE

DRAWING NUMBER **SDI-117**