



LEGEND ON PLANS



SIDE VIEW

LABEL ENCLOSURE DOOR WITH CONTROLLER DESIGNATION USING 2" BLACK VINYL LETTERS/NUMBERS.

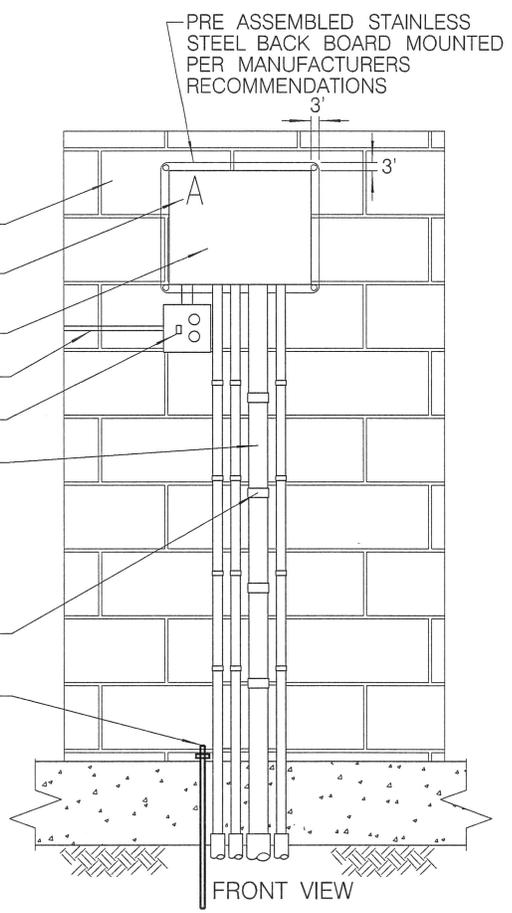

FRONT VIEW

CONDUITS - PVC SCH 40
SEAL CONDUITS AT BOTH ENDS
(1) FOR CONTROL WIRES.
SEE NOTE #1 BELOW.
(1) 1" FOR MASTER VALVE WIRE.
(1) 1" FOR FLOW SENSING CABLE.
(2) 1" SPARE.

STEEL CONDUIT STRAPS AND FASTENERS,
4 PER CONDUIT.

GROUNDING ROD
PER MANUFACTURER SPECS

NOTES:

1. CONTROL WIRE CONDUIT SHALL BE TWICE THE DIAMETER OF THE WIRE BUNDLE, 2" MINIMUM.
2. PROVIDE SEPARATE CIRCUIT BREAKERS FOR CONTROLLER(S) AT ELECTRICAL CONTROL PANEL, AND LABEL.
3. PROVIDE RAIN SENSOR AND INSTALL IN AN APPROVED LOCATION.

REVISION	BY	APPROVED	DATE
ORIGINAL*	RH	J. NAGELVOORT	01/12
UPDATED	AR	J. NAGELVOORT	10/15

CITY OF SAN DIEGO - STANDARD DRAWING

**AUTOMATIC IRRIGATION CONTROLLER
INDOOR WALL MOUNTED**

RECOMMENDED BY THE CITY OF SAN DIEGO
STANDARDS COMMITTEE

CABungca 10/5/15

COORDINATOR R.C.E. 56523 DATE

DRAWING NUMBER **SDI-118**