




TYPE A

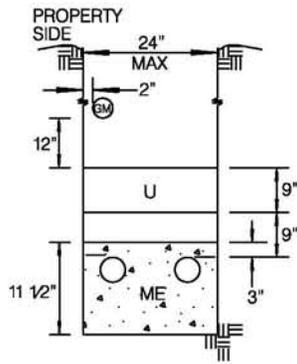


TYPE B

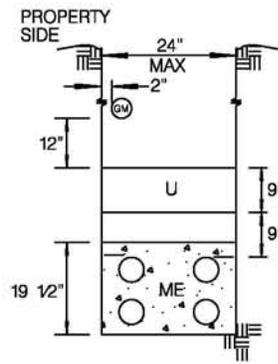


TYPE C

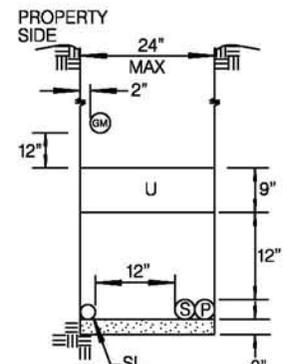


TYPE D

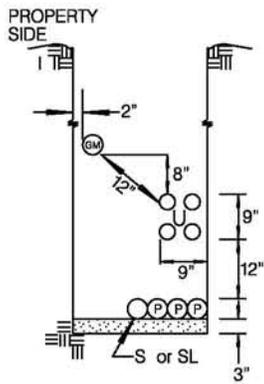

TYPE E

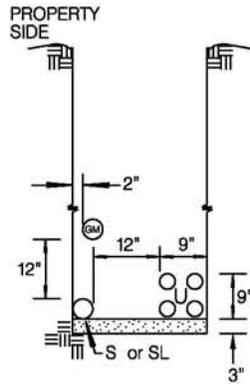

TYPE F

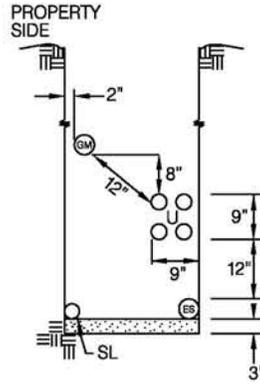

TYPE G
SERVICE TRENCH
ON
PUBLIC PROPERTY

LEGEND		MINIMUM COVER
GM	GAS MAIN	30"
GS	GAS SERVICE	30"
P	PRIMARY ELECTRIC	42"
S	SECONDARY ELECTRIC	30"
ES	ELECTRIC SERVICE	30"
ME	MULTIPLE ELECTRIC (P, S OR ES IN SPACERS) CONCRETE ENCASED	24"
SL	STREET LIGHT (NOT SERIES)	30"
U	CATV	24"
	TELCO	24"

NOTES

1. ALL DIMENSIONS ARE TYPICAL UNLESS OTHERWISE NOTED.
2. THE LOCATION OF UTILITIES AS SHOWN BY THE STANDARD DRAWING SHALL IN NO WAY VIOLATE EXISTING CODES OR REGULATIONS APPLICABLE TO INDIVIDUAL UTILITIES.
3. INSTALLATION OF SEWER OR WATER UTILITIES ARE NOT PERMITTED IN THE JOINT TRENCHES SHOWN ABOVE.
4. MINIMUM DEPTH OF GAS PIPE MAY, SUBJECT TO GAS COMPANY INSPECTORS APPROVAL, BE REDUCED TO 24" WHERE NECESSARY TO CLEAR STRUCTURE CROSSINGS.
5. DEPTH AND WIDTH OF TRENCH VARIES.
6. CATV MAIN OR TRUCK LINE CONDUIT REQUIRED ALONG ALL STREETS, EXCEPT CUL-DE-SAC STREETS LESS THAN 1000' IN LENGTH WHICH MAY BE SERVED BY FEEDER LINES ONLY.
7. CATV 1 1/2" FEEDER CONDUIT SHALL RUN ACROSS STREETS WITH EACH POWER SERVICE LINE AND CAPPED AT EDGE OF SIDEWALK.
8. ALL CATV TERMINALS AND CONDUITS SHALL BE TERMINATED AT GENERALLY ACCEPTED LOCATIONS AND MARKED. A MAP SHALL BE FILED WITH THE CITY SHOWING THE LOCATIONS OF THE CATV SYSTEM.
9. IN NO CASE SHALL CATV CONDUITS BE PLACED WITHIN 12" OF GAS LINES, ALSO CONDUITS SHALL NOT BE PLACED DIRECTLY OVER GAS LINES.
10. CATV CONDUIT MAY BE PLACED WITH THE TELCO CONDUIT PROVIDED THE TELCO MINIMUM DEPTH IS HELD.
11. TRAFFIC SIGNAL CONDUIT SHALL BE PLACED WHERE STREET LIGHT CONDUIT IS SHOWN.

REVISION	BY	APPROVED	DATE
ORIGINAL*	BY	J. NAGELVOORT	01/12

CITY OF SAN DIEGO - STANDARD DRAWING

JOINT TRENCH LOCATIONS

RECOMMENDED BY THE CITY OF SAN DIEGO STANDARDS COMMITTEE

H. Hadli 1/31/2012

COORDINATOR R.C.E. 65271 DATE

DRAWING NUMBER **SDM-103**