


TYPICAL SECTION

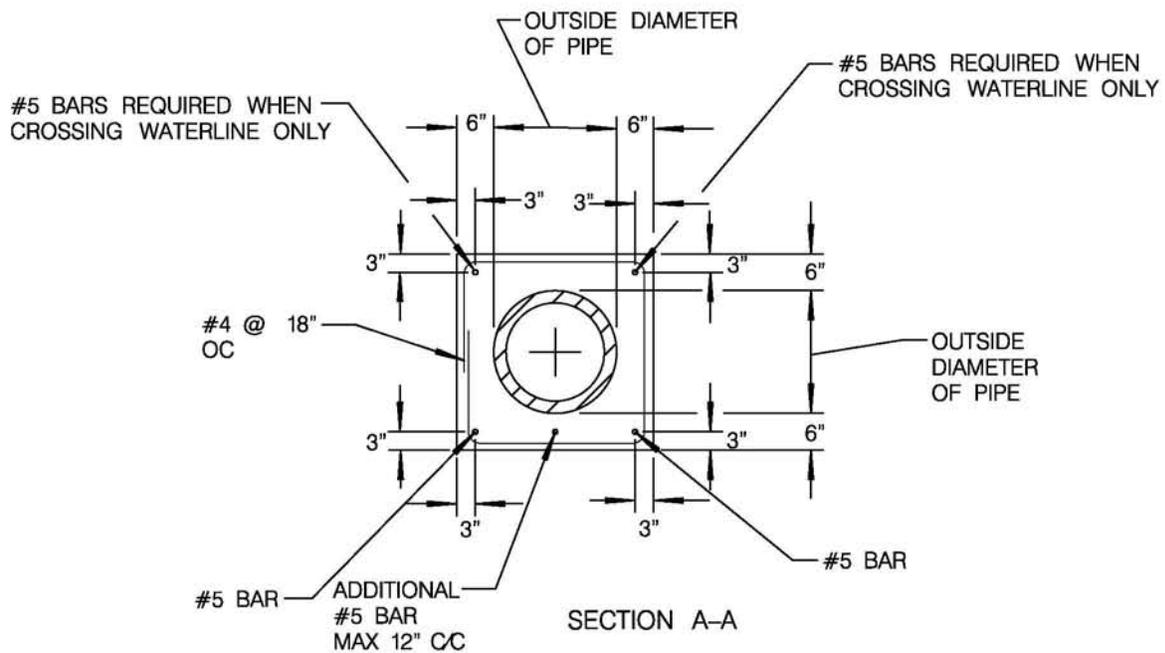

SECTION A-A

NOTES

1. FOR WATER LINE CONSTRUCTION, ENCASEMENT SHALL EXTEND TO FIRST JOINT BEYOND 2' AT BOTH SIDES OF TRENCH OR TO A DISTANCE OF 4', WHICHEVER IS LESS.
2. WHERE CONNECTING TO FLEXIBLE PIPE, JOIN USING TWO COUPLINGS WITH A SHORT PIPE SPOOL (TYPICAL).
3. NO ENCASEMENT IS REQUIRED WHERE THE TRENCH WIDTH IS 24" OR LESS.
4. FOR EXISTING PVC PIPE, IT SHALL BE COVERED WITH TAR PAPER, POLYURETHANE BAGGIE OR RUBBER MAT PRIOR TO POURING CONCRETE.

LEGEND ON PLANS



REVISION	BY	APPROVED	DATE
ORIGINAL	RA	A. OSKOUI	12/06
UPDATED	KA	J. NAGELVOORT	01/12

CITY OF SAN DIEGO - STANDARD DRAWING

**CONCRETE SUPPORT
FOR UNDERCUT SEWER PIPE**

RECOMMENDED BY THE CITY OF SAN DIEGO
STANDARDS COMMITTEE

H. Hadli 1/31/2012
COORDINATOR R.C.E. 65271 DATE

DRAWING
NUMBER **SDS-117**