



VALVE SIZE	D	H
1" & 2"	16"	24"
4"	24"	30"
6"	30"	36"

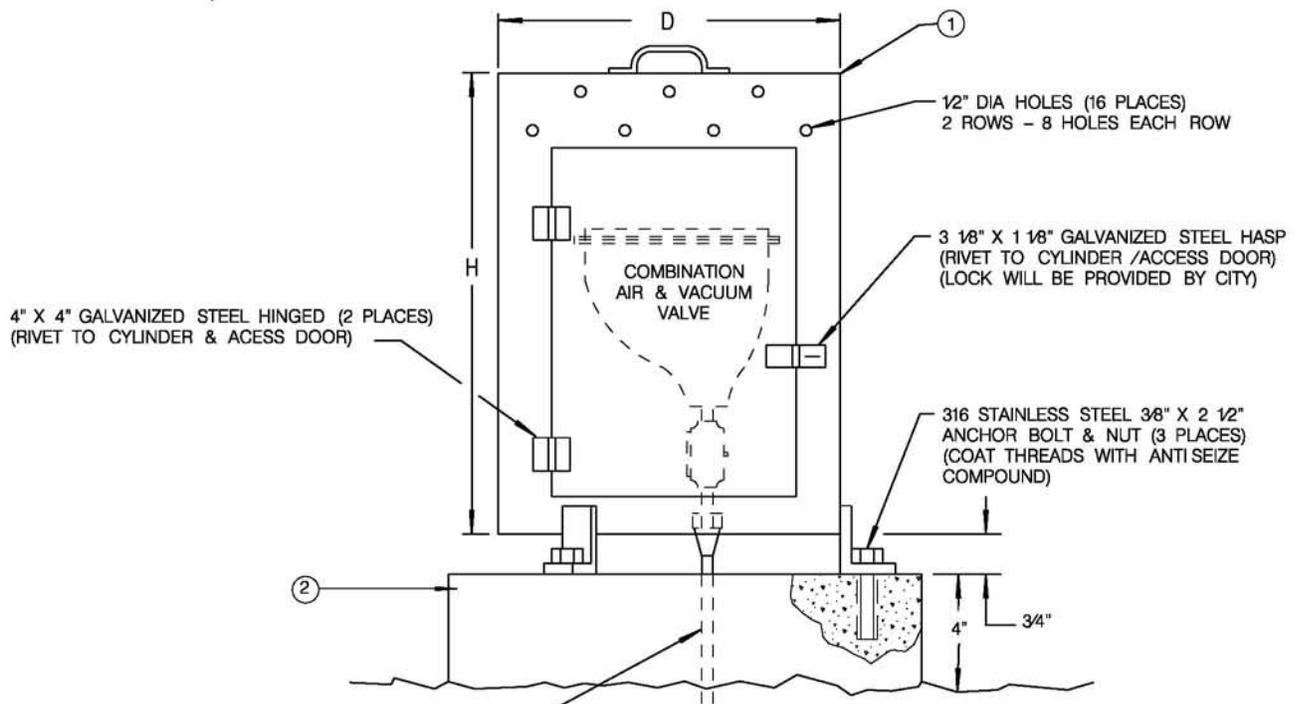


PIPE THROUGH CONCRETE SHALL BE WRAPPED IN 10 MIL POLYETHENE WRAPPING TAPE, WITH EACH WRAP OF TAPE TO OVERLAP THE PREVIOUS WRAP BY 1/3 THE WIDTH OF THE TAPE

ITEMS CALL OUT:

- ① 316" STEEL ENCLOSURE WITH ACCESS DOOR, MISC. HARDWARE. CABINET AND HARDWARE SHOULD BE ZINC RICH EPOXY POWDER PRIMER (2-3 MIL DRY FILM THICKNESS) AND POLYESTER POWDER TOP COAT (2-3 MIL DRY FILM THICKNESS).
- ② 3' X 3' X 4" CONCRETE PAD 520-C-2500.
- ③ D AND H CHANGES ONLY WITH APPROVAL OF THE CITY ENGINEER.

REVISION	BY	APPROVED	DATE	CITY OF SAN DIEGO - STANDARD DRAWING	RECOMMENDED BY THE CITY OF SAN DIEGO STANDARDS COMMITTEE
ORIGINAL		M. ROLLINGER	5-20-92		
NOTES	JS	A. OSKOUI	12/06		
UPDATED	KA	J. NAGELVOORT	01/12		
AIR AND VACUUM VALVE ENCLOSURE & LOCATION				 COORDINATOR R.C.E. 65271 DATE 1/31/2012	
				DRAWING NUMBER SDW-117	

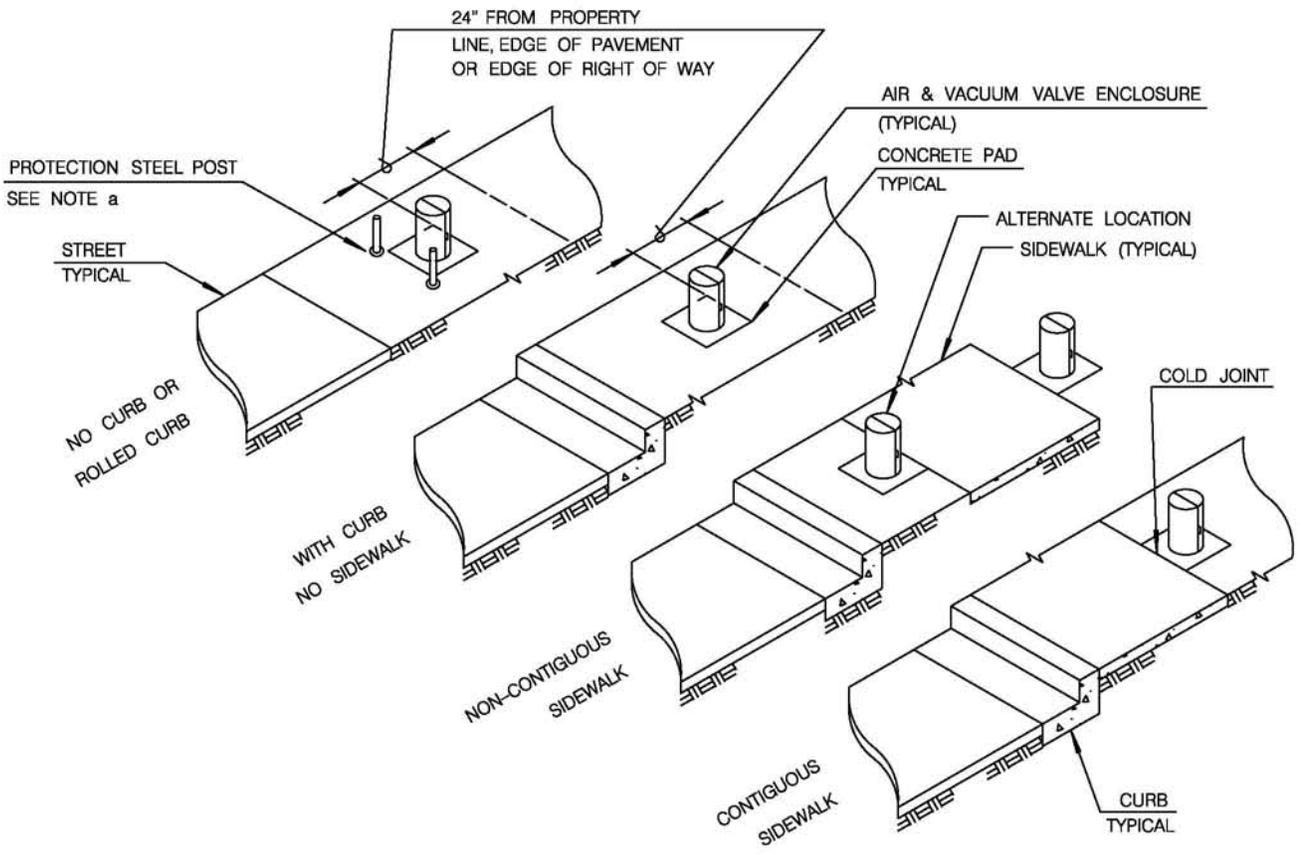

NOTES:

- a.) PROTECTION POSTS SHALL BE INSTALLED AS CALLED FOR ON THE PLANS OR AS DIRECTED BY THE ENGINEER PER WM-04.
- b.) AIR & VACUUM VALVES & APPURTENANCES INSTALLED FOR THE USE OF RECYCLED WATER SHALL BE IDENTIFIED AS DESCRIBED IN THE SPECIFICATIONS.

REVISION	BY	APPROVED	DATE	CITY OF SAN DIEGO - STANDARD DRAWING	RECOMMENDED BY THE CITY OF SAN DIEGO STANDARDS COMMITTEE	
ORIGINAL	KA	J. NAGELVOORT	01/12		<i>H. Hadli</i>	1/31/2012
				AIR AND VACUUM VALVE ENCLOSURE & LOCATION	COORDINATOR R.C.E. 65271 DATE	
					DRAWING NUMBER	SDW-117