


SECTION

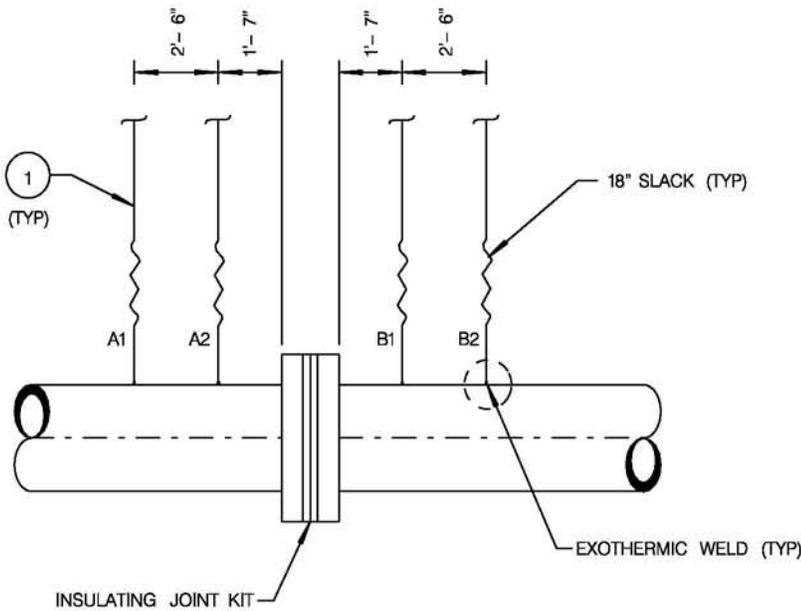

ELEVATION A - A

NOTES:

1. IN PAVED, CITY OWNED ROADWAYS, THE REPAIR OF THE ROAD SURFACE SHALL BE PER APPLICABLE STANDARD DRAWINGS. IN STATE HIGHWAYS, CONFORM TO APPLICABLE CALTRANS STANDARD.
2. FOR LOCATION, OF TEST STATION, USE REGIONAL STD DWG W15. EXACT LOCATION SHALL BE APPROVED BY CORROSION ENGR.
3. USE APPLICABLE TEST STATION DRAWING FOR UNDEVELOPED AREAS

ITEM CALL OUT:

1. CABLE: AWG #2, COPPER ASTM B3, STRANDED ASTM B8, INSULATED PER ASTM D1248, TYPE 1 CLASS C, GRADE 5.
2. POLYETHYLENE WARNING TAPE.
3. SAND: 50 SIEVE

REVISION	BY	APPROVED	DATE
ORIGINAL		A. OSKOUI	12/03
UPDATED	KA	J. NAGELVOORT	01/12

CITY OF SAN DIEGO - STANDARD DRAWING

**INSULATING FLANGE FOUR - WIRE
TEST STATION INSTALLATION**

RECOMMENDED BY THE CITY OF SAN DIEGO STANDARDS COMMITTEE

H. Hadli 1/31/2012
COORDINATOR R.C.E. 65271 DATE

DRAWING NUMBER **SDW-130**