


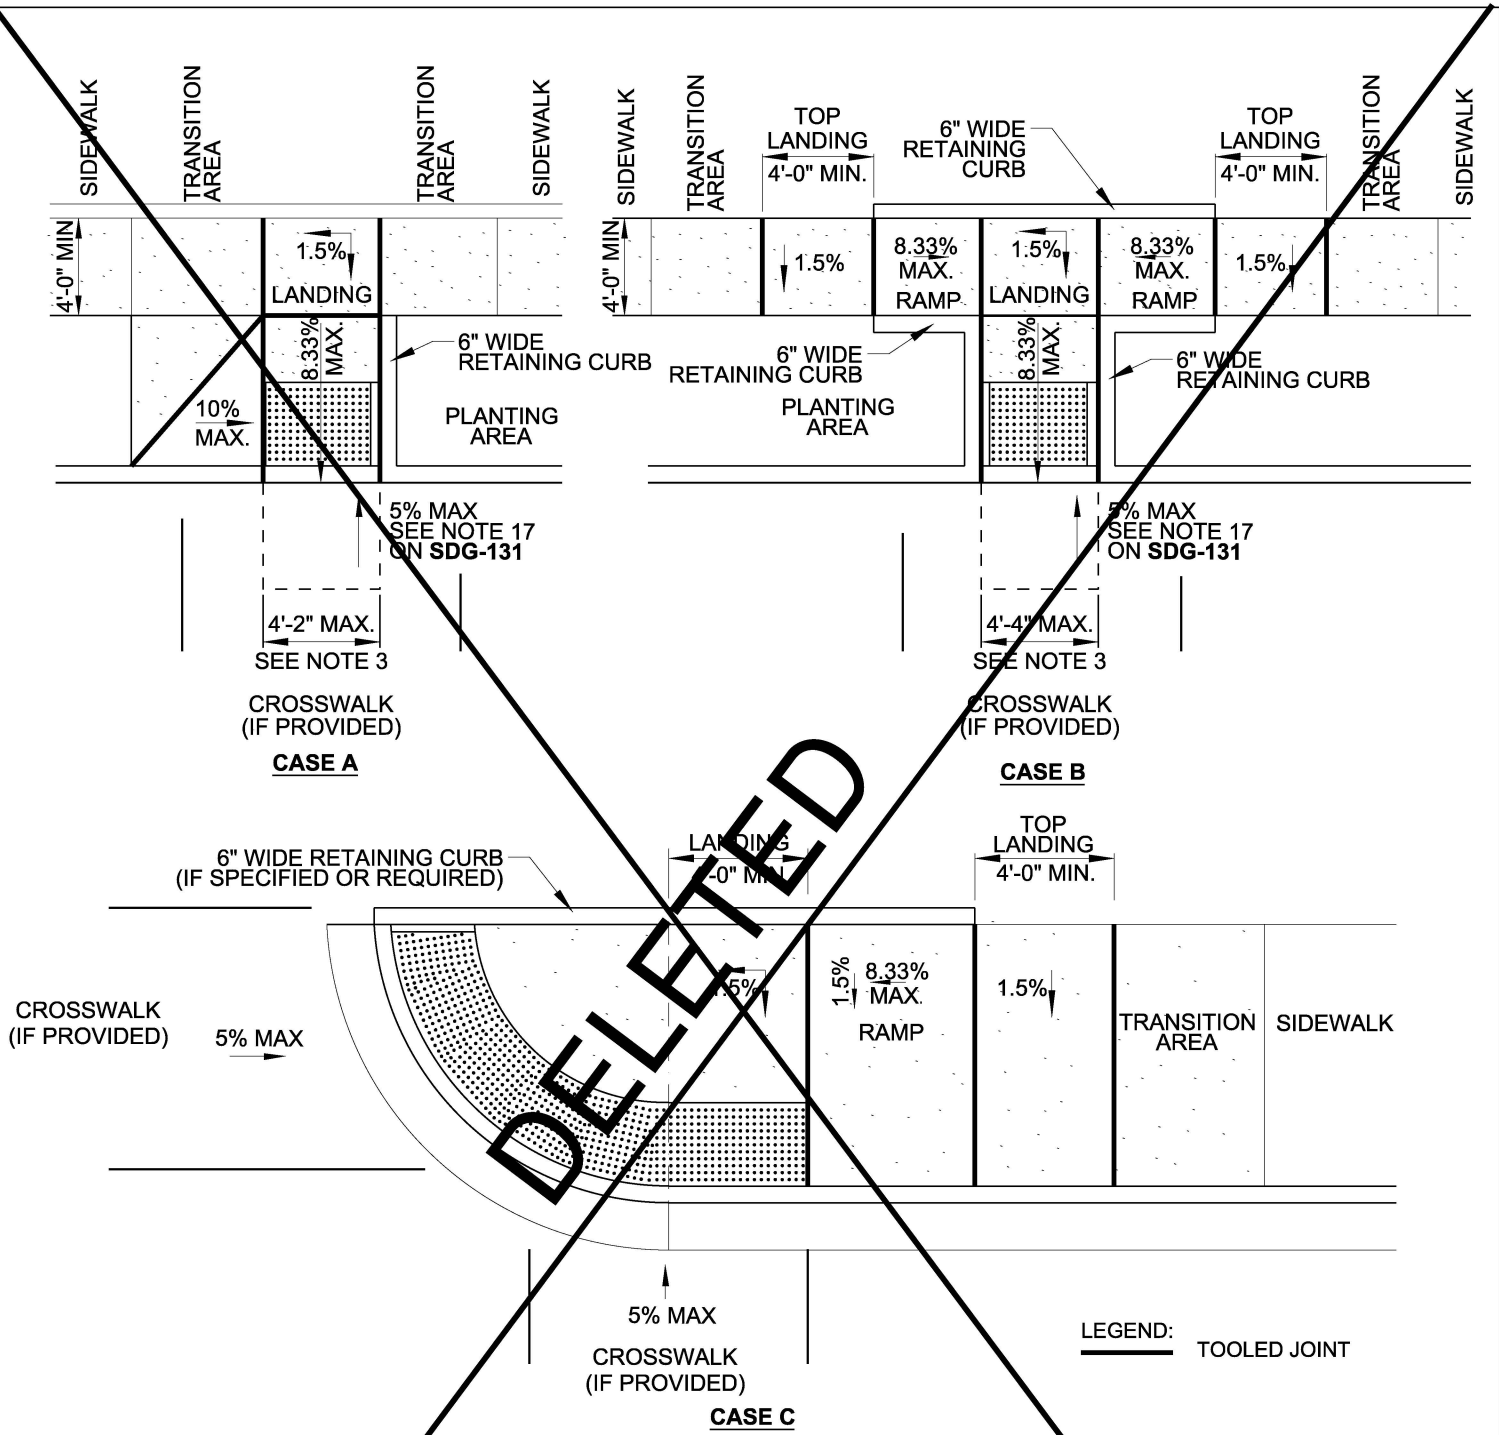

NOTES:

1. CASE A THROUGH C MAY ONLY BE USED IF THERE ARE SITE CONSTRAINTS.
2. TRANSITION AREA REQUIRED IF EXISTING SIDEWALK HAS A CROSS SLOPE THAT EXCEEDS 2%.
3. CASE A CURB RAMP - 4'-0" WIDE DETECTABLE WARNING TILE. IF A FLARE CANNOT BE INSTALLED, WIDEN CURB RAMP WIDTH TO 4'-2" MAXIMUM TO ACCOMMODATE FORMWORK FOR THE 6" WIDE RETAINING CURB.
4. CASE B CURB RAMP - 4'-0" WIDE DETECTABLE WARNING TILE. WIDEN CURB RAMP WIDTH TO 4'-4" MAXIMUM TO ACCOMMODATE FORMWORK FOR TWO 6" WIDE RETAINING CURBS.
5. CASE C CURB RAMP - SEE **SDG-135**, SHEET 2 OF 3, NOTE 1 FOR ADDITIONAL REQUIREMENTS.

REVISION	BY	APPROVED	DATE
ORIGINAL	FC	J. NAGELVOORT	02/16
REDRAFTED	CD	J. NAGELVOORT	09/18
UPDATED	HN	J. NAGELVOORT	04/19
DELETED	FC	J. NAGELVOORT	09/20

CITY OF SAN DIEGO - STANDARD DRAWING

GENERAL CURB RAMPS

RECOMMENDED BY THE CITY
OF SAN DIEGO STANDARDS COMMITTEE

Chungpa 9/22/20
COORDINATOR R.C.E. 56523 DATE

DRAWING
NUMBER

SDG-138