


CROSSWALK
(IF PROVIDED)

CASE A

6" WIDE RETAINING CURB
(IF SPECIFIED OR REQUIRED)

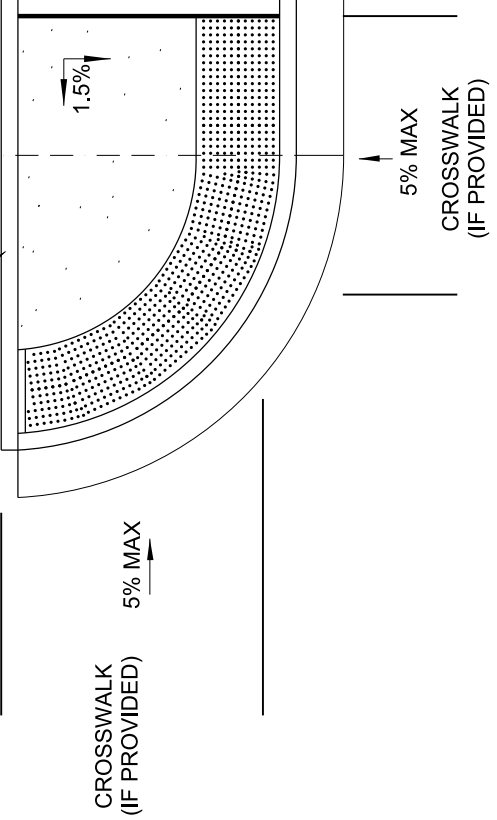

CROSSWALK
(IF PROVIDED)

CASE B

5% MAX
CROSSWALK
(IF PROVIDED)

CASE C

LEGEND: TOOLED JOINT

NOTES:

- CASE A THROUGH C MAY ONLY BE USED IF THERE ARE SITE CONSTRAINTS.
- TRANSITION AREA REQUIRED IF EXISTING SIDEWALK HAS A CROSS SLOPE THAT EXCEEDS 2%.
- CASE A CURB RAMP - 4'-0" WIDE DETECTABLE WARNING TILE. IF A FLARE CANNOT BE INSTALLED, WIDEN CURB RAMP WIDTH TO 4'-2" MAXIMUM TO ACCOMMODATE FORMWORK FOR THE 6" WIDE RETAINING CURB.
- CASE B CURB RAMP - 4'-0" WIDE DETECTABLE WARNING TILE. WIDEN CURB RAMP WIDTH TO 4'-4" MAXIMUM TO ACCOMMODATE FORMWORK FOR TWO 6" WIDE RETAINING CURBS.
- CASE C CURB RAMP - SEE **SDG-135**, SHEET 2 OF 3, NOTE 1 FOR ADDITIONAL REQUIREMENTS.

REVISION	BY	APPROVED	DATE
ORIGINAL	FC	J. NAGELVOORT	02/16
REDRAFTED	CD	J. NAGELVOORT	09/18
UPDATED	HN	J. NAGELVOORT	04/19

CITY OF SAN DIEGO - STANDARD DRAWING

GENERAL CURB RAMPS

RECOMMENDED BY THE CITY
OF SAN DIEGO STANDARDS COMMITTEE

Chungga 4/10/19
COORDINATOR, R.C.E. 56623 DATE

DRAWING
NUMBER

SDG-138