


SIDE VIEW

LABEL ENCLOSURE DOOR WITH CONTROLLER DESIGNATION USING 2" BLACK VINYL LETTERS/NUMBERS.

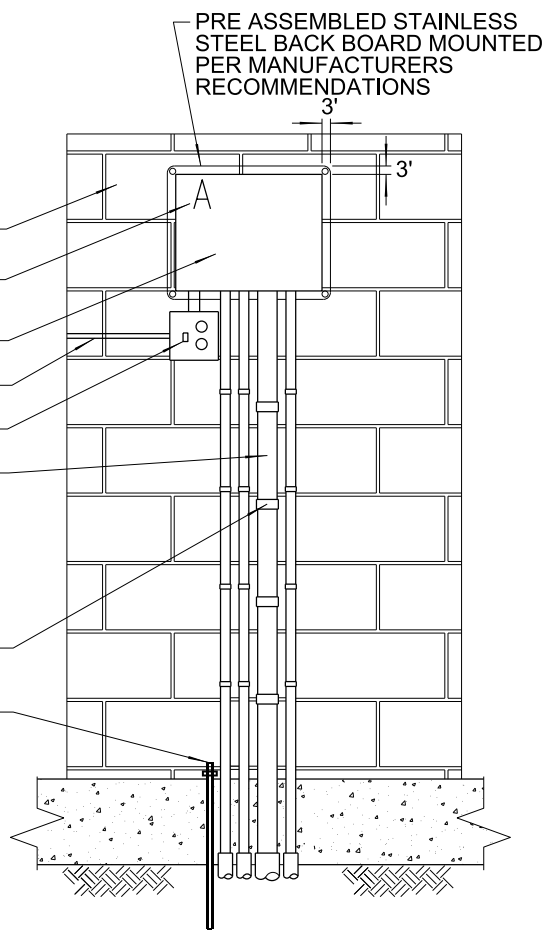

FRONT VIEW

NOTES:

1. CONTROL WIRE CONDUIT SHALL BE TWICE THE DIAMETER OF THE WIRE BUNDLE, 2" MINIMUM.
2. PROVIDE SEPARATE CIRCUIT BREAKERS FOR CONTROLLER(S) AT ELECTRICAL CONTROL PANEL, AND LABEL.
3. PROVIDE RAIN SENSOR AND INSTALL IN AN APPROVED LOCATION.
4. USE GALVANIZED STEEL CONDUIT FOR WALL MOUNTED APPLICATIONS. USE PVC SCHEDULE 40 CONDUITS FOR BELOW GRADE APPLICATIONS.

REVISION	BY	APPROVED	DATE
ORIGINAL*	RH	J. NAGELVOORT	01/12
UPDATED	AR	J. NAGELVOORT	02/16
REDRAFTED	CD	J. NAGELVOORT	09/18
UPDATED	AJ	J. NAGELVOORT	09/21

CITY OF SAN DIEGO – STANDARD DRAWING

**AUTOMATIC IRRIGATION CONTROLLER
INDOOR WALL MOUNTED**

RECOMMENDED BY THE CITY
OF SAN DIEGO STANDARDS COMMITTEE

Alaine L. James 09/30/21
COORDINATOR R.C.E. 81047 DATE

DRAWING NUMBER **SDI-118**