



BONDING STRAP INSTALLED ON SLEEVE-TYPE COUPLING

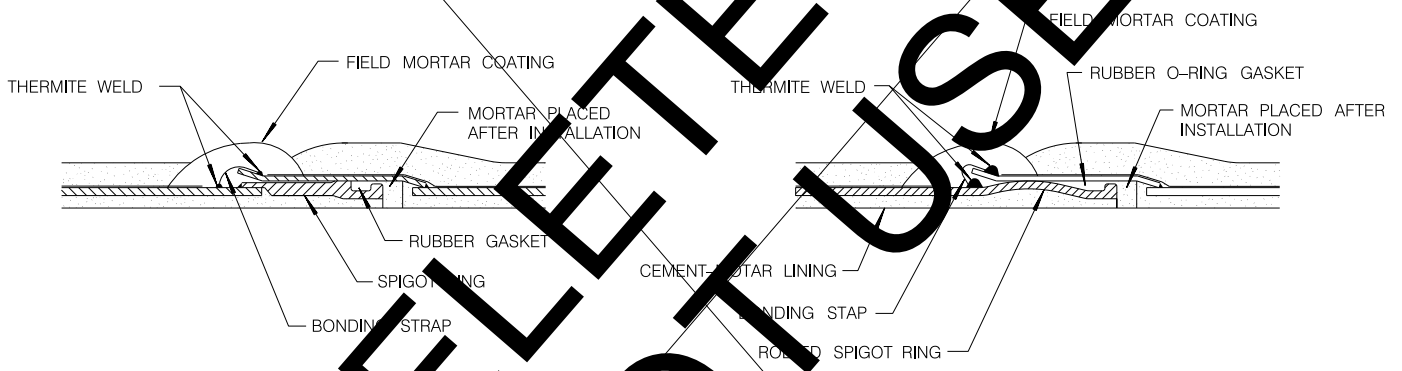

BONDING STRAP FOR BELL AND SPIGOT RUBBER-GASKETED JOINT

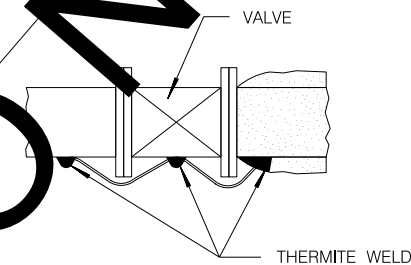

BONDING STRAP INSTALLED ON VALVE

DO NOT USE

NOTES:

1. REMOVE COATING AND CLEAN APPROXIMATELY 2" AREA TO A BRIGHT METAL SURFACE FOR WELDING.
2. THE EXACT TYPE, SIZE AND NUMBER OF BONDING WIRE /STRAP SHALL BE DETERMINED BY PIPE SIZE AND TYPE.
3. WHERE NOT PROTECTED BY CEMENT MORTAR COATING, THERMITE WELD SHALL BE COVERED WITH COLD APPLIED COAL TAR SOLUTION.

REVISION	BY	APPROVED	DATE
ORIGINAL		T. MUELLER	2-12-86
UPDATED	KA	J. NAGELVOORT	01/12
DELETED	EF	J. NAGELVOORT	11/17

CITY OF SAN DIEGO – STANDARD DRAWING

**BONDING STRAP FOR
STEEL AND SCRW PIPE**

RECOMMENDED BY THE CITY OF SAN DIEGO
STANDARDS COMMITTEE

Chung 11/20/2017
COORDINATOR R.C.E. 56523 DATE

DRAWING NUMBER **SDW-116**